





Billy Creek Filter Marsh - Node/Link Diagram
EXHIBIT B-1



Map for reference only and is not a Survey. The City of Fort Myers makes no claims or guarantees about the accuracy or correctness of the information contained on this map, and expressly disclaims liability for errors and omissions.
Source: City of Fort Myers

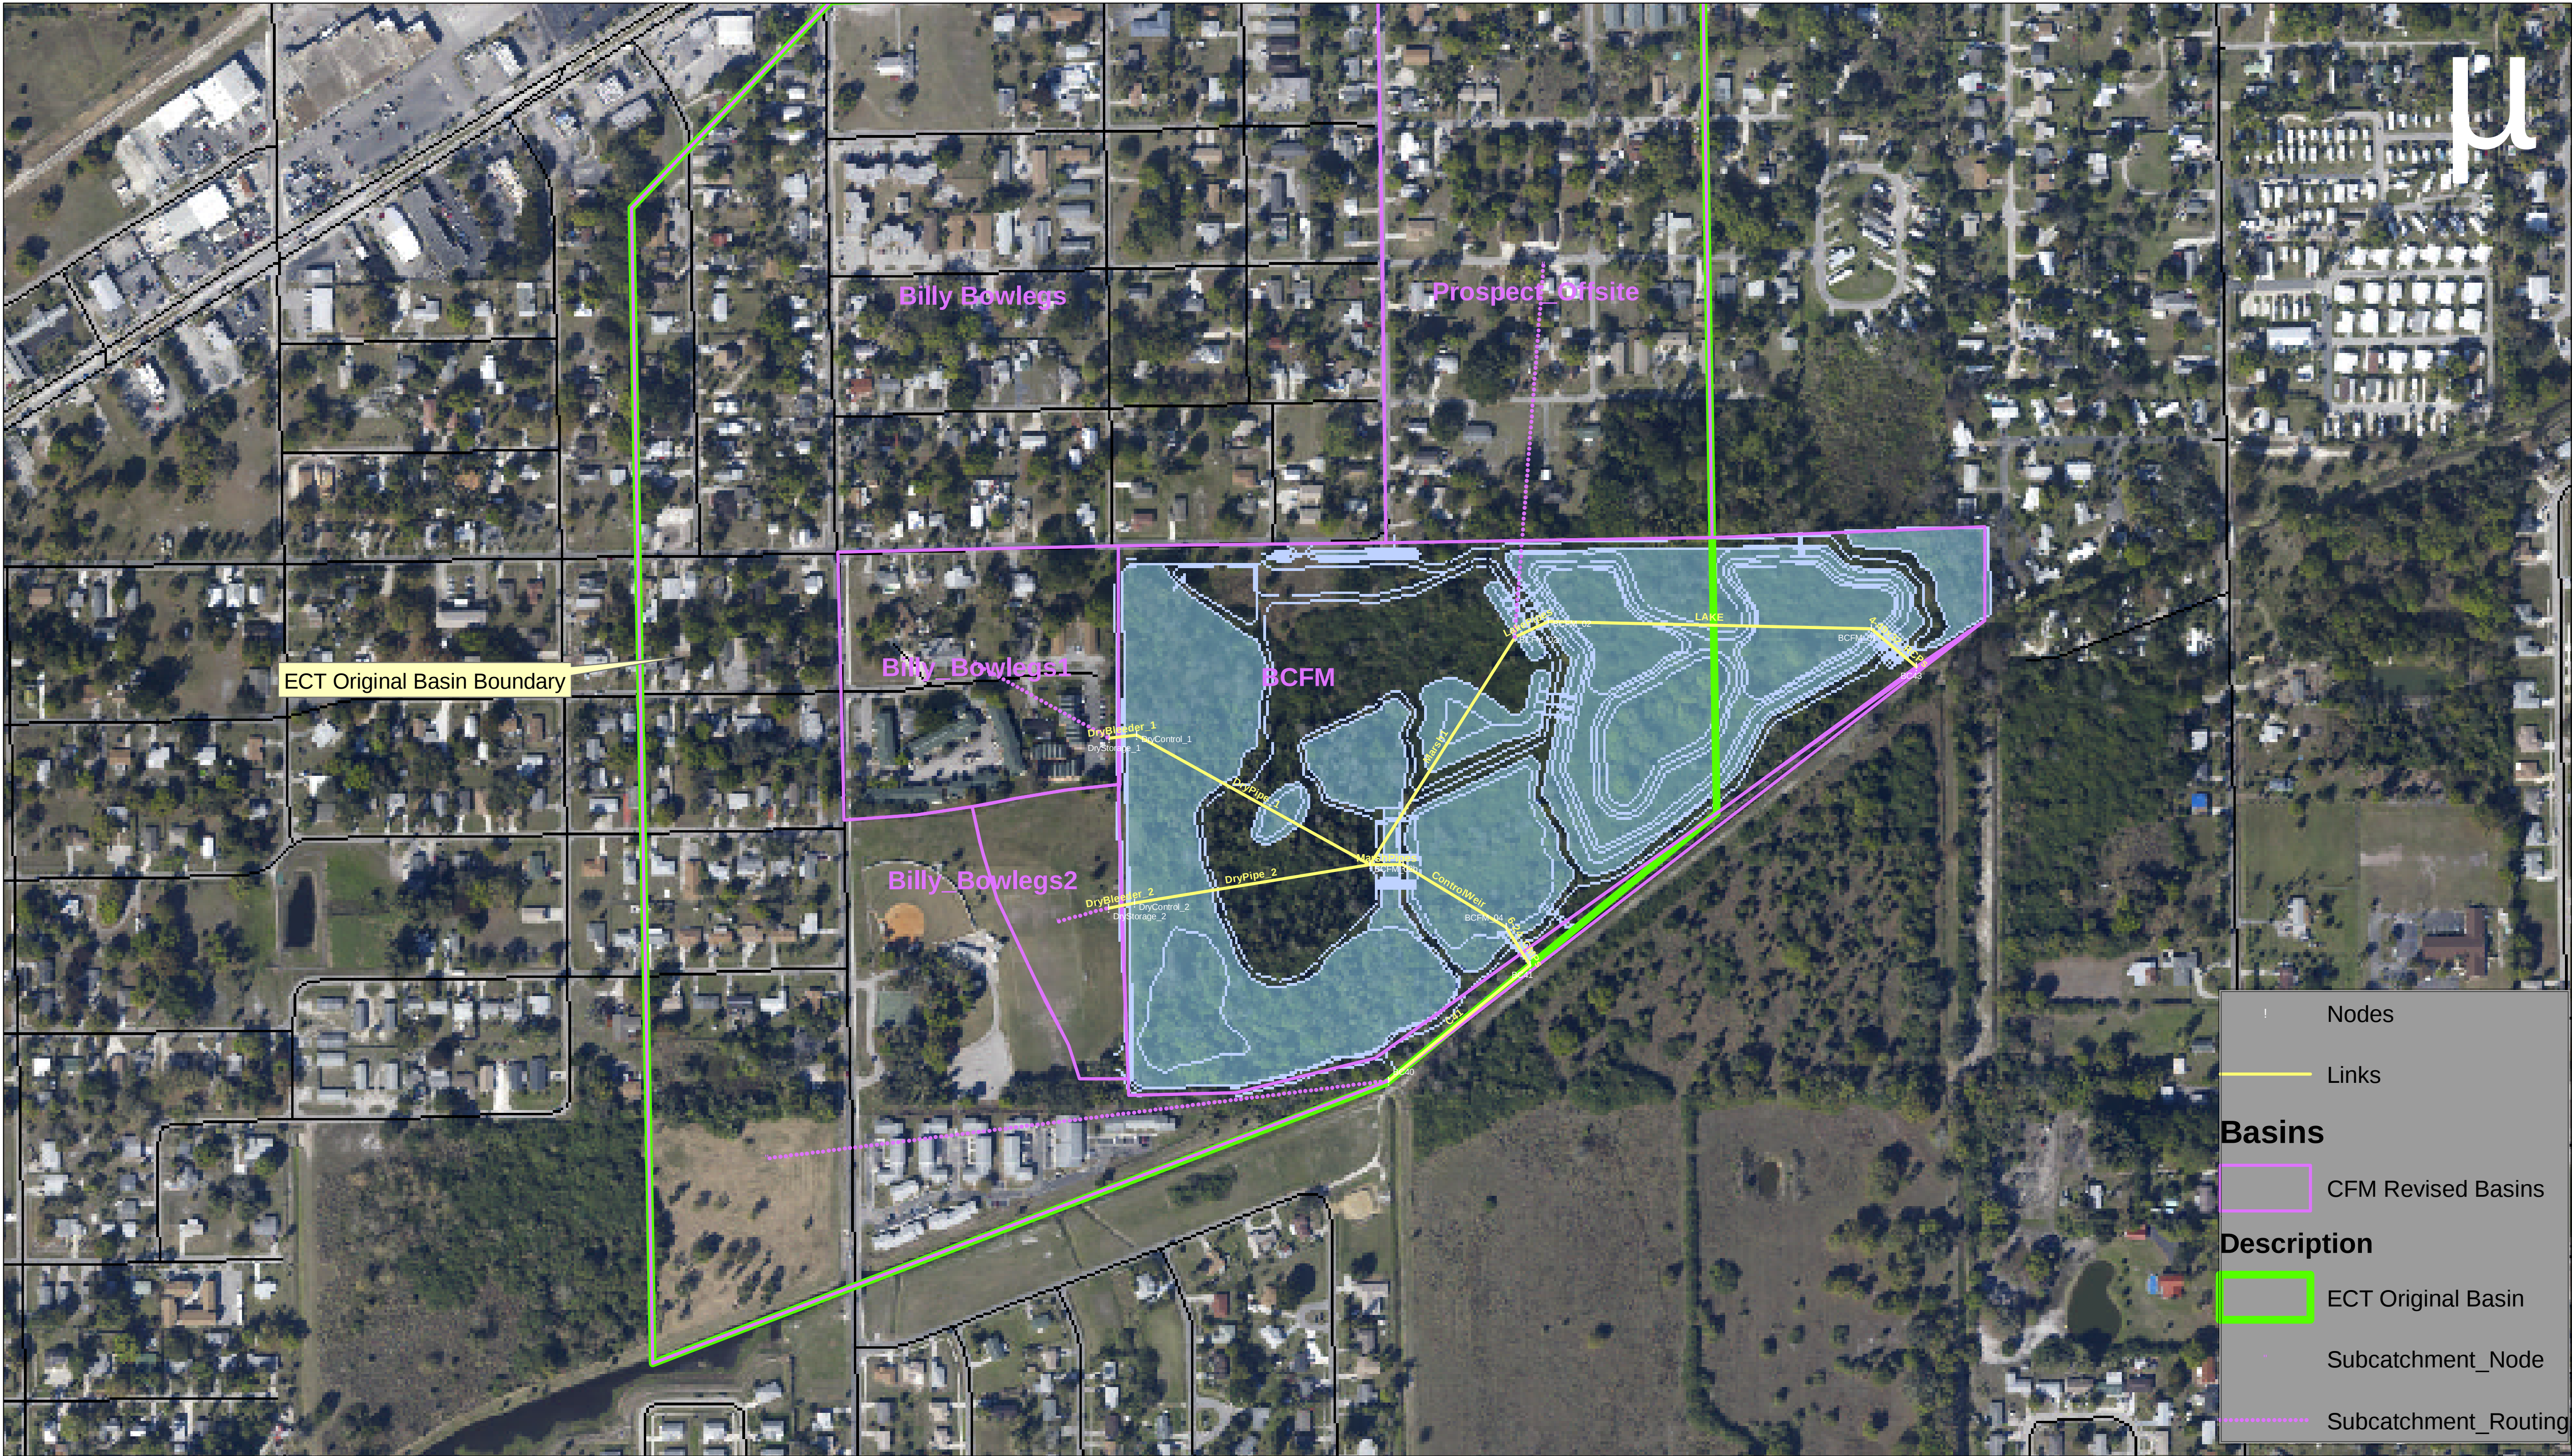

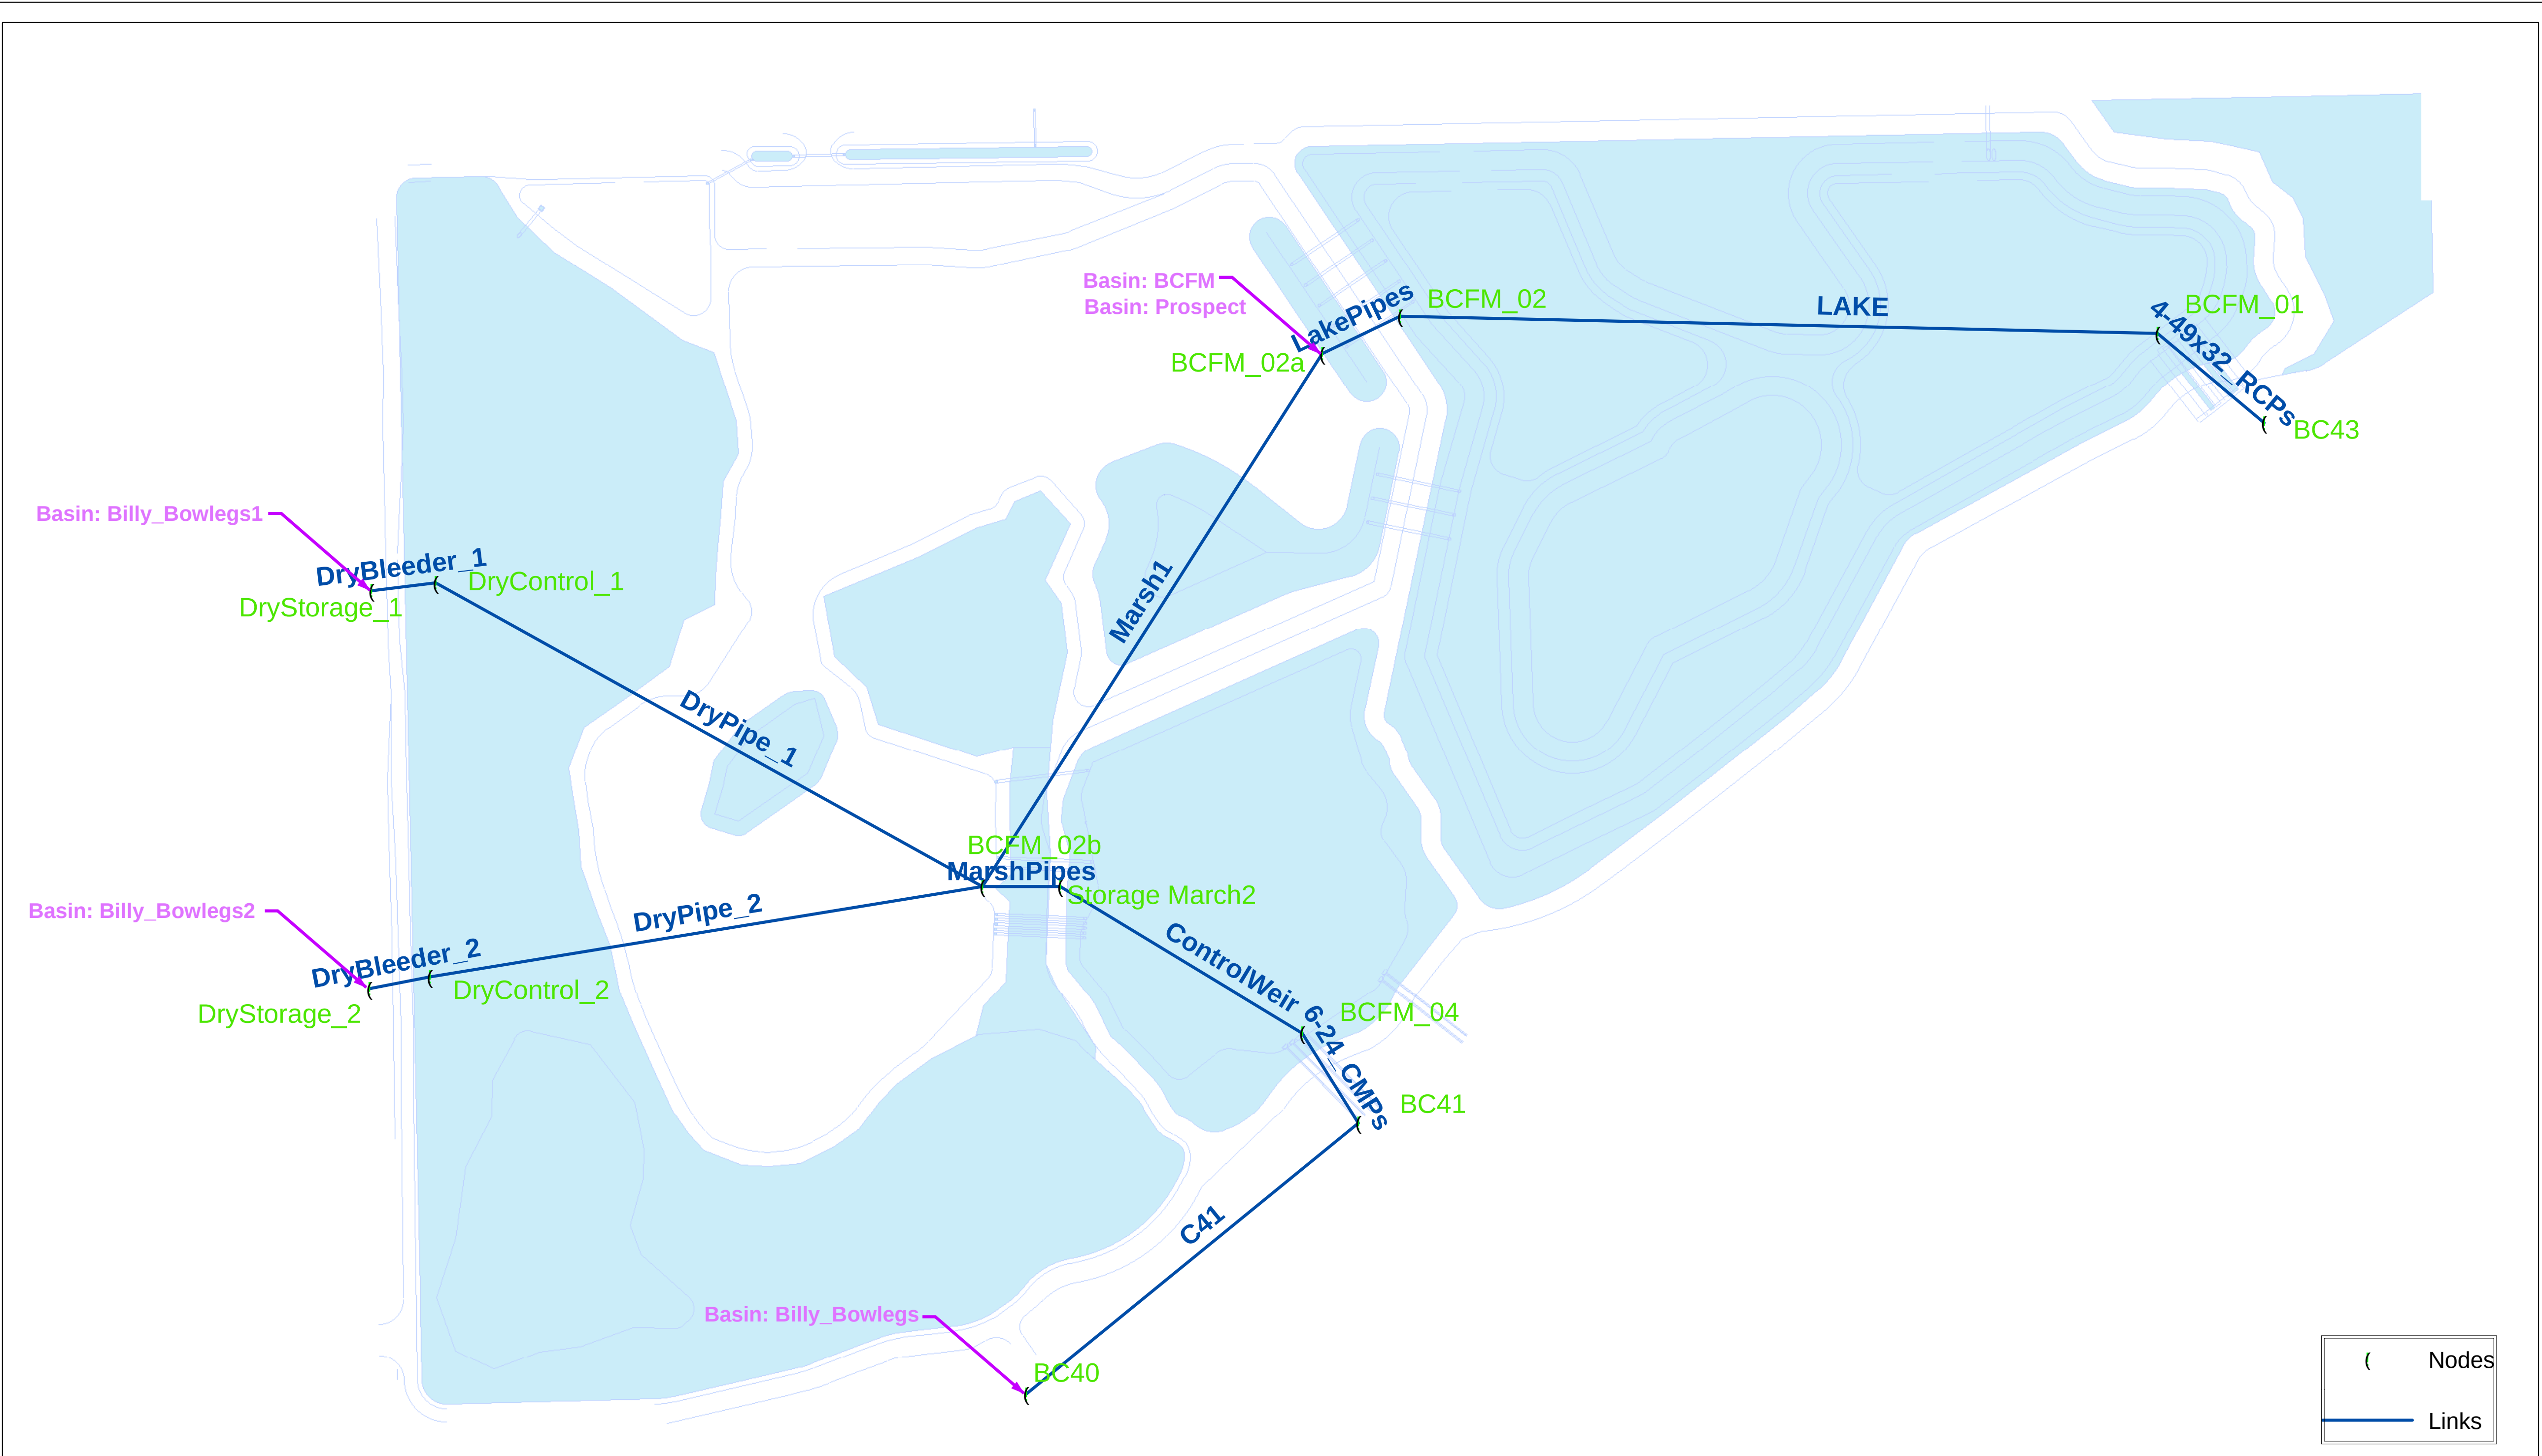


Billy Creek Filter Marsh - Node/Link Diagram
EXHIBIT B-1





City of Fort Myers

Map for reference only and is not a Survey. The City of Fort Myers makes no claims or guarantees about the accuracy or currency of the information contained on this map, and expressly disclaims liability for errors and omissions. Source: City of Fort Myers




0 50 100 150 200 Feet

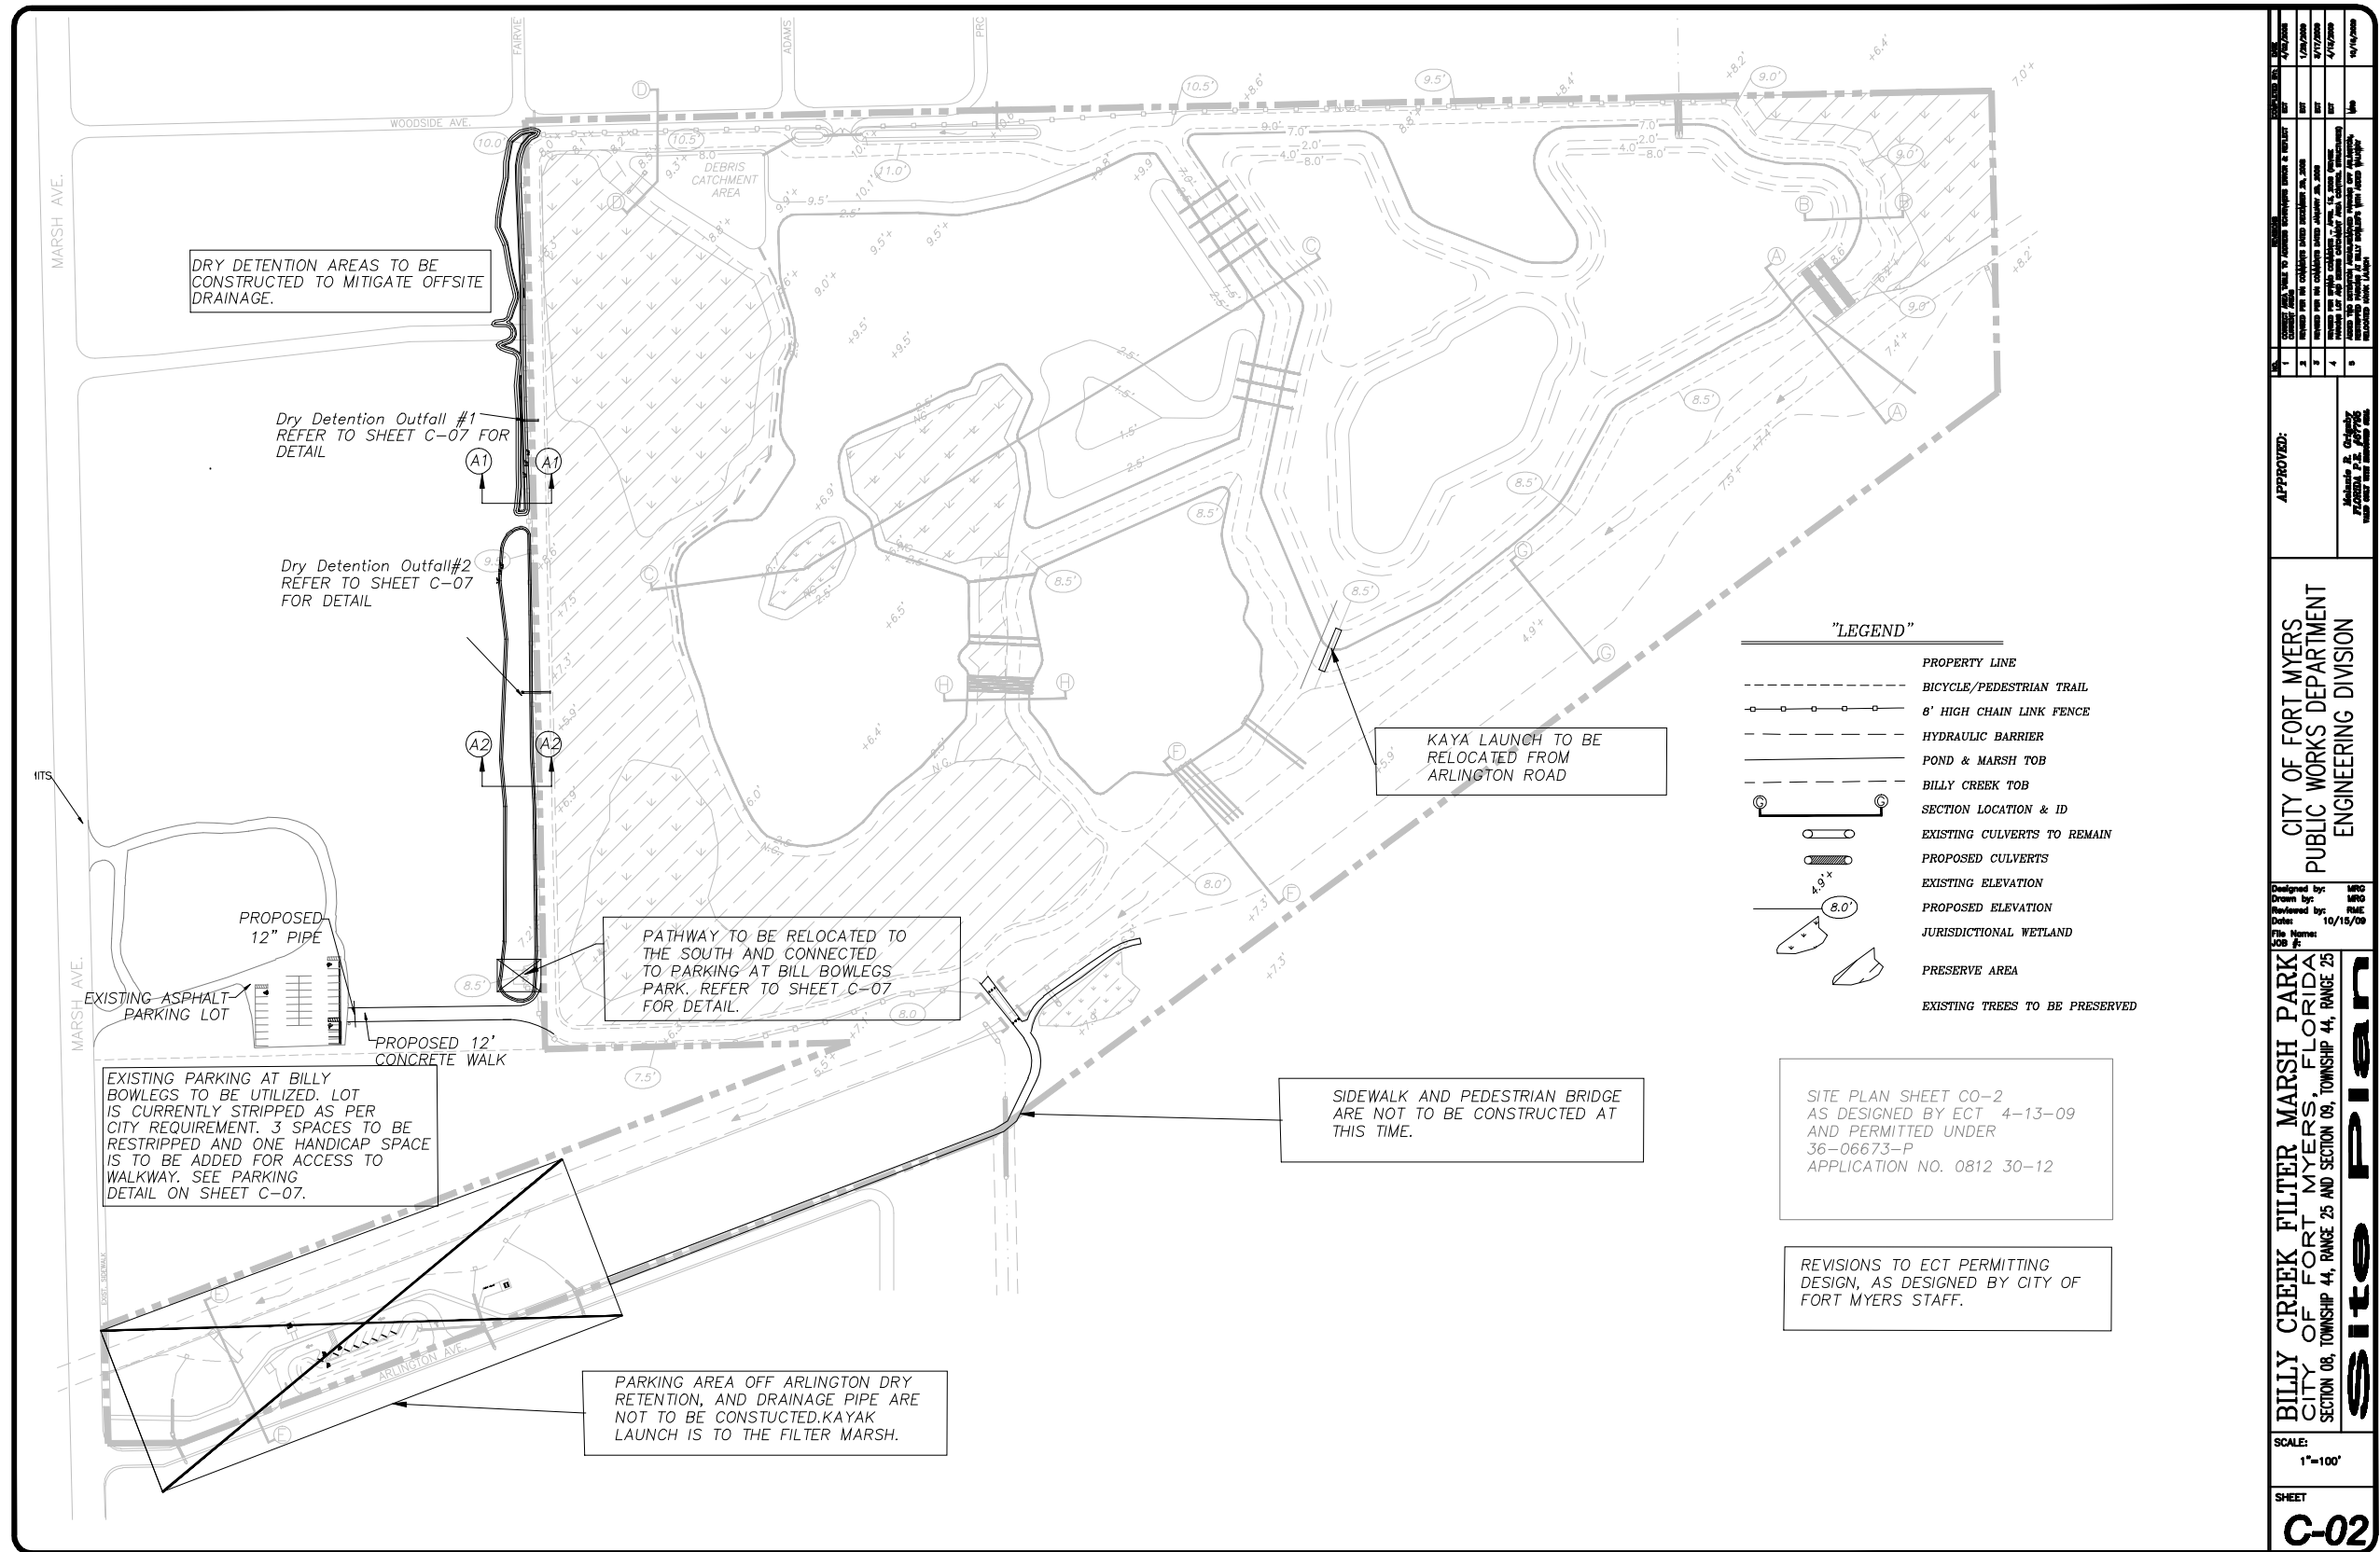


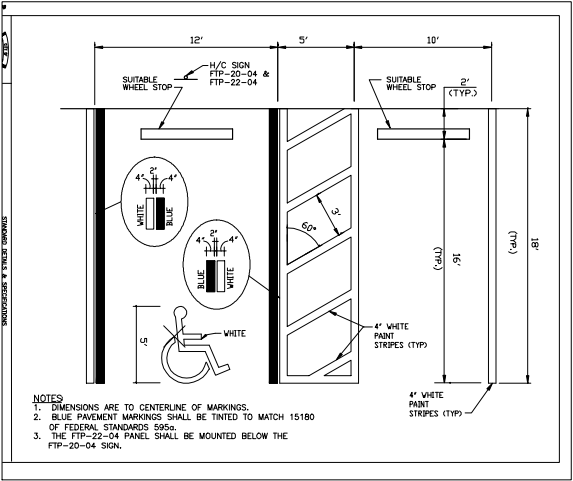

CITY PARKING DETAIL

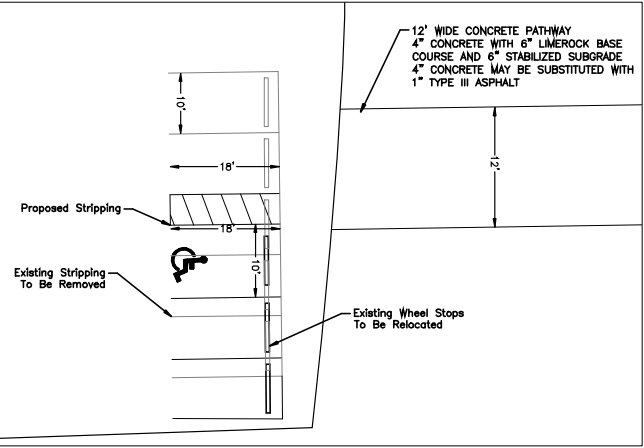

PARKING LOT AREA
 SCALE: 1' = 40'

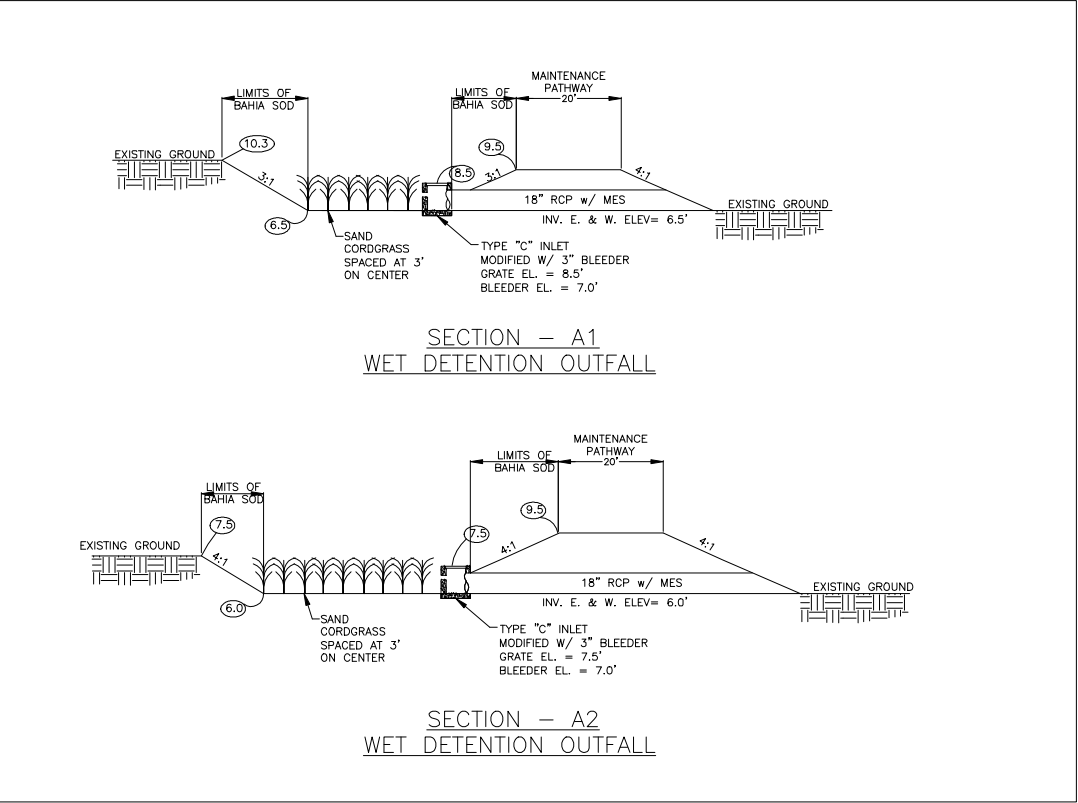

BILLY CREEK FILTER MARSH PARK CITY OF FORT MYERS, FLORIDA SECTION 08, TOWNSHIP 44, RANGE 25 AND SECTION 09, TOWNSHIP 44, RANGE 25		Approved: Michael E. Grady P.E. 10/15/09	SHEET NO. ADDED DUE TO ADDITION OF WET DETENTION AREA 10/15/09
Detail Sheet C-07			



City of Fort Myers, Florida

Engineering Department/Stormwater Management

P.O. Drawer 2217

Ft. Myers, FL 33902

PH# (239) 321-7467

FAX# (239) 344-5943

December 23, 2009

Carmen Quan, P.E.
South Florida Water Management District
Lower West Coast Regional Service Center
2301 McGregor Blvd
Fort Myers, FL 33901

RE: *Billy Bowlegs Park*
Permit Application for 36-07250-P
Lee County, Sections 8&9, Township 44S, Range 25E

Dear Carmen,

This letter is in response to your request for additional information requested on December 22, 2009, in reference to the operation and maintenance of the water management system. The City is required through their NPDES MS4 permit to inspect all stormwater ponds and detention areas on an annual basis that they own. Since the City shall be the owner of this system, it shall be inspected on an annual basis and maintenance shall occur on an as needed interval. The pipes that discharge from the system shall be inspected at the same time to ensure that the system is working properly and identify if additional maintenance is needed.

Please contact me should you need any additional information.

Sincerely,

Melanie R. Grigsby, P.E.
Stormwater Resource Manager