

Southwest Wastewater Service Area.


- New Customers
 - o Residential ±738 (ERC's)

Nutrients removed from septic tanks

- Estimated to remove 6.7 tons per year of nitrogen
- Estimated to remove 1.6 tons per year of phosphorus
- Cost
 - o \$13,950,000



FIGURE 1
PROJECT LOCATION

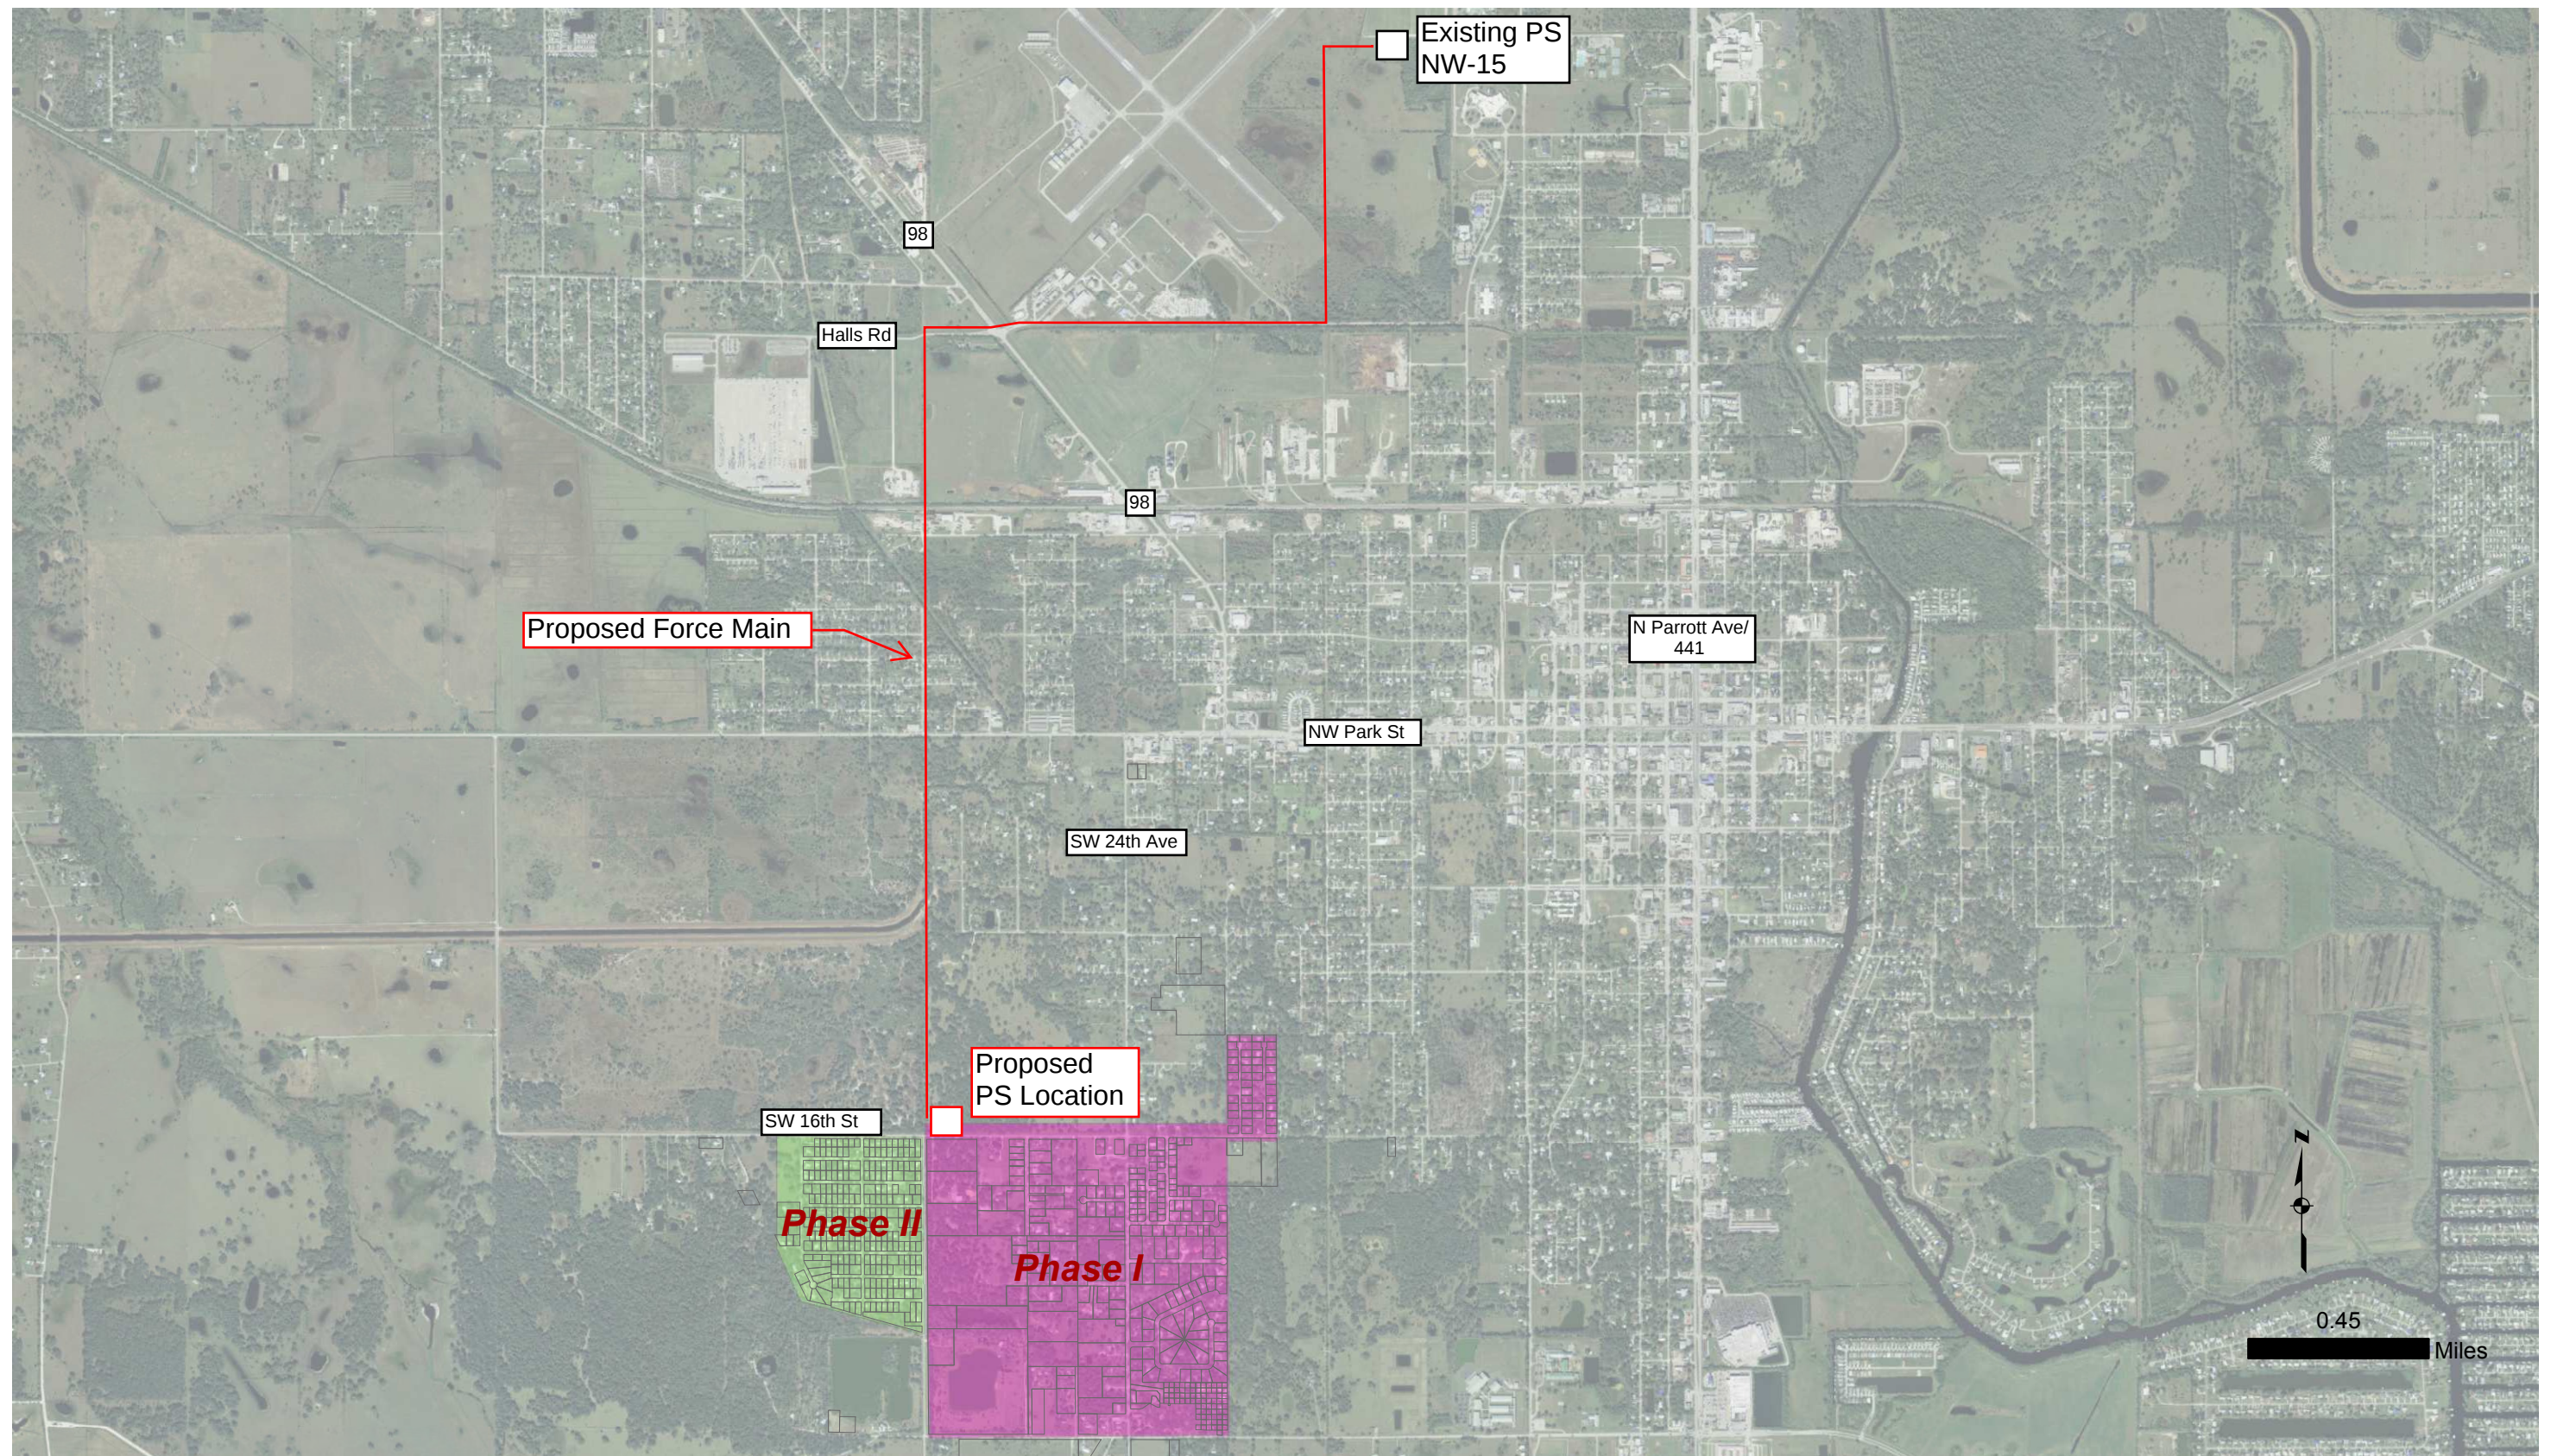

OKEECHOBEE UTILITY AUTHORITY
SOUTHWEST SECTION WASTEWATER SERVICE AREA

FIGURE 2
PROJECT FM ROUTE