

RAVEN ENVIRONMENTAL RESTORATION SERVICES, LLC.



Client: Florida Department of Environmental Protection
Property: 261 Dr. Frederick Humphries St
Apalachicola, FL 32320

Operator: ADMIN

Estimator: RICK ALEMAN
Company: RAVEN ENVIRONMENTAL RESTORATION
SERVICES, LLC
Business: 653 W 23RD STREET SUITE 286
PANAMA CITY, FL 32405

Business: (850) 512-1109
E-mail: ADMIN@RAVENENVIRO.
COM

Type of Estimate: Other
Date Entered: 10/25/2023 Date Assigned:

Price List: FLMI8X_OCT20
Labor Efficiency: Restoration/Service/Remodel
Estimate: DEP-261-DR-FEDERICK

Raven Environmental Restoration Services, LLC
6800 Bird Rd, Suite 454, Miami, FL 33155
653 W 23rd Street Suite 286, Panama City, FL 32405
FL Licensed Mold Assessor #MRSA3240
FL Licensed Mold Remediator #MRSR3415
Asbestos Contractor/Supervisor #180952
Lead Renovator #181119
1.800.316.0464 Toll Free
786.349.3133 South FL Office (HQ)
850.512.1109 North FL Office
305.402.7777 Fax
admin@ravenenviro.com
www.ravenenviro.com

RAVEN ENVIRONMENTAL RESTORATION SERVICES, LLC.



1



2



3



4




5



6



7

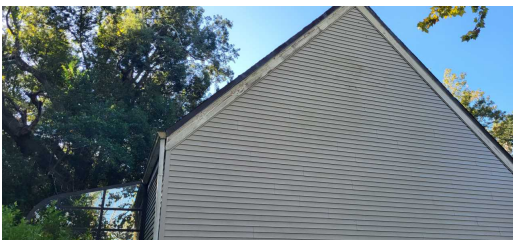

8



RAVEN ENVIRONMENTAL RESTORATION SERVICES, LLC.




9



10



11

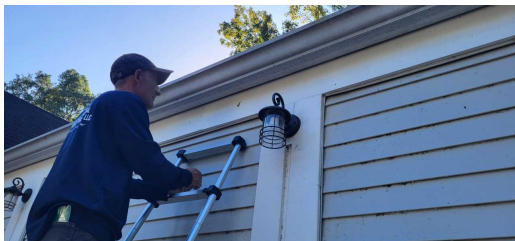

12



13



14



15



16



RAVEN ENVIRONMENTAL RESTORATION SERVICES, LLC.



17



18



19



RAVEN ENVIRONMENTAL RESTORATION SERVICES, LLC.

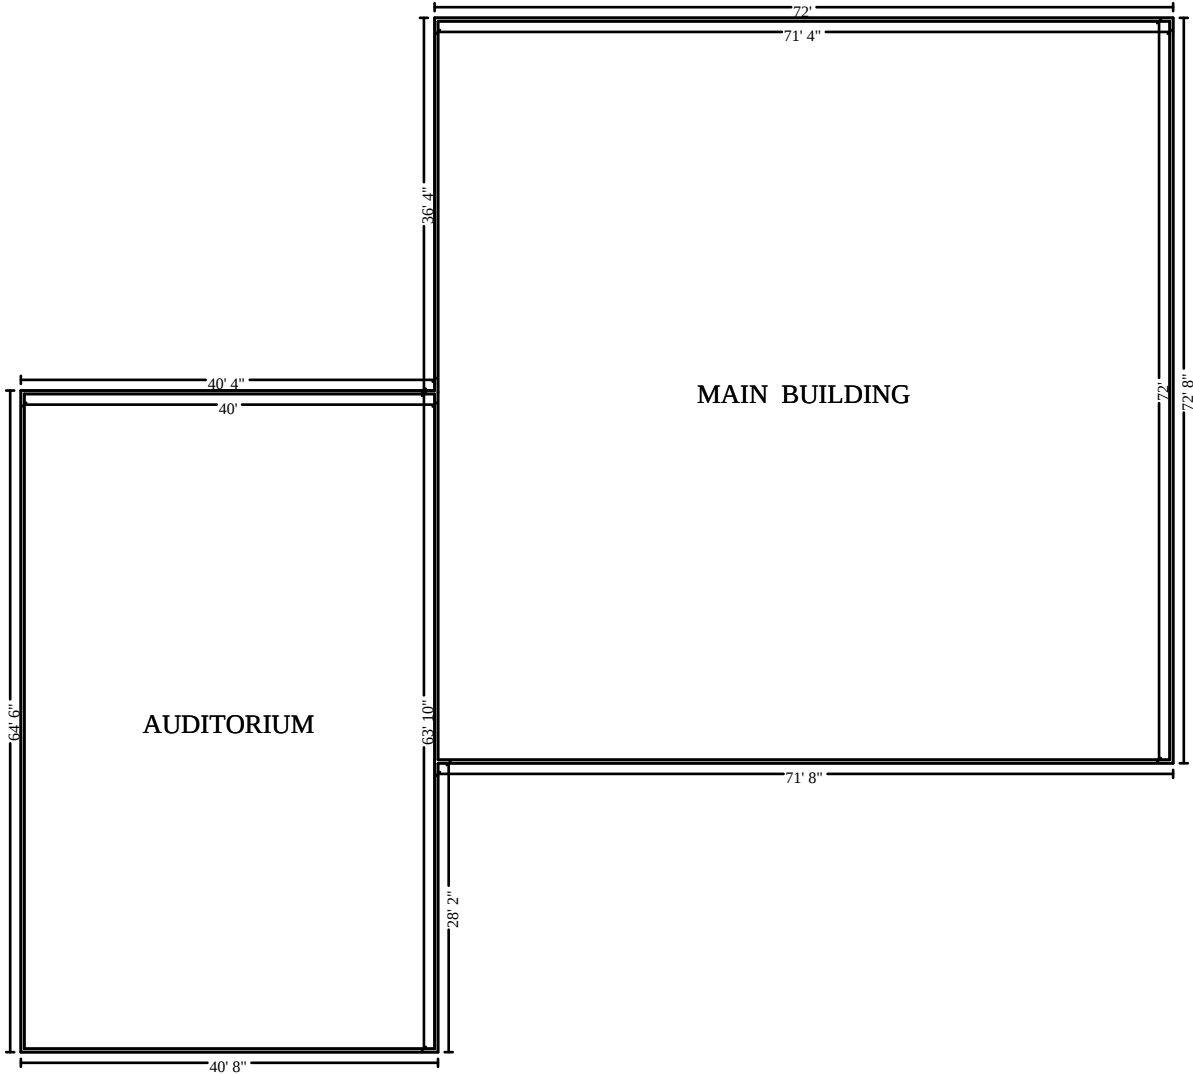


Image Detail			
Image No.	Type	Date Taken	Taken By
1	2-20231030_101158 SUBJECT PROPERTY	10/30/2023	
2	3-20231030_101203 FRONT BUILDING ELEVATION	10/30/2023	
3	4-20231030_101214 REAR BUILDING ELEVATION	10/30/2023	
4	5-20231030_101320 REAR BUILDING	10/30/2023	
5	6-20231030_101357 REAR ELEVATION FRONT AND REAR	10/30/2023	
6	7-20231030_101420 FRONT BUILDING ELEVATION	10/30/2023	
7	8-20231030_101457 FRONT RIGHT ELEVATION FASCIA	10/30/2023	
8	9-20231030_101833 FRONT BUILDING ELEVATION TRIM	10/30/2023	
9	10-20231030_101956 FRONT BUILDING ELEVATION FASCIA	10/30/2023	
10	11-20231030_102020 FRONT ELEVATION FASCIA	10/30/2023	
11	12-20231030_102111	10/30/2023	
12	13-20231030_102405 MAIN ENTRANCE ELEVATION SOFFIT	10/30/2023	
13	14-20231030_102552 MAIN ENETRANCE TRIM TRUSSES	10/30/2023	
14	15-20231030_103041 REAR BUILDING SIDE ELEVATION FASCIA	10/30/2023	
15	16-20231030_103300 REAR BUILDING WINDOW TRIM	10/30/2023	
16	17-20231030_103808 REAR BUILDING SIDE ELEVATION FASCIA	10/30/2023	
17	18-20231030_103812	10/30/2023	
18	19-20231030_104228	10/30/2023	

RAVEN ENVIRONMENTAL RESTORATION SERVICES, LLC.



Continued - Image Detail			
Image No.	Type	Date Taken	Taken By
19	REAR BUILDING REAR ELEVATION FASCIA		
	20-20231030_104756	10/30/2023	
	REAR FRONT BUILDING FASCIA		



Received by:	☐ Accepted ☐ Rejected	Prepared by:	Analyzed by:	Reported by:
--------------	--	--------------	--------------	--------------



LEAD ANALYSIS REPORT

1675 N. Commerce Parkway, Weston, FL 33326 / TOLL FREE 800-427-0550

TEST ADDRESS:

DEPARTMENT OF ENVIRONMENTAL PROTECTION
261 DR FREDERICK S HUMPHRIES ST
APALACHICOLA, FL 32320

REPORT NUMBER:

1684685

RECEIVED DATE:

11/01/2023

ANALYSIS DATE:

11/02/2023

REPORT DATE:

11/02/2023

PHONE:

786-349-3133

CLIENT:

RAVEN ENVIRONMENTAL RESTORATION SERVICES
6800 BIRD RD #454
MIAMI, FL 33155

EMAIL:

admin@ravenenviro.com

CERTIFICATE OF LEAD ANALYSIS

ANALYSIS METHOD EPA SW 846 7000B

SAMPLE ID	TYPE	LOCATION	RESULT	CONCLUSION
1684685-1	P	BUILDING FRONT TRIM	<300 PPM*	NOT ELEVATED
1684685-2	P	BUILDING FRONT FASCIA	<170 PPM*	NOT ELEVATED
1684685-3	P	BUILDING ENTRANCE SOFFITS	<49 PPM**	NOT ELEVATED
1684685-4	P	BUILDING ENTRANCE TRUSSE	<190 PPM***	NOT ELEVATED
1684685-5	P	REAR BUILDING FASCIA	<170 PPM***	NOT ELEVATED
1684685-6	P	REAR BUILDING WINDOW TRIM	<130 PPM*	NOT ELEVATED
1684685-7	P	REAR BUILDING SIDE ELEVATION FASCIA	<45 PPM	NOT ELEVATED
1684685-8	P	REAR LEFT SIDE ELEVATION FASCIA	<41 PPM	NOT ELEVATED
1684685-9	P	FRONT BUILDING REAR ELEVATION FASCIA	<120 PPM*	NOT ELEVATED
1684685-10	P	FRONT BUILDING REAR ELEVATION TRIM	<83 PPM	NOT ELEVATED

Sample Type Codes: P = Paint D = Dust S = Soil B = Bulk

EPA THRESHOLD STANDARDS

Lead in Paint:	Lead in Dust	Lead in Soil:
≤ 5000 PPM	Floors/Flooring: ≤10 µg/ft ²	Soil Play Area ≤ 400 PPM
≤ 0.5 %	Exterior Concrete: ≤850 µg/ft ²	Soil Remainder ≤ 1200 PPM
	Window Sills: ≤ 100 µg/ft ²	
	Window Trough: ≤ 400 µg/ft ²	

Diana Sauri, Quality Control Manager

Minimum Detection Limit (MDL): 5.0 PPM. For work involving HUD, Child occupied buildings and other residential units, the Federal Lead Standard is 0.5% by weight (5000 PPM). The Machine Reporting Limit is 10 micrograms (PPM) of total Lead.

Lead Paint

* = Sample submitted was less than the recommended amount. A minimum of 0.1 grams should be submitted.

** = Sample contains substantial amounts of substrate which may affect the calculated results with units of ppm and % by weight.

*** = Sample submitted was less than the recommended amount. A minimum of 0.1 grams should be submitted. Sample contains substantial amounts of substrate which may affect the calculated results with units of ppm and % by weight.

Lead Dust:

**** = The laboratory has been unable to verify that the wipe samples submitted conform to ASTM E1792 or specifications issued by the EPA

***** = Could not calculate concentration (µg/ft²). Area for sample not provided on chain-of-custody

The above PRO-LAB / SSPTM, INC. results are provided by Environmental Hazards Services, LLC. California Certification #2319; NY ELAP #11714

Seagull Environmental Management Company

900 N.W. 5TH Avenue, Fort Lauderdale, Florida 33311 (954) 524-7208



This is to Certify that
Ricardo A Aleman

6800 Bird Rd Suite 454, Miami, FL 33155

has successfully completed an English
8 Hr. Lead-Safe Renovator Course

1-Oct-19 TO 1-Oct-19

Accepted as Individual Certification in EPA administered states.

Alabama Accreditation: Jan. 27, 2011

Georgia Accredited: Chapter 391-3-24

Approved in Mississippi, Utah, and accepted in most authorized states.

Trainer(s): Samuel Orr

Training Address: 900 NW 5th Ave, Fort Lauderdale, FL 33311

Passed an examination & hands-on skills assessment on: 1-Oct-19

This Certificate Expires:

Federally Administered States	29-Sep-24
Most authorized states	30-Sep-22
Georgia	30-Sep-22

This certificate is only valid in conjunction with the appropriate firm certification. In addition, in some EPA authorized states, one must surrender this certificate to obtain a state certification for the individual. For additional certificates, contact Seagull at 1-800-966-9933.

Processed By:

Seagull

To Authenticate Certificate
www.seagulltraining.com
1-800-966-9933

UNDER CIVIL AND CRIMINAL PENALTIES UNDER CIVIL AND CRIMINAL
PENALTIES OF LAW FOR MAKING OR SUBMISSION OF FALSE OR
FRAUDULENT STATEMENTS OR REPRESENTATIONS (18 U.S.C. 1001
AND 15 U.S.C 2615)

Certificate Number:



R-I-Subpart Q-19-81119

Course Number: SE1940