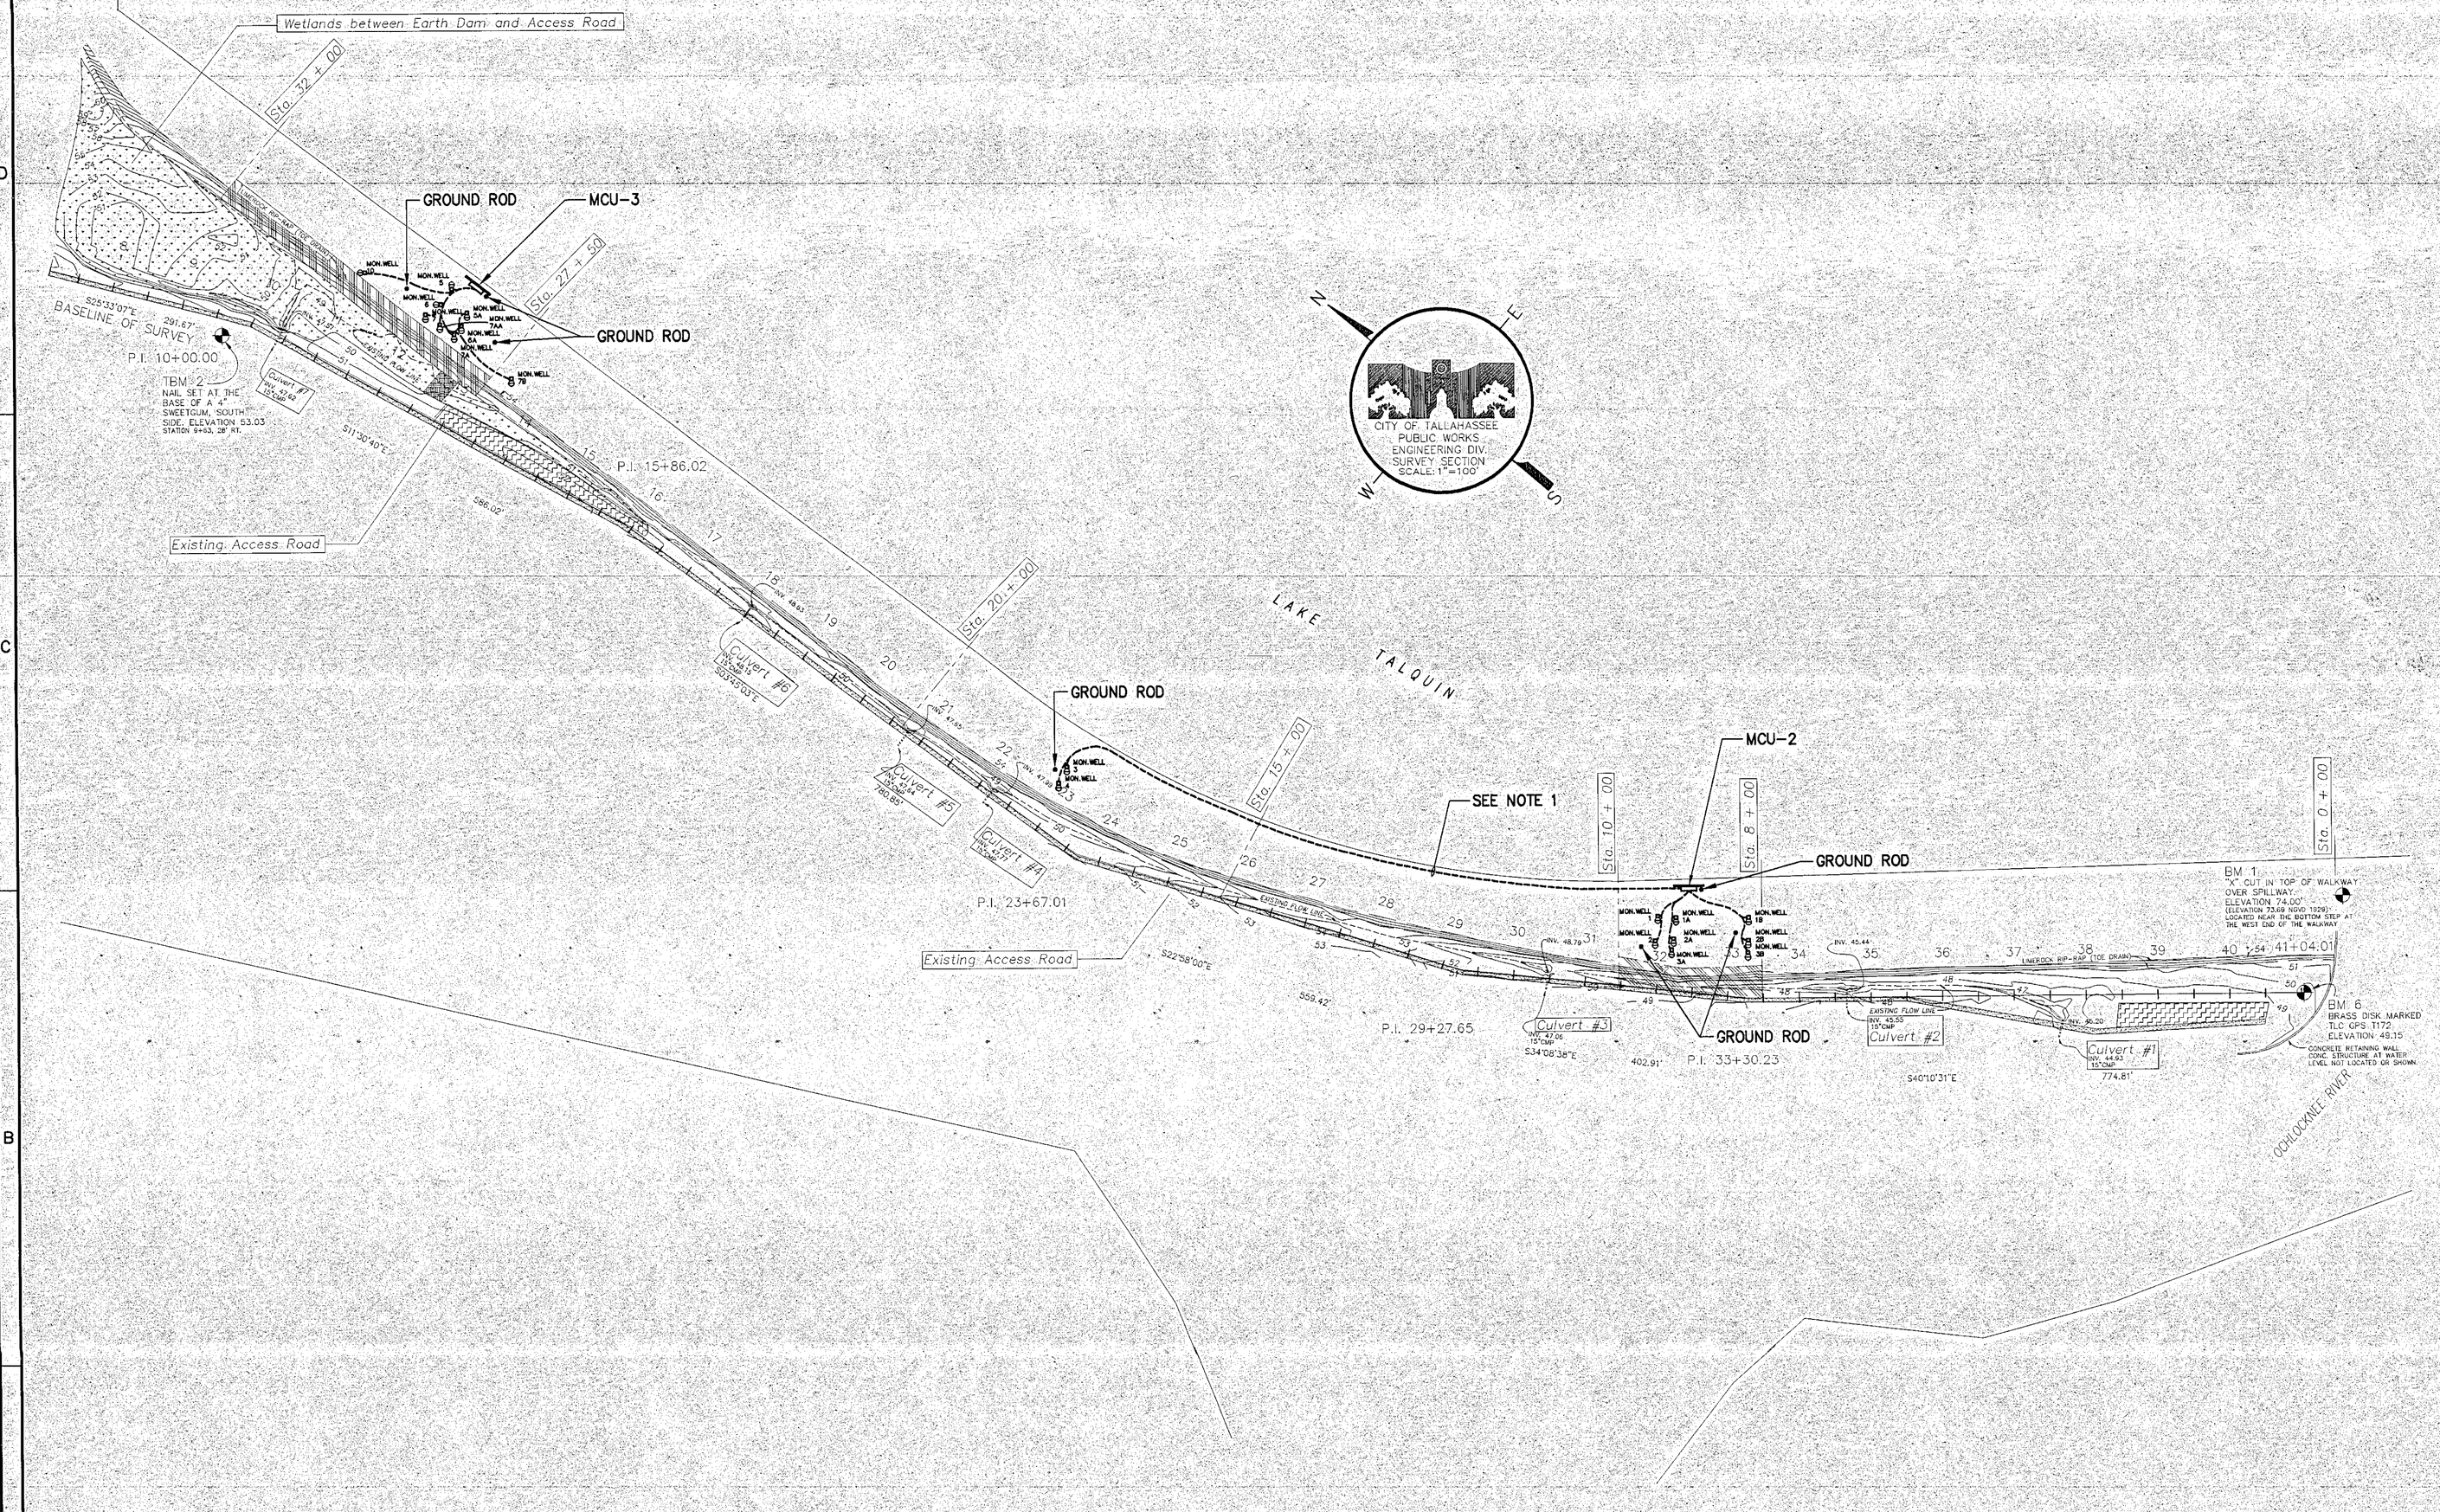


NOTES:

1. A CABLE PLOW SHALL BE USED TO CUT A TRENCH 18" (±2") DEEP TO ROUTE THE PIEZOMETER CABLE FROM EACH WELL LOCATION TO THE MCU LOCATED ON THE EARTH DAM. AFTERWARD, COMPACTION AND REPLANTING SOD SHALL BE REQUIRED IN ALL EXCAVATED AREAS.
2. A TRACER WIRE SHALL BE PLACED ALONG WITH ALL BURIED PIEZOMETER CABLE.
3. ALL PIEZOMETER CABLE ABOVE GRADE SHALL BE ROUTED IN GALVANIZED RIGID CONDUIT.
4. ALL GALVANIZED RIGID CONDUIT AND TUBE STEEL WHICH ENTERS THE GROUND AND ALONG THE LENGTH THAT IS BURIED SHALL BE COATED WITH BITUMASTIC.
5. JUNCTION BOXES SHALL BE LOCATED AT EACH WELL SITE. (SEE INSTALLATION DETAIL)
6. ALL ENCLOSURE PENETRATIONS SHALL BE BOTTOM ENTRY AND WATERTIGHT.
7. STANCHIONS SHALL BE PLACED IN LINE WITH EXISTING SIGNS.

REFERENCE DWGS:

INSTR. LOCATION PLAN:	
SPILLWAY & POWER HOUSE	47786101
SPILLWAY	47786103
DETAILS:	
DETAILS & SECTIONS	47786201
DETAILS & SECTIONS	47786202

REVISIONS

REV.	DESCRIPTION	DATE	APPR'D
A	ISSUED FOR APPROVAL	11/14/97	

WATKINS ENGINEERS AND CONSTRUCTORS
P.O. Box 2194 Tallahassee, Florida 32316
W.E.C. # 4778-6102

CITY OF TALLAHASSEE APPROVAL
CITY OF TALLAHASSEE ENG. — DATE 11/19/97
WATKINS APPROVAL
PROJ. ENG. — DATE
DISCIPLINE'S ENG. — DATE 11/19/97
CHECK — DATE
DESIGN/DRAFT M.J.GOSIK — DATE 10/97
CITY OF TALLAHASSEE PROJECT ITEM NO.
CUSTOMER IDENT. NO.
CUSTOMER CITY OF TALLAHASSEE

THIS DRAWING AND THE INFORMATION DISCLOSED THEREON ARE THE PROPERTY OF THE CITY OF TALLAHASSEE. THE DRAWING AND INFORMATION ARE PROVIDED ON A RESTRICTED BASIS AND ARE NOT TO BE USED IN ANY WAY DETRIMENTAL TO THE CITY OF TALLAHASSEE.

C.H. CORN HYDROELECTRIC PROJECT
JACKSON BLUFF DAM, LAKE TALQUIN
EARTH DAM
INSTR. LOCATION PLAN

CITY OF TALLAHASSEE

DRAWING NO. 47786102 — SCALE 1"=100'-0" — REV. A — SHEET

PROJECT: | FILE NAME: | PLOT SCALE: | LAST VIEWED BY: | LAST MODIFICATION BY:

G:\ACAD\4778\6000\LOCPLANS\47786102 Fri Nov 14 07:02:19 1997