



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: July 2019

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank System Equipment Registration Form

Fill out completely

General Information

Company Name:

Contact Name:

Company Address:

City, State:

Zip:

E-mail:

Contact Number:

Product Name:

Product Type:

Model Number(s):

Rule(s) citation that registration is being requested within Chapter 62-761 (UST), and/or 62-762 (AST), F.A.C.:

Write a brief description of equipment registration request including product limitations:

Information Checklist (Choose Yes, No, or N/A - Not Applicable):

Yes No N/A

1. Third-party Certification by a Nationally Recognized Testing Laboratory? (Required)
2. Documentation of third-party evaluation that the equipment meets DEP Rules?
3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory?
4. Technical information and drawings included?
5. Installation instructions included?
6. Annual Operability Testing Requirements (Rules 62-761.500, 62-762.501, & 62-762.502 F.A.C.)?
7. Integrity Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702, F.A.C.)?
8. Compatible with fuel blends containing >10% ethanol or >20% biodiesel?
9. Has the product been approved or registered in other countries or states? (If so provide list)
10. Any requirements for company-certified installers or trainers?
11. Was this product(s) previously approved or registered by the Department? If yes, EQ-
12. Any changes or modifications to the equipment since the last submittal to DEP?

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@floridadep.gov, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

Printed Name and Title

Signature (right click to sign)

Date

For Department Use Only:

Date Application Received:

Application complete:

Yes:

No: Re

EQ-

Date of complete or incomplete letter sent:

Date Equipment Requires Renewal:

Storage tank system equipment requires renewal every 5 years in accordance with subsection 62-762.851(2), F.A.C.



File MH9432

Vol 1

Auth. Page 1

Issued: 1971-11-23

Revised: 2013-01-09

FOLLOW-UP SERVICE PROCEDURE
(TYPE L)

ABOVEGROUND FLAMMABLE-LIQUID TANKS
(EEEEV)

Manufacturer: SEE ADDENDUM FOR MANUFACTURER LOCATIONS

Applicant: 1723510 (Party Site)
ACTERRA GROUP LLC
(100501-506) CORPORATE CENTRE 200
3305 3RD AVE
PO BOX 160
MARION IA 52302

Listee/Classified Co.: 1723510 (Party Site)
SAME AS APPLICANT
(100501-506)

This Follow-Up Service Procedure authorizes the above Manufacturer(s) to use the marking specified by UL LLC, or any authorized licensee of UL LLC, including the UL Contracting Party, only on products when constructed, tested and found to be in compliance with the requirements of this Follow-Up Service Procedure and in accordance with the terms of the applicable service agreement with UL Contracting Party and any applicable Service Terms. The UL Contracting Party for Follow-Up Services is listed on addendum to this Follow-Up Service Procedure ("UL Contracting Party"). UL Contracting Party and UL LLC are referred to jointly herein as "UL."

UL further defines responsibilities, duties and requirements for both Manufacturers and UL representatives in the document titled, "UL Mark Surveillance Requirements" that can be located at the following web-site: <http://www.ul.com/fus> and in the document titled "UL and Subscriber Responsibilities" that can be located at the following website: <http://www.ul.com/responsibilities>. Manufacturers without Internet access may obtain the current version of these documents from their local UL customer service representative or UL field representative. For assistance, or to obtain a paper copy of these documents or the applicable Service Terms, please contact UL's Customer Service at <http://www.ul.com/global/eng/pages/corporate/contactus>, select a location and enter your request, or call the number listed for that location.

The Applicant, the specified Manufacturer(s) and any Listee/Classified Co. in this Follow-Up Service Procedure must agree to receive Follow-Up Services from UL Contracting Party. If your applicable agreement is a Global Services Agreement ("GSA") with an effective date of January 1, 2012 or later and this Follow-Up Service Procedure is issued on or after that effective date, the Applicant, the specified Manufacturer(s) and any Listee/Classified Co. will be bound to a Service Agreement for Follow-Up Services upon the earliest by any Subscriber of use of the prescribed UL Mark, acceptance of the factory inspection, or payment of the Follow-Up Service fees which will incorporate such GSA, this Follow-Up Service Procedure and the Follow-Up Service Terms which can be accessed by clicking here: <http://www.ul.com/contracts/Terms-After-12-31-2011>. In all other events, Follow-Up Services will be governed by and incorporate the terms of your applicable service agreement and this Follow-Up Service Procedure.

It is the responsibility of the Listee/Classified Co. to make sure that only the products meeting the aforementioned requirements bear the authorized Marks of UL LLC, or any authorized licensee of UL LLC.

This Follow-Up Service Procedure contains information for the use of the above Manufacturer(s) and representatives of UL and is not to be used for any other purpose. It is provided to the Manufacturer with the understanding that it will be returned upon request and is not to be copied in whole or in part.

This Follow-Up Service Procedure, and any subsequent revisions, is the property of UL and is not transferable. This Follow-Up Service Procedure contains confidential information for use only by the above named Manufacturer(s) and representatives of UL and is not to be used for any other purpose. It is provided to the Subscribers with the understanding that it is not to be copied, either wholly or in part unless specifically allowed, and that it will be returned to UL, upon request.

Capitalized terms used but not defined herein have the meanings set forth in the GSA and the applicable Service Terms or any other applicable UL service agreement.

UL shall not incur any obligation or liability for any loss, expense or damages, including incidental, consequential or punitive damages arising out of or in connection with the use or reliance upon this Follow-Up Service Procedure to anyone other than the above Manufacturer(s) as provided in the agreement between UL LLC or an authorized licensee of UL LLC, including UL Contracting Party, and the Manufacturer(s).

UL LLC has signed below solely in its capacity as the accredited entity to indicate that this Follow-Up Service Procedure is in compliance with the accreditation requirements.

William R. Carney
Director
North American Certification Program

LOCATION

(100501-506) 1723510 (Party Site)
ACTERRA GROUP LLC
CORPORATE CENTRE 200
3305 3RD AVE
PO BOX 160
MARION IA 52302

Factory ID: NONE
UL Contracting Party for above site is: UL LLC



Regular Inspection Report

Date: 6/17/2025

Report #: 00054678-00000002

Field representative

Name: Robert Prochazka

Phone:

Email: bob.prochazka@ul.com

Manufacturer representative

Name: Ryan Poldberg

Phone: 319-377 6357

Email: ryan.poldberg@acterragroup.net

Inspection details

Manufacturer: ACTERRA GROUP LLC

Party site #: 609816

Manufacturer address: Corporate Centre 200 3305 3Rd Ave Po Box 160, Marion, Iowa, 52302-0160, United States

Applicant: ACTERRA GROUP LLC

File/Volume/CCN: MH9301-2-EGHX-609816,MH9301-ST1-EGHX-609816,MH9301-ST2-EGHX-609816,MH9301-ST3-EGHX-609816,MH9301-ST4-EGHX-609816,MH9301-ST5-EGHX-609816

Product type: Underground Flammable Liquid Tanks

UL Marks used since last audit? No

Specific environment conditions required? No

Nonconformance issued: None issued

Sample status: Samples required but none are available

Product(s)

Catalog or model designation	Product name	File/Volume/CCN	Section	Multiple Listed model if applicable
No Products Examined		MH9301-2-EGHX-609816		

Product Documents / Production Ready Visit

No Products Examined - Production Ready Visit

Authorization to use the UL Mark is contingent upon a regular countercheck of the products intended to be labeled to ensure compliance to UL Solution requirements. Since there was no completed labeled production at the time of this inspection, please notify your field representative (named on this report) as soon as the next production date or dates are known, so that an inspection can be conducted prior to the next shipment of UL Marked product.

No UL Solutions owned IMTE was used during inspection

Comments



Regular Inspection Report

Date: 6/17/2025

Report #: 00054678-00000001

Field representative

Name: Robert Prochazka

Phone:

Email: bob.prochazka@ul.com

Manufacturer representative

Name: Ryan Poldberg

Phone: 319-377 6357

Email: ryan.poldberg@acterragroup.net

Inspection details

Manufacturer: ACTERRA GROUP LLC

Party site #: 609816

Manufacturer address: Corporate Centre 200 3305 3Rd Ave Po Box 160, Marion, Iowa, 52302-0160, United States

Applicant: ACTERRA GROUP LLC

File/Volume/CCN: MH9432-1-EEEEV-609816

Product type: Aboveground Flammable Liquid Tanks

UL Marks used since last audit? Yes

Specific environment conditions required? No

Nonconformance issued: None issued


Sample status: Samples not required

Product(s)

Catalog or model designation	Product name	File/Volume/CCN	Section	Multiple Listed model if applicable
T140875	300 Gal Above ground tank	MH9432-1-EEEEV-609816		

No UL Solutions owned IMTE was used during inspection

Comments

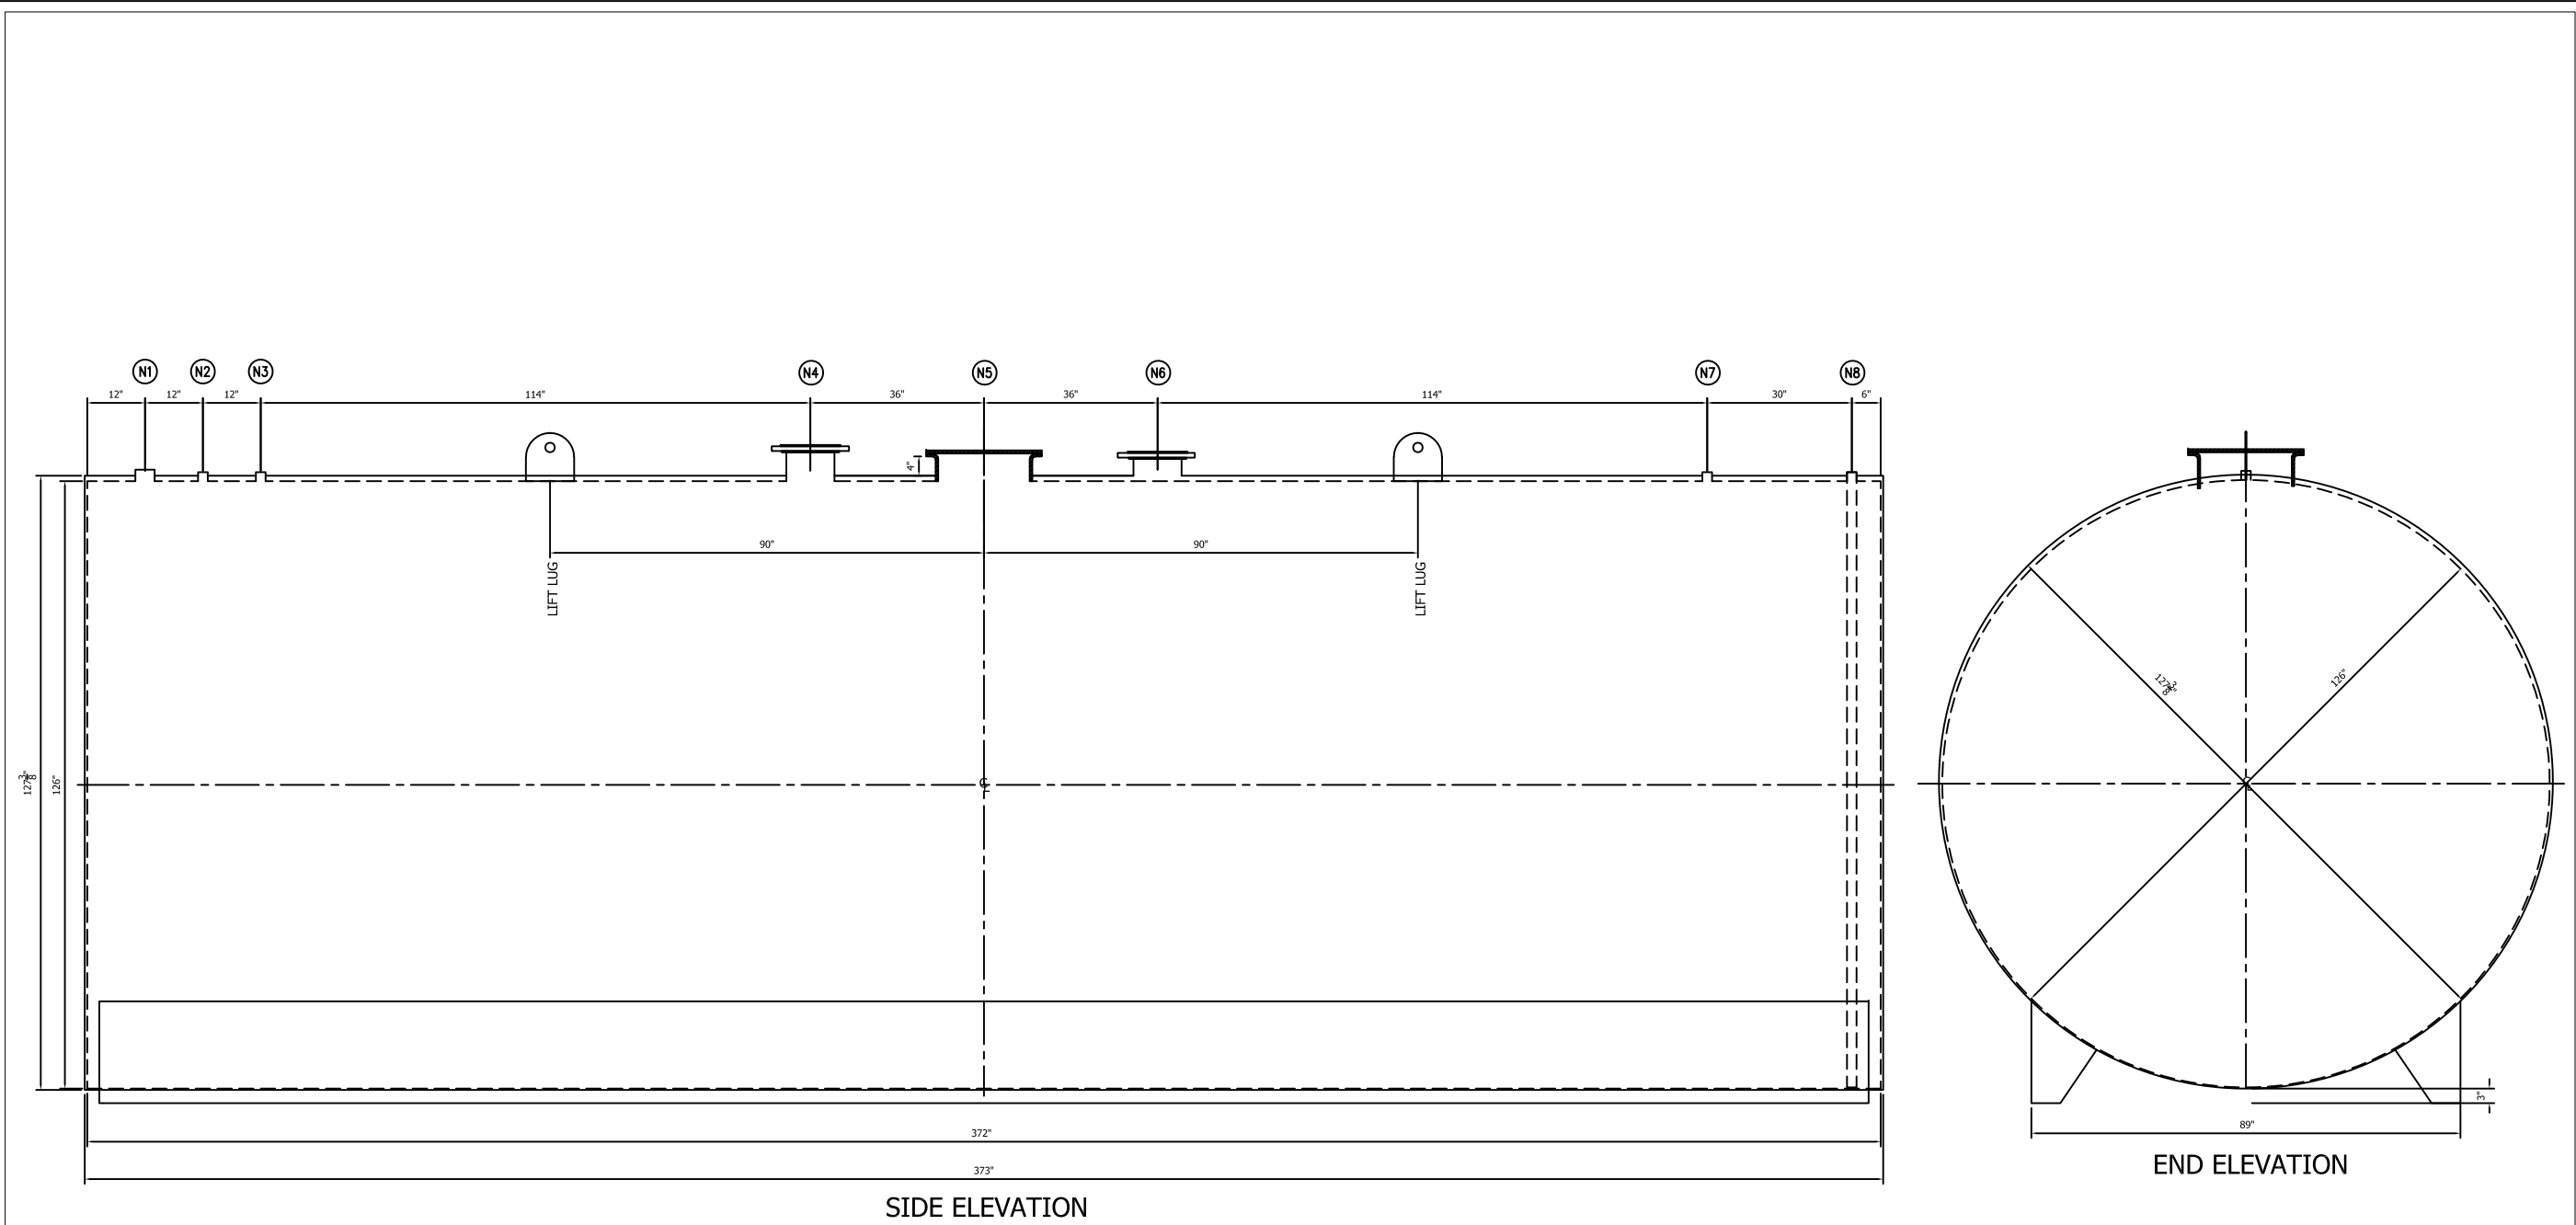

- GENERAL SPECIFICATIONS
1.

ORDER QUANTITY: 1 TANK
2.

NOMINAL CAPACITY: 20,000 GALLONS
3.

OPERATING PRESSURE: ATMOSPHERIC
4.

OPERATING TEMPERATURE: AMBIENT
5.

CONSTRUCTION: DOUBLE-WELDED BUTT JOINT
6.

MATERIAL: MILD CARBON STEEL
7.

TEST ANNULAR SPACE: 4 LBS MAXIMUM
8.

APPROVED LABELS: UL142
9.

EXTERIOR COATING: SANDBLAST AND DTM WHITE ENAMEL
10.

TANK ACCESSORIES TO BE PROVIDED AND INSTALLED BY OTHERS (UNLESS NOTED ELSEWHERE)
11.

PRIMARY TANK: WELD SEAM 10" OFF CENTER TOP OF TANK
12.



SECONDARY TANK: WELD SEAM TO BOTTOM

FITTING DETAIL	
N1	4" FNPT TOP OPENING (FILL)
N2	2" FNPT TOP OPENING (DISPENSE)
N3	2" FNPT TOP OPENING (GAUGE)
N4	8" FLNG TOP OPENING (EMERGENCY VENT)
N5	24" DOUBLE PUNCHED MANWAY
N6	8" FLNG TOP OPENING (INTER EMERGENCY VENT)
N7	2" FNPT TOP OPENING (VENT)
N8	2" FNPT TOP OPENING (INTERSTITIAL MONITOR)

MATERIAL DETAIL	
HEADS INNER AND OUTER 72 X 144 X 5/16"	
INNER TANK SHELL 72 X 372 X 1/4"	
OUTER TANK SHELL 72 X 375 X 7 GA	
2 - LIFTING LUGS - LUGLARGE PER DRAWING A-1	
WEAR PLATE 2- 18" W X 179" X 1/4" LONG	
BOTTOM PLATES 2-12" X 123" X 5/8" 2-12" X 20' X 5/8"	

GENERAL DIMENSIONS			
CAPACITY	DIAMETER	LENGTH	WEIGHT
20,000 GAL	126"	372"	26,600 LBS

GAUGE / THICKNESS			
OUTER HEADS	OUTER SHELLS	INNER HEADS	INNER SHELLS
7 GA	7 GA	1/4"	1/4"

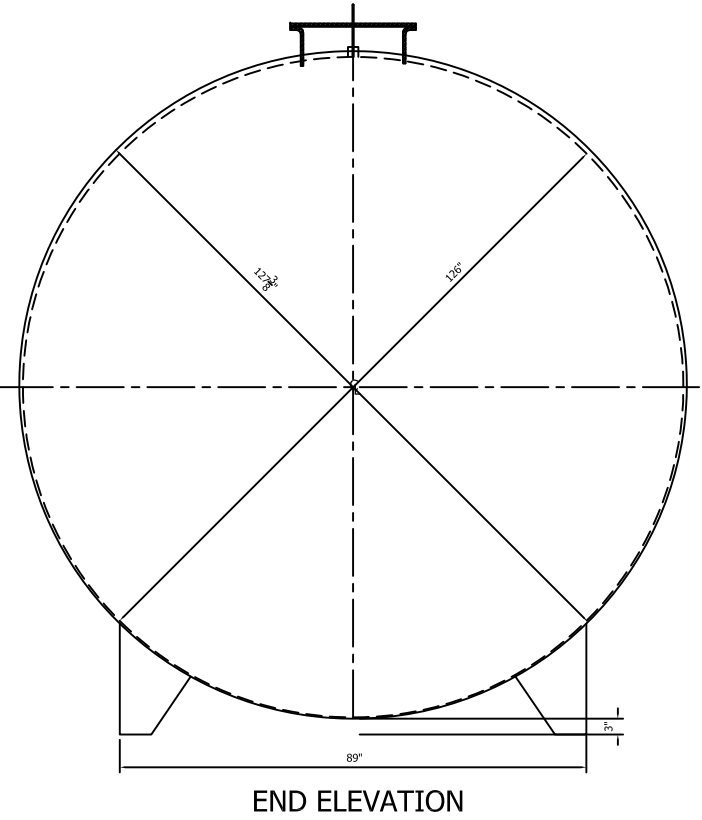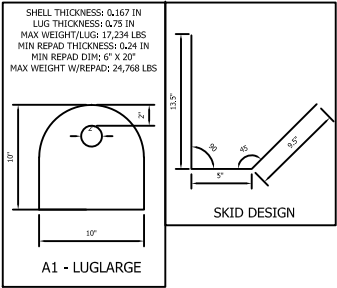

CUSTOMER APPROVAL

CUSTOMER: _____

DATE: _____

NO.	REVISION / ISSUE	DATE

CUSTOMER INFORMATION

BHT300000
UL142 DOUBLEWALL B-SKID TANK

DRAWN BY:	CRP	DRAWING NO.:	NO. 001
REVIEWED BY:	MEJ	DRAWING DATE:	
SCALE:	NTS	AGG REFERENCE NO.:	
CAD FILE NAME:			



acterra

GROUP.com


Corporate Centre 200
PO Box 160
Marion, IA 52302-0160
T 319.377.6357
F 319.377.0075
www.acterragroup.com
info@acterragroup.com

DISCLAIMERS

THIS DRAWING IS THE PROPERTY OF ACTERRA GROUP, LLC AND IS SUBMITTED AS A CONFIDENTIAL DISCLOSURE. ALL RIGHTS TO REPRODUCE THIS DRAWING AND THE ARTICLES THEREIN ARE EXPRESSLY RESERVED. THIS DOCUMENT AND ITS CONTENTS SHALL BE CONSIDERED INTELLIGENT PROPERTY OF THE ACTERRA GROUP, LLC. THEREFORE, THE USE OF THE DOCUMENT AND ITS CONTENTS ARE STRICTLY PROHIBITED WITHOUT THE WRITTEN APPROVAL OF THE ACTERRA GROUP, LLC. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT INTENDED TO REPLACE OR REPRESENT NECESSARY ENGINEERING CALCULATIONS. THE SIZES, DIMENSIONS, THICKNESS, ETC. ARE NOT TO SUPERSEDE EXISTING TANK LAWS, REGULATIONS OR STANDARDS.

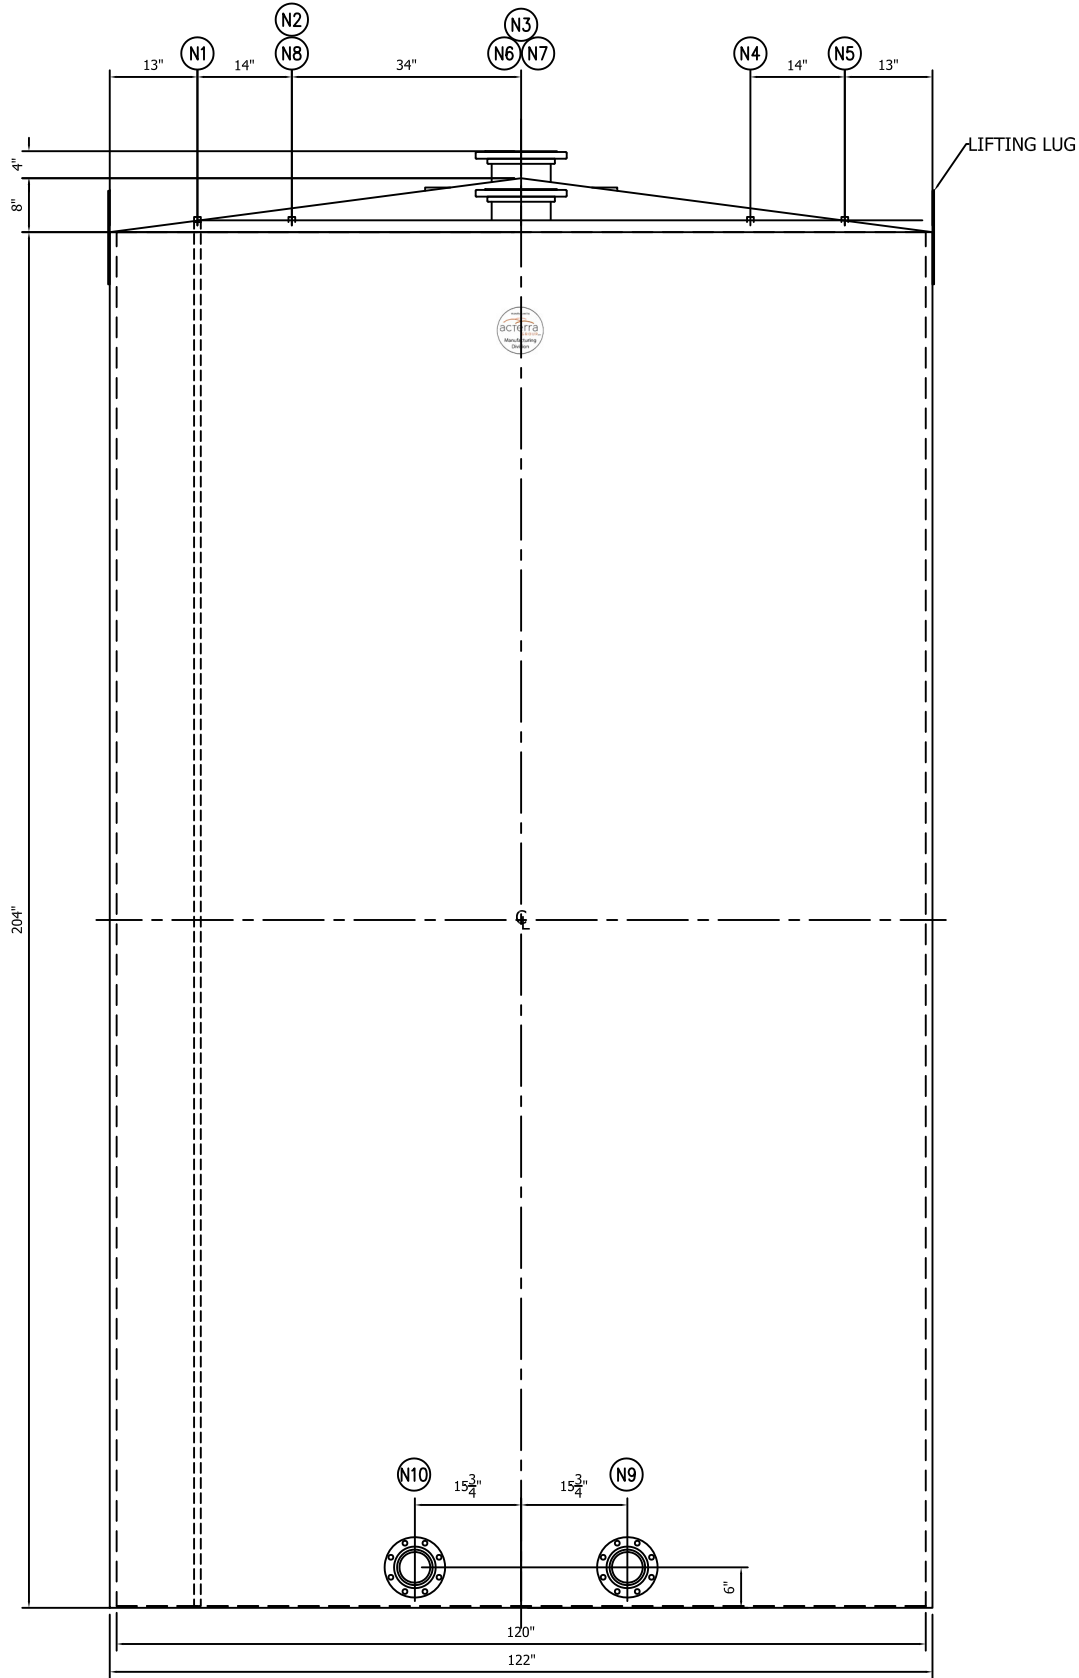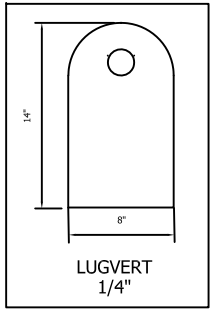

ELEVATION

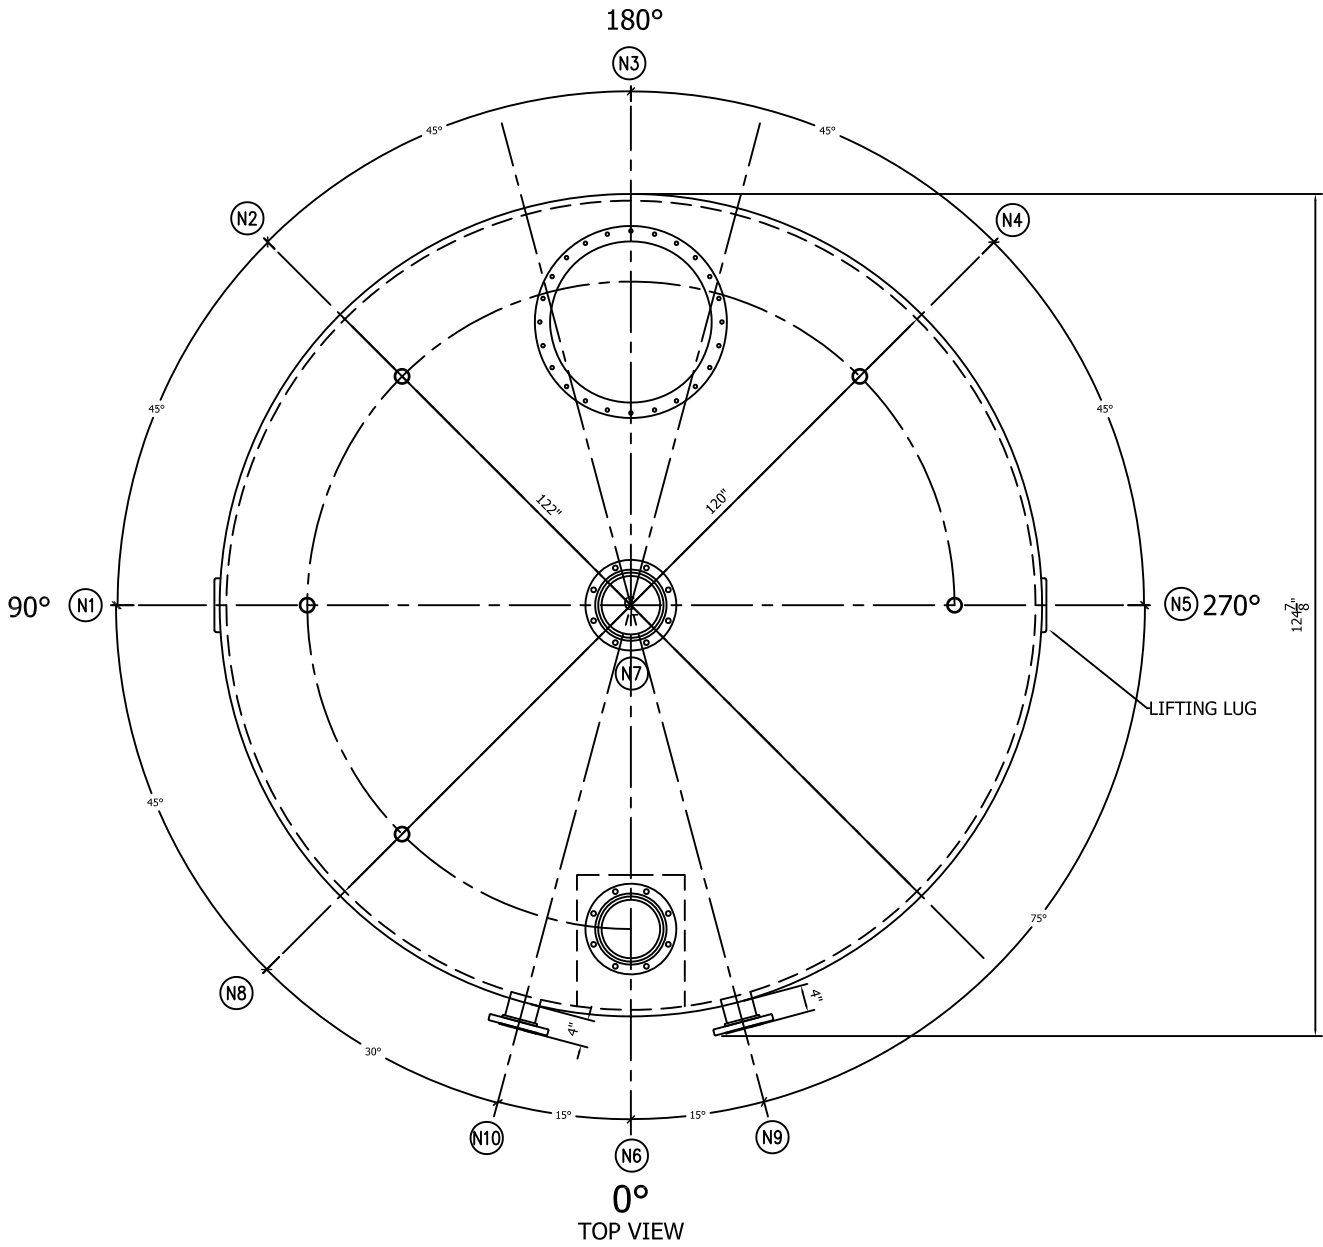

FITTING DETAIL	
N1	2" FNPT TOP OPENING (INTER-ZYP604120 205"L)
N2	2" FNPT TOP OPENING (ZYP632000)
N3	24" SINGLE PUNCH MANWAY
N4	2" FNPT TOP OPENING (ZYP632000)
N5	2" FNPT TOP OPENING (ZYP632000)
N6	8" FLNG TOP OPENING (INTER-FTP08)
N7	8" FLNG TOP OPENING (FTP08)
N8	2" FNPT TOP OPENING (ZYP632000)
N9	4" FLNG SIDE OPENING (FTP04)
N10	4" FLNG SIDE OPENING (FTP04)

GENERAL DIMENSIONS			
CAPACITY	DIAMETER	HEIGHT	WEIGHT
10,000 GAL	10'	17'	12,500 LBS

GENERAL DIMENSIONS			
TOP HEAD	OUTER SHELL	BOTTOM HEAD	INNER SHELL
1/4"	1/4"	1/4"	--

GENERAL SPECIFICATIONS

- ORDER QUANTITY: 1 TANK
- NOMINAL CAPACITY: 10,000 GALLONS
- VESSEL OPERATING PRESSURE: ATMOSPHERIC
- VESSEL OPERATING TEMPERATURE: AMBIENT
- CONSTRUCTION: CORNER WELDS
- MATERIAL: MILD CARBON STEEL
- TEST: TANK 2 LBS MAXIMUM
- APPROVED LABELS: UL142
- EXTERIOR COATING: SANDBLAST PAINT DTM WHITE
- WELD OUTSIDE ONLY
- CLEAN ALL FACTORY EDGES - OUTSIDE ONLY
- TANK ACCESSORIES TO BE PROVIDED AND INSTALLED BY OTHERS (UNLESS NOTED ELSEWHERE)

NO.	REVISION / ISSUE	DATE

CUSTOMER INFORMATION

BHT300000
DOUBLEWALL VERTICAL UL 142
ABOVEGROUND STORAGE TANK

DRAWN BY:	CRP	DRAWING NO.:	NO. 001
REVIEWED BY:	MEJ	DRAWING DATE:	
SCALE:	NTS	AGE REFERENCE NO.1	
CAD FILE NAME:			



Corporate Centre 200
PO Box 160
Marlon, IA 52302-0160
T 319.377.6357
F 319.377.0075
www.acterragroup.com
Info@acterragroup.com

DISCLAIMERS

THIS DRAWING IS THE PROPERTY OF ACTERRA GROUP, LLC AND IS SUBMITTED AS A CONFIDENTIAL DISCLOSURE. ALL RIGHTS TO REPRODUCE THIS DRAWING AND THE ARTICLES THEREIN ARE EXPRESSLY RESERVED. THIS DOCUMENT AND ITS CONTENTS SHALL BE CONSIDERED INTELLIGENT PROPERTY OF THE ACTERRA GROUP, LLC. THEREFORE, THE USE OF THE DOCUMENT AND ITS CONTENTS ARE STRICTLY PROHIBITED WITHOUT THE WRITTEN APPROVAL OF THE ACTERRA GROUP, LLC. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT INTENDED TO REPLACE OR REPRESENT NECESSARY ENGINEERING CALCULATIONS. THE SIZES, DIMENSIONS, THICKNESS, ETC., ARE NOT TO SUPERSEDE EXISTING TANK LAWS, REGULATIONS OR STANDARDS.

CUSTOMER APPROVAL

CUSTOMER: _____

DATE: _____