



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: July 2019

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank System Equipment Registration Form

Fill out completely

General Information

Company Name:

Contact Name:

Company Address:

City, State:

Zip:

E-mail:

Contact Number:

Product Name:

Product Type:

Model Number(s):

Rule(s) citation that registration is being requested within Chapter 62-761 (UST), and/or 62-762 (AST), F.A.C.:

Write a brief description of equipment registration request including product limitations:

Information Checklist (Choose Yes, No, or N/A - Not Applicable):

Yes No N/A

1. Third-party Certification by a Nationally Recognized Testing Laboratory? (Required)
2. Documentation of third-party evaluation that the equipment meets DEP Rules?
3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory?
4. Technical information and drawings included?
5. Installation instructions included?
6. Annual Operability Testing Requirements (Rules 62-761.500, 62-762.501, & 62-762.502 F.A.C.)?
7. Integrity Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702, F.A.C.)?
8. Compatible with fuel blends containing >10% ethanol or >20% biodiesel?
9. Has the product been approved or registered in other countries or states? (If so provide list)
10. Any requirements for company-certified installers or trainers?
11. Was this product(s) previously approved or registered by the Department? If yes, EQ-
12. Any changes or modifications to the equipment since the last submittal to DEP?

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@floridadep.gov, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

Printed Name and Title

Signature (right click to sign)

Date

For Department Use Only:

Date Application Received:

Application complete:

Yes:

No: Re

EQ-

Date of complete or incomplete letter sent:

Date Equipment Requires Renewal:

Storage tank system equipment requires renewal every 5 years in accordance with subsection 62-762.851(2), F.A.C.



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: July 2019

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank System Equipment Registration Form

Fill out completely

General Information

Company Name: Clay and Bailey Mfg. Co. Contact Name: Boris Bajic
Company Address: 6401 East 40th Street City, State: Kansas City Zip: 64129
E-mail: bbajic@claybailey.com Contact Number: 816-924-3900
Product Name: 6100-09-12XX, 14XX, 15XX and 17XX Series Spill Containment Devices including version with internal hinge
Model Number(s): 6100-09-12XX, 14XX, 15XX and 17XX Series Product Type: Spill Containment / Overfill Protection Devices
Rule(s) citation that registration is being requested within Chapter 62-761 (UST), and/or 62-762 (AST), F.A.C.: 62-762.501 (2)(f), F.A.C.

Write a brief description of equipment registration request including product limitations:

The Clay & Bailey 6100 Series, UL File No. MH25085 / ULC File No. MH47031, Spill Containment Box is for shop-fabricated aboveground storage tanks (ASTs), providing spill containment and overspill protection. It is composed of spun mild steel, powder coated for corrosion protection, comes with or without the built-in drain, & has a hinged locking lid with either external or internal hinge. **NOT FOR USE WITH ETHANOL MIX FUEL OR BIOFUELS**

Information Checklist (Choose Yes, No, or N/A - Not Applicable):

	Yes	No	N/A
1. Third-party Certification by a Nationally Recognized Testing Laboratory? (Required)	☒	☐	☐
2. Documentation of third-party evaluation that the equipment meets DEP Rules?	☒	☐	☐
3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory?	☒	☐	☐
4. Technical information and drawings included?	☒	☐	☐
5. Installation instructions included?	☒	☐	☐
6. Annual Operability Testing Requirements (Rules 62-761.500, 62-762.501, & 62-762.502 F.A.C.)?	☐	☒	☐
7. Integrity Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702, F.A.C.)?	☐	☒	☐
8. Compatible with fuel blends containing >10% ethanol or >20% biodiesel?	☒	☐	☐
9. Has the product been approved or registered in other countries or states? (If so provide list)	☒	☐	☐
10. Any requirements for company-certified installers or trainers?	☐	☒	☐
11. Was this product(s) previously approved or registered by the Department? If yes, EQ- <u>740/874</u>	☒	☐	☐
12. Any changes or modifications to the equipment since the last submittal to DEP?	☐	☒	☐

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@floridadep.gov, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

The Clay & Bailey 6100-09-12XX, 14XX, 15XX and 17XX Series, UL File No. MH25085 and ULC File No. MH47031 Spill Containment Devices for storage tank systems must be installed and tested in accordance with the manufacturer's Installation Instruction, industry standards, and all local, State, and Federal regulations prior to being placed into service and recorded in accordance with Rule 62-762.711, F.A.C. requirements.

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

Boris Bajic, Engineering Manager

Printed Name and Title

Boris Bajic

Signature (right click to sign)

Digitally signed by Boris Bajic
Date: 2021.07.28 10:23:24 -05'00'

07/28/2021

Date

For Department Use Only:

Date Application Received: 07/28/2021 Application complete: Yes: ☒ No: ☐

EQ- 874 Date of complete or incomplete letter sent: 07/29/2021 Date Equipment Requires Renewal: 07/29/2121

Storage tank system equipment requires renewal every 5 years in accordance with subsection 62-762.851(2), F.A.C.

DEP Form 62-762.901(9) Information Checklist Additional Information:

Item number:

1. The Clay & Bailey 6100-09-12XX, 14XX, 15XX and 17XX Series Spill Containment Devices are UL listed; UL File No. MH25085 that covers both US and Canada. Please see attached UL Certificate of Compliance and Certifications Directory.
2. UL evaluation documentation is proprietary. Spill Containment Devices are UL and ULC listed as shown on the attached UL Certifications Directory and Certificate of Compliance.
3. UL is nationally and internationally recognized testing laboratory that provides safety-related certification, validation, testing, inspection, auditing, advising and training services to a wide range of clients, including manufacturers, retailers, policymakers, etc. More information can be found on UL's website: www.ul.com
7. Spill Containment Box is tested for liquid tightness at factory and does not require repairs. If found to be leaking it will be replaced with a new one.
9. 6100-09-12XX, 14XX, 15XX and 17XX Series Spill Containment Devices are also approved in Canada by ULC.

Tank Accessories for Flammable and Combustible Liquids

COMPANY**MH25085****CLAY & BAILEY MFG CO**

6401 E 40Th St

Kansas City, MO 64129-1711 United States

Automatic Pressure-filled type Overfill Protection Devices, Model(s): 01228-03-40XX @, 01228-03-41XX @, GEN X OPV 01228-03-45XXYY @

Automatic Pressure-filled type Overfill Protection Devices, Model(s): GEN X OPV FOR 2" RISER PIPE 01228-03-56XXYY

Emergency vents, Model(s): 0367-09-3000 (a), 0367-09-4000 (a), 0367-09-5000 (a), 0367-09-6000 (a), 354-02-2000 (a), 365-01-3000 (a), 365-03-3000 (a), 366-01-4000 (a), 366-01-5000 (a), 366-01-6000 (a), 366-03-30HF (a), 366-03-4000 (a), 366-03-40HF (a), 366-03-5000 (a), 366-03-50HF (a), 366-03-6000 (a), 366-03-60HF (a), 366-03-80HF (a), 367-01-4000 (a), 367-01-5000 (a), 367-01-6000 (a), 367-03-30HF (a), 367-03-4000 (a), 367-03-40HF (a), 367-03-5000 (a), 367-03-50HF (a), 367-03-6000 (a), 367-03-60HDF (a), 367-03-60HF (a), 367-03-80HF (a), 368-01-4000 (a), 368-01-6000 (a), 368-01-8000 (a), 368-03-4000 (a), 368-03-6000 (a), 368-03-8000 (a), 369-01-4000 (a), 369-01-6000 (a), 369-01-8000 (a), 369-03-4000 (a), 369-03-6000 (a), 369-03-8000 (a), 370-01-8000 (a), 370-03-1000 (a), 370-03-10HF (a), 370-03-60HF (a), 370-03-8000 (a), 370-03-80HF (a)

Overfill prevention devices, Model(s): 1228-03-2200, 1228-03-2400, 1228-03-2500, 2x4 OP, 3x4 OP, 4x6 OP

Spill containers, Model(s): 3.5 gallon capacity cylindrical., 5 gallon capacity cylindrical., 5 gallon capacity rectangular., 7.5 gallon capacity cylindrical.

(a) - For use on Aboveground Tanks for Flammable and Combustible Liquids.

@ - where XX represent the length of the drop tube. Maximum rated pressure of 50 psi and for use with Class I liquids.

@ - where XX represents the length of the fill pipe and YY represents the length of the drop tube / pipe

[Last Updated](#) on 2026-03-03

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions

Cookies on UL Solutions

We use cookies to personalize content and ads, to provide social media features and to analyze our traffic. We also share information about your use of our site with our social media, advertising and analytics partners. [Learn more](#)

[Cookies Settings](#)[Reject All](#)[Accept All Cookies](#)

Tank Accessories for Flammable and Combustible Liquids Certified for Canada

COMPANY**CLAY & BAILEY MFG CO**

6401 E 40Th St

Kansas City, MO 64129-1711 United States

MH25085

Automatic Pressure-filled type Overfill Protection Devices, Model(s): 01228-03-40XX @, 01228-03-41XX @, GEN X OPV 01228-03-45XXYY @

Automatic Pressure-filled type Overfill Protection Devices, Model(s): GEN X OPV FOR 2" RISER PIPE 01228-03-56XXYY

Emergency vents, Model(s): 0367-09-3000 (a), 0367-09-4000 (a), 0367-09-5000 (a), 0367-09-6000 (a), 354-02-2000 (a), 365-01-3000 (a), 365-03-3000 (a), 366-01-4000 (a), 366-01-5000 (a), 366-01-6000 (a), 366-03-30HF (a), 366-03-4000 (a), 366-03-40HF (a), 366-03-5000 (a), 366-03-50HF (a), 366-03-6000 (a), 366-03-60HF (a), 366-03-80HF (a), 367-01-4000 (a), 367-01-5000 (a), 367-01-6000 (a), 367-03-30HF (a), 367-03-4000 (a), 367-03-40HF (a), 367-03-5000 (a), 367-03-50HF (a), 367-03-6000 (a), 367-03-60HF (a), 367-03-80HF (a), 368-01-4000 (a), 368-01-6000 (a), 368-01-8000 (a), 368-03-4000 (a), 368-03-6000 (a), 368-03-8000 (a), 369-01-4000 (a), 369-01-6000 (a), 369-01-8000 (a), 369-03-4000 (a), 369-03-6000 (a), 369-03-8000 (a), 370-01-8000 (a), 370-03-1000 (a), 370-03-10HF (a), 370-03-60HF (a), 370-03-8000 (a), 370-03-80HF (a)

Overfill prevention devices, Model(s): 1228-03-2200, 1228-03-2400, 1228-03-2500, 2x4 OP, 3x4 OP, 4x6 OP

Spill containers, Model(s): 3.5 gallon capacity cylindrical., 5 gallon capacity cylindrical., 5 gallon capacity rectangular., 7.5 gallon capacity cylindrical.

(a) - For use on Aboveground Tanks for Flammable and Combustible Liquids.

@ - where XX represent the length of the drop tube. Maximum rated pressure of 50 psi and for use with Class 1 liquids.

@ - where XX represents the length of the fill pipe and YY represents the length of the drop tube / pipe

[Last Updated](#) on 2026-03-03

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings).

Cookies on UL Solutions

We use cookies to personalize content and ads, to provide social media features and to analyze our traffic. We also share information about your use of our site with our social media, advertising and analytics partners. [Learn more](#)

[Cookies Settings](#)[Reject All](#)[Accept All Cookies](#)

CERTIFICATE OF COMPLIANCE

Certificate Number 20170608-MH25085
Report Reference MH25085-20160831
Issue Date 2017-JUNE-08

Issued to: CLAY & BAILEY MFG CO
6401 E 40Th St
Kansas City MO 64129-1711

**This is to certify that
representative samples of**

TANK ACCESSORIES FOR FLAMMABLE AND
COMBUSTIBLE LIQUIDS

3.5, 5 and 7.5 Gallon Spill Containers. 5 Gallon generator
base tank spill containers.

Have been investigated by UL in accordance with the
Standard(s) indicated on this Certificate.

Standard(s) for Safety:
Additional Information:

UL2583, Outline of Investigation for Fuel Tank Accessories
See the UL Online Certifications Directory at
www.ul.com/database for additional information

Only those products bearing the UL Certification Mark should be considered as being covered by UL's
Certification and Follow-Up Service.

Look for the UL Certification Mark on the product.



Bruce Mahrenholz, Director North American Certification Program
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please
contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



EGVV7.MH47031 - Tank Accessories for Flammable and Combustible Liquids Certified for Canada

Tank Accessories for Flammable and Combustible Liquids Certified for Canada

[See General Information for Tank Accessories for Flammable and Combustible Liquids Certified for Canada](#)

CLAY & BAILEY MFG CO

MH47031

6401 E 40Th St
Kansas City, MO 64129-1711 USA

Spill containment devices, for aboveground flammable and combustible liquid storage tanks, Model(s) 13 L capacities., 19 L capacities., 28 L capacities.

Last Updated on 2018-02-23

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"

EGVV.MH25085 - Tank Accessories for Flammable and Combustible Liquids

Tank Accessories for Flammable and Combustible Liquids

CLAY & BAILEY MFG CO

6401 E 40Th St
Kansas City, MO 64129-1711 United States

MH25085

Automatic Pressure-filled type Overfill Protection Devices Model(s) 01228-03-41XX @

Emergency vents Model(s) 0367-09-3000 (a), 0367-09-4000 (a), 0367-09-5000 (a), 0367-09-6000 (a), 354-02-2000 (a), 365-03-3000 (a), 366-03-30HF (a), 366-03-4000 (a), 366-03-40HF (a), 366-03-5000 (a), 366-03-50HF (a), 366-03-6000 (a), 366-03-60HF (a), 366-03-80HF (a), 367-03-30HF (a), 367-03-4000 (a), 367-03-40HF (a), 367-03-5000 (a), 367-03-50HF (a), 367-03-6000 (a), 367-03-60HDF (a), 367-03-80HF (a), 368-01-4000 (a), 368-01-6000 (a), 368-01-8000 (a), 368-03-4000 (a), 368-03-6000 (a), 368-03-8000 (a), 369-01-4000 (a), 369-01-6000 (a), 369-01-8000 (a), 369-03-4000 (a), 369-03-6000 (a), 369-03-8000 (a), 370-01-8000 (a), 370-03-1000 (a), 370-03-10HF (a), 370-03-60HF (a), 370-03-8000 (a), 370-03-80HF (a)

Overfill prevention devices Model(s) 1228-03-2200, 2x4 OP, 3x4 OP, 4x6 OP

Pressure vacuum vents Model(s) 0089-03-4885

Spill containers Model(s) 3.5 gallon capacity cylindrical., 5 gallon capacity cylindrical., 5 gallon capacity rectangular., 7.5 gallon capacity cylindrical.

(a) - For use on Aboveground Tanks for Flammable and Combustible Liquids.

@ - where XX represent the length of the drop tube. Maximum rated pressure of 50 psi and for use with Class 1 liquids.

Last Updated on 2021-03-31

Last Updated on 2021-03-31

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"

Spill Containment Box



Features:

Durable Spill Containment Box that captures small spills at the fill point during the fuel delivery operation.


Lockable lid provides secure filling point with water deflecting design.

Made from mild steel with zinc plated steel hardware.

Options include male and female different size threaded connections. Typical part numbers are noted in the table below.

Part #	Gallon	Connection	Connection Size
6100-09-1235	3.5	MALE	2" NPT
6100-09-1435	3.5	MALE	4" NPT
6100-09-1405F	5	FEMALE	4" NPT
6100-09-1405M	5	MALE	4" NPT
6100-09-1451MRB	5	MALE	4" NPT
6100-09-1505	5	MALE	4" NPT
6100-09-1752FRB	7.5	FEMALE	4" NPT
6100-09-1751MRB	7.5	MALE	4" NPT
6100-09-1754	7.5	MALE	4" NPT


Clay & Bailey spill containment boxes comply with various codes – Underwriters Laboratories Inc. UL-2583; Underwriters Laboratories of Canada ULC-S663; Florida DEP listed.

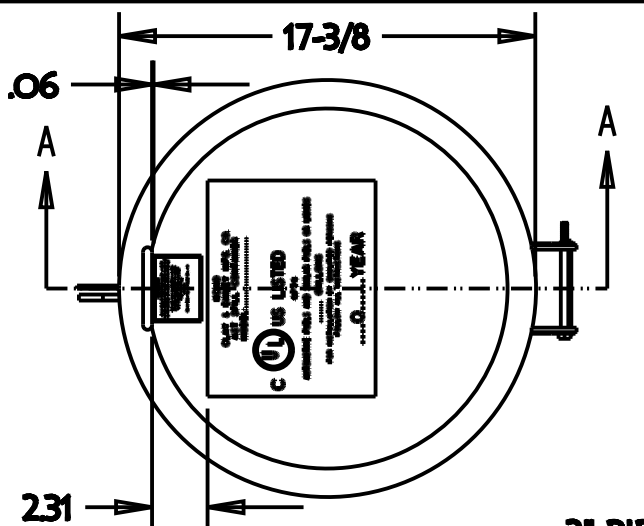


TOP VIEW

2" PIPE X 6" LONG
WITH 2" NPT ON BOTH ENDS


Ø16-1/8

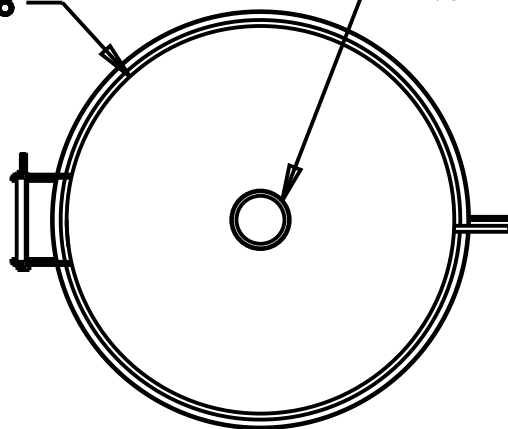

BOTTOM VIEW

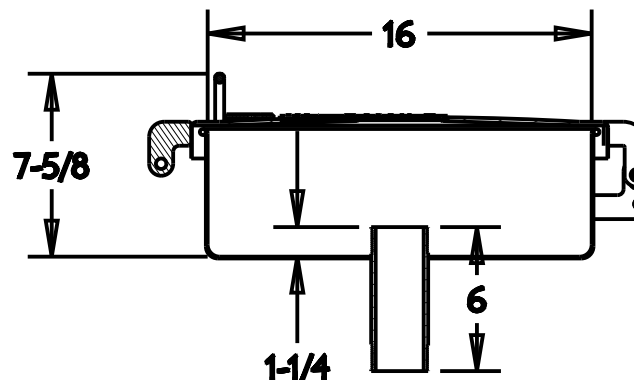

SECTION A-A

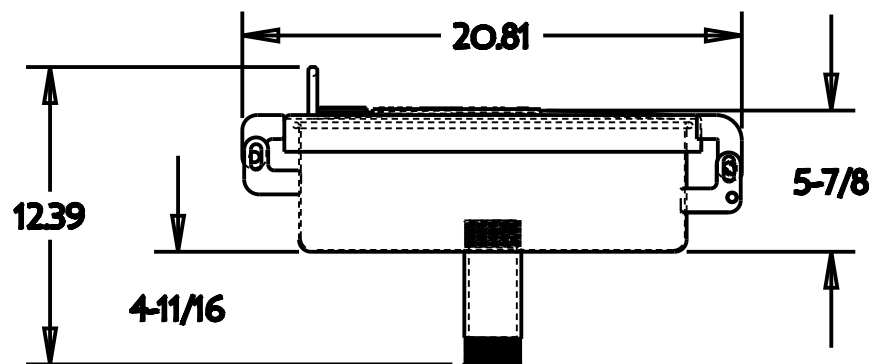

SIDE VIEW

TOLERANCES
X ± .01
XX ± .003
XXX ± .0010
XXXX ± .0005

ANGLES ± .05°

MATERIAL: STEEL

CLAY & BAILEY MFG. CO.

NAME

3.5 GALLON SPILL CONTAINMENT
WITH 2" CONNECTION ASSEMBLY

THIS DRAWING AND CONCEPTS DISCLOSED HEREON
BELONG EXCLUSIVELY TO CLAY & BAILEY WHOSE PRO-
PRIETARY RIGHTS THEREIN SHALL NOT BE APPROPRIATED
IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT.

WT:

SCALE:

DRAWN BY:

DWG:


6100-09-1235

REV.


APPROVED:

DATE: 06/25/08


SHEET OF

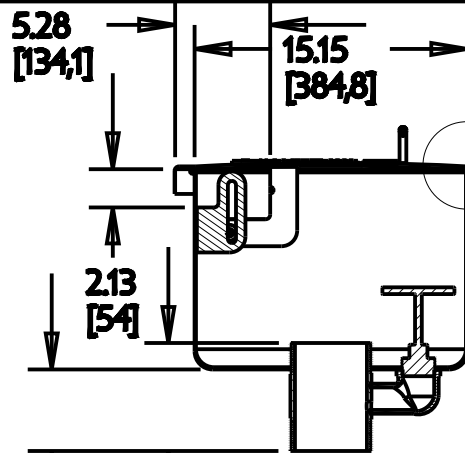

SEE DETAIL A

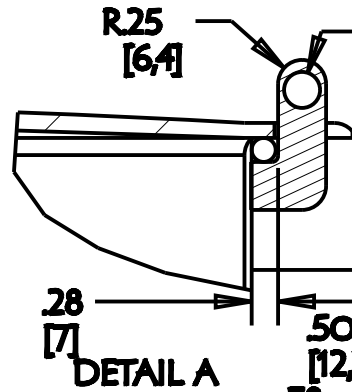


DETAIL A

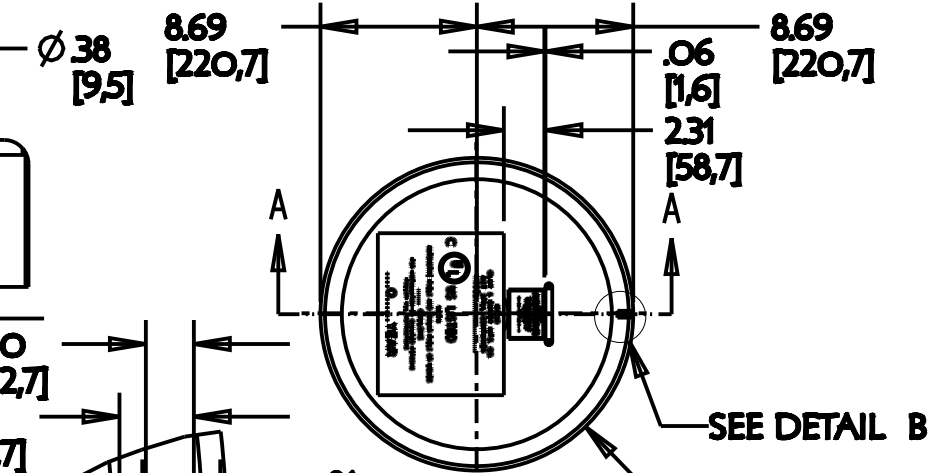

SEE DETAIL B

DETAIL B

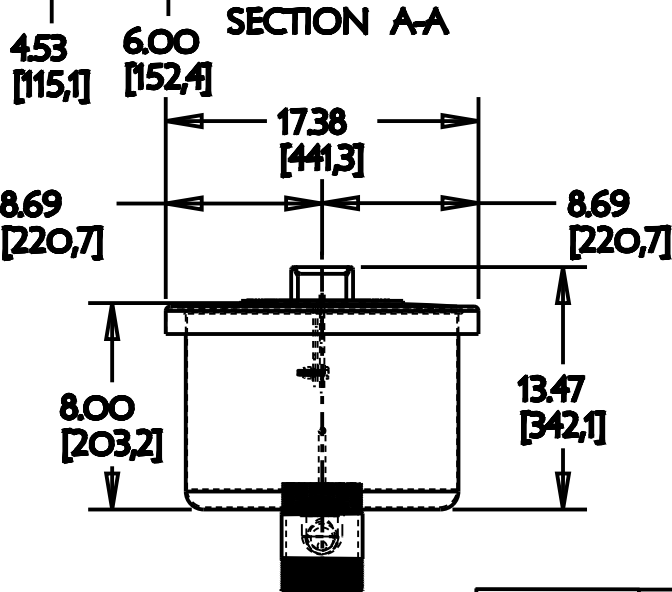

SIDE VIEW

TOLERANCES
X ± .01
XX ± .003
XXX ± .0010
XXXX ± .0005
+/- 1/16"
ANGLES +/- .5°

MATERIAL:

WT:

SCALE:

CLAY & BAILEY MFG. CO.

NAME
5 GALLON SPILL CONTAINMENT
W/INTERNAL HINGE

DRAWN BY
DRD

DWG
6100-09-1451MRB




REV.

APPROVED:


DATE 12/16/13

SHEET 1 OF 1

THIS DRAWING AND CONCEPTS DISCLOSED HEREON BELONG EXCLUSIVELY TO CLAY & BAILEY WHOSE PROPRIETARY RIGHTS THEREIN SHALL NOT BE APPROPRIATED IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT.

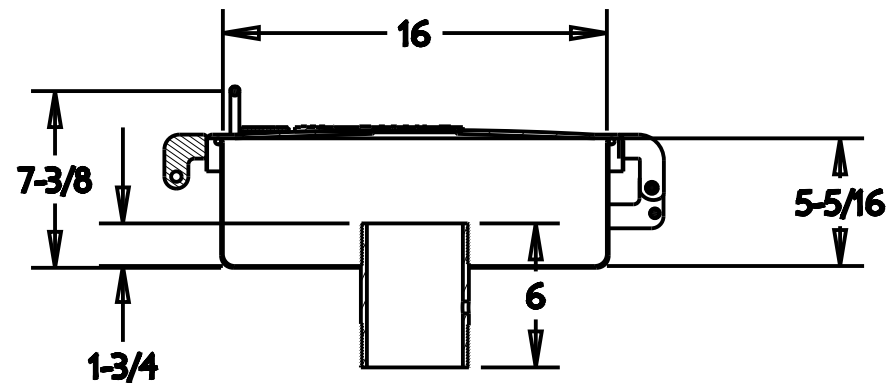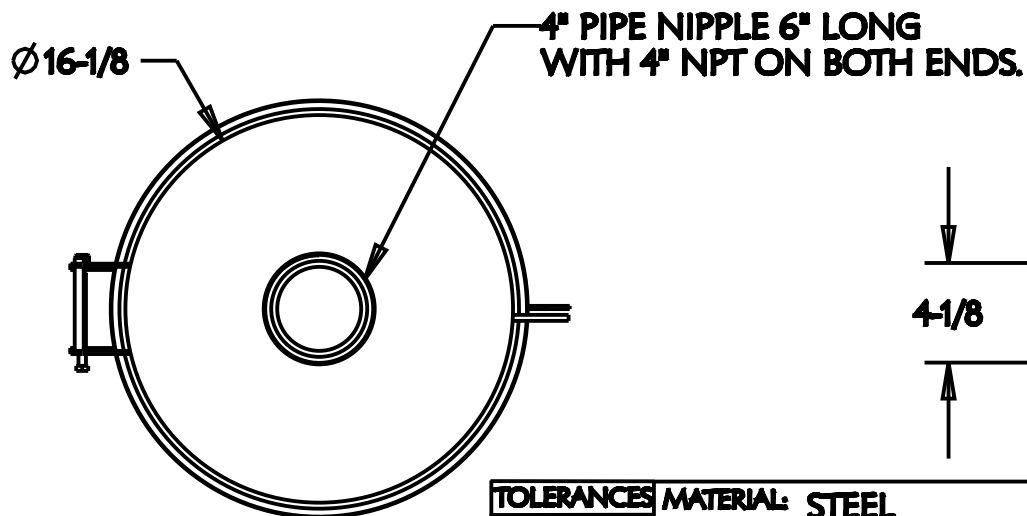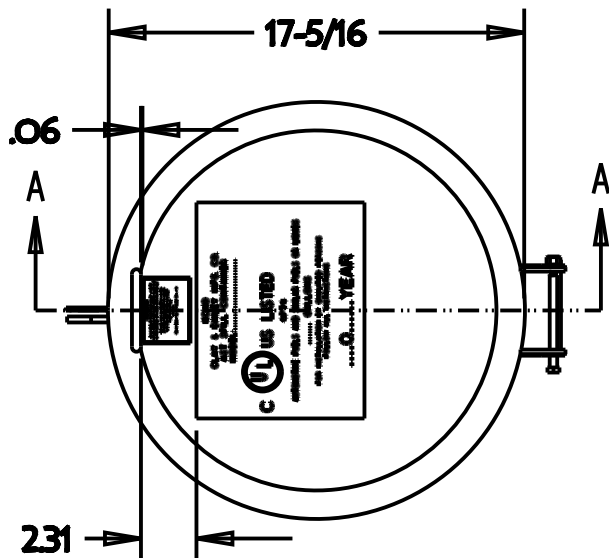

SECTION A-A

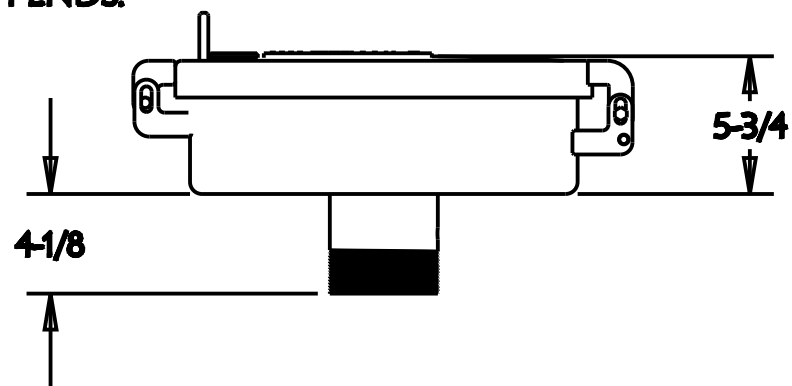

TOLERANCES
X ± .01
XX ± .003
XXX ± .0010
XXXX ± .0005

ANGLES ± .05°

MATERIAL: STEEL

WT:

SCALE:

CLAY & BAILEY MFG. CO.

NAME

3.5 GAL. SPILL CONTAINMENT
ASSEMBLY WITH 4" CONNECTION

DRAWN BY:

DWG:

6100-09-1435



REV.

APPROVED:

DATE 06/25/08

SHEET OF

THIS DRAWING AND CONCEPTS DISCLOSED HEREON
BELONG EXCLUSIVELY TO CLAY & BAILEY WHOSE PRO-
PRIETARY RIGHTS THEREIN SHALL NOT BE APPROPRIATED
IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT.

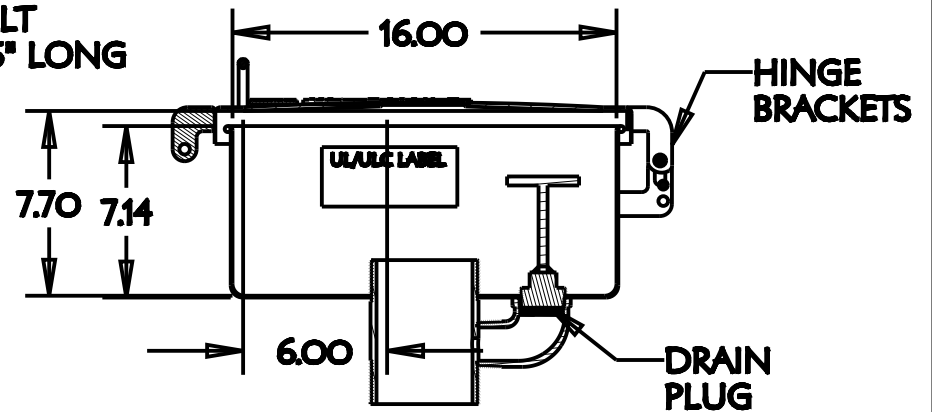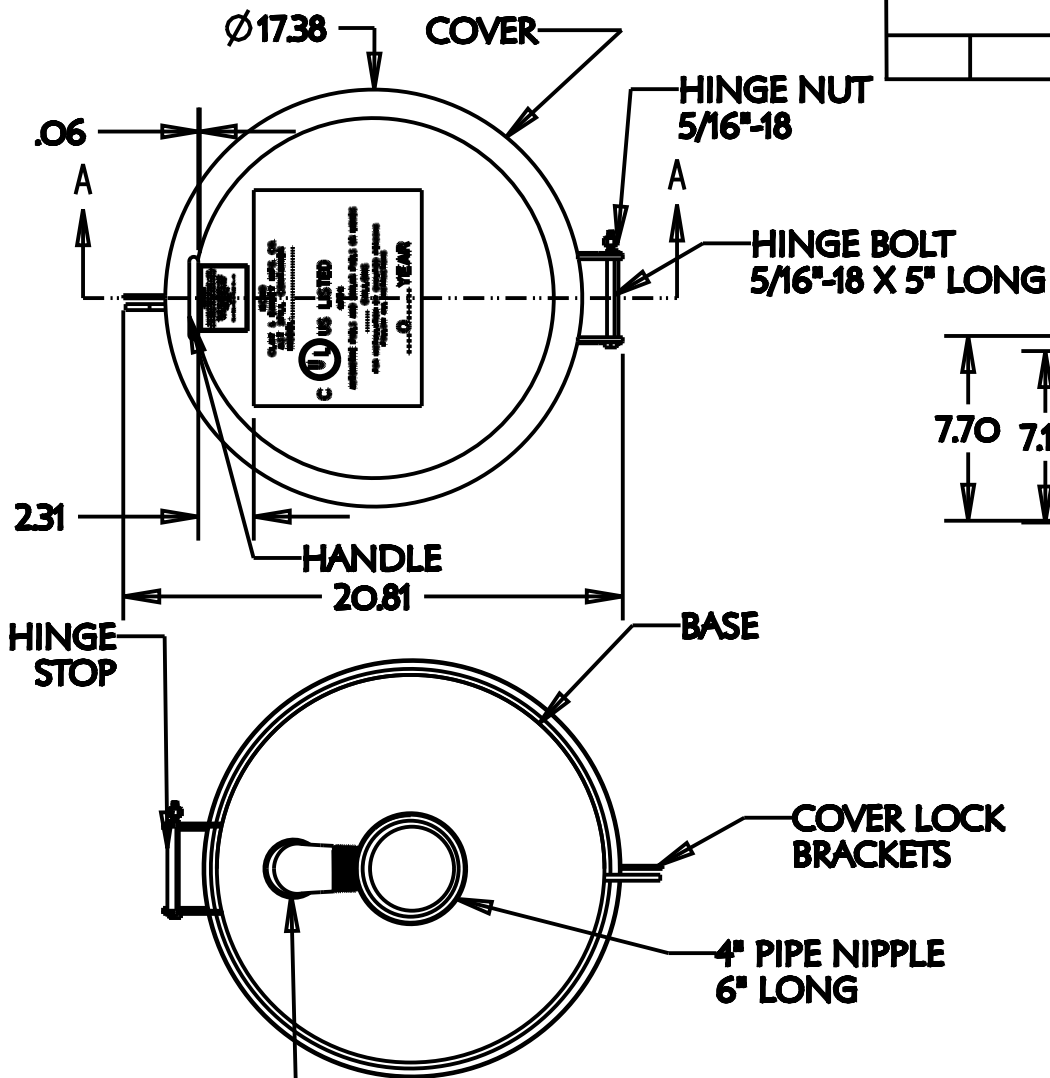

SECTION A-A

DRAIN ELBOW

TOLERANCES
X $\pm .01$
XX $\pm .003$
XXX $\pm .0010$
XXXX $\pm .0005$

ANGLES $\pm .05^\circ$

MATERIAL: 14 GA STEEL

WT:

SCALE:

CLAY & BAILEY MFG. CO.

NAME

5 GAL SPILL BOX ASSEMBLY

DRAWN BY:

DWG:

6100-09-1505

REV.





APPROVED:

DATE 06/30/08

SHEET OF

THIS DRAWING AND CONCEPTS DISCLOSED HEREON BELONG EXCLUSIVELY TO CLAY & BAILEY WHOSE PROPRIETARY RIGHTS THEREIN SHALL NOT BE APPROPRIATED IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT.

A	MOVED UL/ULC LABEL TO COVER	AB	09/26/2018
---	-----------------------------	----	------------

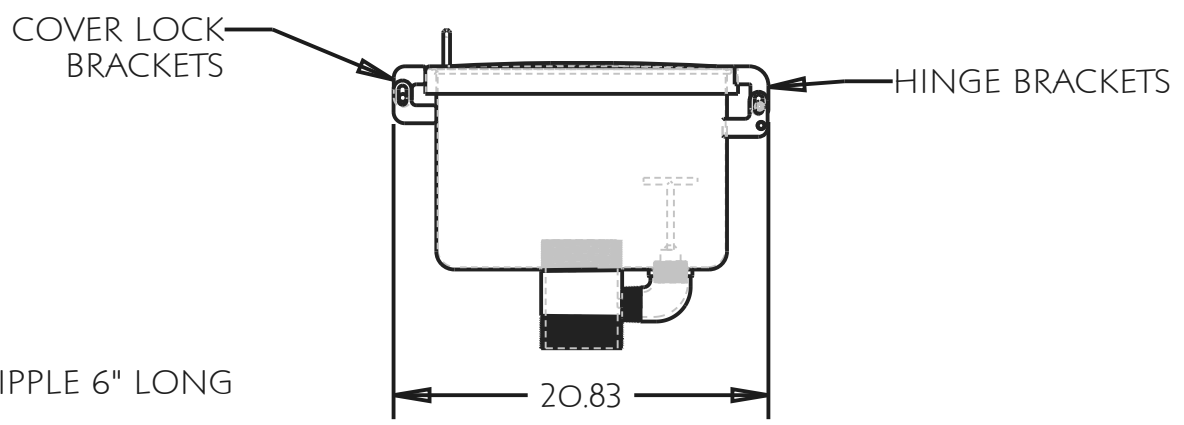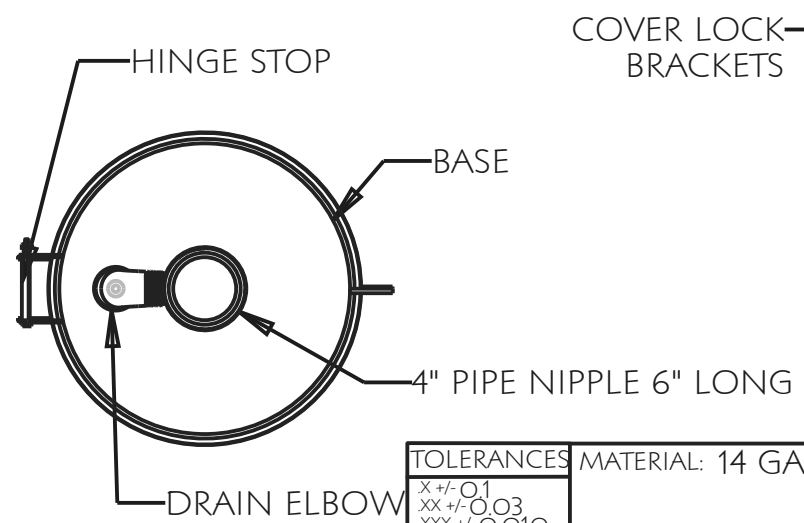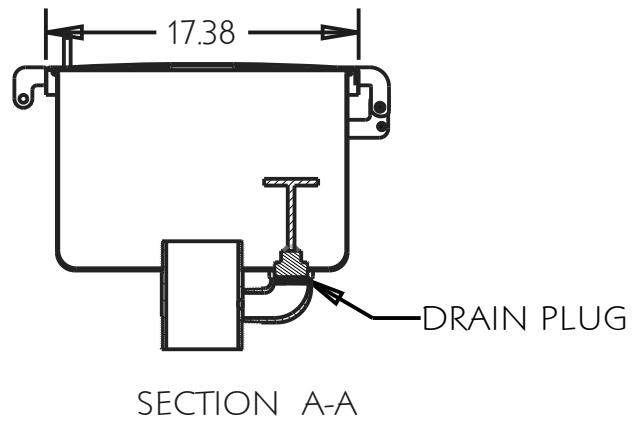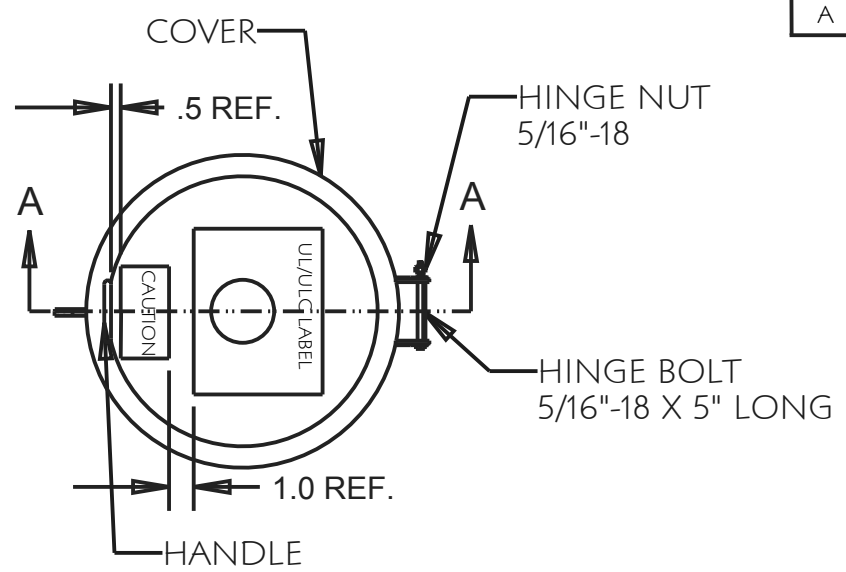


TOLERANCES	MATERIAL: 14 GA. STEEL
X +/- .01	
XX +/- .03	
XXX +/- .010	
XXXX +/- .0005	
ANGLES +/- .5°	

CLAY & BAILEY MFG. CO.			
NAME: 7.5 GAL. SPILL CONTAINMENT BOX ASSEMBLY			



THIS DRAWING AND CONCEPTS DISCLOSED THEREON BELONG EXCLUSIVELY TO CLAY & BAILEY WHOSE PROPRIETARY RIGHTS THEREIN SHALL NOT BE APPROPRIATED IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT.

WT:	
SCALE:	


DRAWN BY:	DWG:	REV.
DRD	6100-09-1754	A
APPROVED:	DATE: 06/12/08	SHEET OF

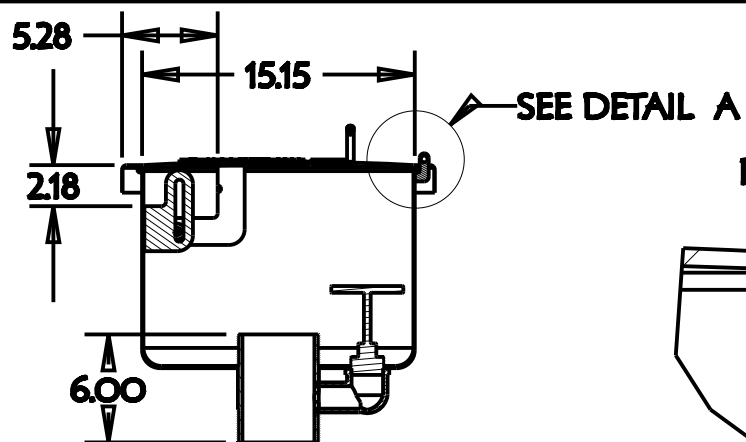



SECTION A-A

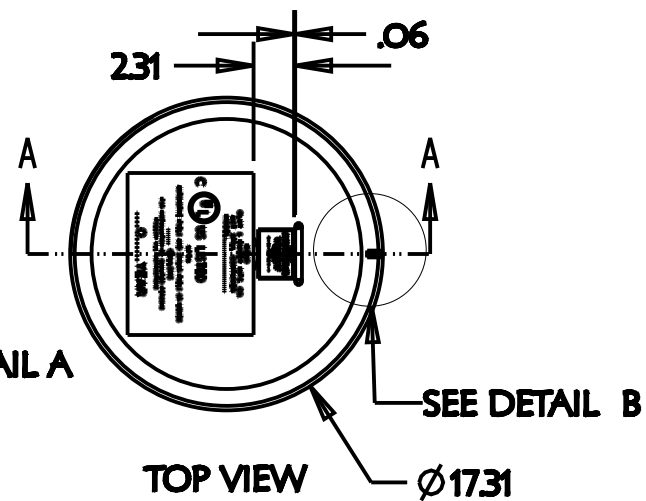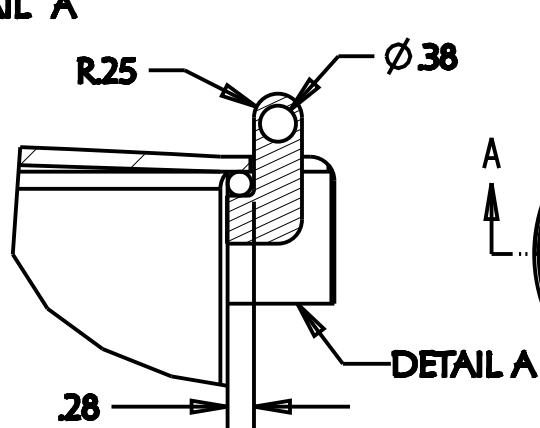

TOP VIEW

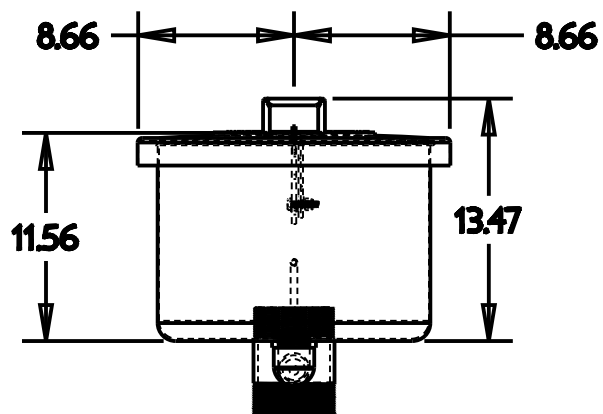

SIDE VIEW

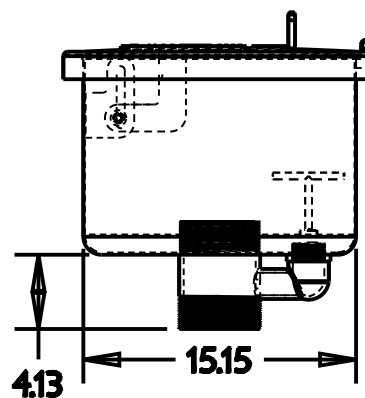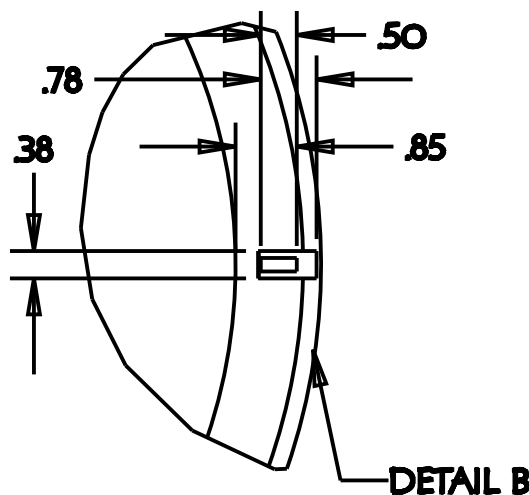

FRONT VIEW

TOLERANCES
X ± .01
XX ± .003
XXX ± .0010
XXXX ± .0005

ANGLE ± .5°

MATERIAL:

WT:

SCALE:

CLAY & BAILEY MFG. CO.

NAME

**7.5 GALLON SPILL CONTAINMENT
W/INTERNAL HINGE**

DRAWN BY

DRD

DWG

6100-09-1751MRB

REV.

APPROVED:

DATE 12/16/13

SHEET OF

THIS DRAWING AND CONCEPTS DISCLOSED THEREON
BELONG EXCLUSIVELY TO CLAY & BAILEY WHOSE PRO-
PRIETARY RIGHTS THEREIN SHALL NOT BE APPROPRIATED
IN WHOLE OR IN PART WITHOUT WRITTEN CONSENT.

 CLAY & BAILEY Mfg. Co. <i>Since 1913</i>		WORK INSTRUCTION, ENGINEERING	Section
			WI
			Code
Revision	Date: 02/25/2016	INSTALL FOR SPILL CONTAINMENT BOXES	CB-WIEN-017
1	Modified: 04/19/2017		Page 1 of 4

Installation Instructions for Spill Containment



Revised by Kahlil Owens
Position Engineering Technician
Date: 2/25/2016

Revision

Date: 02/25/2016

1

Modified: 04/19/2017

INSTALL FOR SPILL CONTAINMENT BOXES

CB-WIEN-017

Page 2 of 4

REVISION LOG

[illegible]

 CLAY & BAILEY Mfg. Co. <i>Since 1913</i>		WORK INSTRUCTION, ENGINEERING	Section
			WI
Revision	Date: 02/25/2016	INSTALL FOR SPILL CONTAINMENT BOXES	Code
1	Modified: 04/19/2017		CB-WIEN-017 Page 3 of 4

OBJECTIVE

The objective of this is to provide instructions for installation of the model **6100 Spill Containment Unit**.

1.1 SCOPE

This procedure is to be used with all Spill Containment Units

2.1 REFERENCE DOCUMENT

N/A

3.1 RESPONSIBLE

The **Engineering Manager** of **Clay & Bailey Mfg. Co.** is responsible for the upkeep and maintenance of this procedure.

4.1 ACTIVITY DESCRIPTION

Installation of Spill Containment Unit (SCU) with male threads.

To prevent accidents and injury to personnel who are responsible for the installation. Ensure the proper equipment is available and setup at the site to gain access to the top of the tank safely and in accordance with local OSHA standards and guidelines

Remove the SCU from its packaging and inspect for shipping damage. Dropping the SCU will damage the SCU which will not thread properly onto tank and or operate properly.

Remove the plug from the tank fitting that the SCU is supposed to be installed.

Apply an even coat of fuel resistant thread sealant on the threads of the outlet of the SCU.

Place the SCU on top of the tank carefully not to damage the SCU and/or the tank in preparation to connect it to the tank.

Using the proper equipment to work on the top of tank and following the appropriate safety precautions place the outlet pipe of the SCU in the appropriate fitting on top of the tank and thread the unit in by hand by turning it clockwise till the threads of the SCU are fully engaged with fitting on the tank.

Using the appropriate wrench to tighten the spill containment by placing the wrench on the outlet pipe just above the threaded portion and turn it clockwise to tighten to a torque of 50 to 75 ft.-lbs.

Installation of Spill Containment Unit with female threads.

 CLAY & BAILEY Mfg. Co. <i>Since 1913</i>		WORK INSTRUCTION, ENGINEERING	Section
			WI
Revision	Date: 02/25/2016	INSTALL FOR SPILL CONTAINMENT BOXES	Code
1	Modified: 04/19/2017		CB-WIEN-017 Page 4 of 4

To prevent accidents and injury to personnel do the installation. Insure the proper equipment is available and setup at the site to gain access to the top of the tank safely and in accordance with local OSHA standards and rules

Remove the SCU from its packaging and inspect for shipping damage. Dropping the unit will damage the SCU which with not thread properly onto tank and/or operate properly.

Remove any cap and/or thread protector from pipe nipple on the tank using the appropriate tools necessary to perform the operation.

Apply an even coat of fuel resistant thread sealant on the pipe nipple on the top of the tank. Do not drop because the SCU with not thread properly onto tank

Place SCU on the top of the tank in area to be installed taking care not to damage the SCU and/or the tank preparation to connect to the tank.

Using proper safety equipment to work on the top of the tank and proper tools to install the unit. Place outlet coupling on the pipe nipple and turn the SCU clockwise to engage the threads continue to turn the unit until it is tightly engaged with the nipple's threads.

Using the appropriate wrench to tighten the SCU by placing the wrench on outlet coupling and turn it clockwise to tighten to a torque of 50-75 ft.-lbs.



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: January 2017

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank Equipment Registration Form

Fill out completely

General Information

Company Name: Clay and Bailey Mfg. Co.

Contact Name: Brad Holmes

Company Address: 6401 E. 40th Street

City: Kansas City

Zip: 64129

E-mail: bholmes@claybailey.com

Contact Number: 800-821-6583

Product Name: 6100 Series 5 and 7.5 Gallon Spill Containment

Model Number(s): 6100-09-1451MRB & 6100-09-1751MRB

Product Type: Spill Containment Devices

Rule(s) citation within Chapter 62-761, or 62-762, F.A.C. that registration is being requested: 62-762.501 (1)(c), F.A.C.

Write a brief description of equipment registration request including product limitations:

The Clay & Bailey Spill Containment 6100 Series, UL File No. MH25085 series Aboveground Spill Container for shop-fabricated AST Systems is an aboveground storage tank spill containment device. This container gives protection from overfills and has the built-in drain. It is made out of spun mild steel and has a hinged locking lid. The spill containment is powder coated for corrosion protection.

Information Checklist

	Yes	No	N/A
1. Third-party Certification by a Nationally Recognized Testing Laboratory?	☒	☐	☐
2. Documentation of third-party evaluation that the equipment meets DEP Rules?	☒	☐	☐
3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory?	☒	☐	☐
4. Installation instructions included?	☒	☐	☐
5. Technical information and drawings included?	☒	☐	☐
6. Annual Operability Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702 F.A.C.)?	☐	☐	☒
7. Compatible with fuel blends containing >10% ethanol or >20% biodiesel?	☐	☒	☐
8. Has the product been approved or registered in other countries or states? (If so provide list)	☒	☐	☐
9. Any requirements for company-certified installers or trainers?	☐	☒	☐
10. Was this product(s) previously approved or registered by the Department?	☐	☒	☐
If yes, please specify the Equipment Number: <u>EQ-_____</u>			
11. Any changes or modifications to the equipment since the last submittal to DEP?	☐	☒	☐

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@dep.state.fl.us, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

The Clay & Bailey Spill Containment 6100Series UL File No. MH25085 must be installed and tested in accordance with Exhibit A prior to being placed into service and recorded in accordance with Rule 62-762.711, F.A.C, requirements in Exhibit A attached with this Final Order.

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

Brad Holmes, Sales Manager

Printed Name and Title

Brad Holmes

Signature

Digitally signed by Brad Holmes
Date: 2017.04.26 14:19:45 -05'00'

04/26/2017

Date

For Department Use Only:

Date Application Received: 4/26/2017 Renew by 4/28/2022

Application complete:

Yes: ☒ No: ☐

EQ- 874

Date of complete or incomplete letter sent: 4/28/2017

Date of entry to the DEP Equipment Registration List: 4/28/2017



Florida Department of Environmental Protection

Bob Martinez Center
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Charlie Crist
Governor

Jeff Kottkamp
Lt. Governor

Michael W. Sole
Secretary

September 28, 2009

Certified Mail

Return Receipt Requested: 7009 0820 0001 2298 5038

Mr. Brad Holmes
Clay & Bailey MFG. Co.
6401 East 40th Street
Kansas City, Missouri 64129

Subject: Approval of Clay & Bailey Spill Containment 6100Series, UL File No.
MH 47031, File No. EQ-740

Dear Mr. Holmes:

The Bureau of Petroleum Storage Systems has concluded its review of the Equipment Approval request dated December August 27, 2009 that was submitted for the above referenced equipment pursuant to Rule 62-762.851, Florida Administrative Code (F.A.C.).

Based on the information provided by the Clay & Bailey MFG. Co., Department finds that applicant's Clay & Bailey Spill Containment 6100Series, UL File No. MH 47031, will provide environmental protection substantially equivalent to that provided by compliance with the requirements established in Rule 62-762.501(1)(c), F.A.C.

Pursuant to Rule 62-762.851, F.A.C., the request for the use of the above referenced product is approved for use for spill containment for shop-fabricated ASTs in the State of Florida provided that the Clay & Bailey Spill Containment 6100Series UL File No. MH 47031, must be installed and tested in accordance with Exhibit A prior to being placed into service and recorded in accordance with Rule 62-762.711, F.A.C, requirements in Exhibit A attached with this Final Order.

Please be advised that the above referenced DEP rules are subject to change. If the above rule standards are modified in the future, this order may be modified or rescinded for future upgrades and installations. Additionally, if the product(s) shows a consistent pattern of failure(s), and therefore does not provide substantially equivalent environmental protection, the Department may rescind this order.

The Department's Order shall become final unless a timely petition for an administrative hearing is filed under sections 120.569 and 120.57, F.S., within 21 days of receipt of this Order. Persons who have filed such a petition may seek to mediate the dispute and choosing mediation will not adversely affect the right to a

hearing if mediation does not result in a settlement. The procedures for petitioning for a hearing and pursuing mediation are set forth below.

Persons affected by this Order have the following options:

- A. If you choose to accept the Department's decision regarding the Order, you do not have to do anything. This Order is final and effective as of the date on the top of the first page of this Order.
- B. If you choose to challenge the decision, you may do the following:
 - 1. File a request for an extension of time to file a petition for hearing with the Department's Agency Clerk in the Office of General Counsel within **21** days of receipt of this Order. This request should be made if you wish to meet with the Department in an attempt to resolve any disputes without first filing a petition for hearing or negotiate an agreement to mediate; or
 - 2. File a petition for administrative hearing with the Department's Agency Clerk in the Office of General Counsel within **21** days of receipt of this Order.
 - 3. In addition to requesting an administrative hearing, any petitioner may elect to pursue mediation under Section 120.573, F.S., and must negotiate an agreement to mediate within **10** days after the deadline for filing a petition.

How to Request an Extension of Time to File a Petition for Hearing

For good cause shown, pursuant to Rule 62-110.106(4), F.A.C., the Department may grant a request for an extension of time to file a petition for hearing. Such a request must be filed (received) by the Agency Clerk in the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida, 32399-3000, within **21** days of receipt of this Order. Petitioner, if different from the applicant, shall mail a copy of the request to the applicant at the time of filing. Failure to file a petition within this time period shall waive the right of anyone who may request an administrative hearing under Sections 120.569 and 120.57, F.S.

How to File a Petition for Administrative Hearing

A person whose substantial interests are affected by this Order may petition for an administrative proceeding (hearing) under Sections 120.569 and 120.57,

F.S. The petition must contain the information set forth below and must be filed (received) by the Agency Clerk in the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, MS 35, Tallahassee, Florida, 32399-3000, within **21** days of receipt of this Order. Petitioner, if different from the applicant shall mail a copy of the petition to the applicant at the time of filing. Failure to file a petition within this time period shall waive the right of anyone who may request an administrative hearing under Sections 120.569 and 120.57, F.S.

Pursuant to Subsection 120.569(2), F.S., and Rule 28-106.201, F.A.C., a petition for administrative hearing shall contain the following information.

- a) The name, address, and telephone number of each petitioner; the name, address, and telephone number of the petitioner's representative, if any, the site owner's name and address, if different from the petitioner, the DEP facility number, and the name and address of the facility;
- b) A statement of when and how the petitioner received notice of the Department's action or proposed action;
- c) An explanation of how each petitioner's substantial interests are or will be affected by the Department's action or proposed action;
- d) A statement of the disputed issues of material fact, or a statement that there are no disputed facts;
- e) A concise statement of the ultimate facts alleged, including a statement of the specific facts the petitioner contends warrant reversal or modification of the Department's action or proposed action;
- f) A statement of the specific rules or statutes the petitioner contends requires reversal or modification of the Department's action or proposed action; and
- g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the Department to take with respect to the Department's action or proposed action.

How to Pursue Mediation

In addition to requesting an administrative hearing, any petitioner may elect to pursue mediation. The election may be accomplished by filing with the Department a mediation agreement with all parties to the proceeding (i.e., the applicant, the Department, and any person who has filed a timely and sufficient petition for hearing). The agreement must contain all the information required by Rule 28-106.404, F.A.C. The agreement, signed by all parties, must be received by the Agency Clerk in the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida, 32399-3000 within **10** days after the deadline for filing a petition, as set forth above. Choosing mediation will not adversely affect the right to a hearing if mediation does not result in a settlement.

Pursuant to Rule 28-106.404, F.A.C., an agreement to mediate must include the following.

- (i) The name, address, and telephone number of the persons who may attend the mediation, (also the DEP facility number, the name and address of the facility if applicable);
- (ii) The name, address, and telephone number of the mediator agreed to by the parties;
- (iii) How the costs and fees associated with the mediation will be allocated (the Department will not pay any of the costs of mediation);
- (iv) The agreement of the parties regarding the confidentiality of discussions and documents introduced during mediation to the extent authorized by law;
- (v) The date, time, and place of the first mediation session;
- (vi) The name of the party's representative who shall have authority to settle or recommend settlement; and
- (vii) The signature of the parties.

As provided in Section 120.573, F.S., the timely agreement of all parties to mediate will toll the time limitations imposed by Sections 120.569 and 120.57, F.S., for holding an administrative hearing and issuing a final order. Unless otherwise agreed by the parties, the mediation must be concluded within sixty days of the execution of the agreement. If mediation results in settlement of the administrative dispute, the Department must enter a final order incorporating the agreement of the parties. Persons seeking to protect their substantial interests that would be affected by such a modified final decision must file their petitions within **21** days of receipt of this notice, or they shall be deemed to have waived their right to a proceeding under Sections 120.569 and 120.57, F.S. If mediation terminates without settlement of the dispute, the Department shall notify all parties in writing that the administrative hearing processes under Sections 120.569 and 120.57, F.S., are resumed.

This Order is final and effective as of the date on the top of the first page of this Order. Timely filing a petition for administrative hearing postpones the date this Order takes effect until the Department issues either a final order pursuant to an administrative hearing or mediation settlement.

Judicial Review

Any party to this Order has the right to seek judicial review of it under Section 120.68, F.S., by filing a notice of appeal under Rule 9.110 of the Florida Rules of Appellate Procedure with the Agency Clerk of the Department in the Office of General Counsel, Mail Station 35, 3900 Commonwealth Boulevard, Tallahassee, Florida 32399-3000, and by filing a copy of the notice of appeal


Mr. Brad Holmes
September 28, 2009
Page 5

accompanied by the applicable filing fees with the appropriate district court of appeal. The notice of appeal must be filed within thirty days after this order is filed with the clerk of the Department (see below).

Questions


Any questions regarding the Department's review of your equipment approval should be directed to Farid Moghadam at (850)245-8848. Questions regarding legal issues should be referred to the Department's Office of General Counsel at (850)245-2242. Contact with any of the above does not constitute a petition for administrative hearing (or time extension) or agreement to mediate.

Sincerely,

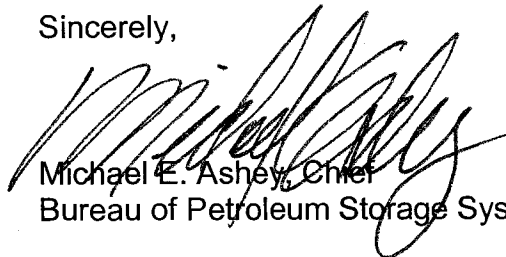
Michael E. Ashley, Chief
Bureau of Petroleum Storage Systems

MEA/fgm

FILING AND ACKNOWLEDGMENT
FILED, on this date, pursuant to §120.52
Florida Statutes, with the designated
Department Clerk, receipt of which is
hereby acknowledged.


Clerk
(or Deputy Clerk)

9/28/09
Date