



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: January 2017

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank Equipment Registration Form

Fill out completely

General Information

Company Name: _____ Contact Name: _____
Company Address: _____ City: _____ Zip: _____
E-mail: _____ Contact Number: _____
Product Name: _____
Model Number(s): _____ Product Type: _____
Rule(s) citation within Chapter 62-761, or 62-762, F.A.C. that registration is being requested: _____

Write a brief description of equipment registration request including product limitations:

Information Checklist

Yes No N/A

1. Third-party Certification by a Nationally Recognized Testing Laboratory?
2. Documentation of third-party evaluation that the equipment meets DEP Rules?
3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory?
4. Installation instructions included?
5. Technical information and drawings included?
6. Annual Operability Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702 F.A.C.)?
7. Compatible with fuel blends containing >10% ethanol or >20% biodiesel?
8. Has the product been approved or registered in other countries or states? (If so provide list)
9. Any requirements for company-certified installers or trainers?
10. Was this product(s) previously approved or registered by the Department?
If yes, please specify the Equipment Number: **EQ-**_____
11. Any changes or modifications to the equipment since the last submittal to DEP?

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@dep.state.fl.us, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

Printed Name and Title

Signature

Date

For Department Use Only:

Date Application Received:

Application complete:


Yes:

No:

EQ-

Date of complete or incomplete letter sent:

Date of entry to the DEP Equipment Registration List:



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: January 2017

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank Equipment Registration Form

Fill out completely

General Information

Company Name: WATKINS INDUSTRIES, INC.

Contact Name: JASON SADLER

Company Address: 544 GRANT RD. / P.O. BOX 1268

City: MINERAL WELLS, TX

Zip: 76067 / 76068

E-mail: JASON@WATKINS-INDUSTRIES.COM

Contact Number: 940-325-6008

Product Name: ATMOSPHERIC STORAGE TANK

Model Number(s): TK-12X9-6; TK-13-6X11

Product Type: AST Overfill

Rule(s) citation within Chapter 62-761, or 62-762, F.A.C. that registration is being requested: 62-762.501

Write a brief description of equipment registration request including product limitations:

UL-142 ABOVE-GROUND ATMOSPHERIC STEEL STORAGE TANKS, IN CAPACITY FROM 100 GAL TO 42,000 GAL.
UL CERTIFICATION/FILE NUMBER MH60306

Information Checklist

- | | Yes | No | N/A |
|---|-------------------------------------|-------------------------------------|-------------------------------------|
| 1. Third-party Certification by a Nationally Recognized Testing Laboratory? | ☒ | ☐ | ☐ |
| 2. Documentation of third-party evaluation that the equipment meets DEP Rules? | ☒ | ☐ | ☐ |
| 3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory? | ☐ | ☐ | ☒ |
| 4. Installation instructions included? | ☐ | ☐ | ☒ |
| 5. Technical information and drawings included? | ☒ | ☐ | ☐ |
| 6. Annual Operability Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702 F.A.C.)? | ☐ | ☒ | ☐ |
| 7. Compatible with fuel blends containing >10% ethanol or >20% biodiesel? | ☒ | ☐ | ☐ |
| 8. Has the product been approved or registered in other countries or states? (If so provide list) | ☐ | ☒ | ☐ |
| 9. Any requirements for company-certified installers or trainers? | ☐ | ☒ | ☐ |
| 10. Was this product(s) previously approved or registered by the Department? | ☐ | ☒ | ☐ |
| If yes, please specify the Equipment Number: <u>EQ-_____</u> | | | |
| 11. Any changes or modifications to the equipment since the last submittal to DEP? | ☐ | ☐ | ☒ |

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@dep.state.fl.us, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

WATKINS INDUSTRIES HAS BEEN SUPPLYING ABOVE-GROUND STORAGE TANKS TO VARIOUS INDUSTRIES FOR ALL TYPES OF LIQUID STORAGE FOR SIX YEARS, ACROSS THE UNITED STATES. IN THAT TIME WATKINS HAS OBTAINED MULTIPLE CERTIFICATIONS WITH A NUMBER OF DIFFERENT GOVERNING BODIES. ADDITIONAL INFORMATION CAN BE FOUND AT WWW.WATKINS-INDUSTRIES.COM

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

JASON SADLER ENGINEERING/QA MANAGER

Printed Name and Title

Signature

02/14/2018

Date

For Department Use Only:

Date Application Received: 2/27/2018


Application complete:

Yes: ☐ No: ☐

EQ- ☐

Date of complete or incomplete letter sent: _____

Date of entry to the DEP Equipment Registration List: _____

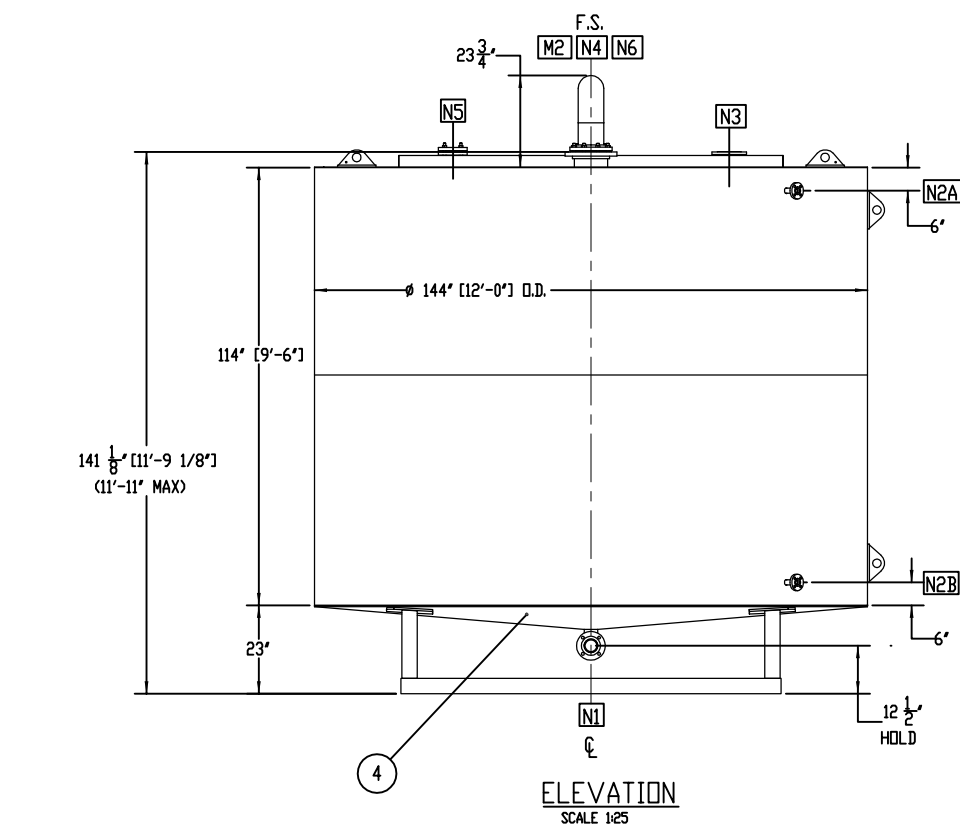

NOTES:

1. TANK SHALL BE MARKED ON THE SHELL NEAR THE EMERGENCY VENT (M2), WITH 2" HIGH LETTERS, IN EXTERIOR GRADE BLACK PAINT, STATING "EMERGENCY VENT".
2. ALL NOZZLES SHALL BE COVERED WITH PLASTIC FLANGE COVERS/PLASTIC COUPLING INSERTS.

	Watkins Metal Fab., Inc. PO Box 1268 Mineral Wells, TX 76068 940-325-6000		LISTED INSTEAD
ABOVEGROUND TANK FOR FLAMMABLE LIQUIDS			
SERIAL NO. <u> A </u>	THIS TANK REQUIRES EMERGENCY		
DESCRIPTION <u> - 12 X 9-6 </u>	RELIEF VENTING CAPACITY NOT LESS		
NOMINAL CAPACITY <u> 8000 GAL </u>	THAN <u> </u> CFH BASED ON		
DESIGN PRESSURE <u> - oz/in² </u>	INSTALLATION WITHIN ONE FOOT OF		
	THE TANK TOP.		
YEAR BUILT <u> 2017 </u>			
SHELL THK. <u> </u>	THIS TANK IS INTENDED FOR		
DECK THK. <u> </u>	STATIONARY INSTALLATION ONLY.		
BOTTOM THK. <u> </u>			
www.wmfonline.biz			

REVISION						ESTIMATED WEIGHTS	LBS.	KG.
REV	DATE	BY	CKD	ENGR	DESCRIPTION	EMPTY	-	.
0	5/5/2017	JW	JLS	JLS	FIRST ISSUE	FULL OF WATER	-	.
						QTY. REQ'D.:	5 (FIVE)	
						WD NO.:	022717-AM	
						CUSTOMER:	ALLOY MECHANICAL	
						P.Q. NO.:	*	



TANK AND VESSEL DIVISION
MINERAL WELLS, TX
WATKINS-INDUSTRIES.COM

UL-142 STORAGE TANK
12' X 9' - 6"
8000 GAL

DWG BY: JW	CHK BY: JLS	SCALE: AS SHOWN
DATE: 5/5/2017	DATE: 5/5/2017	REV: 0

TK-D-82708

ALL DIMENSIONS ARE
± 1/8" (3 MM) UNLESS
OTHERWISE NOTED.

THIS DRAWING IS THE PROPERTY OF WATKINS INDUSTRIES, INC. IN CONSIDERATION OF THE USE OF THIS DRAWING, YOU AGREE THAT IT SHALL BE TREATED AS CONFIDENTIAL MATERIAL, THAT IT SHALL BE RETURNED UPON REQUEST, AND THAT THE CONTENTS THEREOF SHALL NOT BE DISCLOSED, REPRODUCED, COPIED OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR SHALL IT BE USED FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT SPECIFICALLY FURNISHED, EXCEPT BY WRITTEN PERMISSION OF WATKINS INDUSTRIES, INC.

NOTICE OF COMPLETION
AND
AUTHORIZATION TO APPLY THE UL MARK



07/30/2014

Watkins Metal Fabrication Inc
Rusty Watkins
Po Box 1268
Mineral Wells Tx 76068, Us

Our Reference: File MH60306, Vol. TO BE DETERMINED Project Number 4786488002
Your Reference: 3120
Project Scope: New Listing: Single Wall, Vertical Cylindrical Tank - UL 142 Tanks

Dear Rusty Watkins:

Congratulations! UL's investigation of your product(s) has been completed under the above Reference Number and the product was determined to comply with the applicable requirements. This letter temporarily supplements the UL Follow-Up Services Procedure and serves as authorization to apply the UL Mark at authorized factories under UL's Follow-Up Service Program. To provide your manufacturer(s) with the intended authorization to use the UL Mark, you must send a copy of this notice to each manufacturing location currently authorized under File MH60306, Vol. TO BE DETERMINED and *including any special instructions as indicated in the addendum to this letter.*

Records in the Follow-Up Services Procedure covering the product are now being prepared and will be sent in the near future. Until then, this letter authorizes application of the UL Mark for 90 days from the date indicated above.

Additional requirements related to your responsibilities as the Applicant can be found in the document "Applicant responsibilities related to Early Authorizations" that can be found at the following web-site:
<http://www.ul.com/EAResponsibilities>

Any information and documentation provided to you involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL.

We are excited you are now able to apply the UL Mark to your products and appreciate your business. Feel free to contact me or any of our Customer Service representatives if you have any questions.

Very truly yours,

Wendy Russell
408-754-6645
Staff Engineer
Wendy.Russell@ul.com

Reviewed by:

William R. Carney
847/664-1088
Chief Engineer Director I
William.R.Carney@ul.com

NBKD1FB-7ABF64

IPI ADDENDUM



NOTICE OF COMPLETION AND AUTHORIZATION TO APPLY THE UL MARK

Our Reference:	File MH60306, Vol. TO BE DETERMINED	Project Number	4786488002
Your Reference:	3120		
Project Scope:	New Listing: Single Wall, Vertical Cylindrical Tank - UL 142 Tanks		

This addendum covers products manufactured at the following location:

Watkins Metal Fabrication Inc
Rusty Watkins
544 Grant Road
Mineral Wells TX 76067, USA
1088582

Before you may begin shipping product with the UL Mark at the above manufacturing locations, an Initial Production Inspection (IPI) must be successfully performed by a UL representative at the location.

The IPI is intended to confirm that your manufacturing location is capable of producing a product in accordance with UL's requirements. **YOU MAY NOT SHIP PRODUCTS WITH THE UL MARK UNTIL THE IPI HAS BEEN COMPLETED AND UL HAS FOUND THE PRODUCTS AT THE FACTORY TO COMPLY WITH OUR REQUIREMENTS.** Once the IPI has been successfully completed, you will be granted authorization to ship products bearing the UL Mark.

Instructions for the IPI will be sent to our inspection center nearest to you. The Inspection Center will contact you shortly to make arrangements for the IPI.

Inspection Center information

Inspection Center 835
801 Klein Road, Suite 200
Plano TX 75074, USA
1-972-422-8300
George Neumeier