



Department of Environmental Protection

2600 Blair Stone Road ♦ Tallahassee, Florida 32399-2400

DEP Form: 62-762.901(9)

Form Title: Storage Tank Equipment

Registration Form

Effective Date: July 2019

Incorporated in Rule 62-762.851, F.A.C.

Storage Tank System Equipment Registration Form

Fill out completely

General Information

Company Name: CLEANWORLD SERVICES, INC. DBA CLARK WELDING + Contact Name: MELISSA CLARK
Company Address: 369 CALLAHAN AVENUE City, State: APPALACHIA, VA Zip: 24216
E-mail: sales@clarkweldingtanks.com Contact Number: (276) 565-3607
Product Name: UL-142 Above ground single wall and double wall storage tanks
Model Number(s): _____ Product Type: Tanks / AST
Rule(s) citation that registration is being requested within Chapter 62-761 (UST), and/or 62-762 (AST), F.A.C.: 62-762.501

Write a brief description of equipment registration request including product limitations:

Aboveground tanks - single wall with or without supports.
Secondary containment aboveground tanks - with or without supports

Information Checklist (Choose Yes, No, or N/A - Not Applicable):

	Yes	No	N/A
1. Third-party Certification by a Nationally Recognized Testing Laboratory? (Required)	☒	☐	☐
2. Documentation of third-party evaluation that the equipment meets DEP Rules?	☒	☐	☐
3. Documents included about the qualifications of the Nationally Recognized Testing Laboratory?	☒	☐	☐
4. Technical information and drawings included?	☒	☐	☐
5. Installation instructions included?	☒	☐	☐
6. Annual Operability Testing Requirements (Rules 62-761.500, 62-762.501, & 62-762.502 F.A.C.)?	☐	☐	☒
7. Integrity Testing Requirements (Rules 62-761.700, 62-762.701, & 62-762.702, F.A.C.)?	☒	☐	☐
8. Compatible with fuel blends containing >10% ethanol or >20% biodiesel?	☒	☐	☐
9. Has the product been approved or registered in other countries or states? (If so provide list)	☐	☐	☒
10. Any requirements for company-certified installers or trainers?	☐	☒	☐
11. Was this product(s) previously approved or registered by the Department? If yes, EQ- _____	☐	☒	☐
12. Any changes or modifications to the equipment since the last submittal to DEP?	☐	☒	☐

Document Information: Provide supporting documents indicated as "Yes" above including this form via email to Tanknotify@floridadep.gov, or documents can be sent to FDEP, Division of Waste Management, 2600 Blair Stone Road, MS 4560, Tallahassee, FL 32399.

Write a brief description of equipment installation and performance in the U.S.:

Scope is limited to tank and accessories only, delivered or shipped by carrier. Installations including concrete pad, electrical connections or other on-site work to be performed on site by others.

Equipment Registration Certification:

To the best of my knowledge and belief, all information submitted on this form is true, accurate and complete.

Melissa Clark - Vice President

Printed Name and Title

Melissa Clark

Signature (right click to sign)

Digitally signed by Melissa Clark
Date: 2021.11.03 16:55:18 -04'00'

11/03/2021

Date

For Department Use Only:

Date Application Received: 11/04/2021 Application complete: Yes: ☒ No: ☐

EQ- 968 Date of complete or incomplete letter sent: 11/17/2021 Date Equipment Requires Renewal: 11/17/2026

Storage tank system equipment requires renewal every 5 years in accordance with subsection 62-762.851(2), F.A.C.

CERTIFICATE OF COMPLIANCE

Certificate Number 20170828-MH62363
Report Reference MH62363-20170825
Issue Date 2017-AUGUST-28

Issued to: Cleanworld Services, Inc DBA Clark Welding Service
369 Callahan Ave
Appalachia VA 24216

**This is to certify that
representative samples of**

ABOVEGROUND FLAMMABLE-LIQUID TANKS
USL - Aboveground tanks for flammable and combustible
liquids with or without supports. Secondary containment
aboveground tanks for flammable and combustible liquids
with or without supports.

Have been investigated by UL in accordance with the
Standard(s) indicated on this Certificate.

Standard(s) for Safety: UL 142, Standard for Steel Aboveground Tanks for
Flammable and Combustible Liquids

Additional Information: See the UL Online Certifications Directory at
www.ul.com/database for additional information

Only those products bearing the UL Certification Mark should be considered as being covered by UL's
Certification and Follow-Up Service.

Look for the UL Certification Mark on the product.




Bruce Mahrenholz, Director North American Certification Program
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please
contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



SIDE

LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP

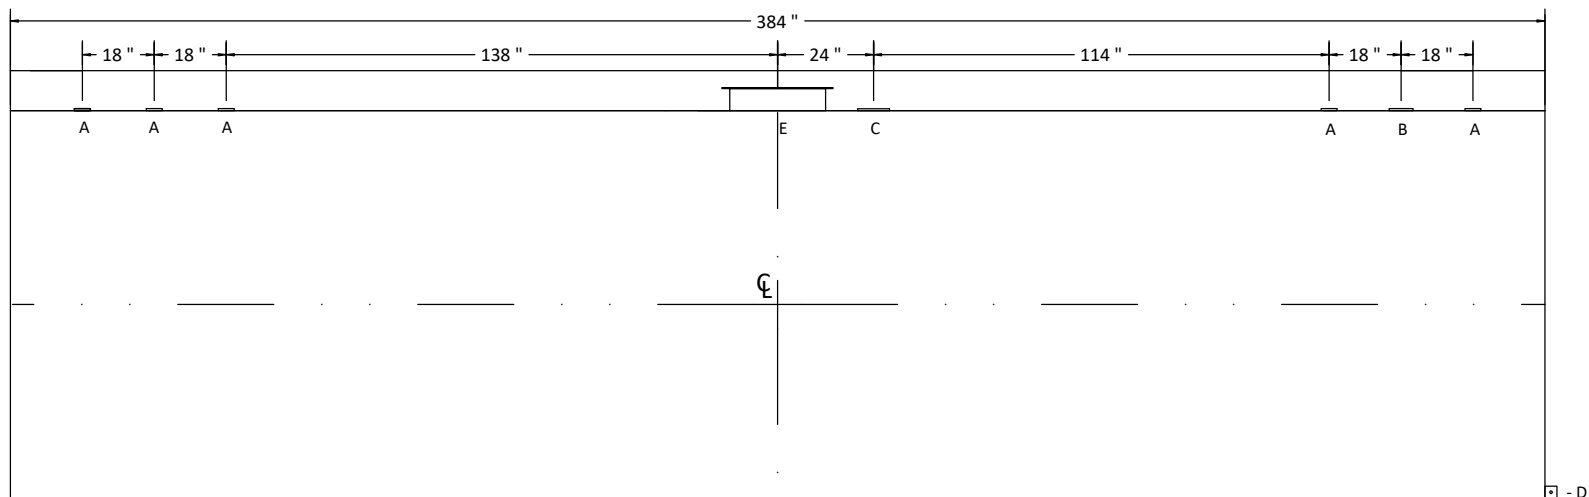


SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
THICKNESS	HEADS: 1/4" SHELL: 1/4"
CONSTRUCTION	LAP WELD OUTSIDE ONLY
TANK TEST	5 PSIG
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

LEGEND

A	4" FNPT OPENING	F	
B	6" FNPT OPENING	G	
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	GROUNDING LUG - 1/4" X 3" X 3" WITH CENTER HOLE	I	
E	24" MANWAY	J	

END

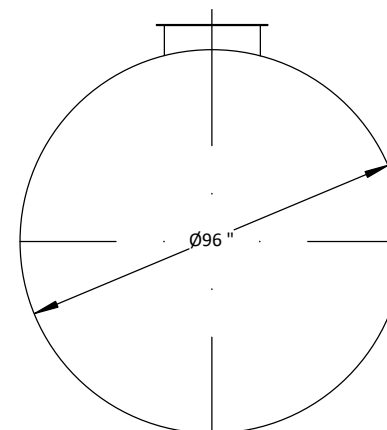

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
PH: (276) 565-3607 | FAX: (276) 565-2550
SALES@CLARKWELDINGTANKS.COM
WWW.CLARKWELDINGTANKS.COM


12,000 GALLON ABOVE GROUND
SINGLE WALL HORIZONTAL
STORAGE TANK

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING

SIDE

LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP


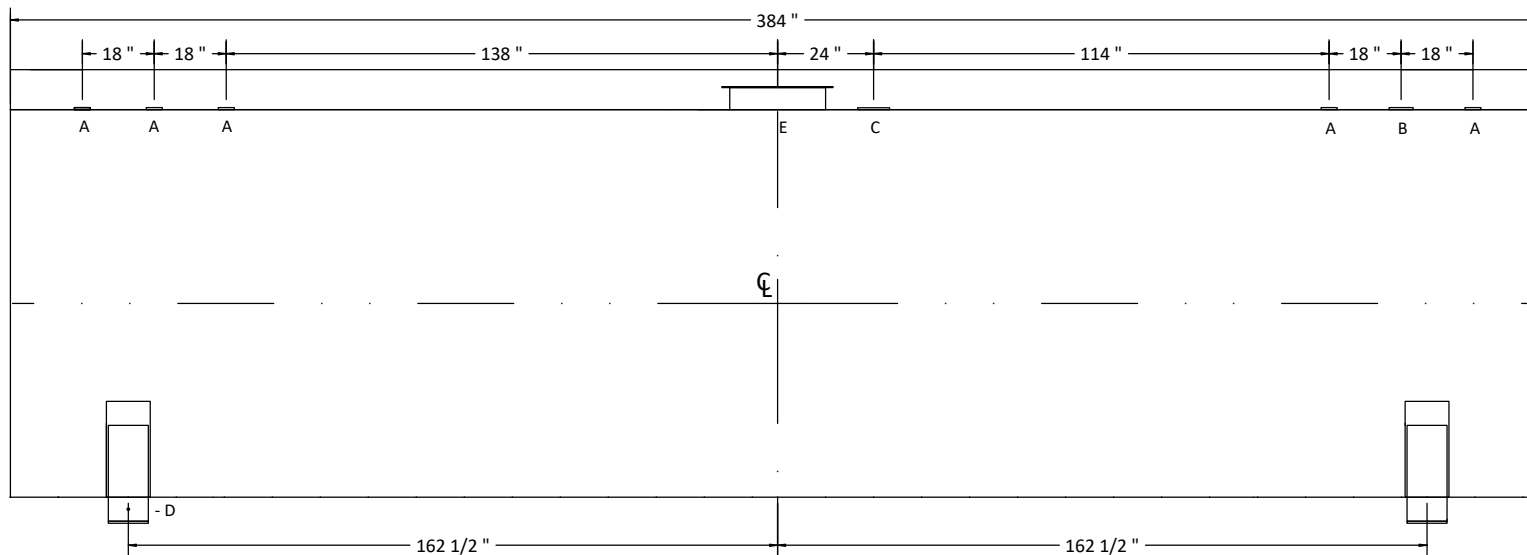


SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
THICKNESS	HEADS: 1/4" SHELL: 1/4"
CONSTRUCTION	LAP WELD OUTSIDE ONLY
TANK TEST	5 PSIG
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

END

SADDLE BASE

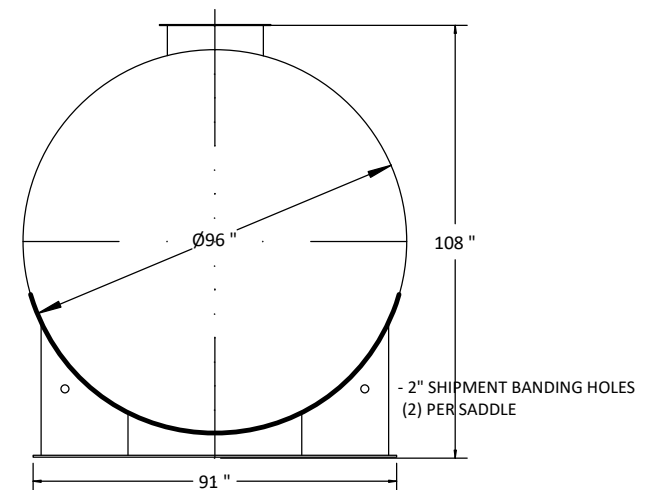

LEGEND

A	4" FNPT OPENING	F	
B	6" FNPT OPENING	G	
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	5/8" DIA. GROUNDING HOLE IN SADDLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
 PH: (276) 565-3607 | FAX: (276) 565-2550
 SALES@CLARKWELDINGTANKS.COM
 WWW.CLARKWELDINGTANKS.COM


**12,000 GALLON ABOVE GROUND
 SINGLE WALL HORIZONTAL
 STORAGE TANK**

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING

SIDE

LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP

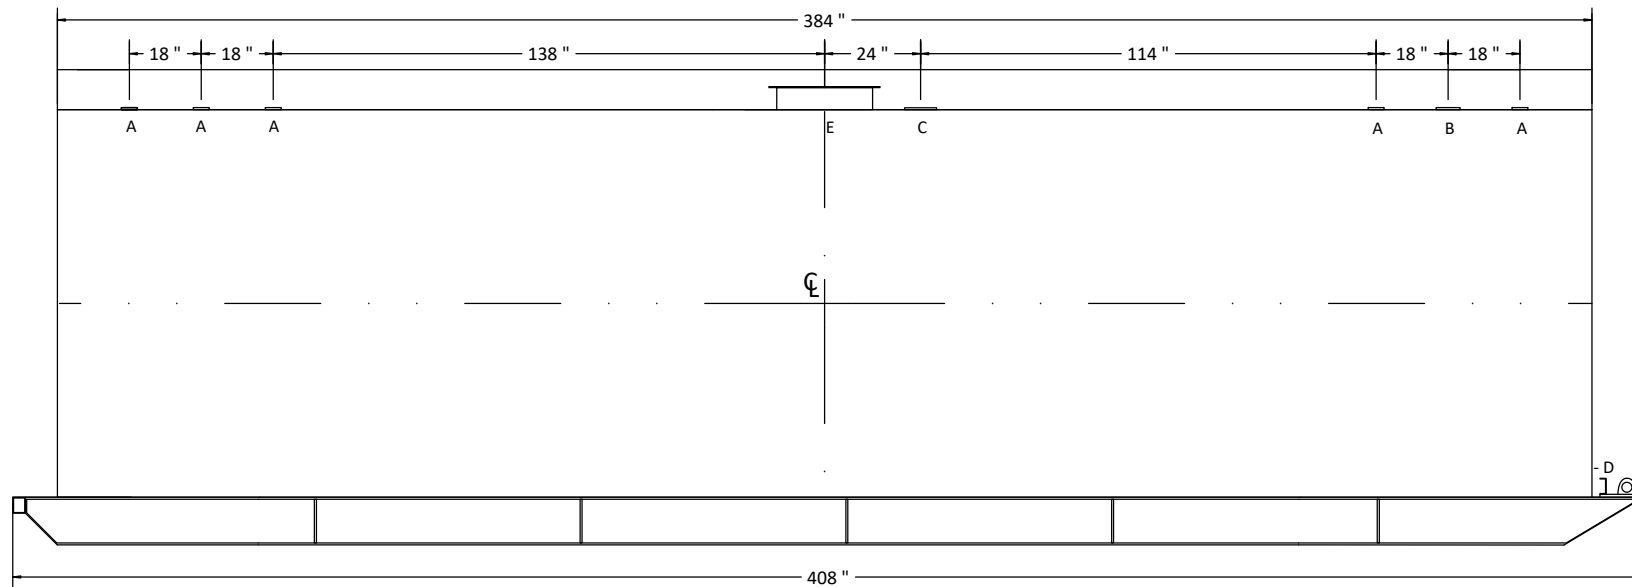


Heavy Duty
12" WF Beam Skids

SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
THICKNESS	HEADS: 1/4" SHELL: 1/4"
CONSTRUCTION	LAP WELD OUTSIDE ONLY
TANK TEST	5 PSIG
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

END

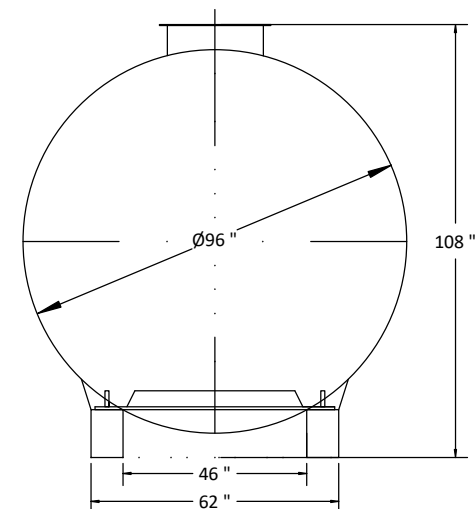

LEGEND

A	4" FNPT OPENING	F	
B	6" FNPT OPENING	G	
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	GROUNDING LUG - 1/4" X 3" X 3" WITH CENTER HOLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
PH: (276) 565-3607 | FAX: (276) 565-2550
SALES@CLARKWELDINGTANKS.COM
WWW.CLARKWELDINGTANKS.COM


12,000 GALLON ABOVE GROUND
SINGLE WALL HORIZONTAL
STORAGE TANK

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING

SIDE

LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP

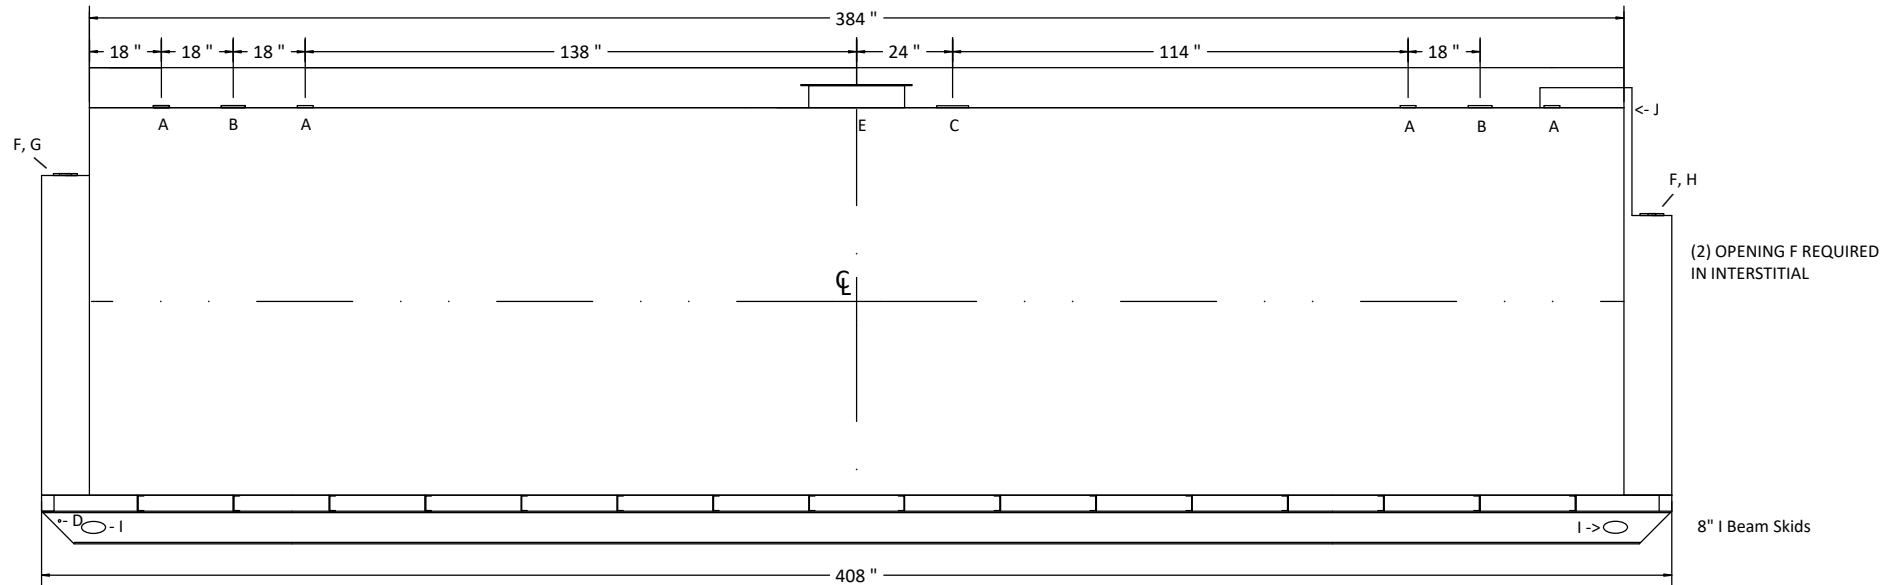


SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
INNER THICKNESS	HEADS: 1/4" SHELL: 1/4"
OUTER THICKNESS	BOTTOM: 3/16" WALLS: 10GA
CONSTRUCTION	LAP WELD OUTSIDE ONLY
TANK TEST	5 PSIG - INNER 3+ PSIG OUTER
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

LEGEND

A	4" FNPT OPENING	F	6" FNPT (INTERSTITIAL EMERGENCY VENT USE)
B	6" FNPT OPENING	G	3" FNPT OPENING
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	2" FNPT OPENING (INTERSTITIAL LEAK MONITORING)
D	5/8" DIA. GROUNDING HOLE IN SKID	I	PULL EYE
E	24" MANWAY	J	32"H x 22"L x 14"W Overfill Chamber

END

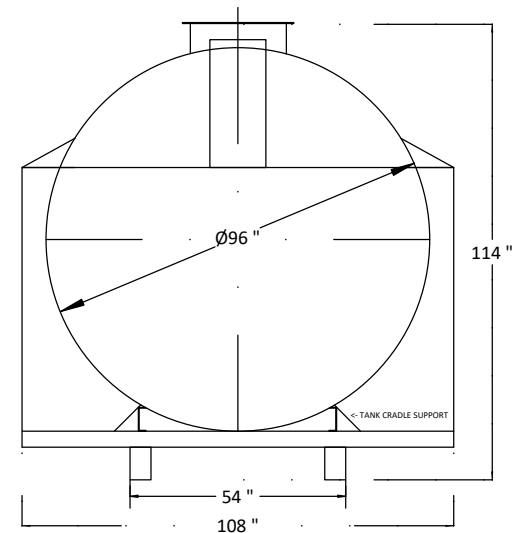

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
 PH: (276) 565-3607 | FAX: (276) 565-2550
 SALES@CLARKWELDINGTANKS.COM
 WWW.CLARKWELDINGTANKS.COM


12,000 GALLON ABOVE GROUND
 110% CAPACITY SELF CONTAINED
 STORAGE TANK

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING

SIDE


LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP

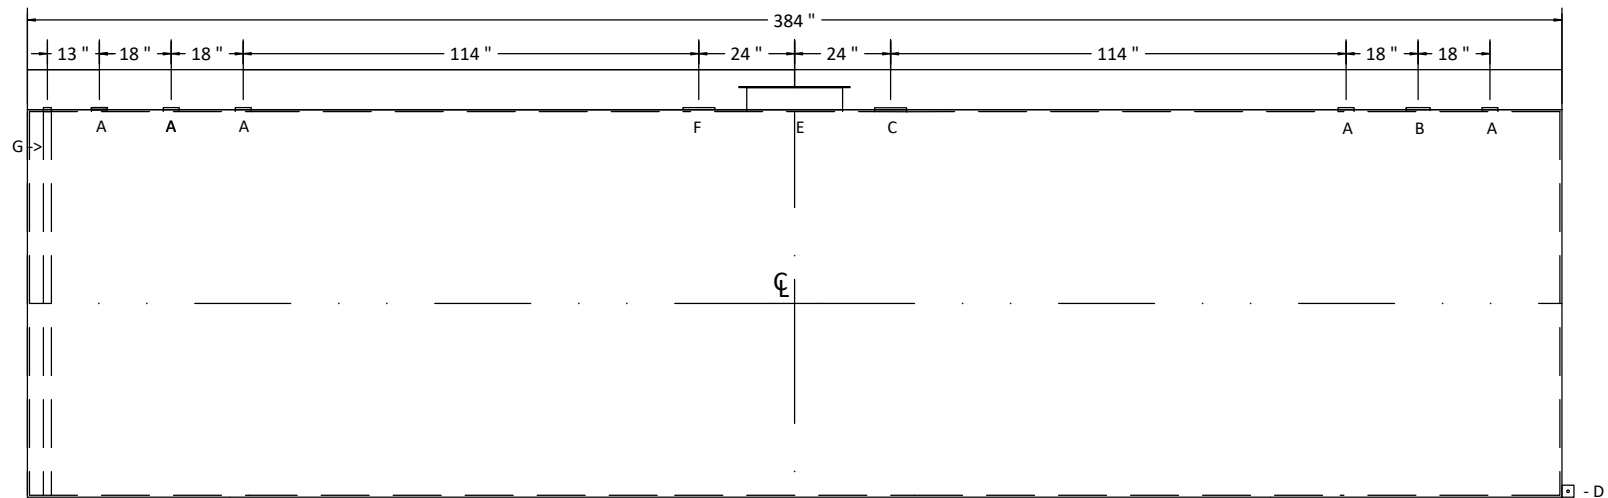

SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
INNER THICKNESS	HEADS: 1/4" SHELL: 1/4"
OUTER THICKNESS	HEADS: 3/16" SHELL: 3/16"
CONSTRUCTION	LAP WELD OUTSIDE ONLY - INNER & OUTER
TANK TEST	5 PSIG - INNER 3+ PSIG - OUTER
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

END

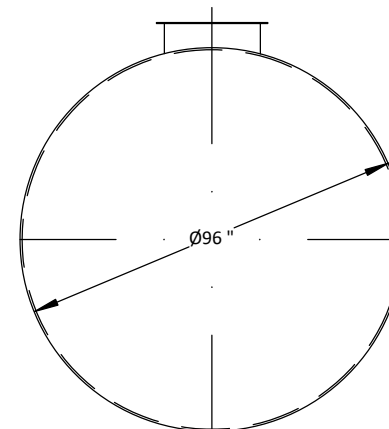

LEGEND

A	4" FNPT OPENING	F	8" FNPT (INTERSTITIAL EMERGENCY VENT USE)
B	6" FNPT OPENING	G	2" INTERSTITIAL MONITOR PORT
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	GROUNDING LUG - 1/4" X 3" X 3" WITH CENTER HOLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
PH: (276) 565-3607 | FAX: (276) 565-2550
SALES@CLARKWELDINGTANKS.COM
WWW.CLARKWELDINGTANKS.COM


12,000 GALLON ABOVE GROUND
DOUBLE WALL HORIZONTAL
STORAGE TANK

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING

SIDE

LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP


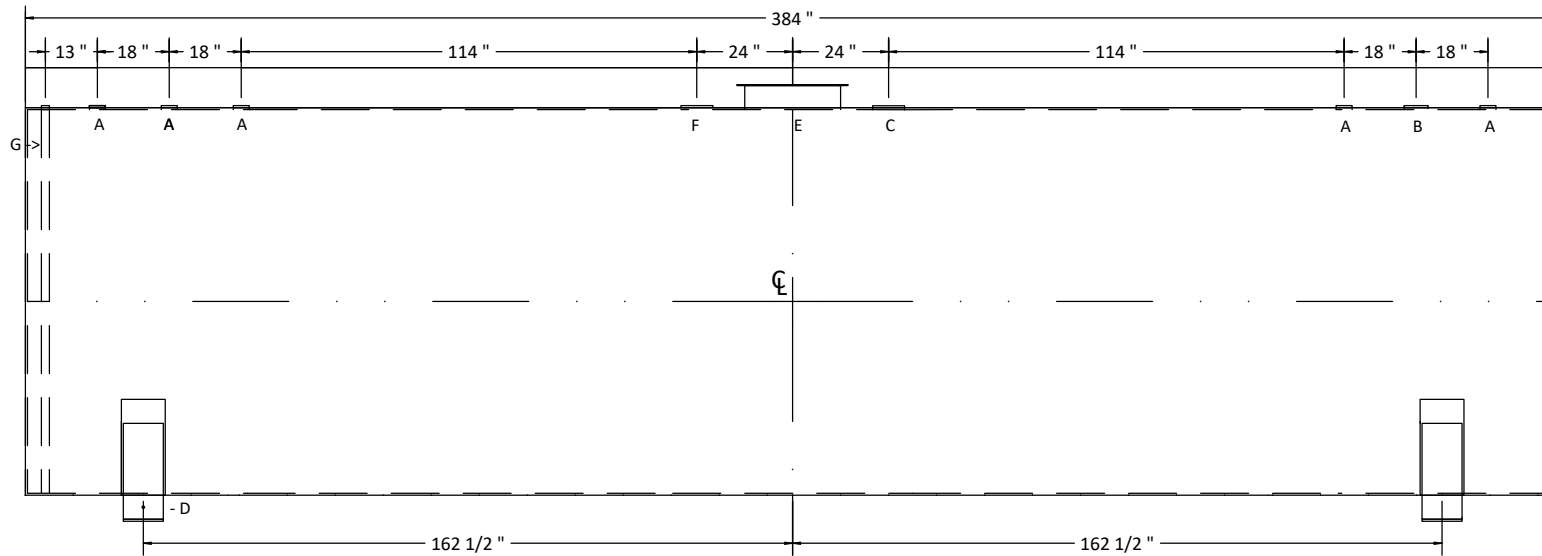


SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
INNER THICKNESS	HEADS: 1/4" SHELL: 1/4"
OUTER THICKNESS	HEADS: 3/16" SHELL: 3/16"
CONSTRUCTION	LAP WELD OUTSIDE ONLY - INNER & OUTER
TANK TEST	5 PSIG - INNER 3+ PSIG - OUTER
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

END

SADDLE BASE

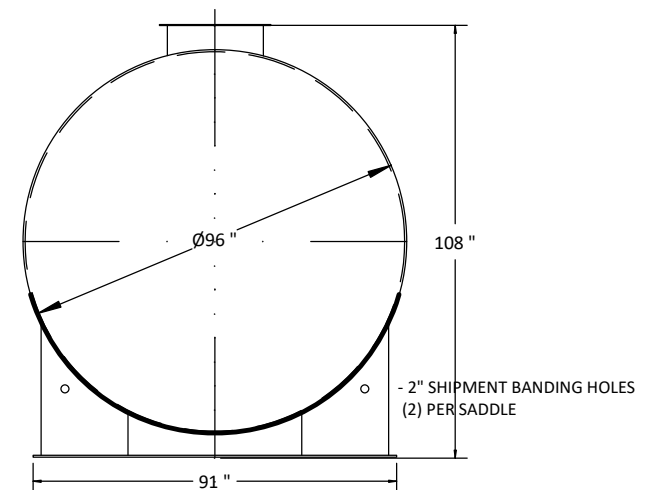

ON 6" H SADDLES

LEGEND

A	4" FNPT OPENING	F	8" FNPT (INTERSTITIAL EMERGENCY VENT USE)
B	6" FNPT OPENING	G	2" INTERSTITIAL MONITOR PORT
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	5/8" DIA. GROUNDING HOLE IN SADDLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
 PH: (276) 565-3607 | FAX: (276) 565-2550
 SALES@CLARKWELDINGTANKS.COM
 WWW.CLARKWELDINGTANKS.COM


**12,000 GALLON ABOVE GROUND
 DOUBLE WALL HORIZONTAL
 STORAGE TANK**

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING

SIDE

LIFTING LUGS TO BE PLACED AS NEEDED BY FABRICATION SHOP

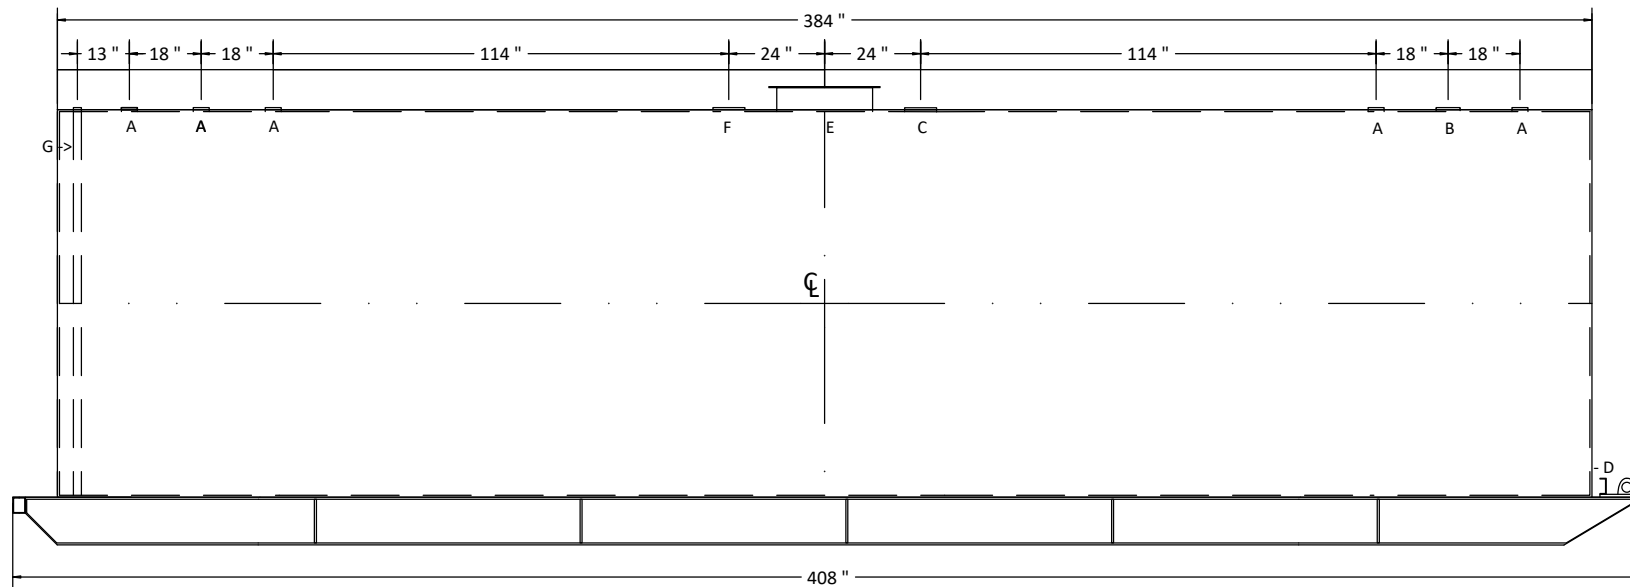


Heavy Duty
12" WF Beam Skids

SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
INNER THICKNESS	HEADS: 1/4" SHELL: 1/4"
OUTER THICKNESS	HEADS: 3/16" SHELL: 3/16"
CONSTRUCTION	LAP WELD OUTSIDE ONLY - INNER & OUTER
TANK TEST	5 PSIG - INNER 3+ PSIG - OUTER
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

END

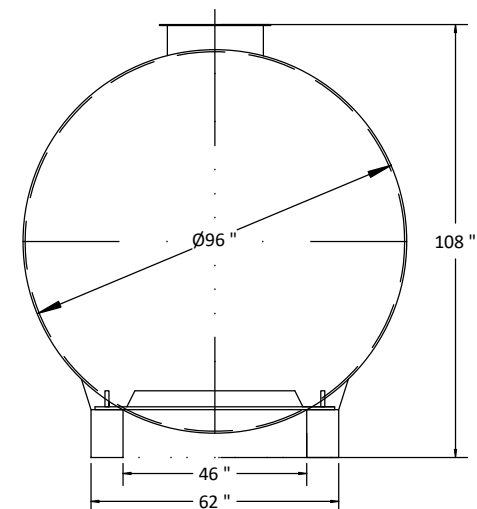

LEGEND

A	4" FNPT OPENING	F	8" FNPT (INTERSTITIAL EMERGENCY VENT USE)
B	6" FNPT OPENING	G	2" INTERSTITIAL MONITOR PORT
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	GROUNDING LUG - 1/4" X 3" X 3" WITH CENTER HOLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

369 CALLAHAN AVENUE, APPALACHIA, VA 24216
PH: (276) 565-3607 | FAX: (276) 565-2550
SALES@CLARKWELDINGTANKS.COM
WWW.CLARKWELDINGTANKS.COM



12,000 GALLON ABOVE GROUND
DOUBLE WALL HORIZONTAL
STORAGE TANK

SCALE: 1/4" = 1'


DRAWING #: N/A - STANDARD DRAWING

END

SIDE

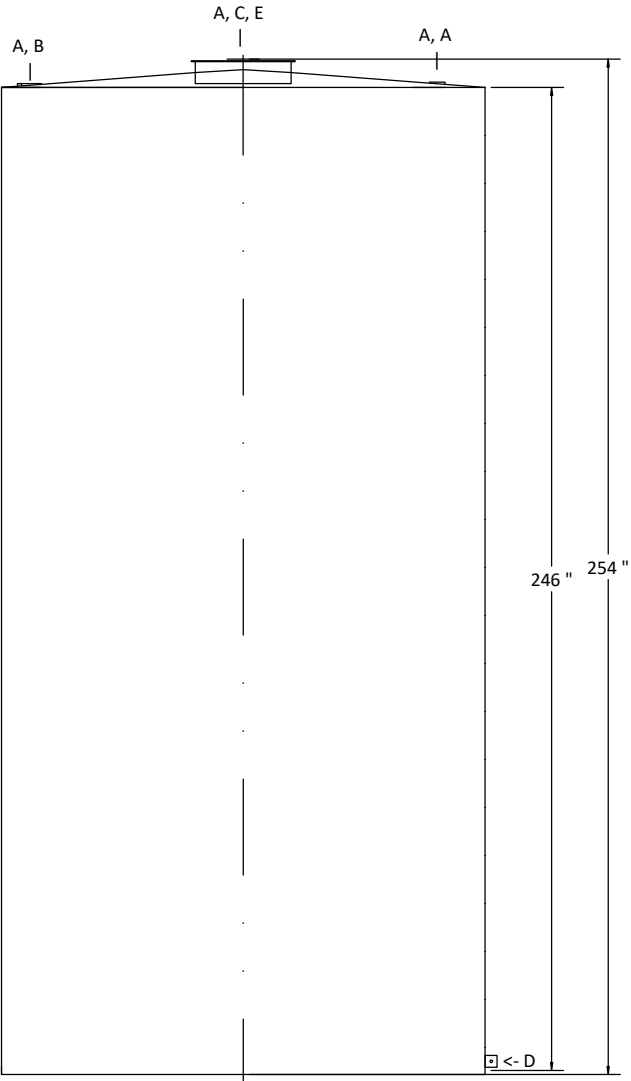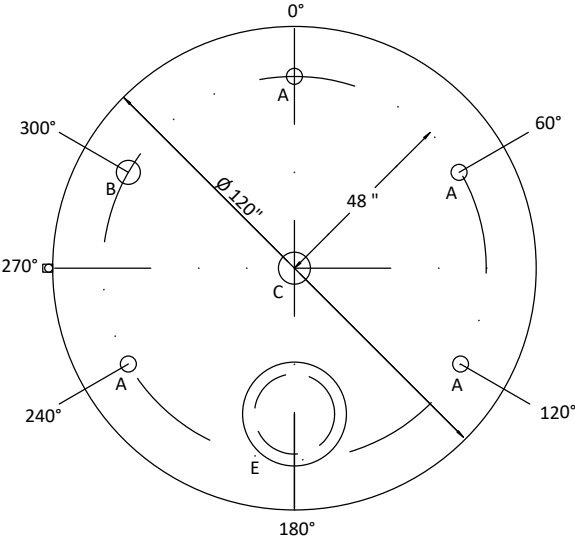

SPECIFICATIONS	
OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
THICKNESS	BOTTOM: 1/4" SHELL: 1/4"
CONSTRUCTION	LAP WELD OUTSIDE ONLY
TANK TEST	5 PSIG
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

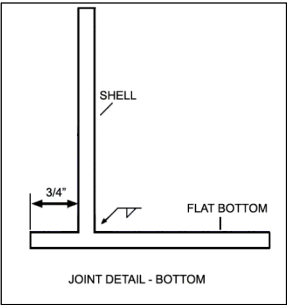


LEGEND			
A	4" FNPT OPENING	F	
B	6" FNPT OPENING	G	
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	GROUNDING LUG - 1/4" X 3" X 3" WITH CENTER HOLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC. CLARK WELDING SERVICE 369 CALLAHAN AVENUE, APPALACHIA, VA 24216 PH: (276) 565-3607 FAX: (276) 565-2550 SALES@CLARKWELDINGTANKS.COM WWW.CLARKWELDINGTANKS.COM	12,000 GALLON ABOVE GROUND SINGLE WALL VERTICAL STORAGE TANK	
	SCALE: 1/4" = 1'	DRAWING #: N/A - STANDARD DRAWING



END

SIDE

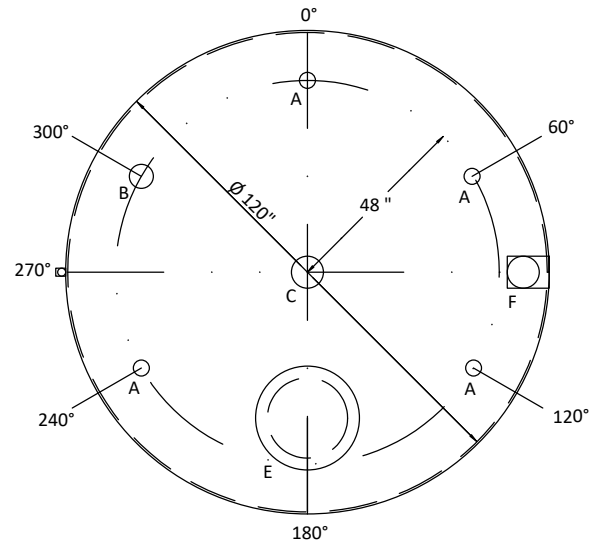

SPECIFICATIONS

OPERATING PRESSURE	ATMOSPHERIC
SPECIFIC GRAVITY	1.0
TANK MATERIAL	MILD CARBON STEEL
INNER THICKNESS	BOTTOM: 1/4" SHELL: 1/4"
OUTER THICKNESS	BOTTOM: 1/4" SHELL: 3/16"
CONSTRUCTION	LAP WELD OUTSIDE ONLY - INNER & OUTER
TANK TEST	5 PSIG - INNER 2+ PSIG - OUTER
INTERIOR FINISH	NONE
EXTERIOR FINISH	SHOP PRIMER (PAINT OPTIONAL)

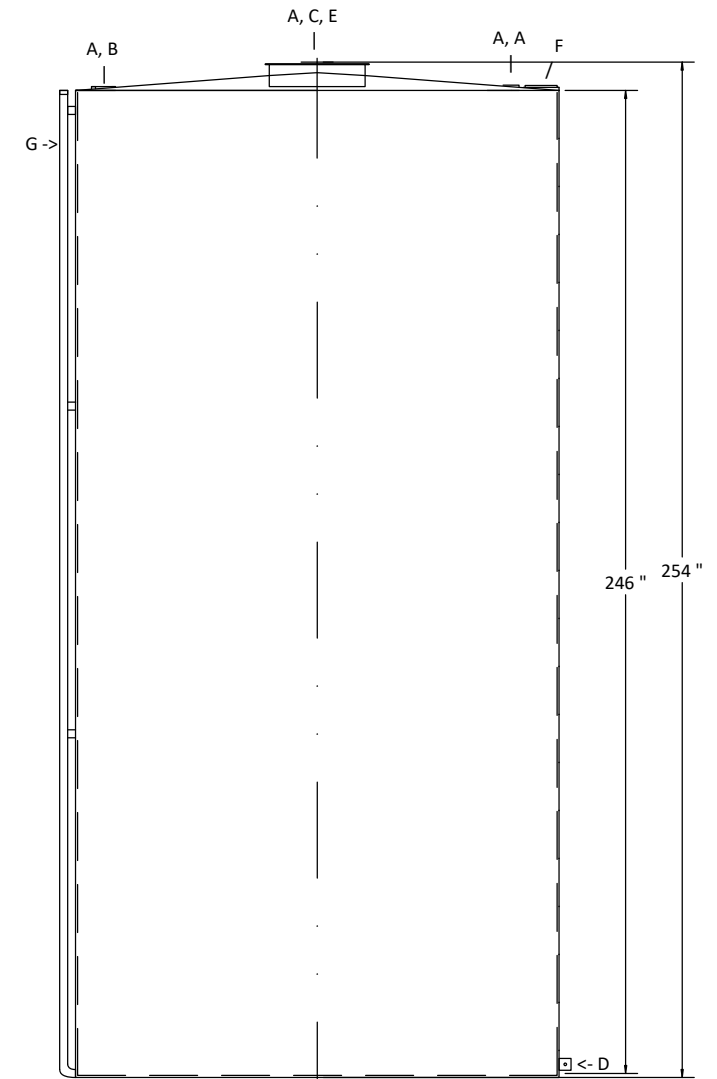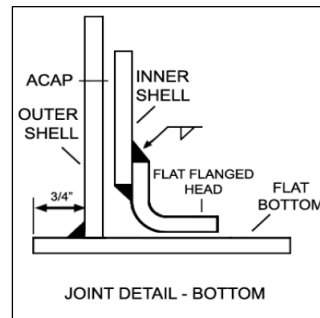

LEGEND

A	4" FNPT OPENING	F	8" FNPT (INTERSTITIAL EMERGENCY VENT USE)
B	6" FNPT OPENING	G	2" INTERSTITIAL MONITOR PORT
C	8" FNPT (PRIMARY EMERGENCY VENT USE)	H	
D	GROUNDING LUG - 1/4" X 3" X 3" WITH CENTER HOLE	I	
E	24" MANWAY	J	

TANK LABEL: UL142

CLEANWORLD SERVICES, INC.
CLARK WELDING SERVICE

 369 CALLAHAN AVENUE, APPALACHIA, VA 24216
 PH: (276) 565-3607 | FAX: (276) 565-2550
 SALES@CLARKWELDINGTANKS.COM
 WWW.CLARKWELDINGTANKS.COM

 12,000 GALLON ABOVE GROUND
 DOUBLE WALL VERTICAL
 STORAGE TANK

SCALE: 1/4" = 1'

DRAWING #: N/A - STANDARD DRAWING