


Published by the Department of Natural Resources, Division of Interior Resources, Bureau of Geology. This public document was promulgated at a cost of \$1,416.50 or (\$0.945) per copy for the purpose of disseminating Water Resources data.



In water from the limestone aquifer throughout most of the county, fluoride content is less than 0.5 mg/l. The Public Health Service (1962) establishes the maximum recommended limit of fluoride as 1.0 mg/l for an area with an annual average maximum daily air temperature of 70.7 to 79.2 degrees F. Concentrations of 0.7 to 1.0 mg/l are considered beneficial in the reduction of dental cavities.

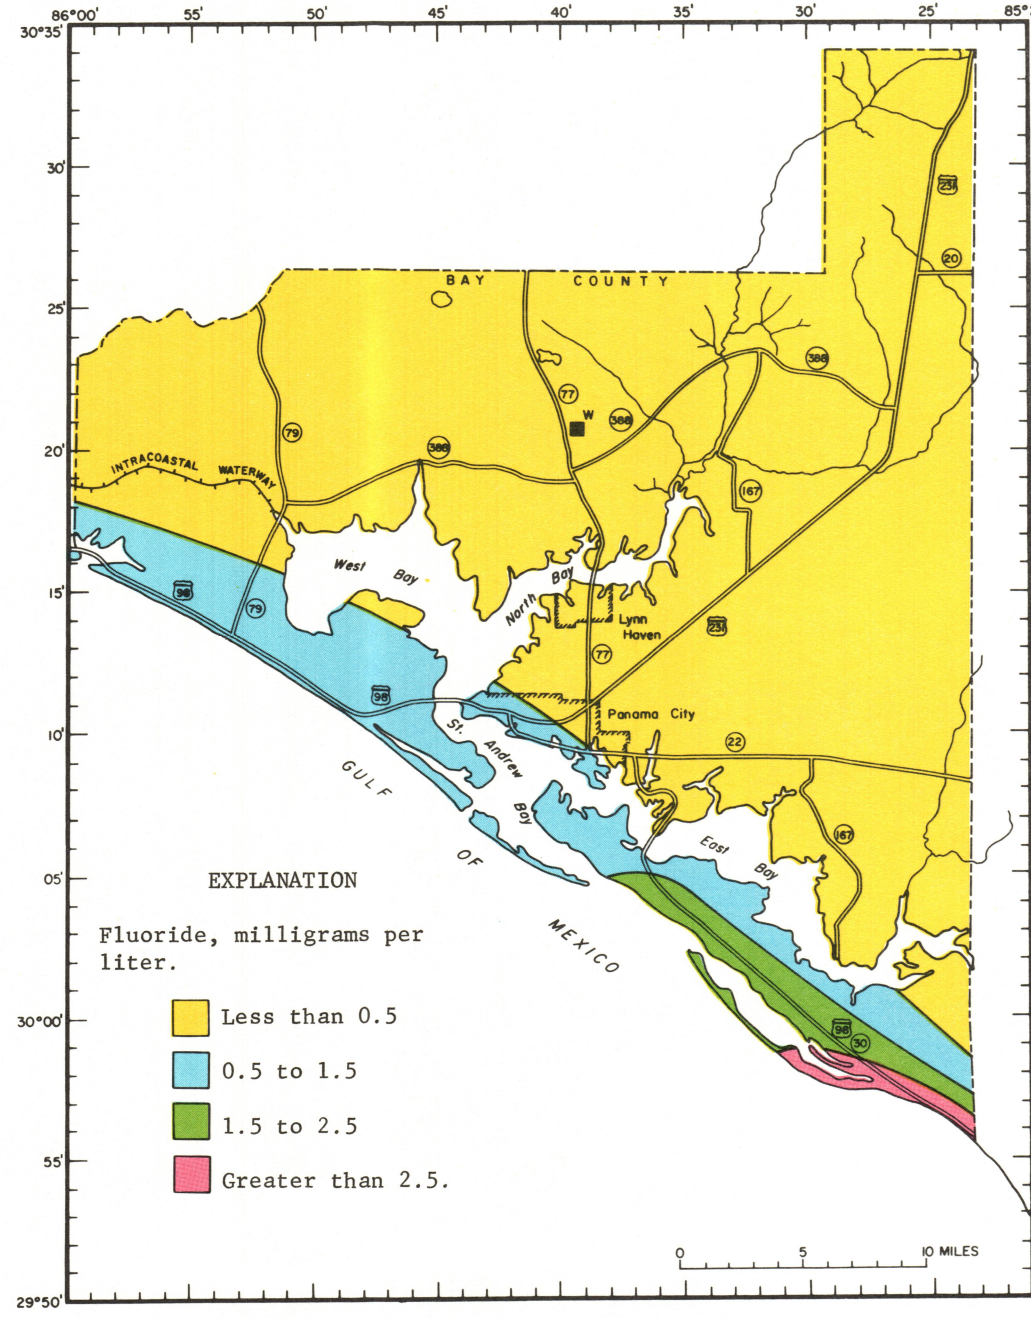