



Florida Department of Environmental Protection

South District Office
Post Office Box 2549
Fort Myers, Florida 33902-2549

Rick Scott
Governor

Jennifer Carroll
Lt. Governor

Herschel T. Vinyard Jr.
Secretary

CERTIFIED MAIL NO.: 7010 1870 0001 8477 3404
RETURN RECEIPT REQUESTED

FILE

In the Matter of an
Application for Permit by:

City of Clewiston
Kevin McCarthy, Utility Director
141 Central Ave
Clewiston, Florida 33440

Hendry County - DW
City of Clewiston Wastewater Treatment Facility
File Number: FL0040665-014-DW1P
Caloosahatchee Basin

NOTICE OF PERMIT REVISION


Enclosed is Permit Number FL0040665, to modify a domestic wastewater treatment facility to increase its permitted capacity to 2.25 million gallons per day. Additional reclaimed water will be land applied to a slow-rate public access system at the Clewiston Golf Course or injected to a Class I underground injection well which discharges to Class G-IV groundwater. The facility is located at latitude 26°43'28"N, longitude 80°56'41" W on Feedlot Road, Clewiston, Florida 33440 in Hendry County. **No increase of capacity is authorized for the existing reuse and disposal system.** This permit is issued under Chapter 403, Florida Statutes.

New monitoring requirements under this permit are effective on the first day of the second month following completion of construction. Until such time, the permittee shall continue to monitor and report in accordance with previously effective permit requirements, if any.

Any party to this order (permit) has the right to seek judicial review of the permit action under Section 120.68, Florida Statutes, by the filing of a notice of appeal under Rules 9.110 and 9.190, Florida Rules of Appellate Procedure, with the Clerk of the Department of Environmental Protection, Office of General Counsel, 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000, and by filing a copy of the notice of appeal accompanied by the applicable filing fees with the appropriate district court of appeal. The notice of appeal must be filed within 30 days from the date when this document is filed with the Clerk of the Department.

Executed in Fort Myers, Florida

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION



Jon M. Iglehart
Director of
District Management

FILING AND ACKNOWLEDGMENT

FILED, on this date, under Section 120.52, Florida Statutes, with the designated Deputy Clerk, receipt of which is hereby acknowledged.

Julius L. Meier 5-27-11
[Clerk] [Date]

CERTIFICATE OF SERVICE

The undersigned hereby certifies that this DOCUMENT AND ATTACHMENTS and all copies were mailed before the close of business on May 27, 2011 to the listed persons.


JMI/NWM/jl

Enclosed: Permit

Copies furnished to:

Lawrence A. Lardieri, P.E.

David Rhodes, P.G.

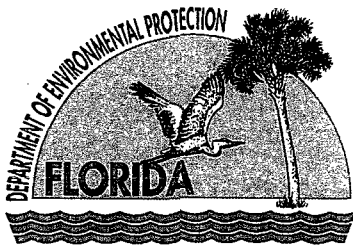

Florida Department of Environmental Protection

South District Office
Post Office Box 2549
Fort Myers, Florida 33902-2549

Rick Scott
Governor

Jennifer Carroll
Lt. Governor

Herschel T. Vinyard Jr.
Secretary

STATE OF FLORIDA DOMESTIC WASTEWATER FACILITY REVISED PERMIT

PERMITTEE:
City of Clewiston

PERMIT NUMBER: FL0040665-014
FILE NUMBER: FL0040665-014-DW1P
ISSUANCE DATE: March 25, 2011
EXPIRATION DATE: March 24, 2016
REVISION DATE: May 27, 2011

RESPONSIBLE OFFICIAL:
Kevin McCarthy
141 Central Ave
Clewiston, Florida 33440-3701
(863) 983-1454

FACILITY:

City of Clewiston Wastewater Treatment Plant
Feedlot Road
Clewiston, FL 33440
Hendry County
Latitude: 26°43' 30" N Longitude: 80°56' 35" W
Water Body ID# 3246

This permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and applicable rules of the Florida Administrative Code (F.A.C.) and constitutes authorization to discharge to waters of the state under the National Pollutant Discharge Elimination System. This permit does not constitute authorization to discharge wastewater other than as expressly stated in this permit. The above named permittee is hereby authorized to construct and operate the facilities in accordance with the documents attached hereto and specifically described as follows:

WASTEWATER TREATMENT:

The facility is an extended aeration process domestic wastewater treatment plant. The permitted capacity for the annual average daily flow is 1.5 million gallons per day. The major units of the facility are one mechanical screen, one grit trap, one equalization tank, two 0.75-million gallon oxidation ditches, two 122,000-gallon clarifiers, one 69,000-gallon chlorine contact chamber, and a sodium hypochlorite disinfection feed system. The solids handling units are one 180,000-gallon aerobic digester, two 45,000-gallon thickening tanks, and one 38,000-gallon lime stabilization tank.

The permittee is authorized to increase the facility's capacity by modifying the facility. The facility will have additional biological treatment units and a second disinfection system for high-level disinfection. The following major changes are authorized:

- Replace the mechanical screen with one 6 MGD 6-millimeter mechanical bar screen.
- Add a manual bar screen.
- Replace the grit trap with a 10 foot diameter vortex grit removal system.
- Add one 0.75 MGD oxidation ditch.
- Replace the splitter box for the clarifiers to accommodate the additional clarifiers.
- Add two 44-foot diameter clarifiers.
- Add a splitter box for the disinfection systems.
- Add two 216 square foot diameter cloth disk filters.
- Add two 25,000- gallon chlorine contact basins.
- Add a reuse pump station.

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

Add sludge holding tanks (for a total of three 164,000 gallon tanks, three 41,000 gallon tanks, and one 38,000 gallon tank.)

Add a sludge dewatering belt press.

Upon completion of the construction, the permitted capacity shall be 2.25 MGD, AADF.

REUSE AND DISPOSAL:

Land Application R-001: Treated effluent is discharged to an existing slow-rate restricted public access system. R-001 is a reuse system which consists of three storage ponds with a total storage volume of 15 million gallons, and 24 sprayfields with a total area of 193 acres. The permitted capacity for the reuse system is 1.5 million gallons per day, annual average daily flow. The fields are underdrained. R-001 is located immediately south of the treatment facility.

Surface Water Discharge D-002: The underdrains in R-001 discharge to Sugarland Drainage Ditch which drains into Canal Number 3 (Water Body Identification Number 3246). The receiving waters are Class III fresh waters. The outfall discharges above the ditch approximately at latitude 26°43' 04" N, longitude 80°56' 37" W.

Underground Injection U-001: An existing 7.93 MGD permitted capacity underground injection well system consisting of 1 Class I underground injection well permitted under Department permit number 249635-003-UO1I, discharging to Class G-IV ground water. Underground Injection Well System U-001 is located approximately at latitude 26°43' 25" N, longitude 80°56' 38" W.

Land Application R-002: A new 0.52 MGD, AADF permitted capacity slow-rate public access system. R-002 is a reuse system which will irrigate 110 acres of the Clewiston Country Club Golf Course. The system has a 1.3 million gallon unlined holding pond. The holding pond is located approximately at latitude 26°43' 25" N, longitude 80°57' 01" W.

IN ACCORDANCE WITH: The limitations, monitoring requirements, and other conditions set forth in this cover sheet and Part I through Part IX on pages 1 through 31 of this permit.

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

I. RECLAIMED WATER AND EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

A. Surface Water Discharges

- During the period beginning on the issuance date and lasting through the expiration date of this permit, the permittee is authorized to discharge effluent from Outfall D-002 to Sugarland Drainage Ditch Canal Number 3. Such discharge shall be limited and monitored by the permittee as specified below and reported in accordance with Permit Condition I.D.7.

Parameter	Units	Max/Min	Effluent Limitations		Monitoring Requirements			Notes
			Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	
Flow	MGD	Max Max	Report Report	Annual Average Monthly Average	Continuous	Recording Flow Meter with Totalizer	FLW-1	See I.A.5
BOD, Carbonaceous 5 day, 20C	mg/L	Max Max Max Max	20.0 25.0 40.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFF-1	
BOD, Carbonaceous 5 day, 20C	lb/day	Max Max	Report Report	Annual Average Monthly Average	Monthly	Calculated	EFF-1	
CBOD, % Removal, 5-day	percent	Min	85	Monthly Average	Monthly	Calculated	EFF-1	
Solids, Total Suspended	mg/L	Max Max Max Max	20.0 30.0 45.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFF-1	
Solids, Total Suspended	lb/day	Max Max	Report Report	Annual Average Monthly Average	Monthly	Calculated	EFF-1	
Solids, Total Suspended, % Removal	percent	Min	85	Monthly Average	Monthly	Calculated	EFF-1	
Coliform, Fecal	#/100mL	Max Max Max	200 200 800	Annual Average Monthly Geometric Mean Single Sample	Weekly	Grab	EFA-1	See I.A.6
pH	s.u.	Min Max	6.0 8.5	Single Sample Single Sample	Continuous	Meter	EFF-1	See I.A.4
Chlorine, Total Residual (For Dechlorination)	mg/L	Max	0.01	Single Sample	Daily	Grab	EFF-1	
Nitrogen, Total	mg/L	Max Max Max Max	5.0 6.25 7.5 10.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFF-1	

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

			Effluent Limitations		Monitoring Requirements			
Parameter	Units	Max/Min	Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	Notes
Nitrogen, Total	lb/day	Max Max	Report Report	Annual Average Monthly Average	Monthly	Calculated	EFF-1	
Phosphorus, Total (as P)	mg/L	Max Max Max Max	0.7 0.875 1.05 1.4	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFF-1	
Phosphorus, Total (as P)	lb/day	Max Max	Report Report	Annual Average Monthly Average	Monthly	Calculated	EFF-1	
Nitrogen, Ammonia, Total (as N)	mg/L	Max	Report	Monthly Average	Weekly	8-hr FPC	EFF-1	
Ammonia, Unionized (as NH3)	mg/L	Max	0.02	Single Sample	Weekly	Calculated	EFF-1	
Nitrite plus Nitrate, Total 1 det. (as N)	mg/L	Max	Report	Monthly Average	Weekly	8-hr FPC	EFF-1	
Nitrogen, Kjeldahl, Total (as N)	mg/L	Max	Report	Monthly Average	Weekly	8-hr FPC	EFF-1	
Solids, Total Dissolved (TDS)	mg/L	Max Max Max	Report Report Report	Annual Average Monthly Average Single Sample	Weekly	8-hr FPC	EFF-1	
Oxygen, Dissolved (DO)	mg/L	Min	5.0	Single Sample	Daily	Grab	EFF-1	
Temperature (F), Water	Deg F	Max	Report	Single Sample	Weekly	Grab	EFF-1	
Chronic Whole Effluent Toxicity, 7-Day IC25 (Ceriodaphnia dubia)	percent	Min	100	Single Sample	Quarterly	24-hr FPC	EFF-1	See I.A.9
Chronic Whole Effluent Toxicity, 7-Day IC25 (Pimephales promelas)	percent	Min	100	Single Sample	Quarterly	24-hr FPC	EFF-1	See I.A.9

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

2. During the period beginning on the issuance date and lasting through the expiration date of this permit, the permittee shall monitor the effects of the discharge effluent from Outfall D-002 on the receiving waters. The receiving waters shall be monitored by the permittee as specified below and reported in accordance with Permit Conditions I.D.7 and VI.1.

Parameter	Units	Max/Min	Effluent Limitations		Monitoring Requirements			Notes
			Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	
Aluminum, Total Recoverable	mg/L	Max	Report	Single Sample	Every 9 months	8-hr FPC	EFF-1	
Antimony, Total Recoverable	ug/L	Max	4,300	Single Sample	Every 9 months	8-hr FPC	EFF-1	
Arsenic, Total Recoverable	ug/L	Max	50	Single Sample	Every 9 months	8-hr FPC	EFF-1	
Chromium, Hexavalent Total Recoverable	ug/L	Max	11	Single Sample	Monthly	8-hr FPC	EFF-1	
Copper, Total Recoverable	ug/L	Max	-	Single Sample	Every 9 months	8-hr FPC	EFF-1	See I.A.7
Coliform, Total	#/100mL	Max	Report	Single Sample	Every 9 months	Grab	EFF-1	
Iron, Total Recoverable	mg/L	Max	1.0	Single Sample	Every 9 months	8-hr FPC	EFF-1	
Silver, Total Recoverable	ug/L	Max	0.07	Single Sample	Monthly	8-hr FPC	EFF-1	
Zinc, Total Recoverable	ug/L	Max	-	Single Sample	Every 9 months	8-hr FPC	EFF-1	See I.A.7
Hardness, Total (as CaCO ₃)	mg/L	Max	Report	Single Sample	Every 9 months	8-hr FPC	EFF-1	
Lead, Total Recoverable	ug/L	Max	-	Single Sample	Every 9 months	8-hr FPC	EFF-1	See I.A.7
Mercury, Total Recoverable	ug/L	Max	0.012	Single Sample	Monthly	8-hr FPC	EFF-1	
Cyanide	ug/L	Max	5.2	Single Sample	Monthly	8-hr FPC	EFF-1	
Surfactants (MBAS)	mg/L	Max	0.5	Single Sample	Every 9 months	8-hr FPC	EFF-1	
Oil and Grease	mg/L	Max	5.0	Single Sample	Every 9 months	Grab	EFF-1	
Nitrogen, Total	mg/L	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Phosphorus, Total (as P)	mg/L	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Nitrogen, Ammonia, Total (as N)	mg/L	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Solids, Total Suspended	mg/L	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
BOD, Carbonaceous 5 day, 20C	mg/L	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

			Effluent Limitations		Monitoring Requirements			
Parameter	Units	Max/Min	Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	Notes
Temperature (F), Water	Deg F	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Salinity	ppt	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Oxygen, Dissolved (DO)	mg/L	Min	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
pH	s.u.	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Turbidity	NTU	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Chlorophyll a	mg/L	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Coliform, Fecal	#/100mL	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	
Coliform, Total	#/100mL	Max	Report	Single Sample	Every 9 months	Grab	SWA-1, SWA-2, SWA-3	

3. Effluent samples shall be taken at the monitoring site locations listed in Permit Condition I.A.1. and as described below:

Monitoring Site Number	Description of Monitoring Site
FLW-1	Recording flow meters and totalizers record the discharge flow from outfall D-002 which discharges into Sugarland District Canal # 3.
EFF-1	The discharge line after all treatment from the facility, just prior to discharging to the Sugarland Drainage District Canal # 3.
SWA-1	Surface water downstream sample location, one mile north of the facility in Canal #3.
SWA-2	Sample water upstream sample location, at the road ½ mile south of EFF-1 in Canal #3.
SWA-3	Surface water background sample location, ½ mile south of SWA-2 in Canal #3.

4. Hourly measurement of pH during the period of required operator attendance may be substituted for continuous measurement. [Chapter 62-601, Figure 2]
5. A recording flow meter with totalizer shall be utilized to measure flow and calibrated at least once every 12 months. [62-601.200(17) and .500(6)]
6. The effluent limitation for the monthly geometric mean for fecal coliform is only applicable if 10 or more values are reported. If fewer than 10 values are reported, the monthly geometric mean shall be calculated and reported on the Discharge Monitoring Report. [62-600.440(4)(c)]
7. The limit for "Copper, Total Recoverable, Zinc, Total Recoverable, and Lead, Total Recoverable", in µg/L, shall be calculated using the following equations:

$$Cu \leq e^{(0.8545[\ln H]-1.702)}$$

$$Zn \leq e^{(0.8473[\ln H]+0.884)}$$

$$Pb \leq e^{(1.273[\ln H]-4.705)}$$

Total hardness shall be measured at the time of the effluent sample. The "ln H" means the natural logarithm of total hardness expressed as mg/L of CaCO₃. For metals criteria involving equations with hardness, the hardness shall be set at 25 mg/L if actual hardness is <25 mg/L and set at 400 mg/L if actual hardness is >400 mg/L.

The measured effluent values shall be recorded on the DMR in the parameter rows for "Copper, Total Recoverable, Zinc, Total Recoverable, and Lead, Total Recoverable (effluent)." The calculated effluent limits shall be recorded on the DMR in the parameter rows for "Copper, Total Recoverable, Zinc, Total Recoverable, and Lead, Total Recoverable (calculated limit)." Compliance with the effluent limitations is determined by calculating the difference between the measured effluent values and the calculated. The compliance values shall be recorded on the DMR in the parameter rows for "Copper, Total Recoverable, Zinc, Total Recoverable, and Lead, Total Recoverable (effluent minus calculated limit)." The compliance values shall not exceed 0.00 (the values must be negative or 0.0). [62-302.530(23), 62-302.530(70), and 62-302.530(39)]

8. If the Department establishes a total maximum daily load (TMDL) or basin management action plan (BMAP) for Canal #3 or downstream waters, the Department may revise this permit to modify the effluent limits contained in this permit. [62-302.500(1)]
9. The permittee shall comply with the following requirements to evaluate chronic whole effluent toxicity of the discharge from outfall D-002.
- a. Effluent Limitation
- (1) In any routine or additional follow-up test for chronic whole effluent toxicity, the 25 percent inhibition concentration (IC25) shall not be less than 100% effluent. [62-302.530(61) and 62-4.241(1)(b), F.A.C.]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

- (2) For acute whole effluent toxicity, the 96-hour LC50 shall not be less than 100% effluent in any test.
[62-302.500(1)(a)4. and 62-4.241(1)(a), F.A.C.]
- b. Monitoring Frequency
- (1) Routine toxicity tests shall be conducted once every three months, the first starting within 60 days of the issuance date of this permit and lasting for the duration of this permit.
 - (2) Upon completion of four consecutive valid routine tests that demonstrate compliance with the effluent limitation in 9.a.(1) above, the permittee may submit a written request to the Department for a reduction in monitoring frequency to once every six months. The request shall include a summary of the data and the complete bioassay laboratory reports for each test used to demonstrate compliance. The Department shall act on the request within 45 days of receipt. Reductions in monitoring shall only become effective upon the Department's written confirmation that the facility has completed four consecutive valid routine tests that demonstrate compliance with the effluent limitation in 9.a.(1) above.
 - (3) If a test within the sequence of the four is deemed invalid based on the acceptance criteria in EPA-821-R-02-013, but is replaced by a repeat valid test initiated within 21 days after the last day of the invalid test, the invalid test will not be counted against the requirement for four consecutive valid tests for the purpose of evaluating the reduction of monitoring frequency.
- c. Sampling Requirements
- (1) For each routine test or additional follow-up test conducted, a total of three flow proportional 24-hr composite samples of final effluent shall be collected and used in accordance with the sampling protocol discussed in EPA-821-R-02-013, Section 8.
 - (2) The first sample shall be used to initiate the test. The remaining two samples shall be collected according to the protocol and used as renewal solutions on Day 3 (48 hours) and Day 5 (96 hours) of the test.
 - (3) Samples for routine and additional follow-up tests shall not be collected on the same day.
- d. Test Requirements
- (1) Routine Tests: All routine tests shall be conducted using a control (0% effluent) and a minimum of five test dilutions: 100%, 50%, 25%, 12.5%, and 6.25% final effluent.
 - (2) The permittee shall conduct a daphnid, *Ceriodaphnia dubia*, Survival and Reproduction Test and a fathead minnow, *Pimephales promelas*, Larval Survival and Growth Test, concurrently.
 - (3) All test species, procedures and quality assurance criteria used shall be in accordance with Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, 4th Edition, EPA-821-R-02-013. Any deviation of the bioassay procedures outlined herein shall be submitted in writing to the Department for review and approval prior to use. In the event the above method is revised, the permittee shall conduct chronic toxicity testing in accordance with the revised method.
 - (4) The control water and dilution water shall be moderately hard water as described in EPA-821-R-02-013, Section 7.2.3.
- e. Quality Assurance Requirements
- (1) A standard reference toxicant (SRT) quality assurance (QA) chronic toxicity test shall be conducted with each species used in the required toxicity tests either concurrently or initiated no more than 30 days before the date of each routine or additional follow-up test conducted. Additionally, the SRT test must be conducted concurrently if the test organisms are obtained from outside the test laboratory unless the test organism supplier provides control chart data from at least the last five monthly chronic toxicity tests using the same reference toxicant and test conditions. If the organism supplier provides the required SRT data, the organism supplier's SRT data and the test laboratory's monthly SRT-QA data shall be included in the reports for each companion routine or additional follow-up test required.
 - (2) If the mortality in the control (0% effluent) exceeds 20% for either species in any test or does not meet "test acceptability criteria", the test for that species (including the control) shall be invalidated and the test repeated. Test acceptability criteria for each species are defined in EPA-821-R-02-013, Section 13.12 (*Ceriodaphnia dubia*) and Section 11.11 (*Pimephales promelas*). The repeat test shall begin within 21 days after the last day of the invalid test.
 - (3) If 100% mortality occurs in all effluent concentrations for either test species prior to the end of any test and the control mortality is less than 20% at that time, the test (including the control) for that species shall be terminated with the conclusion that the test fails and constitutes non-compliance.

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

- (4) Routine and additional follow-up tests shall be evaluated for acceptability based on the observed dose-response relationship as required by EPA-821-R-02-013, Section 10.2.6., and the evaluation shall be included with the bioassay laboratory reports.

f. Reporting Requirements

- (1) Results from all required tests shall be reported on the Discharge Monitoring Report (DMR) as follows:
 - (a) Routine and Additional Follow-up Test Results: The calculated IC25 for each test species shall be entered on the DMR.
- (2) A bioassay laboratory report for each routine test shall be prepared according to EPA-821-R-02-013, Section 10, Report Preparation and Test Review, and mailed to the Department at the address below within 30 days after the last day of the test.
- (3) For additional follow-up tests, a single bioassay laboratory report shall be prepared according to EPA-821-R-02-013, Section 10, and mailed within 30 days after the last day of the second valid additional follow-up test.
- (4) Data for invalid tests shall be included in the bioassay laboratory report for the repeat test.
- (5) The same bioassay data shall not be reported as the results of more than one test.
- (6) All bioassay laboratory reports shall be sent to:
Florida Department of Environmental Protection
South District Office
P.O. Box 2549
Ft. Myers, Florida 33902-2549

g. Test Failures

- (1) A test fails when the test results do not meet the limits in 9.a.(1).
- (2) Additional Follow-up Tests:
 - (a) If a routine test does not meet the chronic toxicity limitation in 9.a.(1) above, the permittee shall notify the Department at the address above within 21 days after the last day of the failed routine test and conduct two additional follow-up tests on each species that failed the test in accordance with 9.d.
 - (b) The first test shall be initiated within 28 days after the last day of the failed routine test. The remaining additional follow-up tests shall be conducted weekly thereafter until a total of two valid additional follow-up tests are completed.
 - (c) The first additional follow-up test shall be conducted using a control (0% effluent) and a minimum of five dilutions: 100%, 50%, 25%, 12.5%, and 6.25% effluent. The permittee may modify the dilution series in the second additional follow-up test to more accurately bracket the toxicity such that at least two dilutions above and two dilutions below the target concentration and a control (0% effluent) are run. All test results shall be analyzed according to the procedures in EPA-821-R-02-013.
- (3) In the event of three valid test failures (whether routine or additional follow-up tests) within a 12-month period, the permittee shall notify the Department within 21 days after the last day of the third test failure.
 - (a) The permittee shall submit a plan for correction of the effluent toxicity within 60 days after the last day of the third test failure.
 - (b) The Department shall review and approve the plan before initiation.
 - (c) The plan shall be initiated within 30 days following the Department's written approval of the plan.
 - (d) Progress reports shall be submitted quarterly to the Department at the address above.
 - (e) During the implementation of the plan, the permittee shall conduct quarterly routine whole effluent toxicity tests in accordance with 9.d. Additional follow-up tests are not required while the plan is in progress. Following completion or termination of the plan, the frequency of monitoring for routine and additional follow-up tests shall return to the schedule established in 9.b.(1). If a routine test is invalid according to the acceptance criteria in EPA-821-R-02-013, a repeat test shall be initiated within 21 days after the last day of the invalid routine test.
 - (f) Upon completion of four consecutive quarterly valid routine tests that demonstrate compliance with the effluent limitation in 9.a.(1) above, the permittee may submit a written request to the Department to terminate the plan. The plan shall be terminated upon written verification by the Department that the facility has passed at least four consecutive quarterly valid routine whole effluent toxicity tests. If a test within the sequence of the four is deemed invalid, but is replaced by

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

a repeat valid test initiated within 21 days after the last day of the invalid test, the invalid test will not be counted against the requirement for four consecutive quarterly valid routine tests for the purpose of terminating the plan.

- (4) If chronic toxicity test results indicate greater than 50% mortality within 96 hours in an effluent concentration equal to or less than the effluent concentration specified as the acute toxicity limit in 9.a.(2), the Department may revise this permit to require acute definitive whole effluent toxicity testing.
- (5) The additional follow-up testing and the plan do not preclude the Department taking enforcement action for acute or chronic whole effluent toxicity failures.

[62-4.241, 62-620.620(3)]

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

B. Underground Injection Control Systems

- During the period beginning upon the completion of the facility's modification and lasting through the expiration date of this permit, the permittee is authorized to discharge effluent to Injection Well System U-001. Such discharge shall be limited and monitored by the permittee as specified below and reported in accordance with condition I.D.7.

			Reclaimed Water Limitations		Monitoring Requirements			
Parameter	Units	Max/Min	Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	Notes
Flow	MGD	Max Max	Report Report	Annual Average Monthly Average	Continuous	Recording Flow Meter with Totalizer	FLW-5	See I.B.4
BOD, Carbonaceous 5 day, 20C	mg/L	Max Max Max Max	20.0 30.0 45.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFA-2	
Solids, Total Suspended	mg/L	Max Max Max Max	20.0 30.0 45.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFB-2	
pH	s.u.	Min Max	6.0 8.5	Single Sample Single Sample	Continuous	Meter	EFA-2	See I.B.3

- Effluent samples shall be taken at the monitoring site locations listed in Permit Condition I.B.1. and as described below:

Monitoring Site Number	Description of Monitoring Site
EFA-2	After the high-level disinfection chambers.
EFB-2	After the disc filters.
FLW-5	Flow meter for the injection well, after the pump station.

- Hourly measurement of pH during the period of required operator attendance may be substituted for continuous measurement. [Chapter 62-601, Figure 2]
- A recording flow meter with totalizer shall be utilized to measure flow and calibrated at least once every 12 months. [62-601.200(17) and .500(6)]
- Disinfection is not required for discharge to Class G-IV waters using Class I wells. However, the permittee must maintain the capability for disinfection at a level that is consistent with the alternate disposal mechanism approved for this facility pursuant to Rule 62-600.540(5), F.A.C. [62-600.540(1)]

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: MAY 27, 2011

C. Reuse and Land Application Systems

- During the period beginning on the issuance date and lasting through the expiration date of this permit, the permittee is authorized to direct reclaimed water to Reuse System R-001. Such reclaimed water shall be limited and monitored by the permittee as specified below and reported in accordance with condition I.D.7.

Parameter	Units	Max./Min	Reclaimed Water Limitations		Monitoring Requirements			Notes
			Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	
Flow (Total effluent to Sprayfields)	MGD	Max Max	1.50 Report	Annual Average Monthly Average	Continuous	Recording Flow Meter with Totalizer	CAL-1	See I.C.6. and I.C.7.
Flow (Overflow from the DIW/Reuse Pump Station)	MGD	Max Max	Report Report	Annual Average Monthly Average	Continuous	Recording Flow Meter with Totalizer	FLW-4	See I.C.6. and I.C.7.
BOD, Carbonaceous 5 day, 20C	mg/L	Max Max Max Max	20.0 30.0 45.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFA-1	
Solids, Total Suspended	mg/L	Max Max Max Max	20.0 30.0 45.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFA-1	
Coliform, Fecal	#/100mL	Max Max Max	200 200 800	Annual Average Monthly Geometric Mean Single Sample	Weekly	Grab	EFA-1	See I.C.4
pH	s.u.	Min Max	6.0 8.5	Single Sample Single Sample	Continuous	Meter	EFA-1	See I.C.3
Chlorine, Total Residual (For Disinfection)	mg/L	Min	0.5	Single Sample	Continuous	Meter	EFA-1	See I.C.5 and I.C.3

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

2. Reclaimed water samples shall be taken at the monitoring site locations listed in Permit Condition I.C.1. and as described below:

Monitoring Site Number	Description of Monitoring Site
CAL-1	Sum of flow meter after chlorine contact basin #1 and FLW-4
EFA-1	The chlorine contact chamber wet well.
FLW-4	Overflow line from effluent pump station.

3. Hourly measurement of pH and total residual chlorine for disinfection during the period of required operator attendance may be substituted for continuous measurement. *[Chapter 62-601, Figure 2]*
4. The effluent limitation for the monthly geometric mean for fecal coliform is only applicable if 10 or more values are reported. If fewer than 10 values are reported, the monthly geometric mean shall be calculated and reported on the Discharge Monitoring Report to calculate the annual average. *[62-600.440(4)(c)]*
5. Total residual chlorine must be maintained for a minimum contact time of 15 minutes based on peak hourly flow. *[62-610.410, 600.440(4)(b) and (5)(b)]*
6. Recording flow meters with totalizers shall be utilized to measure flow and calibrated at least once every 12 months. *[62-601.200(17) and .500(6)]*
7. Monitoring flow at these locations will commence with the completion of the facility expansion.

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

8. During the period beginning upon the completion of the R-002 irrigation system and modified facilities, and lasting through the expiration date of this permit, the permittee is authorized to direct reclaimed water to Reuse System R-002. Such reclaimed water shall be limited and monitored by the permittee as specified below and reported in accordance with condition I.D.7.

Parameter	Units	Max/Min	Reclaimed Water Limitations		Monitoring Requirements			
			Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	Notes
Flow	MGD	Max Max	0.52 Report	Annual Average Monthly Average	Continuous	Meter	FLW-3	See I.C.11
BOD, Carbonaceous 5 day, 20C	mg/L	Max Max Max Max	20.0 30.0 45.0 60.0	Annual Average Monthly Average Weekly Average Single Sample	Weekly	8-hr FPC	EFA-2	
Solids, Total Suspended	mg/L	Max	5.0	Single Sample	Weekly	Grab	EFB-2	
Coliform, Fecal	#/100mL	Max	25	Single Sample	Weekly	Grab	EFA-2	
Coliform, Fecal, % less than detection	percent	Min	75	Monthly Total	Weekly	Calculated	EFA-2	See I.C.12
pH	s.u.	Min Max	6.0 8.5	Single Sample Single Sample	Continuous	Meter	EFA-2	See I.C.10
Chlorine, Total Residual (For Disinfection)	mg/L	Min	1.0	Single Sample	Continuous	Meter	EFA-2	See I.C.13 and I.C.16
Turbidity	NTU	Max	Report	Single Sample	Continuous	Meter	EFB-2	See I.C.14 and I.C.16
Giardia	Cysts /100L	Max	Report	Single Sample	Every 2 years	Grab	EFA-2	See I.C.17
Cryptosporidium	Oocysts /100L	Max	Report	Single Sample	Every 2 years	Grab	EFA-2	See I.C.17

9. Reclaimed water samples shall be taken at the monitoring site locations listed in Permit Condition I.C.8. and as described below:

Monitoring Site Number	Description of Monitoring Site
FLW-3	Reuse flow meter after the pump station.
EFA-2	After chlorine contact basins 2 and 3.
EFB-2	After the disc filters.

10. Hourly measurement of pH during the period of required operator attendance may be substituted for continuous measurement. [Chapter 62-601, Figure 2]
11. A recording flow meter with totalizer shall be utilized to measure flow and calibrated at least once every 12 months. [62-601.200(17) and .500(6)]
12. To report the "% less than detection," count the number of fecal coliform observations that were less than detection, divide by the total number of fecal coliform observations in the month, and multiply by 100% (round to the nearest integer). [62-600.440(5)(f)]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

13. The minimum total chlorine residual shall be limited as described in the approved operating protocol, such that the permit limitation for fecal coliform bacteria will be achieved. In no case shall the total chlorine residual be less than 1.0 mg/L. [62-600.440(5)(b); 62-610.460(2); and 62-610.463(2)]
14. The maximum turbidity shall be limited as described in the approved operating protocol, such that the permit limitations for total suspended solids and fecal coliforms will be achieved. [62-610.463(2)]
15. The treatment facilities shall be operated in accordance with all approved operating protocols. Only reclaimed water that meets the criteria established in the approved operating protocol(s) may be released to system storage or to the reuse system. Reclaimed water that fails to meet the criteria in the approved operating protocol(s) shall be directed to the following permitted alternate discharge system: U-001. [62-610.320(6) and 62-610.463(2)]
16. Instruments for continuous on-line monitoring of total residual chlorine and turbidity shall be equipped with an automated data logging or recording device. [62-610.463(2)]
17. Intervals between sampling for Giardia and Cryptosporidium shall not exceed two years. [62-610.463(4)]

PERMITTEE: City of Clewiston
 FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
 REVISION DATE: May 27, 2011

D. Other Limitations and Monitoring and Reporting Requirements

- During the period beginning on the issuance date and lasting through the expiration date of this permit, the treatment facility shall be limited and monitored by the permittee as specified below and reported in accordance with condition I.D.7.

Parameter	Units	Max/Min	Limitations		Monitoring Requirements			Notes
			Limit	Statistical Basis	Frequency of Analysis	Sample Type	Monitoring Site Number	
Flow	MGD	Max Max Max	1.5* Report Report	Annual Average Monthly Average Quarterly Average	Continuous	Recording Flow Meter with Totalizer	FLW-2	See I.D.4
Percent Capacity, (TMADF/Permitted Capacity) x 100	percent	Max	Report	Monthly Average	Monthly	Calculated	FLW-2	
BOD, Carbonaceous 5 day, 20C (Influent)	mg/L	Max	Report	Single Sample	Weekly	8-hr FPC	INF-1	See I.D.3
Solids, Total Suspended (Influent)	mg/L	Max	Report	Single Sample	Weekly	8-hr FPC	INF-1	See I.D.3

*Upon completion of construction, the permitted capacity shall be 2.25 MGD AADF.

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: MAY 27, 2011

2. Samples shall be taken at the monitoring site locations listed in Permit Condition I.D.1. and as described below:

Monitoring Site Number	Description of Monitoring Site
FLW-2	The parshall flume prior to chlorine contact chamber disinfection. After the modifications are complete, the location shall be moved to the influent flowmeter prior to any side stream mixing.
INF-1	The plant headworks prior to any side stream mixing.

3. Influent samples shall be collected so that they do not contain digester supernatant or return activated sludge, or any other plant process recycled waters. [62-601.500(4)]
4. A recording flow meter with totalizer shall be utilized to measure flow and calibrated at least once every 12 months. [62-601.200(17) and .500(6)]
5. The sample collection, analytical test methods and method detection limits (MDLs) applicable to this permit shall be conducted using a sufficiently sensitive method to ensure compliance with applicable water quality standards and effluent limitations and shall be in accordance with Rule 62-4.246, Chapters 62-160 and 62-601, F.A.C., and 40 CFR 136, as appropriate. The list of Department established analytical methods, and corresponding MDLs (method detection limits) and PQLs (practical quantitation limits), which is titled "FAC 62-4 MDL/PQL Table (April 26, 2006)" is available at <http://www.dep.state.fl.us/labs/library/index.htm>. The MDLs and PQLs as described in this list shall constitute the minimum acceptable MDL/PQL values and the Department shall not accept results for which the laboratory's MDLs or PQLs are greater than those described above unless alternate MDLs and/or PQLs have been specifically approved by the Department for this permit. Any method included in the list may be used for reporting as long as it meets the following requirements:
- The laboratory's reported MDL and PQL values for the particular method must be equal or less than the corresponding method values specified in the Department's approved MDL and PQL list;
 - The laboratory reported MDL for the specific parameter is less than or equal to the permit limit or the applicable water quality criteria, if any, stated in Chapter 62-302, F.A.C. Parameters that are listed as "report only" in the permit shall use methods that provide an MDL, which is equal to or less than the applicable water quality criteria stated in 62-302, F.A.C.; and
 - If the MDLs for all methods available in the approved list are above the stated permit limit or applicable water quality criteria for that parameter, then the method with the lowest stated MDL shall be used.

When the analytical results are below method detection or practical quantitation limits, the permittee shall report the actual laboratory MDL and/or PQL values for the analyses that were performed following the instructions on the applicable discharge monitoring report.

Where necessary, the permittee may request approval of alternate methods or for alternative MDLs or PQLs for any approved analytical method. Approval of alternate laboratory MDLs or PQLs are not necessary if the laboratory reported MDLs and PQLs are less than or equal to the permit limit or the applicable water quality criteria, if any, stated in Chapter 62-302, F.A.C. Approval of an analytical method not included in the above-referenced list is not necessary if the analytical method is approved in accordance with 40 CFR 136 or deemed acceptable by the Department. [62-4.246, 62-160]

6. The permittee shall provide safe access points for obtaining representative influent, reclaimed water, and effluent samples which are required by this permit. [62-601.500(5)]
7. Monitoring requirements under this permit are effective on the first day of the second month following permit issuance. Until such time, the permittee shall continue to monitor and report in accordance with previously effective permit requirements, if any. During the period of operation authorized by this permit, the permittee shall complete and submit to the Department Discharge Monitoring Reports (DMRs) in accordance with the

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

frequencies specified by the REPORT type (i.e. monthly, toxicity, quarterly, semiannual, annual, etc.) indicated on the DMR forms attached to this permit. Monitoring results for each monitoring period shall be submitted in accordance with the associated DMR due dates below.

REPORT Type on DMR	Monitoring Period	Due Date
Monthly or Toxicity	First day of month - last day of month	28 th day of following month
Quarterly	January 1 - March 31	April 28
	April 1 - June 30	July 28
	July 1 - September 30	October 28
	October 1 - December 31	January 28
Semiannual	January 1 - June 30	July 28
	July 1 - December 30	January 28
Annual	January 1 - December 31	January 28

DMRs shall be submitted for each required monitoring period including months of no discharge. The permittee shall make copies of the attached DMR form and shall submit the completed DMR form to the Department by the twenty-eighth (28th) of the month following the month of operation at the address specified below:

Florida Department of Environmental Protection
Wastewater Compliance Evaluation Section, Mail Station 3551
Bob Martinez Center
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

[62-620.610(18)][62-601.300(1),(2), and (3)]

8. During the period of operation authorized by this permit, reclaimed water or effluent shall be monitored annually for the primary and secondary drinking water standards contained in Chapter 62-550, F.A.C., (except for asbestos, color, odor, and corrosivity). These monitoring results shall be reported to the Department annually on the DMR. During years when a permit is not renewed, a certification stating that no new non-domestic wastewater dischargers have been added to the collection system since the last reclaimed water or effluent analysis was conducted may be submitted in lieu of the report. The annual reclaimed water or effluent analysis report or the certification shall be completed and submitted in a timely manner so as to be received by the Department's South District Office by June 28 of each year. Approved analytical methods identified in Rule 62-620.100(3)(j), F.A.C., shall be used for the analysis. If no method is included for a parameter, methods specified in Chapter 62-550, F.A.C., shall be used. [62-601.300(4)][62-601.500(3)][62-610.300(4)]
9. The permittee shall submit an Annual Reuse Report using DEP Form 62-610.300(4)(a)2. on or before January 1 of each year. [62-610.870(3)]
10. Unless specified otherwise in this permit, all reports and other information required by this permit, including 24-hour notifications, shall be submitted to or reported to, as appropriate, the Department's South District Office at the address specified below:

Florida Department of Environmental Protection South District Office
2295 Victoria Ave
Suite 364
Ft. Myers, Florida 33901-3881

Phone Number - (239)344-5600
FAX Number - (850)412-0590
(All FAX copies and e-mails shall be followed by original copies.)

[62-620.305]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

11. All reports and other information shall be signed in accordance with the requirements of Rule 62-620.305, F.A.C. [62-620.305]

II. RESIDUALS MANAGEMENT REQUIREMENTS

1. The method of residuals use or disposal by this facility is disposal in a Class I or II solid waste landfill. [62-620.320(6), 62-640.880(1)]
2. The permittee shall be responsible for proper treatment, management, use, and land application or disposal of its residuals. [62-640.300(5)]
3. Disposal of residuals, septage, and other solids in a solid waste disposal facility, or disposal by placement on land for purposes other than soil conditioning or fertilization, such as at a monofill, surface impoundment, waste pile, or dedicated site, shall be in accordance with the requirements of Chapter 62-701, F.A.C. [62-640.100(6)(k)3&4]
4. If the permittee intends to accept residuals from other facilities, a permit revision is required pursuant to Rule 62-640.880(2)(d), F.A.C. [62-640.880(2)(d)]
5. Storage of residuals or other solids at the permitted facility shall require prior written notification to the Department. [62-640.300(4)]

III. GROUND WATER REQUIREMENTS

1. With the application for permit renewal, the permittee shall submit the results of sampling monitoring wells specified in the Department-approved monitoring plan for the primary and secondary drinking water parameters included in Chapter 62-550, F.A.C., (excluding asbestos, acrylamide, Dioxin, butachlor, epichlorohydrin, pesticides, and PCBs, unless reasonably expected to be a constituent of the discharge or an artifact of the site). Additional volatile and semivolatile parameters as specified in the ground water monitoring plan or permit shall be analyzed. Sampling shall occur no sooner than 180 days before submittal of the renewal application. [62-520.600(5)(b)]
2. Pursuant to Rule 62-520.600, F.A.C. the permittee shall provide the site specific groundwater flow direction and hydraulic gradient that confirms that the proposed background and compliance well locations at the golf course are appropriate within 120 days of the date of issuance of this permit. Pursuant to Rule 62-520.465(2)(3)(c) F.A.C. which permits multiple sites to have a single zone of discharge, the permittee shall provide an updated map of the golf course and new storage pond delineating the wetted areas, the zone of discharge encompassing both the golf course and the new storage pond, and an updated location for the proposed new compliance well such that this well will be downgradient of both the golf course and new storage pond as a part of the updated zone of discharge as required by rule 62-520.600(6)(c), F.A.C. The map should be submitted at a scale that allows all details to be clearly visible. The Department recommends a one inch equals two hundred feet, (1" = 200') map scale for such projects.
3. The permittee shall give at least 72-hours notice to the Department's South District Office, prior to the installation of any monitoring wells. [62-620.320(6)]
4. Prior to construction of ground water monitoring wells, a soil boring shall be made at each monitoring well location in order to properly determine the well depth and screen interval. [62-520.900(3)]
5. Within 30 days after installation of a monitoring well, the permittee shall submit to the Department's South District Office detailed information on the well's location and construction on the attached DEP Form(s) 62-520.900(3), Monitoring Well Completion Report. [62-532.410 and 62-520.900(3)]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

6. Within 30 days of completion of construction of new ground water monitor wells, the permittee shall sample all new monitoring wells for the primary and secondary drinking water parameters included in Chapter 62-550, F.A.C., (excluding asbestos, acrylamide, Dioxin, butachlor, epichlorohydrin, pesticides, and PCBs, unless reasonably expected to be a constituent of the discharge or an artifact of the site) and EPA Methods 601 and 602. [62-520.400 and 62-520.420] [62-520.300(1), and 62-520.600(3)(A)]
7. All piezometers and monitoring wells not part of the approved ground water monitoring plan are to be plugged and abandoned in accordance with Rule 62-532.500(4), F.A.C., unless future use is intended. [62-532.500(4)][62-520.600]
8. For the Part II land application system, all ground water quality criteria specified in Chapter 62-520, F.A.C., shall be met at the edge of the zone of discharge. The zone of discharge for Land Application Site R-001 shall extend horizontally 100 feet from the application site or to the facility's property line, whichever is less, and vertically to the base of the shallow water table aquifer. [62-520.200(27)] [62-520.465]
9. During the period of operation authorized by this permit, the permittee shall continue to sample ground water at the monitoring wells identified in Permit Condition III.10., below in accordance with this permit and the approved ground water monitoring plan prepared in accordance with Rule 62-520.600, F.A.C. [62-520.600] [62-610.412]
10. The following monitoring wells shall be sampled for Reuse System R-001.

Monitoring Well ID	Alternate Well Name and/or Description of Monitoring Location	Aquifer Monitored	New or Existing
MWC-20640	Compliance well located in the northeast.	Surficial	Existing
MWC-24387	Compliance well located at the southeast end.	Surficial	Existing
MWI-20638	Intermediate well located at the south side.	Surficial	Existing
MWI-20639	Intermediate well located along the west side.	Surficial	Existing
MWI-20644	Intermediate well located in the northeast	Surficial	Existing
MWB-114881	Background well located at the north corner of property close to Bahama Ave.	Surficial	New
MWC-114882	Compliance well located between Georgia Ave & offsite reuse storage pond.	Surficial	New

MWC = Compliance; MWI = Intermediate

[62-520.600] [62-610.412]

11. The following parameters shall be analyzed for each monitoring well identified in Permit Condition III.10. Results shall be reported on the permittee's Discharge Monitoring Report in accordance with Condition I.D.7.

Parameter	Compliance Well Limit	Units	Sample Type	Monitoring Frequency
Water Level Relative to NGVD (NAVD allowable)	Report	ft	In Situ	Quarterly
Nitrogen, Nitrate, Total (as N)	10	mg/L	Grab	Quarterly
Solids, Total Dissolved (TDS)	500	mg/L	Grab	Quarterly
Chloride (as Cl)	250	mg/L	Grab	Quarterly
Coliform, Total	4	#/100mL	Grab	Quarterly
pH	6.5 - 8.5	s.u.	In Situ	Quarterly
Sulfate, Total	250	mg/L	Grab	Quarterly
Sodium, Total Recoverable	160	mg/L	Grab	Quarterly
Arsenic, Total Recoverable	0.010	mg/L	Grab	Quarterly
Cadmium, Total Recoverable	0.005	mg/L	Grab	Quarterly
Chromium, Total Recoverable	0.1	mg/L	Grab	Quarterly

Parameter	Compliance Well Limit	Units	Sample Type	Monitoring Frequency
Lead, Total Recoverable	0.015	mg/L	Grab	Quarterly
Phosphorus, Total (as P)	Report	mg/L	Grab	Quarterly
Turbidity	Report	NTU	Grab	Quarterly
Specific Conductance	Report	umhos/cm	In Situ	Quarterly
Temperature (C), Water	Report	Deg C	In Situ	Quarterly
Oxygen, Dissolved (DO)	Report	mg/L	In Situ	Quarterly

[62-520.600(1)] [62-520.600(11)(b)] [62-601.300(3), 62-601.700, and Figure 3 of 62-601] [62-601.300(6)] [62-520.310(5)] [62-520.420(1)] [62-520.400] [62-550.310] [62-550.320]

12. Water levels shall be recorded before evacuating each well for sample collection. Elevation references shall include the top of the well casing and land surface at each well site (NAVD allowable) at a precision of plus or minus 0.01 foot. [62-520.600(1)] [62-520.600(11)(c)] [62-610.412(2)(c)]
13. If the concentration for any constituent listed in Permit Condition III. 11. in the natural background quality of the ground water is greater than the stated maximum, or in the case of pH is also less than the minimum, the representative natural background quality shall be the prevailing standard. [62-520.420(2)]
14. Ground water monitoring wells shall be purged prior to sampling to obtain representative samples. [62-520.600(1)] [62-160.210] [62-601.700(5)]
15. Analyses shall be conducted on unfiltered samples, unless filtered samples have been approved by the Department's South District Office as being more representative of ground water conditions. [62-520.600(1)] [62-520.310(5)]
16. Ground water monitoring test results shall be submitted on Part D of Form 62-620.910(10) in accordance with Permit Condition I.D.7. [62-520.600(1)] [62-520.600(11)(b)] [62-601.300(3), 62-601.700, and Figure 3 of 62-601] [62-620.610(18)]
17. If any monitoring well becomes damaged or inoperable, the permittee shall notify the Department's South District Office immediately and a detailed written report shall follow within seven days. The written report shall detail what problem has occurred and remedial measures that have been taken to prevent recurrence. All monitoring well design and replacement shall be approved by the Department's South District Office prior to installation. [62-520.600] [62-620.320(6)]
18. The Permittee shall provide verbal notice to the Department's South District Office as soon as practical after discovery of a sinkhole within an area for the management or application of wastewater, wastewater residuals (sludges), or reclaimed water. The Permittee shall immediately implement measures appropriate to control the entry of contaminants, and shall detail these measures to the Department's South District Office in a written report within 7 days of the sinkhole discovery. [62-4.070(3)]

IV. ADDITIONAL REUSE AND LAND APPLICATION REQUIREMENTS

A. Part II Slow-Rate/Restricted Access System

1. Advisory signs shall be posted around the site boundaries to designate the nature of the project area. [62-610.418(1)]
2. Routine aquatic weed control and regular maintenance of storage pond embankments and access areas are required. [62-610.414(8)]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

3. The maximum annual average loading rate to the fields shall be limited to 2 inches per week. *[62-610.423(3) and (4)]*
4. The crops or vegetation shall be periodically harvested and removed from the project area. *[62-610.310(3)(d) and 62-610.419(1)(b)]*
5. Dairy cattle whose milk is intended for human consumption shall not be allowed on the project area for a period of 15 days after the last application of reclaimed water. No restrictions are imposed on the grazing of other cattle. *[62-610.425]*
6. Irrigation of edible food crops is prohibited. *[62-610.426]*
7. Overflows from emergency discharge facilities on storage ponds shall be reported as abnormal events in accordance with Permit Condition IX.20. *[62-610.800(9)]*

B. Part III Public Access System

1. The newly constructed modifications to the Part III reuse system shall not be placed in service for any purpose without written approval from the Department. For projects identified in the permit as being constructed in phases, written permission is only required for the first phase. Application for approval shall be made to the Department on DEP Form 62-610.300(4)(a)3, Application for Permission to Place a Public Access Reuse System in Operation. *[62-610.800(7)]*
2. Cross-connections to the potable water system are prohibited. *[62-610.469(7)]*
3. A cross-connection control program shall be implemented and/or remain in effect within the areas where reclaimed water will be provided for use. *[62-610.469(7)]*
4. The permittee shall conduct inspections within the reclaimed water service area to verify proper connections, to minimize illegal cross-connections, and to verify the proper use of reclaimed water. Inspections are required when a customer first connects to the reuse distribution system. Subsequent inspections are required as specified in the cross-connection control and inspection program. *[62-610.469(7)(h)]*
5. If a cross-connection between the potable and reclaimed water systems is discovered, the permittee shall:
 - a. Immediately discontinue potable water and/or reclaimed water service to the affected area.
 - b. If the potable water system is contaminated, clear the potable water lines.
 - c. Eliminate the cross-connection.
 - d. Test the affected area for other possible cross-connections.
 - e. Within 24 hours, notify the Department's South District Office's domestic wastewater and drinking water programs.
 - f. Within 5 days of discovery of a cross-connection, submit a written report to the Department's South District Office detailing: a description of the cross-connection, how the cross-connection was discovered, the exact date and time of discovery, approximate time that the cross-connection existed, the location, the cause, steps taken to eliminate the cross-connection, whether reclaimed water was consumed, and reports of possible illness, whether the drinking water system was contaminated and the steps taken to clear the drinking water system, when the cross-connection was eliminated, plan of action for testing for other possible cross-connections in the area, and an evaluation of the cross-connection control and inspection program to ensure that future cross-connections do not occur.

[62-555.350(3) and 62-555.360][62-620.610(20)]

6. Maximum obtainable separation of reclaimed water lines and potable water lines shall be provided and the minimum separation distances specified in Rule 62-610.469(7), F.A.C., shall be provided. Reuse facilities shall

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

be color coded or marked. Underground piping which is not manufactured of metal or concrete shall be color coded using Pantone Purple 522C using light stable colorants. Underground metal and concrete pipe shall be color coded or marked using purple as the predominant color. [62-610.469(7)]

7. In constructing reclaimed water distribution piping, the permittee shall maintain a 75-foot setback distance from a reclaimed water transmission facility to public water supply wells. No setback distances are required to other potable water supply wells or to any nonpotable water supply wells. [62-610.471(3)]
8. A setback distance of 75 feet shall be maintained between the edge of the wetted area and potable water supply wells, unless the utility adopts and enforces an ordinance prohibiting potable water supply wells within the reuse service area. No setback distances are required to any nonpotable water supply well, to any surface water, to any developed areas, or to any private swimming pools, hot tubs, spas, saunas, picnic tables, barbecue pits, or barbecue grills. [62-610.471(1), (2), (5), and (7)]
9. Reclaimed water shall not be used to fill swimming pools, hot tubs, or wading pools. [62-610.469(4)]
10. Low trajectory nozzles, or other means to minimize aerosol formation shall be used within 100 feet from outdoor public eating, drinking, or bathing facilities. [62-610.471(6)]
11. A setback distance of 100 feet shall be maintained from indoor aesthetic features using reclaimed water to adjacent indoor public eating and drinking facilities. [62-610.471(8)]
12. The public shall be notified of the use of reclaimed water. This shall be accomplished by posting of advisory signs in areas where reuse is practiced, notes on scorecards, or other methods. [62-610.468(2)]
13. All advisory signs and labels on vaults, service boxes, or compartments that house hose bibbs along with all labels on hose bibbs, valves, and outlets shall bear the words "do not drink" and "no beber" along with the equivalent standard international symbol. In addition to the words "do not drink" and "no beber," advisory signs posted at storage ponds and decorative water features shall also bear the words "do not swim" and "no nadar" along with the equivalent standard international symbols. [62-610.468 & .469]
14. All new advisory signs and labels on vaults, service boxes, or compartments that house hose bibbs along with all labels on hose bibbs, valves, and outlets shall bear the words "do not drink" and "no beber" along with the equivalent standard international symbol. In addition to the words "do not drink" and "no beber," advisory signs posted at storage ponds and decorative water features shall also bear the words "do not swim" and "no nadar" along with the equivalent standard international symbols. Existing advisory signs and labels shall be retrofitted, modified, or replaced in order to comply with the revised wording requirements. For existing advisory signs and labels this retrofit, modification, or replacement shall occur within 365 days after the date of this permit. For labels on existing vaults, service boxes, or compartments housing hose bibbs this retrofit, modification, or replacement shall occur within 730 days after the date of this permit. [62-610.468, 62-610.469]
15. The permittee shall ensure that users of reclaimed water are informed about the origin, nature, and characteristics of reclaimed water; the manner in which reclaimed water can be safely used; and limitations on the use of reclaimed water. Notification is required at the time of initial connection to the reclaimed water distribution system and annually after the reuse system is placed into operation. A description of on-going public notification activities shall be included in the Annual Reuse Report. [62-610.468(6)]
16. Routine aquatic weed control and regular maintenance of storage pond embankments and access areas are required. [62-610.414(8)]

Overflows from emergency discharge facilities on storage ponds shall be reported as abnormal events in accordance with Permit Condition IX.20. [62-610.800(9)]

V. OPERATION AND MAINTENANCE REQUIREMENTS

A. Staffing Requirements

1. During the period of operation authorized by this permit, the wastewater facilities shall be operated under the supervision of an operator certified in accordance with Chapter 62-602, F.A.C. In accordance with Chapter 62-699, F.A.C., this facility is a Category III, Class C facility and, at a minimum, operators with appropriate certification must be on the site as follows:

A Class C or higher operator 6 hours/day for 5 days/week and one weekend visit. The lead/chief operator must be a Class C operator, or higher.

After the permittee is authorized to irrigate R-002, the minimum operator staffing shall be a Class C or higher operator 24 hours/day for 7 days/week, with a lead operator of Class B, or higher; unless the operating protocol indicates that reduced staffing is warranted. [62-610.462(2) & (3)]

2. The lead/chief operator shall be employed at the plant full time. "Full time" shall mean at least 4 days per week, working a minimum of 35 hours per week, including leave time. A licensed operator shall be on-site and in charge of each required shift for periods of required staffing time when the lead/chief operator is not on-site. An operator meeting the lead/chief operator class for the treatment plant shall be available during all periods of plant operation. "Available" means able to be contacted as needed to initiate the appropriate action in a timely manner. [62-699.311(10), (6) and (1)]

B. Capacity Analysis Report and Operation and Maintenance Performance Report Requirements

1. The application to renew this permit shall include an updated capacity analysis report prepared in accordance with Rule 62-600.405, F.A.C. [62-600.405(5)]
2. The application to renew this permit shall include a detailed operation and maintenance performance report prepared in accordance with Rule 62-600.735, F.A.C. [62-600.735(1)]

C. Recordkeeping Requirements

1. The permittee shall maintain the following records and make them available for inspection on the site of the permitted facility.
 - a. Records of all compliance monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, including, if applicable, a copy of the laboratory certification showing the certification number of the laboratory, for at least three years from the date the sample or measurement was taken;
 - b. Copies of all reports required by the permit for at least three years from the date the report was prepared;
 - c. Records of all data, including reports and documents, used to complete the application for the permit for at least three years from the date the application was filed;
 - d. Monitoring information, including a copy of the laboratory certification showing the laboratory certification number, related to the residuals use and disposal activities for the time period set forth in Chapter 62-640, F.A.C., for at least three years from the date of sampling or measurement;
 - e. A copy of the current permit;
 - f. A copy of the current operation and maintenance manual as required by Chapter 62-600, F.A.C.;
 - g. A copy of any required record drawings;
 - h. Copies of the licenses of the current certified operators; and
 - i. Copies of the logs and schedules showing plant operations and equipment maintenance for three years from the date of the logs or schedules. The logs shall, at a minimum, include identification of the plant; the signature and license number of the operator and the signature of the person making any entries; date and

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

time in and out; specific operation and maintenance activities, including any preventive maintenance or repairs made or requested; results of tests performed and samples taken, unless documented on a laboratory sheet; and notation of any notification or reporting completed in accordance with Rule 62-602.650(3), F.A.C. The logs shall be maintained on-site in a location accessible to 24-hour inspection, protected from weather damage, and current to the last operation and maintenance performed.

[62-620.350, 62-602.650]

VI. SCHEDULES

1. The permittee shall sample the surface water at locations EFF-1, SWA-1, SWA-2, and SWA-3 for the parameters listed in Condition I.A.2. according to the following schedule:

Action	Sample Date	Report Date
First surface water survey.	May 2011	July 28, 2011
Second surface water survey.	February 2012	April 28, 2012
Third surface water survey.	November 2013	January 28, 2014
Fourth surface water survey.	August 2014	October 28, 2014

2. If the permittee wishes to continue operation of this wastewater facility after the expiration date of this permit, the permittee shall submit an application for renewal no later than one-hundred and eighty days (180) prior to the expiration date of this permit. Application shall be made using the appropriate forms listed in Rule 62-620.910, F.A.C., including submittal of the appropriate processing fee set forth in Rule 62-4.050, F.A.C. [62-620.335(1) and (2)]
3. The permittee shall sample the discharge at EFF-1 in accordance with the instructions provided in Sections 3.A.12., 13., and 14. of the application form 62-620.910(2). The sampling shall occur according to the following schedule:

Action	Due Date
First Monitoring	February 2012
Second Monitoring	November 2013
Third Monitoring	August 31, 2014
Submission of the results of the testing.	With the application for permit renewal.

4. As requested in the application, the following construction schedule for the facilities shall be followed, unless a minor permit revision is issued to amend the schedule:

Implementation Step		Completion Date
a	End construction of facility modifications.	April 1, 2012
b	Submit notice of completion of construction on DEP Form 62-620.910(12).	Prior to operation of modified facilities.
c	Submit notice of record drawings and operation manual on DEP Form 62-620.910(14).	Within 6 months of completion of construction.
d	Submit application to place R-002 in operation	Prior to discharge to the reuse system.

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

Implementation Step		Completion Date
	on DEP Form 62-610.300(4)(a)3.	
e	Submit an operating protocol.	With the application to place R-002 in operation.
f	Begin reuse.	Upon written authorization from the Department.

[62-620.400]

VII. INDUSTRIAL PRETREATMENT PROGRAM REQUIREMENTS

This facility is not required to have a pretreatment program at this time. [62-625.500]

VIII. OTHER SPECIFIC CONDITIONS

1. In the event that the treatment facilities or equipment no longer function as intended, are no longer safe in terms of public health and safety, or odor, noise, aerosol drift, or lighting adversely affects neighboring developed areas at the levels prohibited by Rule 62-600.400(2)(a), F.A.C., corrective action (which may include additional maintenance or modifications of the permitted facilities) shall be taken by the permittee. Other corrective action may be required to ensure compliance with rules of the Department. Additionally, the treatment, management, use or land application of residuals shall not cause a violation of the odor prohibition in Rule 62-296.320(2), F.A.C. [62-600.410(8) and 62-640.400(6)]
2. The deliberate introduction of stormwater in any amount into collection/transmission systems designed solely for the introduction (and conveyance) of domestic/industrial wastewater; or the deliberate introduction of stormwater into collection/transmission systems designed for the introduction or conveyance of combinations of storm and domestic/industrial wastewater in amounts which may reduce the efficiency of pollutant removal by the treatment plant is prohibited, except as provided by Rule 62-610.472, F.A.C. [62-604.130(3)]
3. Collection/transmission system overflows shall be reported to the Department in accordance with Permit Condition IX. 20. [62-604.550] [62-620.610(20)]
4. The operating authority of a collection/transmission system and the permittee of a treatment plant are prohibited from accepting connections of wastewater discharges which have not received necessary pretreatment or which contain materials or pollutants (other than normal domestic wastewater constituents):
 - a. Which may cause fire or explosion hazards; or
 - b. Which may cause excessive corrosion or other deterioration of wastewater facilities due to chemical action or pH levels; or
 - c. Which are solid or viscous and obstruct flow or otherwise interfere with wastewater facility operations or treatment; or
 - d. Which result in the wastewater temperature at the introduction of the treatment plant exceeding 40°C or otherwise inhibiting treatment; or
 - e. Which result in the presence of toxic gases, vapors, or fumes that may cause worker health and safety problems.[62-604.130(5)]
5. The treatment facility, storage ponds and reuse system shall be enclosed with a fence or otherwise provided with features to discourage the entry of animals and unauthorized persons. [62-610.418(1) and 62-600.400(2)(b)]
6. Screenings and grit removed from the wastewater facilities shall be collected in suitable containers and hauled to a Department approved Class I landfill or to a landfill approved by the Department for receipt/disposal of screenings and grit. [62-701.300(1)(a)]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

7. Where required by Chapter 471 or Chapter 492, F.S., applicable portions of reports that must be submitted under this permit shall be signed and sealed by a professional engineer or a professional geologist, as appropriate. [62-620.310(4)]
8. The permittee shall provide adequate notice to the Department of the following:
 - a. Any new introduction of pollutants into the facility from an industrial discharger which would be subject to Chapter 403, F.S., and the requirements of Chapter 62-620, F.A.C., if it were directly discharging those pollutants; and
 - b. Any substantial change in the volume or character of pollutants being introduced into that facility by a source which was identified in the permit application and known to be discharging at the time the permit was issued.

Adequate notice shall include information on the quality and quantity of effluent introduced into the facility and any anticipated impact of the change on the quantity or quality of effluent or reclaimed water to be discharged from the facility.

[62-620.625(2)]

IX. GENERAL CONDITIONS

1. The terms, conditions, requirements, limitations, and restrictions set forth in this permit are binding and enforceable pursuant to Chapter 403, Florida Statutes. Any permit noncompliance constitutes a violation of Chapter 403, Florida Statutes, and is grounds for enforcement action, permit termination, permit revocation and reissuance, or permit revision. [62-620.610(1)]
2. This permit is valid only for the specific processes and operations applied for and indicated in the approved drawings or exhibits. Any unauthorized deviations from the approved drawings, exhibits, specifications, or conditions of this permit constitutes grounds for revocation and enforcement action by the Department. [62-620.610(2)]
3. As provided in subsection 403.087(7), F.S., the issuance of this permit does not convey any vested rights or any exclusive privileges. Neither does it authorize any injury to public or private property or any invasion of personal rights, nor authorize any infringement of federal, state, or local laws or regulations. This permit is not a waiver of or approval of any other Department permit or authorization that may be required for other aspects of the total project which are not addressed in this permit. [62-620.610(3)]
4. This permit conveys no title to land or water, does not constitute state recognition or acknowledgment of title, and does not constitute authority for the use of submerged lands unless herein provided and the necessary title or leasehold interests have been obtained from the State. Only the Trustees of the Internal Improvement Trust Fund may express State opinion as to title. [62-620.610(4)]
5. This permit does not relieve the permittee from liability and penalties for harm or injury to human health or welfare, animal or plant life, or property caused by the construction or operation of this permitted source; nor does it allow the permittee to cause pollution in contravention of Florida Statutes and Department rules, unless specifically authorized by an order from the Department. The permittee shall take all reasonable steps to minimize or prevent any discharge, reuse of reclaimed water, or residuals use or disposal in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit. [62-620.610(5)]
6. If the permittee wishes to continue an activity regulated by this permit after its expiration date, the permittee shall apply for and obtain a new permit. [62-620.610(6)]
7. The permittee shall at all times properly operate and maintain the facility and systems of treatment and control, and related appurtenances, that are installed and used by the permittee to achieve compliance with the conditions

of this permit. This provision includes the operation of backup or auxiliary facilities or similar systems when necessary to maintain or achieve compliance with the conditions of the permit. [62-620.610(7)]

8. This permit may be modified, revoked and reissued, or terminated for cause. The filing of a request by the permittee for a permit revision, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition. [62-620.610(8)]
9. The permittee, by accepting this permit, specifically agrees to allow authorized Department personnel, including an authorized representative of the Department and authorized EPA personnel, when applicable, upon presentation of credentials or other documents as may be required by law, and at reasonable times, depending upon the nature of the concern being investigated, to:
 - a. Enter upon the permittee's premises where a regulated facility, system, or activity is located or conducted, or where records shall be kept under the conditions of this permit;
 - b. Have access to and copy any records that shall be kept under the conditions of this permit;
 - c. Inspect the facilities, equipment, practices, or operations regulated or required under this permit; and
 - d. Sample or monitor any substances or parameters at any location necessary to assure compliance with this permit or Department rules.

[62-620.610(9)]

10. In accepting this permit, the permittee understands and agrees that all records, notes, monitoring data, and other information relating to the construction or operation of this permitted source which are submitted to the Department may be used by the Department as evidence in any enforcement case involving the permitted source arising under the Florida Statutes or Department rules, except as such use is proscribed by Section 403.111, F.S., or Rule 62-620.302, F.A.C. Such evidence shall only be used to the extent that it is consistent with the Florida Rules of Civil Procedure and applicable evidentiary rules. [62-620.610(10)]
11. When requested by the Department, the permittee shall within a reasonable time provide any information required by law which is needed to determine whether there is cause for revising, revoking and reissuing, or terminating this permit, or to determine compliance with the permit. The permittee shall also provide to the Department upon request copies of records required by this permit to be kept. If the permittee becomes aware of relevant facts that were not submitted or were incorrect in the permit application or in any report to the Department, such facts or information shall be promptly submitted or corrections promptly reported to the Department. [62-620.610(11)]
12. Unless specifically stated otherwise in Department rules, the permittee, in accepting this permit, agrees to comply with changes in Department rules and Florida Statutes after a reasonable time for compliance; provided, however, the permittee does not waive any other rights granted by Florida Statutes or Department rules. A reasonable time for compliance with a new or amended surface water quality standard, other than those standards addressed in Rule 62-302.500, F.A.C., shall include a reasonable time to obtain or be denied a mixing zone for the new or amended standard. [62-620.610(12)]
13. The permittee, in accepting this permit, agrees to pay the applicable regulatory program and surveillance fee in accordance with Rule 62-4.052, F.A.C. [62-620.610(13)]
14. This permit is transferable only upon Department approval in accordance with Rule 62-620.340, F.A.C. The permittee shall be liable for any noncompliance of the permitted activity until the transfer is approved by the Department. [62-620.610(14)]
15. The permittee shall give the Department written notice at least 60 days before inactivation or abandonment of a wastewater facility or activity and shall specify what steps will be taken to safeguard public health and safety during and following inactivation or abandonment. [62-620.610(15)]

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

16. The permittee shall apply for a revision to the Department permit in accordance with Rules 62-620.300, F.A.C., and the Department of Environmental Protection Guide to Permitting Wastewater Facilities or Activities Under Chapter 62-620, F.A.C., at least 90 days before construction of any planned substantial modifications to the permitted facility is to commence or with Rule 62-620.325(2), F.A.C., for minor modifications to the permitted facility. A revised permit shall be obtained before construction begins except as provided in Rule 62-620.300, F.A.C. [62-620.610(16)]
17. The permittee shall give advance notice to the Department of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements. The permittee shall be responsible for any and all damages which may result from the changes and may be subject to enforcement action by the Department for penalties or revocation of this permit. The notice shall include the following information:
- a. A description of the anticipated noncompliance;
 - b. The period of the anticipated noncompliance, including dates and times; and
 - c. Steps being taken to prevent future occurrence of the noncompliance.

[62-620.610(17)]

18. Sampling and monitoring data shall be collected and analyzed in accordance with Rule 62-4.246 and Chapters 62-160, 62-601, and 62-610, F.A.C., and 40 CFR 136, as appropriate.
- a. Monitoring results shall be reported at the intervals specified elsewhere in this permit and shall be reported on a Discharge Monitoring Report (DMR), DEP Form 62-620.910(10), or as specified elsewhere in the permit.
 - b. If the permittee monitors any contaminant more frequently than required by the permit, using Department approved test procedures, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the DMR.
 - c. Calculations for all limitations which require averaging of measurements shall use an arithmetic mean unless otherwise specified in this permit.
 - d. Except as specifically provided in Rule 62-160.300, F.A.C., any laboratory test required by this permit shall be performed by a laboratory that has been certified by the Department of Health Environmental Laboratory Certification Program (DOH ELCP). Such certification shall be for the matrix, test method and analyte(s) being measured to comply with this permit. For domestic wastewater facilities, testing for parameters listed in Rule 62-160.300(4), F.A.C., shall be conducted under the direction of a certified operator.
 - e. Field activities including on-site tests and sample collection shall follow the applicable standard operating procedures described in DEP-SOP-001/01 adopted by reference in Chapter 62-160, F.A.C.
 - f. Alternate field procedures and laboratory methods may be used where they have been approved in accordance with Rules 62-160.220, and 62-160.330, F.A.C.

[62-620.610(18)]

19. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule detailed elsewhere in this permit shall be submitted no later than 14 days following each schedule date. [62-620.610(19)]
20. The permittee shall report to the Department's South District Office any noncompliance which may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the permittee becomes aware of the circumstances. A written submission shall also be provided within five days of the time the permittee becomes aware of the circumstances. The written submission shall contain: a description of the noncompliance and its cause; the period of noncompliance including exact dates and time, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

- a. The following shall be included as information which must be reported within 24 hours under this condition:
 - (1) Any unanticipated bypass which causes any reclaimed water or effluent to exceed any permit limitation or results in an unpermitted discharge,
 - (2) Any upset which causes any reclaimed water or the effluent to exceed any limitation in the permit,
 - (3) Violation of a maximum daily discharge limitation for any of the pollutants specifically listed in the permit for such notice, and
 - (4) Any unauthorized discharge to surface or ground waters.
- b. Oral reports as required by this subsection shall be provided as follows:
 - (1) For unauthorized releases or spills of treated or untreated wastewater reported pursuant to subparagraph (a)4. that are in excess of 1,000 gallons per incident, or where information indicates that public health or the environment will be endangered, oral reports shall be provided to the STATE WARNING POINT TOLL FREE NUMBER (800) 320-0519, as soon as practical, but no later than 24 hours from the time the permittee becomes aware of the discharge. The permittee, to the extent known, shall provide the following information to the State Warning Point:
 - (a) Name, address, and telephone number of person reporting;
 - (b) Name, address, and telephone number of permittee or responsible person for the discharge;
 - (c) Date and time of the discharge and status of discharge (ongoing or ceased);
 - (d) Characteristics of the wastewater spilled or released (untreated or treated, industrial or domestic wastewater);
 - (e) Estimated amount of the discharge;
 - (f) Location or address of the discharge;
 - (g) Source and cause of the discharge;
 - (h) Whether the discharge was contained on-site, and cleanup actions taken to date;
 - (i) Description of area affected by the discharge, including name of water body affected, if any; and
 - (j) Other persons or agencies contacted.
 - (2) Oral reports, not otherwise required to be provided pursuant to subparagraph b.1 above, shall be provided to the Department's South District Office within 24 hours from the time the permittee becomes aware of the circumstances.
- c. If the oral report has been received within 24 hours, the noncompliance has been corrected, and the noncompliance did not endanger health or the environment, the Department's South District Office shall waive the written report.

[62-620.610(20)]

21. The permittee shall report all instances of noncompliance not reported under Permit Conditions IX.17., IX.18., or IX.19. of this permit at the time monitoring reports are submitted. This report shall contain the same information required by Permit Condition IX.20. of this permit. [62-620.610(21)]

22. Bypass Provisions.

- a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment works.
- b. Bypass is prohibited, and the Department may take enforcement action against a permittee for bypass, unless the permittee affirmatively demonstrates that:
 - (1) Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage; and
 - (2) There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of *reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance*; and
 - (3) The permittee submitted notices as required under Permit Condition IX.22.b. of this permit.
- c. If the permittee knows in advance of the need for a bypass, it shall submit prior notice to the Department, if possible at least 10 days before the date of the bypass. The permittee shall submit notice of an unanticipated bypass within 24 hours of learning about the bypass as required in Permit Condition IX.20. of this permit. A notice shall include a description of the bypass and its cause; the period of the bypass,

PERMITTEE: City of Clewiston
FACILITY: City of Clewiston Wastewater Treatment Plant

PERMIT NUMBER: FL0040665-014
REVISION DATE: May 27, 2011

including exact dates and times; if the bypass has not been corrected, the anticipated time it is expected to continue; and the steps taken or planned to reduce, eliminate, and prevent recurrence of the bypass.

- d. The Department shall approve an anticipated bypass, after considering its adverse effect, if the permittee demonstrates that it will meet the three conditions listed in Permit Condition IX.22.a.1. through 3. of this permit.
- e. A permittee may allow any bypass to occur which does not cause reclaimed water or effluent limitations to be exceeded if it is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of Permit Condition IX.22.a. through c. of this permit.

[62-620.610(22)]


23. Upset Provisions.

- a. "Upset" means an exceptional incident in which there is unintentional and temporary noncompliance with technology-based effluent limitations because of factors beyond the reasonable control of the permittee.
 - (1) An upset does not include noncompliance caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, careless or improper operation.
 - (2) An upset constitutes an affirmative defense to an action brought for noncompliance with technology based permit effluent limitations if the requirements of upset provisions of Rule 62-620.610, F.A.C., are met.
- b. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed contemporaneous operating logs, or other relevant evidence that:
 - (1) An upset occurred and that the permittee can identify the cause(s) of the upset;
 - (2) The permitted facility was at the time being properly operated;
 - (3) The permittee submitted notice of the upset as required in Permit Condition IX.20. of this permit; and
 - (4) The permittee complied with any remedial measures required under Permit Condition IX.5. of this permit.
- c. In any enforcement proceeding, the burden of proof for establishing the occurrence of an upset rests with the permittee.
- d. Before an enforcement proceeding is instituted, no representation made during the Department review of a claim that noncompliance was caused by an upset is final agency action subject to judicial review.

[62-620.610(23)]

Executed in Fort Myers, Florida

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION



Jon M. Iglehart
Director of
District Management

DATE: MAY 27, 2011

**PLEASE INITIAL & DATE
DRAFT INTENT PERMIT**

Date 04/06/11 Henry County - DW
By Nolin Moor Number: FL0040665-014
Project: Clewiston Expansion
DMR ATTACHED: No Log # 221
IN COMPUTER AT: 0:\DWpermits\HENRY\Clewiston14

NA NA

ENFORCEMENT

- ☐ OK
☐ Return to Permitting

MAP
4/12/11
Dh
5/25/11

GROUNDWATER

- ☒ OK
☐ Return to Permitting

Nwm pm
4/13/11 5/27/11

PERMITTING SUPERVISOR(S)

- ☐ OK
☐

JL JL
4/14/11 5/27/11

CLERICAL

- ☒ Type cover letter, permit and "conditions of permit."

TYPE FOLLOWING ENVELOPES/LABELS

- ☐ Applicant _____
☐ Engineer _____
☐ FDEP Marathon _____
☐ Other _____
☐

J.a.m. J.a.m.
4/19/2011 5/27/2011

PERMITTING SUPERVISOR(S)

- ☒ OK
☐

AA J.a.m.
4/20/11 for A.B.A.
5/27/2011

WATER FACILITIES ADMINISTRATOR

- ☒ OK
☐

DISTRICT DIRECTOR

- ☐ Check, sign permit and cover letter. If any problems, return to permitting.

JL JL
4/20/11 5/27/11

CLERICAL/MAIL

- ☒ Make 2 photocopies of cover letter, permit, and
☒ Group package for Applicant; original cover letter, and permit.
☒ Group package for Engineer; 1 copy of cover letter, and permit.
☒ Group office copies of permit, cover letter, application and supporting correspondence.
☐ Group packages of 1 copy of cover letter, and permit for:
☐ FDEP Marathon
☐ Other that is not on cc list in permit
☐ NPDES ... **SEE PERMIT WRITER TO ASSIST W/MAILING**
☐ Make new file folder for this project

LaMear, Julia

From: LaMear, Julia
Sent: Friday, May 27, 2011 9:28 AM
To: Rhodes, David; Moon, Nolin
Subject: RE: City of Clewiston
Attachments: City of Clewiston FL0040665-014 Notice Revision.pdf; City of Clewiston FL0040665-014 Permit Revision.pdf

Tracking:

Recipient
Rhodes, David
Moon, Nolin

Delivery
Delivered: 5/27/2011 9:28 AM
Delivered: 5/27/2011 9:28 AM

Julia LaMear
Administrative Assistant I
South District/Water Facilities
Florida Department of Environmental Protection
2295 Victoria Avenue, Ste 364
Fort Myers, Florida 33902
(239) 344-5658 Direct Number
(239) 344-5600 Main Number
(850) 412-0590 Fax Number

7010 1870 0001 8477 3404

U.S. Postal Service™		
CERTIFIED MAIL™ RECEIPT		
(Domestic Mail Only; No Insurance Coverage Provided)		
For delivery information visit our website at www.usps.com		
OFFICIAL USE		
Postage \$	Postmark Here	
Certified Fee		
Return Receipt Fee (Endorsement Required)		
Restrict (Endors.)	KEVIN MCCARTHY UTILITIES DIRECTOR CITY OF CLEWISTON 141 CENTRAL AVENUE CLEWISTON FL 33440	
Total		
Sent To		
Street or PO		
City, St		
PS Form 3800, August 2006		
See Reverse for Instructions		

SENDER: COMPLETE THIS SECTION	COMPLETE THIS SECTION ON DELIVERY
■ Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired. ■ Print your name and address on the reverse so that we can return the card to you. ■ Attach this card to the back of the mailpiece, or on the front if space permits.	A. Signature ☐ Agent ☐ Addressee <i>[Signature]</i> B. Received by (Printed Name) ☐ C. Date of Delivery <i>[Signature]</i> 5-31-11 D. Is delivery address different from item 1? ☐ Yes ☐ No If YES, enter delivery address below: RECEIVED JUN 02 2011
1. Article Addressed to: KEVIN MCCARTHY UTILITIES DIRECTOR CITY OF CLEWISTON 141 CENTRAL AVENUE CLEWISTON FL 33440	3. Service Type ☒ Certified Mail ☐ Express Mail ☐ Registered ☒ Return Receipt for Merchandise ☐ Insured Mail ☐ C.O.D.
2. Article Number (Transfer from) 7010 1870 0001 8477 3404	4. Restricted Delivery? (Extra Fee) ☐ Yes <i>DW/Nwm/JC</i>
PS Form 3811, February 2004 Domestic Return Receipt 102595-02-M-1540	