

APPENDIX 10.8

EMF CALCULATIONS



Report on the

Citrus County Combined Cycle Site EMF Calculations



Duke Energy

Project No. 71404

July 2014

Citrus County Combined Cycle Site EMF Calculations

Report prepared for

**Duke Energy
Charlotte, NC**

July 2014

Project No. 71404

prepared by

**Burns & McDonnell Engineering Company, Inc.
Kansas City, MO**

COPYRIGHT © 2014 BURNS & McDONNELL ENGINEERING COMPANY, INC.

INDEX AND CERTIFICATION


**Duke Energy
Citrus County Combined Cycle Site EMF Calculations
Project No. 71404**


Report Index

<u>Chapter Number</u>	<u>Chapter Title</u>	<u>Number of Pages</u>
1.0	Summary of Results	1
Exhibit A	EMF Output	83
Exhibit B	Cross Section Drawings	5

Certification

I hereby certify, as a Professional Engineer in the state of Florida, that the information in this document was assembled under my direct personal charge. This report is not intended or represented to be suitable for reuse by the Duke Energy or others without specific verification or adaptation by the Engineer.

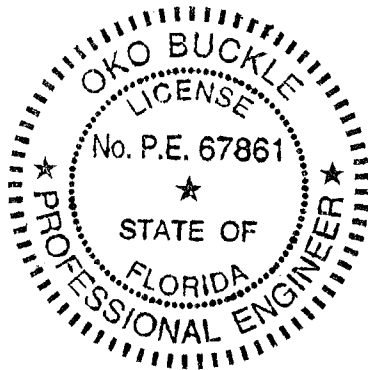


Oko Buckle, P.E. (Florida License #67861)

Date: 7/14/2014

1.0 Summary of Results

Florida Administrative Code (Rule 62-814) provides standard values that electric and magnetic field levels must meet for proposed transmission projects. For this project, the requirements state that the magnetic field levels must be 200mG or below at the edge of the transmission right-of-way or at the property boundary of a new substation. Also, 62-814 states that the electric field levels must be below 2.00 kV/m at the edge of the transmission right-of-way or at the property boundary of a new substation and must remain below 10 kV/m on the transmission line right-of-way.

Table 1. Summary of Results for EMF Calculations.					
Cross Section	Magnetic Field (mG)		Electric Field (kV/m)		
	Left Edge of ROW	Right Edge of ROW	Left Edge of ROW	Max on ROW	Right Edge of ROW
1 – Existing Corridor East of Citrus County Combined Cycle Site	45.81	16.51	0.18	7.65	0.03
2 – Proposed Corridor West of Citrus County Combined Cycle Site	42.83	6.09	0.18	7.65	0.04
3A – New Configuration Running North on West Side of Plant	0.16	52.41	0.00	5.02	0.18
3B – New Configuration Running East on North Side of Plant	189.27	3.07	0.25	5.02	0.01
3C – New Configuration Running South on East Side of Plant	4.69	52.41	0.02	5.02	0.18
4 – New Configuration Entering Station – Near Plant Access Road	0.54	5.34	0.00	7.52	0.00

2.0 Assumptions

EMF Calculations were performed based on the following assumptions:

1. All currents flow in the same direction for all circuits.
2. Conductors for 500-kV are 2-2335 kcmil ACAR per phase. The existing and proposed 230-kV conductors are 1-1590 kcmil ACSR per phase.
3. Maximum Continuous Ratings for the two conductor sizes are:
 - a. 2-2335 kcmil ACAR = 4455A
 - b. 1-1590 kcmil ACSR = 1980A
4. Existing phasing for all was provided for all circuits but the double circuit 230-kV tower on the south side of the ROW. The same phasing was assumed for these circuits as what is listed for the double circuit 230-kV towers on the north side of the ROW.
5. Phasing for the proposed configurations has been assumed.
6. Conductor height above ground has been assumed to be the minimum design clearance. For 500-kV this value is 40 feet and for 230-kV the value is 28 feet.
7. Calculated Magnetic and Electric Fields reported at one meter above ground.
8. Proposed tubular steel structures assumed to have a pole diameter of four feet.

EXHIBIT A – EMF Output

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Circuit Name	Id	Dist From Left ROW (ft)	Dist From Circuit CL (ft)	Minimum Height (ft)	SubConductors			Maximum Voltage (kV)	Angle (Degrees)	MCR (Amps)
					# of	Diameter (in)	Spacing (in)			
CR-B 500	1A1	286.00	45.00	40.00	2	1.76	18.00	550.0	0	4455
CR-B 500	1B1	241.00	0.00	40.00	2	1.76	18.00	550.0	120	4455
CR-B 500	1C1	196.00	-45.00	40.00	2	1.76	18.00	550.0	240	4455
CR-B 500	1G1	201.60	-39.40	90.00	1	0.50	0.00	0.0	0	0
CR-B 500	1G2	280.40	39.40	90.00	1	0.50	0.00	0.0	0	0
CR-CF 500	2A1	911.00	45.00	40.00	2	1.76	18.00	550.0	0	4455
CR-CF 500	2B1	866.00	0.00	40.00	2	1.76	18.00	550.0	120	4455
CR-CF 500	2C1	821.00	-45.00	40.00	2	1.76	18.00	550.0	240	4455
CR-CF 500	2G1	826.60	-39.40	90.00	1	0.50	0.00	0.0	0	0
CR-CF 500	2G2	905.40	39.40	90.00	1	0.50	0.00	0.0	0	0
CRE 230	3A1	351.00	-15.00	28.00	1	1.50	0.00	241.0	0	1980
CRE 230	3B1	343.00	-23.00	50.60	1	1.50	0.00	241.0	120	1980
CRE 230	3C1	334.80	-31.20	28.00	1	1.50	0.00	241.0	240	1980
CRE 230	3G1	351.50	-14.50	100.00	1	0.50	0.00	0.0	0	0
CR-B 230	4A1	397.20	31.20	28.00	1	1.50	0.00	241.0	0	1980
CR-B 230	4B1	389.00	23.00	50.60	1	1.50	0.00	241.0	120	1980
CR-B 230	4C1	381.00	15.00	28.00	1	1.50	0.00	241.0	240	1980
CR-B 230	4G1	380.50	14.50	100.00	1	0.50	0.00	0.0	0	0
CR-H #1	5A1	976.00	-15.00	28.00	1	1.50	0.00	241.0	0	1980
CR-H #1	5B1	968.00	-23.00	50.60	1	1.50	0.00	241.0	120	1980
CR-H #1	5C1	959.80	-31.20	28.00	1	1.50	0.00	241.0	240	1980
CR-H #1	5G1	976.50	-14.50	100.00	1	0.50	0.00	0.0	0	0
CR-H #2	6A1	1022.20	31.20	28.00	1	1.50	0.00	241.0	0	1980
CR-H #2	6B1	1014.00	23.00	50.60	1	1.50	0.00	241.0	120	1980
CR-H #2	6C1	1006.00	15.00	28.00	1	1.50	0.00	241.0	240	1980
CR-H #2	6G1	1005.50	14.50	100.00	1	0.50	0.00	0.0	0	0

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
0.00	0.18	45.81	6.00	0.20	48.02	18.00	0.23	52.98	30.00	0.27	58.80
1325.00	0.03	16.51	7.00	0.20	48.41	19.00	0.23	53.43	31.00	0.28	59.33
-4.00	0.18	44.42	8.00	0.20	48.80	20.00	0.24	53.89	32.00	0.28	59.86
-3.00	0.18	44.76	9.00	0.21	49.19	21.00	0.24	54.35	33.00	0.28	60.41
-2.00	0.18	45.11	10.00	0.21	49.59	22.00	0.24	54.82	34.00	0.29	60.96
-1.00	0.18	45.46	11.00	0.21	50.00	23.00	0.25	55.29	35.00	0.29	61.52
0.00	0.18	45.81	12.00	0.21	50.41	24.00	0.25	55.77	36.00	0.30	62.09
1.00	0.19	46.17	13.00	0.22	50.82	25.00	0.25	56.26	37.00	0.30	62.67
2.00	0.19	46.53	14.00	0.22	51.24	26.00	0.26	56.75	38.00	0.31	63.25
3.00	0.19	46.89	15.00	0.22	51.67	27.00	0.26	57.25	39.00	0.31	63.85
4.00	0.19	47.27	16.00	0.23	52.10	28.00	0.27	57.76	40.00	0.32	64.45
5.00	0.20	47.64	17.00	0.23	52.54	29.00	0.27	58.28	41.00	0.32	65.06

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
42.00	0.32	65.68	84.00	0.66	103.25	126.00	1.68	187.79	168.00	5.27	419.37
43.00	0.33	66.31	85.00	0.68	104.52	127.00	1.73	190.94	169.00	5.41	428.08
44.00	0.33	66.95	86.00	0.69	105.82	128.00	1.77	194.18	170.00	5.54	436.94
45.00	0.34	67.60	87.00	0.70	107.15	129.00	1.82	197.49	171.00	5.68	445.93
46.00	0.35	68.26	88.00	0.72	108.50	130.00	1.87	200.89	172.00	5.81	455.06
47.00	0.35	68.93	89.00	0.73	109.87	131.00	1.91	204.37	173.00	5.95	464.30
48.00	0.36	69.61	90.00	0.75	111.28	132.00	1.97	207.93	174.00	6.08	473.66
49.00	0.36	70.30	91.00	0.76	112.71	133.00	2.02	211.59	175.00	6.22	483.11
50.00	0.37	71.00	92.00	0.78	114.17	134.00	2.07	215.35	176.00	6.35	492.64
51.00	0.37	71.71	93.00	0.79	115.65	135.00	2.13	219.19	177.00	6.48	502.24
52.00	0.38	72.43	94.00	0.81	117.17	136.00	2.19	223.14	178.00	6.61	511.89
53.00	0.39	73.17	95.00	0.83	118.72	137.00	2.25	227.19	179.00	6.73	521.57
54.00	0.39	73.91	96.00	0.84	120.30	138.00	2.31	231.34	180.00	6.85	531.26
55.00	0.40	74.67	97.00	0.86	121.91	139.00	2.37	235.60	181.00	6.96	540.94
56.00	0.40	75.44	98.00	0.88	123.56	140.00	2.44	239.97	182.00	7.07	550.59
57.00	0.41	76.22	99.00	0.90	125.24	141.00	2.50	244.45	183.00	7.17	560.17
58.00	0.42	77.02	100.00	0.92	126.96	142.00	2.57	249.06	184.00	7.26	569.67
59.00	0.42	77.83	101.00	0.94	128.71	143.00	2.65	253.78	185.00	7.34	579.06
60.00	0.43	78.65	102.00	0.96	130.50	144.00	2.72	258.62	186.00	7.42	588.31
61.00	0.44	79.48	103.00	0.98	132.32	145.00	2.80	263.59	187.00	7.49	597.39
62.00	0.45	80.33	104.00	1.00	134.19	146.00	2.88	268.69	188.00	7.54	606.28
63.00	0.45	81.19	105.00	1.02	136.10	147.00	2.96	273.92	189.00	7.59	614.95
64.00	0.46	82.07	106.00	1.05	138.04	148.00	3.04	279.29	190.00	7.62	623.37
65.00	0.47	82.96	107.00	1.07	140.03	149.00	3.13	284.80	191.00	7.64	631.52
66.00	0.48	83.87	108.00	1.09	142.07	150.00	3.22	290.46	192.00	7.65	639.36
67.00	0.49	84.79	109.00	1.12	144.14	151.00	3.31	296.25	193.00	7.64	646.89
68.00	0.49	85.73	110.00	1.14	146.27	152.00	3.40	302.20	194.00	7.63	654.07
69.00	0.50	86.69	111.00	1.17	148.44	153.00	3.50	308.30	195.00	7.60	660.88
70.00	0.51	87.66	112.00	1.20	150.66	154.00	3.60	314.56	196.00	7.55	667.31
71.00	0.52	88.65	113.00	1.23	152.94	155.00	3.70	320.97	197.00	7.50	673.35
72.00	0.53	89.66	114.00	1.26	155.26	156.00	3.81	327.54	198.00	7.43	678.97
73.00	0.54	90.68	115.00	1.29	157.64	157.00	3.92	334.28	199.00	7.34	684.18
74.00	0.55	91.72	116.00	1.32	160.07	158.00	4.03	341.18	200.00	7.25	688.95
75.00	0.56	92.78	117.00	1.35	162.56	159.00	4.14	348.25	201.00	7.15	693.30
76.00	0.57	93.86	118.00	1.38	165.10	160.00	4.26	355.48	202.00	7.03	697.21
77.00	0.58	94.96	119.00	1.42	167.71	161.00	4.38	362.88	203.00	6.91	700.70
78.00	0.59	96.08	120.00	1.45	170.38	162.00	4.50	370.45	204.00	6.78	703.75
79.00	0.60	97.22	121.00	1.49	173.11	163.00	4.62	378.19	205.00	6.64	706.39
80.00	0.61	98.38	122.00	1.52	175.91	164.00	4.75	386.10	206.00	6.50	708.61
81.00	0.63	99.57	123.00	1.56	178.77	165.00	4.88	394.18	207.00	6.35	710.42
82.00	0.64	100.77	124.00	1.60	181.71	166.00	5.01	402.42	208.00	6.21	711.84
83.00	0.65	102.00	125.00	1.64	184.71	167.00	5.14	410.82	209.00	6.06	712.88

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
210.00	5.91	713.55	252.00	5.38	680.86	294.00	6.64	537.00	336.00	2.88	250.84
211.00	5.77	713.86	253.00	5.29	684.05	295.00	6.55	525.76	337.00	2.90	252.05
212.00	5.63	713.84	254.00	5.19	687.06	296.00	6.45	514.33	338.00	2.91	253.63
213.00	5.50	713.48	255.00	5.11	689.87	297.00	6.34	502.71	339.00	2.92	255.59
214.00	5.38	712.82	256.00	5.02	692.46	298.00	6.22	490.93	340.00	2.93	257.96
215.00	5.27	711.86	257.00	4.95	694.80	299.00	6.09	479.02	341.00	2.94	260.68
216.00	5.18	710.61	258.00	4.88	696.90	300.00	5.95	466.99	342.00	2.95	263.69
217.00	5.10	709.10	259.00	4.83	698.74	301.00	5.80	454.86	343.00	2.97	266.87
218.00	5.03	707.33	260.00	4.79	700.31	302.00	5.65	442.64	344.00	2.98	270.09
219.00	4.98	705.31	261.00	4.76	701.59	303.00	5.49	430.36	345.00	2.99	273.20
220.00	4.96	703.07	262.00	4.76	702.59	304.00	5.33	418.03	346.00	3.01	276.06
221.00	4.94	700.61	263.00	4.76	703.30	305.00	5.16	405.65	347.00	3.02	278.52
222.00	4.95	697.94	264.00	4.79	703.69	306.00	4.99	393.23	348.00	3.03	280.46
223.00	4.97	695.09	265.00	4.84	703.78	307.00	4.82	380.79	349.00	3.03	281.77
224.00	5.01	692.06	266.00	4.90	703.54	308.00	4.65	368.34	350.00	3.03	282.37
225.00	5.06	688.87	267.00	4.98	702.97	309.00	4.47	355.87	351.00	3.02	282.19
226.00	5.12	685.55	268.00	5.07	702.06	310.00	4.30	343.40	352.00	3.00	281.20
227.00	5.19	682.10	269.00	5.17	700.79	311.00	4.13	330.94	353.00	2.98	279.36
228.00	5.27	678.56	270.00	5.28	699.16	312.00	3.96	318.52	354.00	2.95	276.67
229.00	5.35	674.96	271.00	5.40	697.15	313.00	3.80	306.17	355.00	2.91	273.15
230.00	5.44	671.34	272.00	5.53	694.76	314.00	3.64	293.95	356.00	2.87	268.83
231.00	5.52	667.73	273.00	5.66	691.98	315.00	3.49	282.01	357.00	2.82	263.74
232.00	5.60	664.19	274.00	5.79	688.79	316.00	3.35	270.60	358.00	2.77	257.94
233.00	5.68	660.78	275.00	5.92	685.18	317.00	3.22	260.27	359.00	2.71	251.49
234.00	5.75	657.58	276.00	6.05	681.15	318.00	3.10	251.94	360.00	2.65	244.47
235.00	5.82	654.68	277.00	6.17	676.68	319.00	2.99	246.53	361.00	2.59	236.97
236.00	5.88	652.16	278.00	6.29	671.78	320.00	2.90	243.83	362.00	2.53	229.09
237.00	5.93	650.12	279.00	6.40	666.44	321.00	2.82	242.86	363.00	2.48	220.95
238.00	5.96	648.67	280.00	6.50	660.65	322.00	2.76	242.80	364.00	2.44	212.70
239.00	5.99	647.86	281.00	6.60	654.42	323.00	2.72	243.20	365.00	2.40	204.54
240.00	6.01	647.77	282.00	6.68	647.74	324.00	2.69	243.82	366.00	2.37	196.71
241.00	6.01	648.38	283.00	6.75	640.62	325.00	2.67	244.52	367.00	2.35	189.51
242.00	6.00	649.68	284.00	6.81	633.08	326.00	2.67	245.24	368.00	2.34	183.27
243.00	5.98	651.59	285.00	6.85	625.11	327.00	2.68	245.92	369.00	2.34	178.33
244.00	5.95	654.04	286.00	6.89	616.73	328.00	2.70	246.53	370.00	2.35	174.95
245.00	5.91	656.90	287.00	6.90	607.96	329.00	2.72	247.06	371.00	2.37	173.18
246.00	5.86	660.07	288.00	6.91	598.80	330.00	2.74	247.53	372.00	2.39	172.91
247.00	5.79	663.46	289.00	6.90	589.28	331.00	2.77	247.94	373.00	2.41	173.87
248.00	5.72	666.97	290.00	6.87	579.42	332.00	2.80	248.33	374.00	2.44	175.75
249.00	5.65	670.52	291.00	6.84	569.24	333.00	2.82	248.75	375.00	2.47	178.25
250.00	5.56	674.06	292.00	6.78	558.76	334.00	2.84	249.26	376.00	2.49	181.14
251.00	5.47	677.52	293.00	6.72	548.00	335.00	2.86	249.94	377.00	2.51	184.24

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
378.00	2.53	187.40	420.00	1.60	234.86	462.00	0.38	108.84	504.00	0.17	71.74
379.00	2.54	190.52	421.00	1.54	230.15	463.00	0.37	107.37	505.00	0.17	71.25
380.00	2.55	193.54	422.00	1.47	225.48	464.00	0.36	105.93	506.00	0.16	70.78
381.00	2.55	196.42	423.00	1.41	220.87	465.00	0.36	104.54	507.00	0.16	70.32
382.00	2.56	199.17	424.00	1.35	216.31	466.00	0.35	103.19	508.00	0.16	69.87
383.00	2.55	201.80	425.00	1.29	211.83	467.00	0.34	101.88	509.00	0.16	69.43
384.00	2.55	204.39	426.00	1.23	207.43	468.00	0.33	100.61	510.00	0.15	69.01
385.00	2.55	207.06	427.00	1.18	203.11	469.00	0.33	99.37	511.00	0.15	68.59
386.00	2.55	209.96	428.00	1.13	198.89	470.00	0.32	98.17	512.00	0.15	68.18
387.00	2.55	213.34	429.00	1.08	194.77	471.00	0.31	97.00	513.00	0.15	67.79
388.00	2.56	217.45	430.00	1.04	190.74	472.00	0.31	95.86	514.00	0.14	67.40
389.00	2.58	222.47	431.00	1.00	186.82	473.00	0.30	94.76	515.00	0.14	67.02
390.00	2.60	228.46	432.00	0.96	183.00	474.00	0.29	93.68	516.00	0.14	66.65
391.00	2.62	235.23	433.00	0.92	179.28	475.00	0.29	92.64	517.00	0.14	66.29
392.00	2.65	242.46	434.00	0.88	175.67	476.00	0.28	91.62	518.00	0.13	65.94
393.00	2.68	249.80	435.00	0.85	172.16	477.00	0.28	90.64	519.00	0.13	65.60
394.00	2.72	256.95	436.00	0.82	168.75	478.00	0.27	89.67	520.00	0.13	65.27
395.00	2.75	263.67	437.00	0.79	165.44	479.00	0.27	88.74	521.00	0.13	64.94
396.00	2.77	269.81	438.00	0.76	162.22	480.00	0.26	87.83	522.00	0.13	64.62
397.00	2.80	275.25	439.00	0.73	159.11	481.00	0.26	86.94	523.00	0.12	64.31
398.00	2.81	279.93	440.00	0.71	156.09	482.00	0.25	86.07	524.00	0.12	64.01
399.00	2.82	283.81	441.00	0.68	153.16	483.00	0.25	85.23	525.00	0.12	63.72
400.00	2.82	286.86	442.00	0.66	150.32	484.00	0.24	84.41	526.00	0.12	63.43
401.00	2.81	289.10	443.00	0.64	147.57	485.00	0.24	83.61	527.00	0.12	63.16
402.00	2.79	290.54	444.00	0.62	144.90	486.00	0.23	82.84	528.00	0.12	62.88
403.00	2.76	291.22	445.00	0.60	142.32	487.00	0.23	82.08	529.00	0.11	62.62
404.00	2.72	291.17	446.00	0.58	139.82	488.00	0.23	81.34	530.00	0.11	62.36
405.00	2.68	290.45	447.00	0.56	137.39	489.00	0.22	80.62	531.00	0.11	62.11
406.00	2.63	289.10	448.00	0.55	135.04	490.00	0.22	79.92	532.00	0.11	61.87
407.00	2.57	287.19	449.00	0.53	132.77	491.00	0.21	79.23	533.00	0.11	61.63
408.00	2.50	284.76	450.00	0.52	130.56	492.00	0.21	78.57	534.00	0.11	61.40
409.00	2.44	281.89	451.00	0.50	128.43	493.00	0.21	77.92	535.00	0.10	61.18
410.00	2.36	278.63	452.00	0.49	126.36	494.00	0.20	77.28	536.00	0.10	60.96
411.00	2.29	275.03	453.00	0.48	124.35	495.00	0.20	76.66	537.00	0.10	60.75
412.00	2.21	271.14	454.00	0.46	122.41	496.00	0.20	76.06	538.00	0.10	60.55
413.00	2.13	267.02	455.00	0.45	120.53	497.00	0.19	75.47	539.00	0.10	60.35
414.00	2.06	262.71	456.00	0.44	118.70	498.00	0.19	74.90	540.00	0.10	60.16
415.00	1.98	258.24	457.00	0.43	116.93	499.00	0.19	74.34	541.00	0.10	59.97
416.00	1.90	253.67	458.00	0.42	115.21	500.00	0.18	73.79	542.00	0.10	59.79
417.00	1.82	249.01	459.00	0.41	113.54	501.00	0.18	73.26	543.00	0.09	59.62
418.00	1.75	244.31	460.00	0.40	111.93	502.00	0.18	72.74	544.00	0.09	59.45
419.00	1.68	239.58	461.00	0.39	110.36	503.00	0.17	72.23	545.00	0.09	59.29

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
546.00	0.09	59.13	588.00	0.09	56.93	630.00	0.17	62.80	671.99	0.33	79.29
547.00	0.09	58.98	589.00	0.10	56.97	631.00	0.17	63.05	672.99	0.33	79.87
548.00	0.09	58.83	590.00	0.10	57.02	632.00	0.17	63.30	673.99	0.34	80.46
549.00	0.09	58.69	591.00	0.10	57.08	632.99	0.17	63.56	674.99	0.34	81.06
550.00	0.09	58.55	592.00	0.10	57.13	633.99	0.18	63.83	675.99	0.35	81.67
551.00	0.09	58.42	593.00	0.10	57.20	634.99	0.18	64.10	676.99	0.35	82.30
552.00	0.09	58.29	594.00	0.10	57.26	635.99	0.18	64.38	677.99	0.36	82.94
553.00	0.09	58.17	595.00	0.10	57.33	636.99	0.19	64.67	678.99	0.37	83.58
554.00	0.09	58.06	596.00	0.10	57.41	637.99	0.19	64.96	679.99	0.37	84.25
555.00	0.09	57.95	597.00	0.10	57.49	638.99	0.19	65.25	680.99	0.38	84.92
556.00	0.09	57.84	598.00	0.11	57.57	639.99	0.19	65.56	681.99	0.39	85.61
557.00	0.08	57.74	599.00	0.11	57.66	640.99	0.20	65.87	682.99	0.39	86.31
558.00	0.08	57.65	600.00	0.11	57.76	641.99	0.20	66.18	683.99	0.40	87.02
559.00	0.08	57.56	601.00	0.11	57.86	642.99	0.20	66.51	684.99	0.41	87.75
560.00	0.08	57.47	602.00	0.11	57.96	643.99	0.21	66.84	685.99	0.41	88.49
561.00	0.08	57.39	603.00	0.11	58.07	644.99	0.21	67.18	686.99	0.42	89.24
562.00	0.08	57.31	604.00	0.11	58.18	645.99	0.21	67.52	687.99	0.43	90.01
563.00	0.08	57.24	605.00	0.12	58.29	646.99	0.22	67.87	688.99	0.44	90.80
564.00	0.08	57.18	606.00	0.12	58.41	647.99	0.22	68.23	689.99	0.45	91.60
565.00	0.08	57.11	607.00	0.12	58.54	648.99	0.22	68.59	690.99	0.45	92.41
566.00	0.08	57.06	608.00	0.12	58.67	649.99	0.23	68.97	691.99	0.46	93.25
567.00	0.08	57.00	609.00	0.12	58.81	650.99	0.23	69.35	692.99	0.47	94.09
568.00	0.08	56.96	610.00	0.12	58.95	651.99	0.23	69.73	693.99	0.48	94.96
569.00	0.08	56.91	611.00	0.13	59.09	652.99	0.24	70.13	694.99	0.49	95.84
570.00	0.08	56.87	612.00	0.13	59.24	653.99	0.24	70.53	695.99	0.50	96.74
571.00	0.08	56.84	613.00	0.13	59.39	654.99	0.25	70.95	696.99	0.51	97.65
572.00	0.08	56.81	614.00	0.13	59.55	655.99	0.25	71.36	697.99	0.52	98.59
573.00	0.08	56.78	615.00	0.13	59.72	656.99	0.25	71.79	698.99	0.53	99.54
574.00	0.08	56.76	616.00	0.14	59.89	657.99	0.26	72.23	699.99	0.54	100.51
575.00	0.09	56.74	617.00	0.14	60.06	658.99	0.26	72.67	700.99	0.55	101.50
576.00	0.09	56.73	618.00	0.14	60.24	659.99	0.27	73.13	701.99	0.56	102.52
577.00	0.09	56.72	619.00	0.14	60.42	660.99	0.27	73.59	702.99	0.57	103.55
578.00	0.09	56.72	620.00	0.14	60.61	661.99	0.28	74.06	703.99	0.58	104.60
579.00	0.09	56.72	621.00	0.15	60.81	662.99	0.28	74.54	704.99	0.59	105.67
580.00	0.09	56.73	622.00	0.15	61.01	663.99	0.28	75.03	705.99	0.60	106.77
581.00	0.09	56.74	623.00	0.15	61.21	664.99	0.29	75.52	706.99	0.62	107.89
582.00	0.09	56.75	624.00	0.15	61.42	665.99	0.29	76.03	707.99	0.63	109.03
583.00	0.09	56.77	625.00	0.15	61.64	666.99	0.30	76.55	708.99	0.64	110.19
584.00	0.09	56.79	626.00	0.16	61.86	667.99	0.30	77.08	709.99	0.65	111.38
585.00	0.09	56.82	627.00	0.16	62.08	668.99	0.31	77.61	710.99	0.67	112.59
586.00	0.09	56.85	628.00	0.16	62.32	669.99	0.31	78.16	711.99	0.68	113.83
587.00	0.09	56.89	629.00	0.16	62.55	670.99	0.32	78.72	712.99	0.70	115.09

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
713.99	0.71	116.38	755.99	1.90	207.24	797.99	5.94	462.92	839.99	5.27	709.60
714.99	0.73	117.70	756.99	1.95	210.72	798.99	6.07	472.17	840.99	5.17	708.44
715.99	0.74	119.04	757.99	2.00	214.29	799.99	6.21	481.52	841.99	5.09	707.01
716.99	0.76	120.42	758.99	2.06	217.95	800.99	6.34	490.95	842.99	5.03	705.32
717.99	0.77	121.82	759.99	2.11	221.71	801.99	6.47	500.45	843.99	4.98	703.39
718.99	0.79	123.25	760.99	2.17	225.56	802.99	6.60	510.00	844.99	4.95	701.24
719.99	0.81	124.71	761.99	2.23	229.51	803.99	6.72	519.59	845.99	4.94	698.86
720.99	0.82	126.21	762.99	2.29	233.57	804.99	6.84	529.18	846.99	4.95	696.28
721.99	0.84	127.74	763.99	2.36	237.74	805.99	6.95	538.77	847.99	4.97	693.52
722.99	0.86	129.30	764.99	2.42	242.01	806.99	7.06	548.33	848.99	5.01	690.57
723.99	0.88	130.89	765.99	2.49	246.40	807.99	7.16	557.82	849.99	5.06	687.46
724.99	0.90	132.52	766.99	2.56	250.91	808.99	7.25	567.24	850.99	5.12	684.22
725.99	0.92	134.19	767.99	2.63	255.53	809.99	7.34	576.55	851.99	5.19	680.85
726.99	0.94	135.89	768.99	2.70	260.28	810.99	7.41	585.73	852.99	5.27	677.38
727.99	0.96	137.64	769.99	2.78	265.15	811.99	7.48	594.74	853.99	5.35	673.84
728.99	0.98	139.42	770.99	2.86	270.15	812.99	7.53	603.57	854.99	5.44	670.27
729.99	1.00	141.24	771.99	2.94	275.29	813.99	7.58	612.18	855.99	5.52	666.70
730.99	1.03	143.10	772.99	3.03	280.56	814.99	7.61	620.55	856.99	5.60	663.20
731.99	1.05	145.00	773.99	3.11	285.97	815.99	7.63	628.65	857.99	5.68	659.82
732.99	1.08	146.95	774.99	3.20	291.52	816.99	7.64	636.45	858.99	5.75	656.64
733.99	1.10	148.95	775.99	3.29	297.22	817.99	7.64	643.94	859.99	5.82	653.73
734.99	1.13	150.99	776.99	3.39	303.06	818.99	7.62	651.09	860.99	5.88	651.21
735.99	1.15	153.07	777.99	3.49	309.06	819.99	7.59	657.88	861.99	5.93	649.15
736.99	1.18	155.21	778.99	3.59	315.21	820.99	7.55	664.29	862.99	5.97	647.67
737.99	1.21	157.39	779.99	3.69	321.52	821.99	7.49	670.31	863.99	5.99	646.84
738.99	1.24	159.63	780.99	3.79	327.99	822.99	7.42	675.93	864.99	6.01	646.71
739.99	1.27	161.92	781.99	3.90	334.62	823.99	7.34	681.14	865.99	6.01	647.30
740.99	1.30	164.27	782.99	4.01	341.41	824.99	7.25	685.92	866.99	6.01	648.59
741.99	1.33	166.67	783.99	4.13	348.37	825.99	7.14	690.28	867.99	5.99	650.50
742.99	1.36	169.13	784.99	4.24	355.50	826.99	7.03	694.22	868.99	5.96	652.95
743.99	1.40	171.65	785.99	4.36	362.80	827.99	6.91	697.73	869.99	5.91	655.83
744.99	1.43	174.23	786.99	4.48	370.26	828.99	6.78	700.82	870.99	5.86	659.02
745.99	1.47	176.88	787.99	4.61	377.89	829.99	6.64	703.49	871.99	5.80	662.44
746.99	1.51	179.59	788.99	4.73	385.69	830.99	6.50	705.75	872.99	5.73	665.99
747.99	1.54	182.36	789.99	4.86	393.66	831.99	6.35	707.61	873.99	5.65	669.58
748.99	1.58	185.21	790.99	4.99	401.79	832.99	6.20	709.09	874.99	5.56	673.16
749.99	1.62	188.13	791.99	5.13	410.08	833.99	6.06	710.19	875.99	5.48	676.67
750.99	1.67	191.12	792.99	5.26	418.53	834.99	5.91	710.92	876.99	5.38	680.07
751.99	1.71	194.18	793.99	5.39	427.13	835.99	5.77	711.30	877.99	5.29	683.31
752.99	1.76	197.32	794.99	5.53	435.88	836.99	5.63	711.35	878.99	5.20	686.38
753.99	1.80	200.55	795.99	5.67	444.77	837.99	5.50	711.07	879.99	5.11	689.25
754.99	1.85	203.85	796.99	5.80	453.79	838.99	5.38	710.48	880.99	5.03	691.89

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
881.99	4.95	694.31	923.99	6.09	480.52	965.99	2.94	261.23	1007.99	2.55	202.09
882.99	4.89	696.47	924.99	5.95	468.45	966.99	2.95	264.38	1008.99	2.55	204.71
883.99	4.83	698.38	925.99	5.81	456.28	967.99	2.97	267.69	1009.99	2.55	207.39
884.99	4.79	700.01	926.99	5.65	444.01	968.99	2.98	271.02	1010.99	2.55	210.31
885.99	4.77	701.37	927.99	5.50	431.67	969.99	2.99	274.22	1011.99	2.55	213.72
886.99	4.76	702.44	928.99	5.33	419.27	970.99	3.01	277.16	1012.99	2.56	217.89
887.99	4.77	703.22	929.99	5.17	406.81	971.99	3.02	279.67	1013.99	2.58	223.06
888.99	4.80	703.69	930.99	5.00	394.32	972.99	3.03	281.65	1014.99	2.60	229.24
889.99	4.84	703.85	931.99	4.82	381.79	973.99	3.03	282.98	1015.99	2.62	236.21
890.99	4.90	703.69	932.99	4.65	369.23	974.99	3.03	283.58	1016.99	2.65	243.61
891.99	4.98	703.19	933.99	4.48	356.64	975.99	3.02	283.39	1017.99	2.69	251.06
892.99	5.07	702.36	934.99	4.30	344.04	976.99	3.00	282.37	1018.99	2.72	258.26
893.99	5.17	701.17	935.99	4.13	331.44	977.99	2.98	280.48	1019.99	2.75	264.97
894.99	5.28	699.62	936.99	3.97	318.85	978.99	2.95	277.74	1020.99	2.78	271.04
895.99	5.40	697.69	937.99	3.80	306.29	979.99	2.92	274.16	1021.99	2.80	276.38
896.99	5.53	695.38	938.99	3.65	293.83	980.99	2.87	269.76	1022.99	2.82	280.92
897.99	5.66	692.67	939.99	3.50	281.57	981.99	2.82	264.59	1023.99	2.82	284.63
898.99	5.79	689.55	940.99	3.35	269.74	982.99	2.77	258.71	1024.99	2.82	287.50
899.99	5.92	686.02	941.99	3.22	258.85	983.99	2.71	252.18	1025.99	2.81	289.54
900.99	6.05	682.06	942.99	3.10	249.89	984.99	2.65	245.08	1026.99	2.80	290.77
901.99	6.17	677.66	943.99	2.99	244.06	985.99	2.59	237.51	1027.99	2.77	291.23
902.99	6.29	672.83	944.99	2.90	241.33	986.99	2.54	229.56	1028.99	2.73	290.96
903.99	6.40	667.55	945.99	2.82	240.50	987.99	2.48	221.37	1029.99	2.69	290.00
904.99	6.50	661.82	946.99	2.76	240.61	988.99	2.44	213.09	1030.99	2.64	288.42
905.99	6.60	655.65	947.99	2.72	241.17	989.99	2.40	204.92	1031.99	2.58	286.28
906.99	6.68	649.03	948.99	2.69	241.94	990.99	2.37	197.10	1032.99	2.52	283.63
907.99	6.75	641.97	949.99	2.67	242.78	991.99	2.35	189.92	1033.99	2.45	280.53
908.99	6.81	634.47	950.99	2.67	243.63	992.99	2.34	183.71	1034.99	2.38	277.04
909.99	6.86	626.55	951.99	2.68	244.44	993.99	2.34	178.78	1035.99	2.30	273.22
910.99	6.89	618.21	952.99	2.70	245.18	994.99	2.35	175.38	1036.99	2.23	269.12
911.99	6.91	609.47	953.99	2.72	245.85	995.99	2.36	173.56	1037.99	2.15	264.79
912.99	6.91	600.34	954.99	2.74	246.45	996.99	2.39	173.22	1038.99	2.07	260.27
913.99	6.90	590.85	955.99	2.77	246.99	997.99	2.41	174.10	1039.99	1.99	255.61
914.99	6.88	581.00	956.99	2.80	247.52	998.99	2.44	175.90	1040.99	1.91	250.84
915.99	6.84	570.84	957.99	2.82	248.09	999.99	2.46	178.36	1041.99	1.84	245.99
916.99	6.79	560.37	958.99	2.84	248.74	1000.99	2.49	181.23	1042.99	1.76	241.10
917.99	6.72	549.62	959.99	2.86	249.56	1001.99	2.51	184.32	1043.98	1.69	236.20
918.99	6.65	538.61	960.99	2.88	250.62	1002.99	2.53	187.50	1044.98	1.62	231.30
919.99	6.56	527.36	961.99	2.89	251.99	1003.99	2.54	190.65	1045.98	1.55	226.42
920.99	6.46	515.91	962.99	2.91	253.72	1004.99	2.55	193.71	1046.98	1.49	221.58
921.99	6.34	504.27	963.99	2.92	255.84	1005.99	2.55	196.64	1047.98	1.43	216.80
922.99	6.22	492.47	964.99	2.93	258.36	1006.99	2.55	199.42	1048.98	1.37	212.09

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1049.98	1.31	207.45	1091.98	0.37	92.41	1133.98	0.19	55.24	1175.98	0.11	38.35
1050.98	1.25	202.90	1092.98	0.37	91.02	1134.98	0.19	54.69	1176.98	0.11	38.06
1051.98	1.20	198.44	1093.98	0.36	89.68	1135.98	0.18	54.15	1177.98	0.11	37.77
1052.98	1.15	194.07	1094.98	0.35	88.37	1136.98	0.18	53.62	1178.98	0.11	37.49
1053.98	1.11	189.80	1095.98	0.35	87.09	1137.98	0.18	53.10	1179.98	0.11	37.21
1054.98	1.06	185.64	1096.98	0.34	85.84	1138.98	0.18	52.59	1180.98	0.11	36.93
1055.98	1.02	181.58	1097.98	0.33	84.63	1139.98	0.18	52.09	1181.98	0.11	36.66
1056.98	0.98	177.62	1098.98	0.33	83.45	1140.98	0.17	51.59	1182.98	0.11	36.39
1057.98	0.94	173.77	1099.98	0.32	82.30	1141.98	0.17	51.11	1183.98	0.10	36.13
1058.98	0.91	170.02	1100.98	0.32	81.17	1142.98	0.17	50.63	1184.98	0.10	35.86
1059.98	0.87	166.38	1101.98	0.31	80.07	1143.98	0.17	50.16	1185.98	0.10	35.61
1060.98	0.84	162.84	1102.98	0.31	79.00	1144.98	0.16	49.70	1186.98	0.10	35.35
1061.98	0.81	159.41	1103.98	0.30	77.96	1145.98	0.16	49.24	1187.98	0.10	35.10
1062.98	0.78	156.07	1104.98	0.29	76.94	1146.98	0.16	48.79	1188.98	0.10	34.85
1063.98	0.76	152.83	1105.98	0.29	75.94	1147.98	0.16	48.35	1189.98	0.10	34.60
1064.98	0.73	149.68	1106.98	0.29	74.97	1148.98	0.16	47.92	1190.98	0.10	34.36
1065.98	0.71	146.63	1107.98	0.28	74.02	1149.98	0.15	47.49	1191.98	0.10	34.12
1066.98	0.69	143.67	1108.98	0.28	73.09	1150.98	0.15	47.07	1192.98	0.09	33.88
1067.98	0.67	140.80	1109.98	0.27	72.18	1151.98	0.15	46.66	1193.98	0.09	33.64
1068.98	0.65	138.02	1110.98	0.27	71.29	1152.98	0.15	46.25	1194.98	0.09	33.41
1069.98	0.63	135.32	1111.98	0.26	70.42	1153.98	0.15	45.85	1195.98	0.09	33.18
1070.98	0.61	132.70	1112.98	0.26	69.57	1154.98	0.14	45.45	1196.98	0.09	32.96
1071.98	0.59	130.16	1113.98	0.25	68.74	1155.98	0.14	45.06	1197.98	0.09	32.73
1072.98	0.58	127.69	1114.98	0.25	67.93	1156.98	0.14	44.68	1198.98	0.09	32.51
1073.98	0.56	125.30	1115.98	0.25	67.13	1157.98	0.14	44.30	1199.98	0.09	32.29
1074.98	0.55	122.98	1116.98	0.24	66.35	1158.98	0.14	43.93	1200.98	0.09	32.07
1075.98	0.53	120.73	1117.98	0.24	65.59	1159.98	0.14	43.56	1201.98	0.09	31.86
1076.98	0.52	118.55	1118.98	0.24	64.84	1160.98	0.13	43.20	1202.98	0.09	31.65
1077.98	0.51	116.43	1119.98	0.23	64.11	1161.98	0.13	42.85	1203.98	0.09	31.44
1078.98	0.49	114.37	1120.98	0.23	63.39	1162.98	0.13	42.49	1204.98	0.08	31.23
1079.98	0.48	112.37	1121.98	0.23	62.69	1163.98	0.13	42.15	1205.98	0.08	31.03
1080.98	0.47	110.44	1122.98	0.22	62.00	1164.98	0.13	41.81	1206.98	0.08	30.82
1081.98	0.46	108.55	1123.98	0.22	61.33	1165.98	0.13	41.47	1207.98	0.08	30.62
1082.98	0.45	106.73	1124.98	0.22	60.67	1166.98	0.13	41.14	1208.98	0.08	30.42
1083.98	0.44	104.95	1125.98	0.21	60.02	1167.98	0.12	40.81	1209.98	0.08	30.23
1084.98	0.43	103.22	1126.98	0.21	59.38	1168.98	0.12	40.49	1210.98	0.08	30.03
1085.98	0.42	101.55	1127.98	0.21	58.75	1169.98	0.12	40.17	1211.98	0.08	29.84
1086.98	0.41	99.91	1128.98	0.20	58.14	1170.98	0.12	39.86	1212.98	0.08	29.65
1087.98	0.40	98.33	1129.98	0.20	57.54	1171.98	0.12	39.55	1213.98	0.08	29.46
1088.98	0.40	96.79	1130.98	0.20	56.95	1172.98	0.12	39.24	1214.98	0.08	29.28
1089.98	0.39	95.29	1131.98	0.20	56.37	1173.98	0.12	38.94	1215.98	0.08	29.10
1090.98	0.38	93.83	1132.98	0.19	55.80	1174.98	0.11	38.64	1216.98	0.08	28.91

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **26** Conductors (**18** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 1- Existing Corridor East of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1217.98	0.07	28.73	1259.98	0.05	22.57	1301.98	0.04	18.31
1218.98	0.07	28.55	1260.98	0.05	22.45	1302.98	0.04	18.23
1219.98	0.07	28.38	1261.98	0.05	22.33	1303.98	0.04	18.14
1220.98	0.07	28.20	1262.98	0.05	22.21	1304.98	0.04	18.06
1221.98	0.07	28.03	1263.98	0.05	22.10	1305.98	0.04	17.98
1222.98	0.07	27.86	1264.98	0.05	21.98	1306.98	0.04	17.90
1223.98	0.07	27.69	1265.98	0.05	21.87	1307.98	0.04	17.81
1224.98	0.07	27.52	1266.98	0.05	21.75	1308.98	0.04	17.73
1225.98	0.07	27.36	1267.98	0.05	21.64	1309.98	0.04	17.65
1226.98	0.07	27.19	1268.98	0.05	21.53	1310.98	0.04	17.57
1227.98	0.07	27.03	1269.98	0.05	21.42	1311.98	0.04	17.49
1228.98	0.07	26.87	1270.98	0.05	21.31	1312.98	0.04	17.41
1229.98	0.07	26.71	1271.98	0.05	21.20	1313.98	0.04	17.33
1230.98	0.07	26.55	1272.98	0.05	21.09	1314.98	0.04	17.26
1231.98	0.07	26.40	1273.98	0.05	20.98	1315.98	0.04	17.18
1232.98	0.07	26.24	1274.98	0.05	20.88	1316.98	0.04	17.10
1233.98	0.06	26.09	1275.98	0.05	20.77	1317.98	0.04	17.03
1234.98	0.06	25.94	1276.98	0.05	20.67	1318.98	0.03	16.95
1235.98	0.06	25.79	1277.98	0.05	20.57	1319.98	0.03	16.88
1236.98	0.06	25.64	1278.98	0.05	20.46	1320.98	0.03	16.80
1237.98	0.06	25.49	1279.98	0.05	20.36	1321.98	0.03	16.73
1238.98	0.06	25.34	1280.98	0.05	20.26	1322.98	0.03	16.65
1239.98	0.06	25.20	1281.98	0.04	20.16	1323.98	0.03	16.58
1240.98	0.06	25.06	1282.98	0.04	20.06	1324.98	0.03	16.51
1241.98	0.06	24.91	1283.98	0.04	19.96	1325.98	0.03	16.44
1242.98	0.06	24.77	1284.98	0.04	19.86	1326.98	0.03	16.37
1243.98	0.06	24.63	1285.98	0.04	19.77	1327.98	0.03	16.30
1244.98	0.06	24.50	1286.98	0.04	19.67	1328.98	0.03	16.23
1245.98	0.06	24.36	1287.98	0.04	19.58	1329.98	0.03	16.16
1246.98	0.06	24.22	1288.98	0.04	19.48			
1247.98	0.06	24.09	1289.98	0.04	19.39			
1248.98	0.06	23.96	1290.98	0.04	19.29			
1249.98	0.06	23.82	1291.98	0.04	19.20			
1250.98	0.06	23.69	1292.98	0.04	19.11			
1251.98	0.06	23.56	1293.98	0.04	19.02			
1252.98	0.06	23.44	1294.98	0.04	18.93			
1253.98	0.06	23.31	1295.98	0.04	18.84			
1254.98	0.05	23.18	1296.98	0.04	18.75			
1255.98	0.05	23.06	1297.98	0.04	18.66			
1256.98	0.05	22.93	1298.98	0.04	18.57			
1257.98	0.05	22.81	1299.98	0.04	18.49			
1258.98	0.05	22.69	1300.98	0.04	18.40			

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 2- Proposed Corridor West of Citrus County Combined Cycle Site

Circuit Name	Id	Dist From Left ROW (ft)	Dist From Circuit CL (ft)	Minimum Height (ft)	SubConductors			Maximum Voltage (kV)	Angle (Degrees)	MCR (Amps)
					# of	Diameter (in)	Spacing (in)			
CR-B 500	1A1	286.00	45.00	40.00	2	1.76	18.00	550.0	0	4455
CR-B 500	1B1	241.00	0.00	40.00	2	1.76	18.00	550.0	120	4455
CR-B 500	1C1	196.00	-45.00	40.00	2	1.76	18.00	550.0	240	4455
CR-B 500	1G1	201.60	-39.40	90.00	1	0.50	0.00	0.0	0	0
CR-B 500	1G2	280.40	39.40	90.00	1	0.50	0.00	0.0	0	0
CRE 230	3A1	351.00	-15.00	28.00	1	1.50	0.00	241.0	0	1980
CRE 230	3B1	343.00	-23.00	50.60	1	1.50	0.00	241.0	120	1980
CRE 230	3C1	334.80	-31.20	28.00	1	1.50	0.00	241.0	240	1980
CRE 230	3G1	351.50	-14.50	100.00	1	0.50	0.00	0.0	0	0
CR-B 230	4A1	397.20	31.20	28.00	1	1.50	0.00	241.0	0	1980
CR-B 230	4B1	389.00	23.00	50.60	1	1.50	0.00	241.0	120	1980
CR-B 230	4C1	381.00	15.00	28.00	1	1.50	0.00	241.0	240	1980
CR-B 230	4G1	380.50	14.50	100.00	1	0.50	0.00	0.0	0	0
CR-H #1	5A1	976.00	-15.00	28.00	1	1.50	0.00	241.0	0	1980
CR-H #1	5B1	968.00	-23.00	50.60	1	1.50	0.00	241.0	120	1980
CR-H #1	5C1	959.80	-31.20	28.00	1	1.50	0.00	241.0	240	1980
CR-H #1	5G1	976.50	-14.50	100.00	1	0.50	0.00	0.0	0	0
CR-H #2	6A1	1022.20	31.20	28.00	1	1.50	0.00	241.0	0	1980
CR-H #2	6B1	1014.00	23.00	50.60	1	1.50	0.00	241.0	120	1980
CR-H #2	6C1	1006.00	15.00	28.00	1	1.50	0.00	241.0	240	1980
CR-H #2	6G1	1005.50	14.50	100.00	1	0.50	0.00	0.0	0	0

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
0.00	0.18	42.83	11.00	0.21	46.95	28.00	0.26	54.61	45.00	0.34	64.35
1325.00	0.04	6.09	12.00	0.21	47.36	29.00	0.26	55.12	46.00	0.34	65.00
-4.00	0.17	41.47	13.00	0.21	47.77	30.00	0.27	55.64	47.00	0.35	65.66
-3.00	0.17	41.80	14.00	0.22	48.18	31.00	0.27	56.16	48.00	0.35	66.34
-2.00	0.18	42.14	15.00	0.22	48.60	32.00	0.28	56.69	49.00	0.36	67.02
-1.00	0.18	42.49	16.00	0.22	49.03	33.00	0.28	57.23	50.00	0.36	67.71
0.00	0.18	42.83	17.00	0.22	49.46	34.00	0.28	57.78	51.00	0.37	68.42
1.00	0.18	43.18	18.00	0.23	49.89	35.00	0.29	58.33	52.00	0.37	69.14
2.00	0.19	43.54	19.00	0.23	50.34	36.00	0.29	58.89	53.00	0.38	69.87
3.00	0.19	43.90	20.00	0.23	50.79	37.00	0.30	59.46	54.00	0.39	70.61
4.00	0.19	44.26	21.00	0.24	51.24	38.00	0.30	60.04	55.00	0.39	71.36
5.00	0.19	44.63	22.00	0.24	51.70	39.00	0.31	60.63	56.00	0.40	72.12
6.00	0.19	45.01	23.00	0.24	52.17	40.00	0.31	61.23	57.00	0.41	72.90
7.00	0.20	45.39	24.00	0.25	52.65	41.00	0.32	61.83	58.00	0.41	73.69
8.00	0.20	45.77	25.00	0.25	53.13	42.00	0.32	62.45	59.00	0.42	74.49
9.00	0.20	46.16	26.00	0.25	53.62	43.00	0.33	63.07	60.00	0.43	75.31
10.00	0.20	46.55	27.00	0.26	54.11	44.00	0.33	63.70	61.00	0.43	76.14

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 2- Proposed Corridor West of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
62.00	0.44	76.98	104.00	1.00	130.68	146.00	2.87	265.58	188.00	7.54	606.63
63.00	0.45	77.84	105.00	1.02	132.59	147.00	2.95	270.84	189.00	7.58	615.45
64.00	0.46	78.71	106.00	1.04	134.53	148.00	3.04	276.24	190.00	7.62	624.03
65.00	0.46	79.60	107.00	1.06	136.52	149.00	3.12	281.78	191.00	7.64	632.33
66.00	0.47	80.50	108.00	1.09	138.56	150.00	3.21	287.47	192.00	7.65	640.34
67.00	0.48	81.42	109.00	1.11	140.64	151.00	3.30	293.30	193.00	7.64	648.03
68.00	0.49	82.35	110.00	1.14	142.76	152.00	3.40	299.29	194.00	7.62	655.37
69.00	0.50	83.30	111.00	1.17	144.94	153.00	3.50	305.42	195.00	7.59	662.34
70.00	0.51	84.27	112.00	1.19	147.16	154.00	3.60	311.72	196.00	7.55	668.94
71.00	0.52	85.25	113.00	1.22	149.43	155.00	3.70	318.18	197.00	7.49	675.13
72.00	0.53	86.25	114.00	1.25	151.76	156.00	3.80	324.79	198.00	7.42	680.92
73.00	0.54	87.27	115.00	1.28	154.14	157.00	3.91	331.58	199.00	7.34	686.28
74.00	0.55	88.31	116.00	1.31	156.57	158.00	4.02	338.53	200.00	7.25	691.22
75.00	0.56	89.36	117.00	1.34	159.07	159.00	4.14	345.65	201.00	7.14	695.72
76.00	0.57	90.44	118.00	1.38	161.62	160.00	4.25	352.93	202.00	7.03	699.79
77.00	0.58	91.53	119.00	1.41	164.23	161.00	4.37	360.39	203.00	6.91	703.42
78.00	0.59	92.65	120.00	1.45	166.90	162.00	4.49	368.03	204.00	6.78	706.63
79.00	0.60	93.78	121.00	1.48	169.64	163.00	4.62	375.83	205.00	6.64	709.41
80.00	0.61	94.94	122.00	1.52	172.44	164.00	4.74	383.80	206.00	6.50	711.77
81.00	0.62	96.12	123.00	1.56	175.31	165.00	4.87	391.95	207.00	6.35	713.72
82.00	0.63	97.32	124.00	1.60	178.25	166.00	5.00	400.26	208.00	6.20	715.28
83.00	0.65	98.54	125.00	1.64	181.26	167.00	5.13	408.73	209.00	6.06	716.44
84.00	0.66	99.79	126.00	1.68	184.35	168.00	5.27	417.37	210.00	5.91	717.24
85.00	0.67	101.06	127.00	1.72	187.51	169.00	5.40	426.16	211.00	5.77	717.68
86.00	0.68	102.36	128.00	1.77	190.75	170.00	5.54	435.10	212.00	5.63	717.77
87.00	0.70	103.68	129.00	1.81	194.08	171.00	5.67	444.18	213.00	5.50	717.53
88.00	0.71	105.02	130.00	1.86	197.48	172.00	5.81	453.40	214.00	5.38	716.98
89.00	0.73	106.40	131.00	1.91	200.98	173.00	5.95	462.74	215.00	5.27	716.12
90.00	0.74	107.80	132.00	1.96	204.56	174.00	6.08	472.20	216.00	5.17	714.98
91.00	0.76	109.22	133.00	2.01	208.23	175.00	6.21	481.76	217.00	5.09	713.56
92.00	0.77	110.68	134.00	2.07	211.99	176.00	6.35	491.40	218.00	5.03	711.88
93.00	0.79	112.16	135.00	2.12	215.86	177.00	6.48	501.11	219.00	4.98	709.95
94.00	0.80	113.68	136.00	2.18	219.82	178.00	6.60	510.88	220.00	4.95	707.79
95.00	0.82	115.23	137.00	2.24	223.88	179.00	6.72	520.68	221.00	4.94	705.41
96.00	0.84	116.81	138.00	2.30	228.05	180.00	6.84	530.49	222.00	4.95	702.82
97.00	0.86	118.42	139.00	2.37	232.33	181.00	6.96	540.30	223.00	4.97	700.04
98.00	0.87	120.06	140.00	2.43	236.72	182.00	7.06	550.07	224.00	5.01	697.08
99.00	0.89	121.74	141.00	2.50	241.22	183.00	7.16	559.79	225.00	5.06	693.96
100.00	0.91	123.45	142.00	2.57	245.84	184.00	7.26	569.43	226.00	5.12	690.70
101.00	0.93	125.20	143.00	2.64	250.59	185.00	7.34	578.96	227.00	5.19	687.32
102.00	0.95	126.99	144.00	2.72	255.46	186.00	7.42	588.36	228.00	5.27	683.84
103.00	0.97	128.82	145.00	2.79	260.45	187.00	7.48	597.59	229.00	5.35	680.29

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **2- Proposed Corridor West of Citrus County Combined Cycle Site**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
230.00	5.44	676.72	272.00	5.53	699.92	314.00	3.64	290.13	356.00	2.87	269.03
231.00	5.52	673.17	273.00	5.66	697.08	315.00	3.49	277.60	357.00	2.82	263.73
232.00	5.60	669.68	274.00	5.79	693.82	316.00	3.35	265.51	358.00	2.77	257.72
233.00	5.68	666.33	275.00	5.92	690.14	317.00	3.22	254.46	359.00	2.71	251.07
234.00	5.75	663.18	276.00	6.05	686.03	318.00	3.10	245.82	360.00	2.65	243.88
235.00	5.82	660.31	277.00	6.17	681.48	319.00	2.99	241.01	361.00	2.59	236.22
236.00	5.88	657.83	278.00	6.29	676.48	320.00	2.90	239.34	362.00	2.53	228.22
237.00	5.93	655.81	279.00	6.40	671.03	321.00	2.82	239.25	363.00	2.48	220.00
238.00	5.96	654.36	280.00	6.50	665.13	322.00	2.76	239.83	364.00	2.44	211.72
239.00	5.99	653.55	281.00	6.60	658.78	323.00	2.72	240.71	365.00	2.40	203.59
240.00	6.01	653.43	282.00	6.68	651.97	324.00	2.69	241.72	366.00	2.37	195.85
241.00	6.01	654.00	283.00	6.75	644.72	325.00	2.67	242.74	367.00	2.35	188.79
242.00	6.00	655.25	284.00	6.81	637.03	326.00	2.67	243.73	368.00	2.34	182.74
243.00	5.99	657.10	285.00	6.86	628.91	327.00	2.68	244.66	369.00	2.34	177.99
244.00	5.95	659.48	286.00	6.89	620.37	328.00	2.70	245.49	370.00	2.35	174.77
245.00	5.91	662.29	287.00	6.91	611.42	329.00	2.72	246.24	371.00	2.36	173.11
246.00	5.86	665.42	288.00	6.91	602.09	330.00	2.74	246.91	372.00	2.38	172.89
247.00	5.80	668.76	289.00	6.90	592.39	331.00	2.77	247.51	373.00	2.41	173.85
248.00	5.73	672.24	290.00	6.88	582.34	332.00	2.80	248.10	374.00	2.44	175.71
249.00	5.65	675.78	291.00	6.84	571.97	333.00	2.82	248.71	375.00	2.46	178.21
250.00	5.56	679.30	292.00	6.79	561.29	334.00	2.84	249.41	376.00	2.49	181.09
251.00	5.47	682.76	293.00	6.72	550.33	335.00	2.86	250.27	377.00	2.51	184.19
252.00	5.38	686.11	294.00	6.64	539.11	336.00	2.88	251.36	378.00	2.53	187.37
253.00	5.29	689.31	295.00	6.56	527.66	337.00	2.89	252.75	379.00	2.54	190.51
254.00	5.20	692.33	296.00	6.45	515.99	338.00	2.91	254.51	380.00	2.55	193.55
255.00	5.11	695.15	297.00	6.34	504.15	339.00	2.92	256.66	381.00	2.55	196.46
256.00	5.02	697.75	298.00	6.22	492.14	340.00	2.93	259.19	382.00	2.55	199.21
257.00	4.95	700.12	299.00	6.09	479.98	341.00	2.94	262.06	383.00	2.55	201.83
258.00	4.88	702.23	300.00	5.95	467.71	342.00	2.95	265.20	384.00	2.55	204.39
259.00	4.83	704.08	301.00	5.81	455.33	343.00	2.97	268.48	385.00	2.55	207.00
260.00	4.79	705.66	302.00	5.65	442.86	344.00	2.98	271.77	386.00	2.55	209.84
261.00	4.77	706.96	303.00	5.49	430.32	345.00	2.99	274.92	387.00	2.55	213.17
262.00	4.76	707.96	304.00	5.33	417.71	346.00	3.01	277.77	388.00	2.56	217.30
263.00	4.77	708.67	305.00	5.16	405.06	347.00	3.02	280.19	389.00	2.58	222.46
264.00	4.80	709.07	306.00	4.99	392.36	348.00	3.03	282.06	390.00	2.60	228.69
265.00	4.84	709.14	307.00	4.82	379.63	349.00	3.03	283.27	391.00	2.62	235.72
266.00	4.90	708.89	308.00	4.65	366.87	350.00	3.03	283.73	392.00	2.65	243.15
267.00	4.98	708.31	309.00	4.47	354.08	351.00	3.02	283.40	393.00	2.69	250.60
268.00	5.07	707.37	310.00	4.30	341.27	352.00	3.00	282.23	394.00	2.72	257.75
269.00	5.17	706.07	311.00	4.13	328.45	353.00	2.98	280.19	395.00	2.75	264.39
270.00	5.28	704.41	312.00	3.96	315.63	354.00	2.95	277.30	396.00	2.78	270.36
271.00	5.40	702.36	313.00	3.80	302.84	355.00	2.91	273.57	397.00	2.80	275.59

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **2- Proposed Corridor West of Citrus County Combined Cycle Site**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
398.00	2.81	280.00	440.00	0.73	146.82	482.00	0.29	72.51	524.00	0.16	46.04
399.00	2.82	283.58	441.00	0.71	143.77	483.00	0.29	71.57	525.00	0.16	45.62
400.00	2.82	286.31	442.00	0.69	140.82	484.00	0.28	70.66	526.00	0.16	45.22
401.00	2.81	288.21	443.00	0.67	137.95	485.00	0.28	69.76	527.00	0.16	44.82
402.00	2.79	289.31	444.00	0.65	135.18	486.00	0.27	68.89	528.00	0.16	44.43
403.00	2.77	289.63	445.00	0.63	132.48	487.00	0.27	68.03	529.00	0.16	44.04
404.00	2.73	289.23	446.00	0.61	129.87	488.00	0.26	67.19	530.00	0.15	43.66
405.00	2.69	288.16	447.00	0.59	127.34	489.00	0.26	66.38	531.00	0.15	43.29
406.00	2.63	286.46	448.00	0.58	124.88	490.00	0.26	65.58	532.00	0.15	42.92
407.00	2.58	284.21	449.00	0.56	122.50	491.00	0.25	64.79	533.00	0.15	42.55
408.00	2.51	281.47	450.00	0.55	120.19	492.00	0.25	64.03	534.00	0.15	42.20
409.00	2.44	278.28	451.00	0.53	117.95	493.00	0.25	63.28	535.00	0.15	41.85
410.00	2.37	274.71	452.00	0.52	115.77	494.00	0.24	62.54	536.00	0.14	41.50
411.00	2.30	270.81	453.00	0.51	113.66	495.00	0.24	61.82	537.00	0.14	41.16
412.00	2.22	266.64	454.00	0.49	111.62	496.00	0.23	61.12	538.00	0.14	40.82
413.00	2.14	262.25	455.00	0.48	109.63	497.00	0.23	60.43	539.00	0.14	40.49
414.00	2.07	257.68	456.00	0.47	107.70	498.00	0.23	59.76	540.00	0.14	40.16
415.00	1.99	252.96	457.00	0.46	105.83	499.00	0.23	59.09	541.00	0.14	39.84
416.00	1.91	248.15	458.00	0.45	104.01	500.00	0.22	58.45	542.00	0.14	39.53
417.00	1.84	243.27	459.00	0.44	102.24	501.00	0.22	57.81	543.00	0.13	39.21
418.00	1.76	238.35	460.00	0.43	100.52	502.00	0.22	57.19	544.00	0.13	38.91
419.00	1.69	233.41	461.00	0.42	98.86	503.00	0.21	56.58	545.00	0.13	38.60
420.00	1.62	228.49	462.00	0.41	97.24	504.00	0.21	55.98	546.00	0.13	38.30
421.00	1.55	223.59	463.00	0.41	95.66	505.00	0.21	55.39	547.00	0.13	38.01
422.00	1.49	218.73	464.00	0.40	94.13	506.00	0.21	54.81	548.00	0.13	37.72
423.00	1.42	213.94	465.00	0.39	92.64	507.00	0.20	54.25	549.00	0.13	37.43
424.00	1.36	209.21	466.00	0.38	91.19	508.00	0.20	53.69	550.00	0.13	37.15
425.00	1.31	204.57	467.00	0.38	89.78	509.00	0.20	53.15	551.00	0.12	36.87
426.00	1.25	200.01	468.00	0.37	88.41	510.00	0.19	52.61	552.00	0.12	36.60
427.00	1.20	195.54	469.00	0.36	87.07	511.00	0.19	52.09	553.00	0.12	36.33
428.00	1.15	191.17	470.00	0.36	85.77	512.00	0.19	51.57	554.00	0.12	36.06
429.00	1.10	186.90	471.00	0.35	84.51	513.00	0.19	51.06	555.00	0.12	35.80
430.00	1.06	182.73	472.00	0.34	83.27	514.00	0.19	50.57	556.00	0.12	35.54
431.00	1.02	178.67	473.00	0.34	82.07	515.00	0.18	50.08	557.00	0.12	35.28
432.00	0.98	174.72	474.00	0.33	80.90	516.00	0.18	49.60	558.00	0.12	35.03
433.00	0.94	170.87	475.00	0.33	79.76	517.00	0.18	49.12	559.00	0.12	34.78
434.00	0.91	167.12	476.00	0.32	78.65	518.00	0.18	48.66	560.00	0.12	34.53
435.00	0.87	163.49	477.00	0.31	77.56	519.00	0.17	48.20	561.00	0.11	34.29
436.00	0.84	159.95	478.00	0.31	76.50	520.00	0.17	47.76	562.00	0.11	34.05
437.00	0.81	156.52	479.00	0.30	75.47	521.00	0.17	47.32	563.00	0.11	33.81
438.00	0.78	153.19	480.00	0.30	74.46	522.00	0.17	46.88	564.00	0.11	33.58
439.00	0.76	149.95	481.00	0.29	73.47	523.00	0.17	46.46	565.00	0.11	33.35

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 2- Proposed Corridor West of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
566.00	0.11	33.12	608.00	0.08	25.74	649.99	0.07	21.27	691.99	0.07	18.67
567.00	0.11	32.90	609.00	0.08	25.60	650.99	0.07	21.18	692.99	0.07	18.63
568.00	0.11	32.68	610.00	0.08	25.47	651.99	0.07	21.10	693.99	0.07	18.59
569.00	0.11	32.46	611.00	0.08	25.34	652.99	0.07	21.03	694.99	0.07	18.55
570.00	0.11	32.24	612.00	0.08	25.21	653.99	0.07	20.95	695.99	0.07	18.51
571.00	0.11	32.03	613.00	0.08	25.08	654.99	0.07	20.87	696.99	0.07	18.47
572.00	0.10	31.82	614.00	0.08	24.96	655.99	0.07	20.79	697.99	0.07	18.43
573.00	0.10	31.61	615.00	0.08	24.83	656.99	0.07	20.72	698.99	0.07	18.40
574.00	0.10	31.41	616.00	0.08	24.71	657.99	0.07	20.64	699.99	0.07	18.36
575.00	0.10	31.20	617.00	0.08	24.58	658.99	0.07	20.57	700.99	0.07	18.32
576.00	0.10	31.00	618.00	0.08	24.46	659.99	0.07	20.50	701.99	0.07	18.29
577.00	0.10	30.81	619.00	0.08	24.34	660.99	0.07	20.43	702.99	0.07	18.26
578.00	0.10	30.61	620.00	0.08	24.23	661.99	0.07	20.36	703.99	0.07	18.22
579.00	0.10	30.42	621.00	0.08	24.11	662.99	0.07	20.29	704.99	0.07	18.19
580.00	0.10	30.23	622.00	0.08	23.99	663.99	0.07	20.22	705.99	0.07	18.16
581.00	0.10	30.04	623.00	0.08	23.88	664.99	0.07	20.15	706.99	0.07	18.13
582.00	0.10	29.85	624.00	0.08	23.77	665.99	0.07	20.09	707.99	0.07	18.10
583.00	0.10	29.67	625.00	0.08	23.66	666.99	0.07	20.02	708.99	0.07	18.07
584.00	0.10	29.49	626.00	0.08	23.55	667.99	0.07	19.96	709.99	0.07	18.04
585.00	0.10	29.31	627.00	0.08	23.44	668.99	0.07	19.89	710.99	0.07	18.02
586.00	0.10	29.13	628.00	0.08	23.33	669.99	0.07	19.83	711.99	0.07	17.99
587.00	0.09	28.96	629.00	0.08	23.22	670.99	0.07	19.77	712.99	0.07	17.97
588.00	0.09	28.79	630.00	0.08	23.12	671.99	0.07	19.71	713.99	0.07	17.94
589.00	0.09	28.62	631.00	0.08	23.02	672.99	0.07	19.65	714.99	0.07	17.92
590.00	0.09	28.45	632.00	0.08	22.91	673.99	0.07	19.59	715.99	0.07	17.90
591.00	0.09	28.28	632.99	0.08	22.81	674.99	0.07	19.53	716.99	0.07	17.88
592.00	0.09	28.12	633.99	0.08	22.71	675.99	0.07	19.47	717.99	0.07	17.85
593.00	0.09	27.95	634.99	0.08	22.61	676.99	0.07	19.42	718.99	0.08	17.84
594.00	0.09	27.79	635.99	0.08	22.51	677.99	0.07	19.36	719.99	0.08	17.82
595.00	0.09	27.64	636.99	0.07	22.42	678.99	0.07	19.31	720.99	0.08	17.80
596.00	0.09	27.48	637.99	0.07	22.32	679.99	0.07	19.25	721.99	0.08	17.78
597.00	0.09	27.32	638.99	0.07	22.23	680.99	0.07	19.20	722.99	0.08	17.77
598.00	0.09	27.17	639.99	0.07	22.14	681.99	0.07	19.15	723.99	0.08	17.75
599.00	0.09	27.02	640.99	0.07	22.04	682.99	0.07	19.10	724.99	0.08	17.74
600.00	0.09	26.87	641.99	0.07	21.95	683.99	0.07	19.05	725.99	0.08	17.73
601.00	0.09	26.72	642.99	0.07	21.86	684.99	0.07	19.00	726.99	0.08	17.71
602.00	0.09	26.58	643.99	0.07	21.77	685.99	0.07	18.95	727.99	0.08	17.70
603.00	0.09	26.43	644.99	0.07	21.69	686.99	0.07	18.90	728.99	0.08	17.69
604.00	0.09	26.29	645.99	0.07	21.60	687.99	0.07	18.85	729.99	0.08	17.68
605.00	0.09	26.15	646.99	0.07	21.52	688.99	0.07	18.81	730.99	0.08	17.68
606.00	0.08	26.01	647.99	0.07	21.43	689.99	0.07	18.76	731.99	0.08	17.67
607.00	0.08	25.87	648.99	0.07	21.35	690.99	0.07	18.72	732.99	0.08	17.66

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **2- Proposed Corridor West of Citrus County Combined Cycle Site**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
733.99	0.08	17.66	775.99	0.10	18.66	817.99	0.14	23.71	859.99	0.22	37.50
734.99	0.08	17.66	776.99	0.10	18.72	818.99	0.14	23.91	860.99	0.22	38.02
735.99	0.08	17.65	777.99	0.10	18.78	819.99	0.14	24.11	861.99	0.23	38.55
736.99	0.08	17.65	778.99	0.10	18.84	820.99	0.14	24.32	862.99	0.23	39.09
737.99	0.08	17.65	779.99	0.10	18.91	821.99	0.14	24.54	863.99	0.23	39.64
738.99	0.08	17.65	780.99	0.10	18.98	822.99	0.14	24.76	864.99	0.24	40.21
739.99	0.08	17.65	781.99	0.10	19.05	823.99	0.15	24.98	865.99	0.24	40.79
740.99	0.08	17.66	782.99	0.10	19.13	824.99	0.15	25.21	866.99	0.24	41.38
741.99	0.08	17.66	783.99	0.10	19.20	825.99	0.15	25.45	867.99	0.25	41.99
742.99	0.08	17.67	784.99	0.10	19.28	826.99	0.15	25.69	868.99	0.25	42.62
743.99	0.08	17.67	785.99	0.11	19.37	827.99	0.15	25.93	869.99	0.25	43.26
744.99	0.08	17.68	786.99	0.11	19.45	828.99	0.15	26.18	870.99	0.26	43.92
745.99	0.08	17.69	787.99	0.11	19.54	829.99	0.16	26.44	871.99	0.26	44.59
746.99	0.08	17.70	788.99	0.11	19.63	830.99	0.16	26.70	872.99	0.26	45.28
747.99	0.08	17.71	789.99	0.11	19.72	831.99	0.16	26.97	873.99	0.27	45.99
748.99	0.08	17.73	790.99	0.11	19.82	832.99	0.16	27.24	874.99	0.27	46.71
749.99	0.08	17.74	791.99	0.11	19.92	833.99	0.16	27.52	875.99	0.28	47.46
750.99	0.09	17.76	792.99	0.11	20.02	834.99	0.16	27.81	876.99	0.28	48.22
751.99	0.09	17.77	793.99	0.11	20.13	835.99	0.17	28.10	877.99	0.28	49.01
752.99	0.09	17.79	794.99	0.11	20.23	836.99	0.17	28.40	878.99	0.29	49.81
753.99	0.09	17.81	795.99	0.11	20.35	837.99	0.17	28.71	879.99	0.29	50.64
754.99	0.09	17.83	796.99	0.11	20.46	838.99	0.17	29.02	880.99	0.30	51.49
755.99	0.09	17.85	797.99	0.12	20.58	839.99	0.17	29.34	881.99	0.30	52.36
756.99	0.09	17.88	798.99	0.12	20.70	840.99	0.18	29.67	882.99	0.31	53.25
757.99	0.09	17.90	799.99	0.12	20.82	841.99	0.18	30.00	883.99	0.31	54.17
758.99	0.09	17.93	800.99	0.12	20.95	842.99	0.18	30.34	884.99	0.32	55.12
759.99	0.09	17.96	801.99	0.12	21.08	843.99	0.18	30.69	885.99	0.32	56.09
760.99	0.09	17.99	802.99	0.12	21.22	844.99	0.18	31.05	886.99	0.33	57.08
761.99	0.09	18.02	803.99	0.12	21.36	845.99	0.19	31.41	887.99	0.33	58.11
762.99	0.09	18.05	804.99	0.12	21.50	846.99	0.19	31.79	888.99	0.34	59.16
763.99	0.09	18.09	805.99	0.12	21.65	847.99	0.19	32.17	889.99	0.35	60.24
764.99	0.09	18.13	806.99	0.12	21.80	848.99	0.19	32.56	890.99	0.35	61.35
765.99	0.09	18.16	807.99	0.13	21.95	849.99	0.19	32.96	891.99	0.36	62.50
766.99	0.09	18.21	808.99	0.13	22.11	850.99	0.20	33.37	892.99	0.37	63.68
767.99	0.09	18.25	809.99	0.13	22.27	851.99	0.20	33.79	893.99	0.37	64.89
768.99	0.09	18.29	810.99	0.13	22.43	852.99	0.20	34.22	894.99	0.38	66.14
769.99	0.09	18.34	811.99	0.13	22.60	853.99	0.20	34.65	895.99	0.39	67.42
770.99	0.10	18.39	812.99	0.13	22.78	854.99	0.21	35.10	896.99	0.39	68.74
771.99	0.10	18.44	813.99	0.13	22.95	855.99	0.21	35.56	897.99	0.40	70.10
772.99	0.10	18.49	814.99	0.13	23.14	856.99	0.21	36.03	898.99	0.41	71.50
773.99	0.10	18.54	815.99	0.14	23.32	857.99	0.21	36.51	899.99	0.42	72.94
774.99	0.10	18.60	816.99	0.14	23.51	858.99	0.22	37.00	900.99	0.43	74.43

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 2- Proposed Corridor West of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
901.99	0.44	75.96	943.99	2.05	201.99	985.99	2.28	155.44	1027.99	2.67	238.74
902.99	0.45	77.54	944.99	2.13	206.25	986.99	2.25	150.67	1028.99	2.63	236.16
903.99	0.46	79.16	945.99	2.20	210.42	987.99	2.23	146.70	1029.99	2.59	233.27
904.99	0.47	80.84	946.99	2.28	214.50	988.99	2.21	143.69	1030.99	2.54	230.11
905.99	0.48	82.56	947.99	2.35	218.45	989.99	2.19	141.80	1031.99	2.48	226.68
906.99	0.49	84.34	948.99	2.42	222.23	990.99	2.19	141.13	1032.99	2.42	223.04
907.99	0.51	86.18	949.99	2.48	225.83	991.99	2.19	141.72	1033.99	2.35	219.20
908.99	0.52	88.07	950.99	2.54	229.20	992.99	2.21	143.53	1034.99	2.28	215.20
909.99	0.54	90.02	951.99	2.59	232.32	993.99	2.23	146.46	1035.99	2.21	211.08
910.99	0.55	92.03	952.99	2.63	235.16	994.99	2.25	150.37	1036.99	2.13	206.85
911.99	0.57	94.11	953.99	2.67	237.69	995.99	2.28	155.10	1037.99	2.06	202.55
912.99	0.58	96.25	954.99	2.69	239.90	996.99	2.32	160.46	1038.99	1.98	198.20
913.99	0.60	98.46	955.99	2.71	241.78	997.99	2.35	166.29	1039.99	1.90	193.82
914.99	0.62	100.73	956.99	2.72	243.31	998.99	2.39	172.43	1040.99	1.82	189.44
915.99	0.64	103.08	957.99	2.72	244.51	999.99	2.42	178.76	1041.99	1.75	185.08
916.99	0.67	105.51	958.99	2.71	245.39	1000.99	2.45	185.14	1042.99	1.67	180.74
917.99	0.69	108.01	959.99	2.70	245.98	1001.99	2.47	191.48	1043.98	1.60	176.44
918.99	0.71	110.58	960.99	2.68	246.31	1002.99	2.49	197.69	1044.98	1.53	172.19
919.99	0.74	113.24	961.99	2.65	246.40	1003.99	2.50	203.68	1045.98	1.47	168.01
920.99	0.77	115.98	962.99	2.62	246.27	1004.99	2.51	209.39	1046.98	1.40	163.90
921.99	0.80	118.81	963.99	2.59	245.93	1005.99	2.51	214.78	1047.98	1.34	159.87
922.99	0.83	121.72	964.99	2.56	245.35	1006.99	2.51	219.78	1048.98	1.28	155.92
923.99	0.86	124.72	965.99	2.53	244.51	1007.99	2.50	224.37	1049.98	1.22	152.06
924.99	0.90	127.81	966.99	2.51	243.38	1008.99	2.49	228.53	1050.98	1.17	148.29
925.99	0.94	130.99	967.99	2.49	241.90	1009.99	2.49	232.23	1051.98	1.12	144.61
926.99	0.98	134.26	968.99	2.48	240.05	1010.99	2.48	235.48	1052.98	1.07	141.02
927.99	1.02	137.62	969.99	2.48	237.80	1011.99	2.48	238.29	1053.98	1.02	137.53
928.99	1.07	141.08	970.99	2.48	235.10	1012.99	2.48	240.66	1054.98	0.98	134.13
929.99	1.12	144.64	971.99	2.48	231.95	1013.99	2.49	242.62	1055.98	0.94	130.83
930.99	1.17	148.28	972.99	2.49	228.35	1014.99	2.51	244.20	1056.98	0.90	127.62
931.99	1.22	152.02	973.99	2.50	224.29	1015.99	2.53	245.44	1057.98	0.87	124.50
932.99	1.28	155.84	974.99	2.51	219.79	1016.99	2.56	246.37	1058.98	0.83	121.47
933.99	1.34	159.75	975.99	2.51	214.86	1017.99	2.59	247.03	1059.98	0.80	118.53
934.99	1.40	163.75	976.99	2.51	209.55	1018.99	2.62	247.43	1060.98	0.77	115.67
935.99	1.46	167.82	977.99	2.50	203.90	1019.99	2.65	247.61	1061.98	0.74	112.91
936.99	1.53	171.96	978.99	2.49	197.96	1020.99	2.68	247.54	1062.98	0.72	110.22
937.99	1.60	176.16	979.99	2.47	191.80	1021.99	2.70	247.22	1063.98	0.69	107.62
938.99	1.67	180.41	980.99	2.45	185.49	1022.99	2.71	246.62	1064.98	0.67	105.09
939.99	1.74	184.71	981.99	2.42	179.13	1023.99	2.72	245.71	1065.98	0.64	102.64
940.99	1.82	189.03	982.99	2.39	172.82	1024.99	2.72	244.48	1066.98	0.62	100.27
941.99	1.90	193.36	983.99	2.35	166.67	1025.99	2.71	242.91	1067.98	0.60	97.97
942.99	1.97	197.69	984.99	2.32	160.83	1026.99	2.70	241.00	1068.98	0.59	95.74

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 2- Proposed Corridor West of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1069.98	0.57	93.57	1111.98	0.25	41.85	1153.98	0.14	23.50	1195.98	0.09	15.12
1070.98	0.55	91.47	1112.98	0.25	41.19	1154.98	0.14	23.22	1196.98	0.09	14.98
1071.98	0.54	89.44	1113.98	0.24	40.55	1155.98	0.14	22.95	1197.98	0.09	14.84
1072.98	0.52	87.46	1114.98	0.24	39.92	1156.98	0.14	22.68	1198.98	0.09	14.70
1073.98	0.51	85.55	1115.98	0.23	39.30	1157.98	0.14	22.42	1199.98	0.09	14.57
1074.98	0.49	83.69	1116.98	0.23	38.70	1158.98	0.14	22.16	1200.98	0.09	14.44
1075.98	0.48	81.89	1117.98	0.23	38.11	1159.98	0.14	21.91	1201.98	0.09	14.31
1076.98	0.47	80.14	1118.98	0.22	37.54	1160.98	0.13	21.66	1202.98	0.09	14.18
1077.98	0.46	78.45	1119.98	0.22	36.97	1161.98	0.13	21.42	1203.98	0.09	14.05
1078.98	0.45	76.80	1120.98	0.22	36.42	1162.98	0.13	21.18	1204.98	0.09	13.93
1079.98	0.44	75.20	1121.98	0.22	35.89	1163.98	0.13	20.94	1205.98	0.09	13.80
1080.98	0.43	73.65	1122.98	0.21	35.36	1164.98	0.13	20.71	1206.98	0.08	13.68
1081.98	0.42	72.14	1123.98	0.21	34.85	1165.98	0.13	20.49	1207.98	0.08	13.56
1082.98	0.41	70.68	1124.98	0.21	34.35	1166.98	0.13	20.26	1208.98	0.08	13.44
1083.98	0.40	69.26	1125.98	0.20	33.85	1167.98	0.12	20.04	1209.98	0.08	13.33
1084.98	0.39	67.88	1126.98	0.20	33.37	1168.98	0.12	19.83	1210.98	0.08	13.21
1085.98	0.39	66.54	1127.98	0.20	32.90	1169.98	0.12	19.61	1211.98	0.08	13.10
1086.98	0.38	65.23	1128.98	0.20	32.44	1170.98	0.12	19.40	1212.98	0.08	12.99
1087.98	0.37	63.96	1129.98	0.19	31.99	1171.98	0.12	19.20	1213.98	0.08	12.88
1088.98	0.36	62.73	1130.98	0.19	31.55	1172.98	0.12	18.99	1214.98	0.08	12.77
1089.98	0.36	61.53	1131.98	0.19	31.12	1173.98	0.12	18.80	1215.98	0.08	12.66
1090.98	0.35	60.37	1132.98	0.19	30.69	1174.98	0.12	18.60	1216.98	0.08	12.55
1091.98	0.34	59.24	1133.98	0.18	30.28	1175.98	0.11	18.41	1217.98	0.08	12.45
1092.98	0.34	58.13	1134.98	0.18	29.87	1176.98	0.11	18.22	1218.98	0.08	12.35
1093.98	0.33	57.06	1135.98	0.18	29.47	1177.98	0.11	18.03	1219.98	0.08	12.24
1094.98	0.33	56.02	1136.98	0.18	29.08	1178.98	0.11	17.85	1220.98	0.08	12.14
1095.98	0.32	55.00	1137.98	0.17	28.70	1179.98	0.11	17.67	1221.98	0.07	12.04
1096.98	0.32	54.01	1138.98	0.17	28.33	1180.98	0.11	17.49	1222.98	0.07	11.95
1097.98	0.31	53.05	1139.98	0.17	27.96	1181.98	0.11	17.31	1223.98	0.07	11.85
1098.98	0.30	52.11	1140.98	0.17	27.60	1182.98	0.11	17.14	1224.98	0.07	11.75
1099.98	0.30	51.19	1141.98	0.17	27.25	1183.98	0.11	16.97	1225.98	0.07	11.66
1100.98	0.29	50.30	1142.98	0.16	26.90	1184.98	0.10	16.80	1226.98	0.07	11.57
1101.98	0.29	49.43	1143.98	0.16	26.56	1185.98	0.10	16.64	1227.98	0.07	11.47
1102.98	0.29	48.59	1144.98	0.16	26.23	1186.98	0.10	16.47	1228.98	0.07	11.38
1103.98	0.28	47.76	1145.98	0.16	25.90	1187.98	0.10	16.31	1229.98	0.07	11.29
1104.98	0.28	46.96	1146.98	0.16	25.58	1188.98	0.10	16.16	1230.98	0.07	11.20
1105.98	0.27	46.17	1147.98	0.15	25.27	1189.98	0.10	16.00	1231.98	0.07	11.12
1106.98	0.27	45.41	1148.98	0.15	24.96	1190.98	0.10	15.85	1232.98	0.07	11.03
1107.98	0.26	44.66	1149.98	0.15	24.65	1191.98	0.10	15.70	1233.98	0.07	10.95
1108.98	0.26	43.94	1150.98	0.15	24.36	1192.98	0.10	15.55	1234.98	0.07	10.86
1109.98	0.26	43.22	1151.98	0.15	24.07	1193.98	0.10	15.40	1235.98	0.07	10.78
1110.98	0.25	42.53	1152.98	0.15	23.78	1194.98	0.09	15.26	1236.98	0.07	10.70

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **21** Conductors (**15** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 2- Proposed Corridor West of Citrus County Combined Cycle Site

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1237.98	0.07	10.61	1279.98	0.05	7.92	1321.98	0.04	6.19
1238.98	0.07	10.53	1280.98	0.05	7.87	1322.98	0.04	6.16
1239.98	0.06	10.45	1281.98	0.05	7.82	1323.98	0.04	6.12
1240.98	0.06	10.38	1282.98	0.05	7.77	1324.98	0.04	6.09
1241.98	0.06	10.30	1283.98	0.05	7.72	1325.98	0.04	6.06
1242.98	0.06	10.22	1284.98	0.05	7.67	1326.98	0.04	6.03
1243.98	0.06	10.15	1285.98	0.05	7.63	1327.98	0.04	5.99
1244.98	0.06	10.07	1286.98	0.05	7.58	1328.98	0.04	5.96
1245.98	0.06	10.00	1287.98	0.05	7.53	1329.98	0.04	5.93
1246.98	0.06	9.92	1288.98	0.05	7.48			
1247.98	0.06	9.85	1289.98	0.05	7.44			
1248.98	0.06	9.78	1290.98	0.05	7.39			
1249.98	0.06	9.71	1291.98	0.04	7.35			
1250.98	0.06	9.64	1292.98	0.04	7.30			
1251.98	0.06	9.57	1293.98	0.04	7.26			
1252.98	0.06	9.50	1294.98	0.04	7.22			
1253.98	0.06	9.43	1295.98	0.04	7.17			
1254.98	0.06	9.37	1296.98	0.04	7.13			
1255.98	0.06	9.30	1297.98	0.04	7.09			
1256.98	0.06	9.24	1298.98	0.04	7.05			
1257.98	0.06	9.17	1299.98	0.04	7.01			
1258.98	0.06	9.11	1300.98	0.04	6.96			
1259.98	0.06	9.05	1301.98	0.04	6.92			
1260.98	0.06	8.98	1302.98	0.04	6.88			
1261.98	0.05	8.92	1303.98	0.04	6.84			
1262.98	0.05	8.86	1304.98	0.04	6.80			
1263.98	0.05	8.80	1305.98	0.04	6.77			
1264.98	0.05	8.74	1306.98	0.04	6.73			
1265.98	0.05	8.68	1307.98	0.04	6.69			
1266.98	0.05	8.62	1308.98	0.04	6.65			
1267.98	0.05	8.57	1309.98	0.04	6.61			
1268.98	0.05	8.51	1310.98	0.04	6.58			
1269.98	0.05	8.45	1311.98	0.04	6.54			
1270.98	0.05	8.40	1312.98	0.04	6.50			
1271.98	0.05	8.34	1313.98	0.04	6.47			
1272.98	0.05	8.29	1314.98	0.04	6.43			
1273.98	0.05	8.23	1315.98	0.04	6.39			
1274.98	0.05	8.18	1316.98	0.04	6.36			
1275.98	0.05	8.13	1317.98	0.04	6.32			
1276.98	0.05	8.07	1318.98	0.04	6.29			
1277.98	0.05	8.02	1319.98	0.04	6.26			
1278.98	0.05	7.97	1320.98	0.04	6.22			

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Circuit Name	Id	Dist From Left ROW (ft)	Dist From Circuit CL (ft)	Minimum Height (ft)	SubConductors			Maximum Voltage (kV)	Angle (Degrees)	MCR (Amps)
					# of	Diameter (in)	Spacing (in)			
230-1	1A1	2946.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-1	1B1	2946.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-1	1C1	2946.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-1	1G1	2949.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-2	2A1	2963.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-2	2B1	2963.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-2	2C1	2963.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-2	2G1	2961.00	6.00	90.00	1	0.50	0.00	0.0	0	0
230-3	3A1	3071.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-3	3B1	3071.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-3	3C1	3071.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-3	3G1	3074.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-4	4A1	3088.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-4	4B1	3088.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-4	4C1	3088.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-4	4G1	3086.00	6.00	90.00	1	0.50	0.00	0.0	0	0

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
0.00	0.00	0.16	16.00	0.00	0.16	38.00	0.00	0.16	60.00	0.00	0.16
3205.00	0.18	52.41	17.00	0.00	0.16	39.00	0.00	0.16	61.00	0.00	0.16
-4.00	0.00	0.16	18.00	0.00	0.16	40.00	0.00	0.16	62.00	0.00	0.17
-3.00	0.00	0.16	19.00	0.00	0.16	41.00	0.00	0.16	63.00	0.00	0.17
-2.00	0.00	0.16	20.00	0.00	0.16	42.00	0.00	0.16	64.00	0.00	0.17
-1.00	0.00	0.16	21.00	0.00	0.16	43.00	0.00	0.16	65.00	0.00	0.17
0.00	0.00	0.16	22.00	0.00	0.16	44.00	0.00	0.16	66.00	0.00	0.17
1.00	0.00	0.16	23.00	0.00	0.16	45.00	0.00	0.16	67.00	0.00	0.17
2.00	0.00	0.16	24.00	0.00	0.16	46.00	0.00	0.16	68.00	0.00	0.17
3.00	0.00	0.16	25.00	0.00	0.16	47.00	0.00	0.16	69.00	0.00	0.17
4.00	0.00	0.16	26.00	0.00	0.16	48.00	0.00	0.16	70.00	0.00	0.17
5.00	0.00	0.16	27.00	0.00	0.16	49.00	0.00	0.16	71.00	0.00	0.17
6.00	0.00	0.16	28.00	0.00	0.16	50.00	0.00	0.16	72.00	0.00	0.17
7.00	0.00	0.16	29.00	0.00	0.16	51.00	0.00	0.16	73.00	0.00	0.17
8.00	0.00	0.16	30.00	0.00	0.16	52.00	0.00	0.16	74.00	0.00	0.17
9.00	0.00	0.16	31.00	0.00	0.16	53.00	0.00	0.16	75.00	0.00	0.17
10.00	0.00	0.16	32.00	0.00	0.16	54.00	0.00	0.16	76.00	0.00	0.17
11.00	0.00	0.16	33.00	0.00	0.16	55.00	0.00	0.16	77.00	0.00	0.17
12.00	0.00	0.16	34.00	0.00	0.16	56.00	0.00	0.16	78.00	0.00	0.17
13.00	0.00	0.16	35.00	0.00	0.16	57.00	0.00	0.16	79.00	0.00	0.17
14.00	0.00	0.16	36.00	0.00	0.16	58.00	0.00	0.16	80.00	0.00	0.17
15.00	0.00	0.16	37.00	0.00	0.16	59.00	0.00	0.16	81.00	0.00	0.17

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
82.00	0.00	0.17	124.00	0.00	0.17	166.00	0.00	0.18	208.00	0.00	0.18
83.00	0.00	0.17	125.00	0.00	0.17	167.00	0.00	0.18	209.00	0.00	0.18
84.00	0.00	0.17	126.00	0.00	0.17	168.00	0.00	0.18	210.00	0.00	0.18
85.00	0.00	0.17	127.00	0.00	0.17	169.00	0.00	0.18	211.00	0.00	0.18
86.00	0.00	0.17	128.00	0.00	0.17	170.00	0.00	0.18	212.00	0.00	0.18
87.00	0.00	0.17	129.00	0.00	0.17	171.00	0.00	0.18	213.00	0.00	0.18
88.00	0.00	0.17	130.00	0.00	0.17	172.00	0.00	0.18	214.00	0.00	0.18
89.00	0.00	0.17	131.00	0.00	0.17	173.00	0.00	0.18	215.00	0.00	0.18
90.00	0.00	0.17	132.00	0.00	0.17	174.00	0.00	0.18	216.00	0.00	0.18
91.00	0.00	0.17	133.00	0.00	0.17	175.00	0.00	0.18	217.00	0.00	0.18
92.00	0.00	0.17	134.00	0.00	0.17	176.00	0.00	0.18	218.00	0.00	0.18
93.00	0.00	0.17	135.00	0.00	0.17	177.00	0.00	0.18	219.00	0.00	0.18
94.00	0.00	0.17	136.00	0.00	0.17	178.00	0.00	0.18	220.00	0.00	0.18
95.00	0.00	0.17	137.00	0.00	0.17	179.00	0.00	0.18	221.00	0.00	0.18
96.00	0.00	0.17	138.00	0.00	0.17	180.00	0.00	0.18	222.00	0.00	0.18
97.00	0.00	0.17	139.00	0.00	0.17	181.00	0.00	0.18	223.00	0.00	0.18
98.00	0.00	0.17	140.00	0.00	0.17	182.00	0.00	0.18	224.00	0.00	0.18
99.00	0.00	0.17	141.00	0.00	0.17	183.00	0.00	0.18	225.00	0.00	0.18
100.00	0.00	0.17	142.00	0.00	0.17	184.00	0.00	0.18	226.00	0.00	0.19
101.00	0.00	0.17	143.00	0.00	0.17	185.00	0.00	0.18	227.00	0.00	0.19
102.00	0.00	0.17	144.00	0.00	0.17	186.00	0.00	0.18	228.00	0.00	0.19
103.00	0.00	0.17	145.00	0.00	0.17	187.00	0.00	0.18	229.00	0.00	0.19
104.00	0.00	0.17	146.00	0.00	0.17	188.00	0.00	0.18	230.00	0.00	0.19
105.00	0.00	0.17	147.00	0.00	0.17	189.00	0.00	0.18	231.00	0.00	0.19
106.00	0.00	0.17	148.00	0.00	0.18	190.00	0.00	0.18	232.00	0.00	0.19
107.00	0.00	0.17	149.00	0.00	0.18	191.00	0.00	0.18	233.00	0.00	0.19
108.00	0.00	0.17	150.00	0.00	0.18	192.00	0.00	0.18	234.00	0.00	0.19
109.00	0.00	0.17	151.00	0.00	0.18	193.00	0.00	0.18	235.00	0.00	0.19
110.00	0.00	0.17	152.00	0.00	0.18	194.00	0.00	0.18	236.00	0.00	0.19
111.00	0.00	0.17	153.00	0.00	0.18	195.00	0.00	0.18	237.00	0.00	0.19
112.00	0.00	0.17	154.00	0.00	0.18	196.00	0.00	0.18	238.00	0.00	0.19
113.00	0.00	0.17	155.00	0.00	0.18	197.00	0.00	0.18	239.00	0.00	0.19
114.00	0.00	0.17	156.00	0.00	0.18	198.00	0.00	0.18	240.00	0.00	0.19
115.00	0.00	0.17	157.00	0.00	0.18	199.00	0.00	0.18	241.00	0.00	0.19
116.00	0.00	0.17	158.00	0.00	0.18	200.00	0.00	0.18	242.00	0.00	0.19
117.00	0.00	0.17	159.00	0.00	0.18	201.00	0.00	0.18	243.00	0.00	0.19
118.00	0.00	0.17	160.00	0.00	0.18	202.00	0.00	0.18	244.00	0.00	0.19
119.00	0.00	0.17	161.00	0.00	0.18	203.00	0.00	0.18	245.00	0.00	0.19
120.00	0.00	0.17	162.00	0.00	0.18	204.00	0.00	0.18	246.00	0.00	0.19
121.00	0.00	0.17	163.00	0.00	0.18	205.00	0.00	0.18	247.00	0.00	0.19
122.00	0.00	0.17	164.00	0.00	0.18	206.00	0.00	0.18	248.00	0.00	0.19
123.00	0.00	0.17	165.00	0.00	0.18	207.00	0.00	0.18	249.00	0.00	0.19

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
250.00	0.00	0.19	292.00	0.00	0.19	334.00	0.00	0.20	376.00	0.00	0.21
251.00	0.00	0.19	293.00	0.00	0.19	335.00	0.00	0.20	377.00	0.00	0.21
252.00	0.00	0.19	294.00	0.00	0.19	336.00	0.00	0.20	378.00	0.00	0.21
253.00	0.00	0.19	295.00	0.00	0.19	337.00	0.00	0.20	379.00	0.00	0.21
254.00	0.00	0.19	296.00	0.00	0.19	338.00	0.00	0.20	380.00	0.00	0.21
255.00	0.00	0.19	297.00	0.00	0.19	339.00	0.00	0.20	381.00	0.00	0.21
256.00	0.00	0.19	298.00	0.00	0.19	340.00	0.00	0.20	382.00	0.00	0.21
257.00	0.00	0.19	299.00	0.00	0.20	341.00	0.00	0.20	383.00	0.00	0.21
258.00	0.00	0.19	300.00	0.00	0.20	342.00	0.00	0.20	384.00	0.00	0.21
259.00	0.00	0.19	301.00	0.00	0.20	343.00	0.00	0.20	385.00	0.00	0.21
260.00	0.00	0.19	302.00	0.00	0.20	344.00	0.00	0.20	386.00	0.00	0.21
261.00	0.00	0.19	303.00	0.00	0.20	345.00	0.00	0.20	387.00	0.00	0.21
262.00	0.00	0.19	304.00	0.00	0.20	346.00	0.00	0.20	388.00	0.00	0.21
263.00	0.00	0.19	305.00	0.00	0.20	347.00	0.00	0.20	389.00	0.00	0.21
264.00	0.00	0.19	306.00	0.00	0.20	348.00	0.00	0.20	390.00	0.00	0.21
265.00	0.00	0.19	307.00	0.00	0.20	349.00	0.00	0.20	391.00	0.00	0.21
266.00	0.00	0.19	308.00	0.00	0.20	350.00	0.00	0.20	392.00	0.00	0.21
267.00	0.00	0.19	309.00	0.00	0.20	351.00	0.00	0.20	393.00	0.00	0.21
268.00	0.00	0.19	310.00	0.00	0.20	352.00	0.00	0.20	394.00	0.00	0.21
269.00	0.00	0.19	311.00	0.00	0.20	353.00	0.00	0.20	395.00	0.00	0.21
270.00	0.00	0.19	312.00	0.00	0.20	354.00	0.00	0.20	396.00	0.00	0.21
271.00	0.00	0.19	313.00	0.00	0.20	355.00	0.00	0.20	397.00	0.00	0.21
272.00	0.00	0.19	314.00	0.00	0.20	356.00	0.00	0.20	398.00	0.00	0.21
273.00	0.00	0.19	315.00	0.00	0.20	357.00	0.00	0.20	399.00	0.00	0.21
274.00	0.00	0.19	316.00	0.00	0.20	358.00	0.00	0.20	400.00	0.00	0.21
275.00	0.00	0.19	317.00	0.00	0.20	359.00	0.00	0.20	401.00	0.00	0.21
276.00	0.00	0.19	318.00	0.00	0.20	360.00	0.00	0.20	402.00	0.00	0.21
277.00	0.00	0.19	319.00	0.00	0.20	361.00	0.00	0.20	403.00	0.00	0.21
278.00	0.00	0.19	320.00	0.00	0.20	362.00	0.00	0.20	404.00	0.00	0.21
279.00	0.00	0.19	321.00	0.00	0.20	363.00	0.00	0.20	405.00	0.00	0.21
280.00	0.00	0.19	322.00	0.00	0.20	364.00	0.00	0.20	406.00	0.00	0.21
281.00	0.00	0.19	323.00	0.00	0.20	365.00	0.00	0.20	407.00	0.00	0.21
282.00	0.00	0.19	324.00	0.00	0.20	366.00	0.00	0.21	408.00	0.00	0.21
283.00	0.00	0.19	325.00	0.00	0.20	367.00	0.00	0.21	409.00	0.00	0.21
284.00	0.00	0.19	326.00	0.00	0.20	368.00	0.00	0.21	410.00	0.00	0.21
285.00	0.00	0.19	327.00	0.00	0.20	369.00	0.00	0.21	411.00	0.00	0.21
286.00	0.00	0.19	328.00	0.00	0.20	370.00	0.00	0.21	412.00	0.00	0.21
287.00	0.00	0.19	329.00	0.00	0.20	371.00	0.00	0.21	413.00	0.00	0.21
288.00	0.00	0.19	330.00	0.00	0.20	372.00	0.00	0.21	414.00	0.00	0.21
289.00	0.00	0.19	331.00	0.00	0.20	373.00	0.00	0.21	415.00	0.00	0.21
290.00	0.00	0.19	332.00	0.00	0.20	374.00	0.00	0.21	416.00	0.00	0.21
291.00	0.00	0.19	333.00	0.00	0.20	375.00	0.00	0.21	417.00	0.00	0.21

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
418.00	0.00	0.21	460.00	0.00	0.22	502.00	0.00	0.23	544.00	0.00	0.24
419.00	0.00	0.21	461.00	0.00	0.22	503.00	0.00	0.23	545.00	0.00	0.24
420.00	0.00	0.21	462.00	0.00	0.22	504.00	0.00	0.23	546.00	0.00	0.24
421.00	0.00	0.21	463.00	0.00	0.22	505.00	0.00	0.23	547.00	0.00	0.24
422.00	0.00	0.21	464.00	0.00	0.22	506.00	0.00	0.23	548.00	0.00	0.24
423.00	0.00	0.21	465.00	0.00	0.22	507.00	0.00	0.23	549.00	0.00	0.24
424.00	0.00	0.21	466.00	0.00	0.22	508.00	0.00	0.23	550.00	0.00	0.24
425.00	0.00	0.21	467.00	0.00	0.22	509.00	0.00	0.23	551.00	0.00	0.24
426.00	0.00	0.21	468.00	0.00	0.22	510.00	0.00	0.23	552.00	0.00	0.24
427.00	0.00	0.21	469.00	0.00	0.22	511.00	0.00	0.23	553.00	0.00	0.24
428.00	0.00	0.22	470.00	0.00	0.22	512.00	0.00	0.23	554.00	0.00	0.24
429.00	0.00	0.22	471.00	0.00	0.22	513.00	0.00	0.23	555.00	0.00	0.24
430.00	0.00	0.22	472.00	0.00	0.22	514.00	0.00	0.23	556.00	0.00	0.24
431.00	0.00	0.22	473.00	0.00	0.22	515.00	0.00	0.23	557.00	0.00	0.24
432.00	0.00	0.22	474.00	0.00	0.22	516.00	0.00	0.23	558.00	0.00	0.24
433.00	0.00	0.22	475.00	0.00	0.22	517.00	0.00	0.23	559.00	0.00	0.24
434.00	0.00	0.22	476.00	0.00	0.22	518.00	0.00	0.23	560.00	0.00	0.24
435.00	0.00	0.22	477.00	0.00	0.22	519.00	0.00	0.23	561.00	0.00	0.24
436.00	0.00	0.22	478.00	0.00	0.22	520.00	0.00	0.23	562.00	0.00	0.24
437.00	0.00	0.22	479.00	0.00	0.22	521.00	0.00	0.23	563.00	0.00	0.24
438.00	0.00	0.22	480.00	0.00	0.22	522.00	0.00	0.23	564.00	0.00	0.24
439.00	0.00	0.22	481.00	0.00	0.22	523.00	0.00	0.23	565.00	0.00	0.24
440.00	0.00	0.22	482.00	0.00	0.22	524.00	0.00	0.23	566.00	0.00	0.24
441.00	0.00	0.22	483.00	0.00	0.22	525.00	0.00	0.23	567.00	0.00	0.24
442.00	0.00	0.22	484.00	0.00	0.22	526.00	0.00	0.23	568.00	0.00	0.24
443.00	0.00	0.22	485.00	0.00	0.22	527.00	0.00	0.23	569.00	0.00	0.24
444.00	0.00	0.22	486.00	0.00	0.23	528.00	0.00	0.23	570.00	0.00	0.24
445.00	0.00	0.22	487.00	0.00	0.23	529.00	0.00	0.23	571.00	0.00	0.24
446.00	0.00	0.22	488.00	0.00	0.23	530.00	0.00	0.23	572.00	0.00	0.24
447.00	0.00	0.22	489.00	0.00	0.23	531.00	0.00	0.23	573.00	0.00	0.24
448.00	0.00	0.22	490.00	0.00	0.23	532.00	0.00	0.23	574.00	0.00	0.24
449.00	0.00	0.22	491.00	0.00	0.23	533.00	0.00	0.23	575.00	0.00	0.24
450.00	0.00	0.22	492.00	0.00	0.23	534.00	0.00	0.23	576.00	0.00	0.24
451.00	0.00	0.22	493.00	0.00	0.23	535.00	0.00	0.23	577.00	0.00	0.24
452.00	0.00	0.22	494.00	0.00	0.23	536.00	0.00	0.23	578.00	0.00	0.24
453.00	0.00	0.22	495.00	0.00	0.23	537.00	0.00	0.23	579.00	0.00	0.24
454.00	0.00	0.22	496.00	0.00	0.23	538.00	0.00	0.23	580.00	0.00	0.24
455.00	0.00	0.22	497.00	0.00	0.23	539.00	0.00	0.23	581.00	0.00	0.24
456.00	0.00	0.22	498.00	0.00	0.23	540.00	0.00	0.23	582.00	0.00	0.24
457.00	0.00	0.22	499.00	0.00	0.23	541.00	0.00	0.24	583.00	0.00	0.24
458.00	0.00	0.22	500.00	0.00	0.23	542.00	0.00	0.24	584.00	0.00	0.24
459.00	0.00	0.22	501.00	0.00	0.23	543.00	0.00	0.24	585.00	0.00	0.24

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
586.00	0.00	0.24	628.00	0.00	0.25	669.99	0.00	0.26	711.99	0.00	0.27
587.00	0.00	0.24	629.00	0.00	0.25	670.99	0.00	0.26	712.99	0.00	0.27
588.00	0.00	0.24	630.00	0.00	0.25	671.99	0.00	0.26	713.99	0.00	0.27
589.00	0.00	0.24	631.00	0.00	0.25	672.99	0.00	0.26	714.99	0.00	0.27
590.00	0.00	0.24	632.00	0.00	0.25	673.99	0.00	0.26	715.99	0.00	0.27
591.00	0.00	0.24	632.99	0.00	0.25	674.99	0.00	0.26	716.99	0.00	0.27
592.00	0.00	0.25	633.99	0.00	0.25	675.99	0.00	0.26	717.99	0.00	0.27
593.00	0.00	0.25	634.99	0.00	0.25	676.99	0.00	0.26	718.99	0.00	0.27
594.00	0.00	0.25	635.99	0.00	0.25	677.99	0.00	0.26	719.99	0.00	0.27
595.00	0.00	0.25	636.99	0.00	0.25	678.99	0.00	0.26	720.99	0.00	0.27
596.00	0.00	0.25	637.99	0.00	0.25	679.99	0.00	0.26	721.99	0.00	0.27
597.00	0.00	0.25	638.99	0.00	0.25	680.99	0.00	0.26	722.99	0.00	0.27
598.00	0.00	0.25	639.99	0.00	0.26	681.99	0.00	0.26	723.99	0.00	0.27
599.00	0.00	0.25	640.99	0.00	0.26	682.99	0.00	0.26	724.99	0.00	0.27
600.00	0.00	0.25	641.99	0.00	0.26	683.99	0.00	0.26	725.99	0.00	0.27
601.00	0.00	0.25	642.99	0.00	0.26	684.99	0.00	0.27	726.99	0.00	0.27
602.00	0.00	0.25	643.99	0.00	0.26	685.99	0.00	0.27	727.99	0.00	0.28
603.00	0.00	0.25	644.99	0.00	0.26	686.99	0.00	0.27	728.99	0.00	0.28
604.00	0.00	0.25	645.99	0.00	0.26	687.99	0.00	0.27	729.99	0.00	0.28
605.00	0.00	0.25	646.99	0.00	0.26	688.99	0.00	0.27	730.99	0.00	0.28
606.00	0.00	0.25	647.99	0.00	0.26	689.99	0.00	0.27	731.99	0.00	0.28
607.00	0.00	0.25	648.99	0.00	0.26	690.99	0.00	0.27	732.99	0.00	0.28
608.00	0.00	0.25	649.99	0.00	0.26	691.99	0.00	0.27	733.99	0.00	0.28
609.00	0.00	0.25	650.99	0.00	0.26	692.99	0.00	0.27	734.99	0.00	0.28
610.00	0.00	0.25	651.99	0.00	0.26	693.99	0.00	0.27	735.99	0.00	0.28
611.00	0.00	0.25	652.99	0.00	0.26	694.99	0.00	0.27	736.99	0.00	0.28
612.00	0.00	0.25	653.99	0.00	0.26	695.99	0.00	0.27	737.99	0.00	0.28
613.00	0.00	0.25	654.99	0.00	0.26	696.99	0.00	0.27	738.99	0.00	0.28
614.00	0.00	0.25	655.99	0.00	0.26	697.99	0.00	0.27	739.99	0.00	0.28
615.00	0.00	0.25	656.99	0.00	0.26	698.99	0.00	0.27	740.99	0.00	0.28
616.00	0.00	0.25	657.99	0.00	0.26	699.99	0.00	0.27	741.99	0.00	0.28
617.00	0.00	0.25	658.99	0.00	0.26	700.99	0.00	0.27	742.99	0.00	0.28
618.00	0.00	0.25	659.99	0.00	0.26	701.99	0.00	0.27	743.99	0.00	0.28
619.00	0.00	0.25	660.99	0.00	0.26	702.99	0.00	0.27	744.99	0.00	0.28
620.00	0.00	0.25	661.99	0.00	0.26	703.99	0.00	0.27	745.99	0.00	0.28
621.00	0.00	0.25	662.99	0.00	0.26	704.99	0.00	0.27	746.99	0.00	0.28
622.00	0.00	0.25	663.99	0.00	0.26	705.99	0.00	0.27	747.99	0.00	0.28
623.00	0.00	0.25	664.99	0.00	0.26	706.99	0.00	0.27	748.99	0.00	0.28
624.00	0.00	0.25	665.99	0.00	0.26	707.99	0.00	0.27	749.99	0.00	0.28
625.00	0.00	0.25	666.99	0.00	0.26	708.99	0.00	0.27	750.99	0.00	0.28
626.00	0.00	0.25	667.99	0.00	0.26	709.99	0.00	0.27	751.99	0.00	0.28
627.00	0.00	0.25	668.99	0.00	0.26	710.99	0.00	0.27	752.99	0.00	0.28

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
753.99	0.00	0.28	795.99	0.00	0.29	837.99	0.00	0.30	879.99	0.00	0.32
754.99	0.00	0.28	796.99	0.00	0.29	838.99	0.00	0.30	880.99	0.00	0.32
755.99	0.00	0.28	797.99	0.00	0.29	839.99	0.00	0.30	881.99	0.00	0.32
756.99	0.00	0.28	798.99	0.00	0.29	840.99	0.00	0.30	882.99	0.00	0.32
757.99	0.00	0.28	799.99	0.00	0.29	841.99	0.00	0.30	883.99	0.00	0.32
758.99	0.00	0.28	800.99	0.00	0.29	842.99	0.00	0.31	884.99	0.00	0.32
759.99	0.00	0.28	801.99	0.00	0.29	843.99	0.00	0.31	885.99	0.00	0.32
760.99	0.00	0.28	802.99	0.00	0.29	844.99	0.00	0.31	886.99	0.00	0.32
761.99	0.00	0.28	803.99	0.00	0.29	845.99	0.00	0.31	887.99	0.00	0.32
762.99	0.00	0.28	804.99	0.00	0.29	846.99	0.00	0.31	888.99	0.00	0.32
763.99	0.00	0.28	805.99	0.00	0.29	847.99	0.00	0.31	889.99	0.00	0.32
764.99	0.00	0.28	806.99	0.00	0.30	848.99	0.00	0.31	890.99	0.00	0.32
765.99	0.00	0.28	807.99	0.00	0.30	849.99	0.00	0.31	891.99	0.00	0.32
766.99	0.00	0.28	808.99	0.00	0.30	850.99	0.00	0.31	892.99	0.00	0.32
767.99	0.00	0.29	809.99	0.00	0.30	851.99	0.00	0.31	893.99	0.00	0.32
768.99	0.00	0.29	810.99	0.00	0.30	852.99	0.00	0.31	894.99	0.00	0.32
769.99	0.00	0.29	811.99	0.00	0.30	853.99	0.00	0.31	895.99	0.00	0.32
770.99	0.00	0.29	812.99	0.00	0.30	854.99	0.00	0.31	896.99	0.00	0.32
771.99	0.00	0.29	813.99	0.00	0.30	855.99	0.00	0.31	897.99	0.00	0.32
772.99	0.00	0.29	814.99	0.00	0.30	856.99	0.00	0.31	898.99	0.00	0.32
773.99	0.00	0.29	815.99	0.00	0.30	857.99	0.00	0.31	899.99	0.00	0.32
774.99	0.00	0.29	816.99	0.00	0.30	858.99	0.00	0.31	900.99	0.00	0.32
775.99	0.00	0.29	817.99	0.00	0.30	859.99	0.00	0.31	901.99	0.00	0.32
776.99	0.00	0.29	818.99	0.00	0.30	860.99	0.00	0.31	902.99	0.00	0.32
777.99	0.00	0.29	819.99	0.00	0.30	861.99	0.00	0.31	903.99	0.00	0.32
778.99	0.00	0.29	820.99	0.00	0.30	862.99	0.00	0.31	904.99	0.00	0.32
779.99	0.00	0.29	821.99	0.00	0.30	863.99	0.00	0.31	905.99	0.00	0.32
780.99	0.00	0.29	822.99	0.00	0.30	864.99	0.00	0.31	906.99	0.00	0.32
781.99	0.00	0.29	823.99	0.00	0.30	865.99	0.00	0.31	907.99	0.00	0.32
782.99	0.00	0.29	824.99	0.00	0.30	866.99	0.00	0.31	908.99	0.00	0.32
783.99	0.00	0.29	825.99	0.00	0.30	867.99	0.00	0.31	909.99	0.00	0.32
784.99	0.00	0.29	826.99	0.00	0.30	868.99	0.00	0.31	910.99	0.00	0.33
785.99	0.00	0.29	827.99	0.00	0.30	869.99	0.00	0.31	911.99	0.00	0.33
786.99	0.00	0.29	828.99	0.00	0.30	870.99	0.00	0.31	912.99	0.00	0.33
787.99	0.00	0.29	829.99	0.00	0.30	871.99	0.00	0.31	913.99	0.00	0.33
788.99	0.00	0.29	830.99	0.00	0.30	872.99	0.00	0.31	914.99	0.00	0.33
789.99	0.00	0.29	831.99	0.00	0.30	873.99	0.00	0.31	915.99	0.00	0.33
790.99	0.00	0.29	832.99	0.00	0.30	874.99	0.00	0.31	916.99	0.00	0.33
791.99	0.00	0.29	833.99	0.00	0.30	875.99	0.00	0.31	917.99	0.00	0.33
792.99	0.00	0.29	834.99	0.00	0.30	876.99	0.00	0.31	918.99	0.00	0.33
793.99	0.00	0.29	835.99	0.00	0.30	877.99	0.00	0.32	919.99	0.00	0.33
794.99	0.00	0.29	836.99	0.00	0.30	878.99	0.00	0.32	920.99	0.00	0.33

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
921.99	0.00	0.33	963.99	0.00	0.34	1005.99	0.00	0.36	1047.98	0.00	0.37
922.99	0.00	0.33	964.99	0.00	0.34	1006.99	0.00	0.36	1048.98	0.00	0.37
923.99	0.00	0.33	965.99	0.00	0.34	1007.99	0.00	0.36	1049.98	0.00	0.37
924.99	0.00	0.33	966.99	0.00	0.34	1008.99	0.00	0.36	1050.98	0.00	0.37
925.99	0.00	0.33	967.99	0.00	0.34	1009.99	0.00	0.36	1051.98	0.00	0.37
926.99	0.00	0.33	968.99	0.00	0.34	1010.99	0.00	0.36	1052.98	0.00	0.37
927.99	0.00	0.33	969.99	0.00	0.34	1011.99	0.00	0.36	1053.98	0.00	0.37
928.99	0.00	0.33	970.99	0.00	0.34	1012.99	0.00	0.36	1054.98	0.00	0.37
929.99	0.00	0.33	971.99	0.00	0.34	1013.99	0.00	0.36	1055.98	0.00	0.38
930.99	0.00	0.33	972.99	0.00	0.35	1014.99	0.00	0.36	1056.98	0.00	0.38
931.99	0.00	0.33	973.99	0.00	0.35	1015.99	0.00	0.36	1057.98	0.00	0.38
932.99	0.00	0.33	974.99	0.00	0.35	1016.99	0.00	0.36	1058.98	0.00	0.38
933.99	0.00	0.33	975.99	0.00	0.35	1017.99	0.00	0.36	1059.98	0.00	0.38
934.99	0.00	0.33	976.99	0.00	0.35	1018.99	0.00	0.36	1060.98	0.00	0.38
935.99	0.00	0.33	977.99	0.00	0.35	1019.99	0.00	0.36	1061.98	0.00	0.38
936.99	0.00	0.33	978.99	0.00	0.35	1020.99	0.00	0.36	1062.98	0.00	0.38
937.99	0.00	0.33	979.99	0.00	0.35	1021.99	0.00	0.36	1063.98	0.00	0.38
938.99	0.00	0.33	980.99	0.00	0.35	1022.99	0.00	0.36	1064.98	0.00	0.38
939.99	0.00	0.33	981.99	0.00	0.35	1023.99	0.00	0.36	1065.98	0.00	0.38
940.99	0.00	0.33	982.99	0.00	0.35	1024.99	0.00	0.36	1066.98	0.00	0.38
941.99	0.00	0.34	983.99	0.00	0.35	1025.99	0.00	0.36	1067.98	0.00	0.38
942.99	0.00	0.34	984.99	0.00	0.35	1026.99	0.00	0.36	1068.98	0.00	0.38
943.99	0.00	0.34	985.99	0.00	0.35	1027.99	0.00	0.36	1069.98	0.00	0.38
944.99	0.00	0.34	986.99	0.00	0.35	1028.99	0.00	0.37	1070.98	0.00	0.38
945.99	0.00	0.34	987.99	0.00	0.35	1029.99	0.00	0.37	1071.98	0.00	0.38
946.99	0.00	0.34	988.99	0.00	0.35	1030.99	0.00	0.37	1072.98	0.00	0.38
947.99	0.00	0.34	989.99	0.00	0.35	1031.99	0.00	0.37	1073.98	0.00	0.38
948.99	0.00	0.34	990.99	0.00	0.35	1032.99	0.00	0.37	1074.98	0.00	0.38
949.99	0.00	0.34	991.99	0.00	0.35	1033.99	0.00	0.37	1075.98	0.00	0.38
950.99	0.00	0.34	992.99	0.00	0.35	1034.99	0.00	0.37	1076.98	0.00	0.38
951.99	0.00	0.34	993.99	0.00	0.35	1035.99	0.00	0.37	1077.98	0.00	0.38
952.99	0.00	0.34	994.99	0.00	0.35	1036.99	0.00	0.37	1078.98	0.00	0.38
953.99	0.00	0.34	995.99	0.00	0.35	1037.99	0.00	0.37	1079.98	0.00	0.38
954.99	0.00	0.34	996.99	0.00	0.35	1038.99	0.00	0.37	1080.98	0.00	0.38
955.99	0.00	0.34	997.99	0.00	0.35	1039.99	0.00	0.37	1081.98	0.00	0.39
956.99	0.00	0.34	998.99	0.00	0.35	1040.99	0.00	0.37	1082.98	0.00	0.39
957.99	0.00	0.34	999.99	0.00	0.35	1041.99	0.00	0.37	1083.98	0.00	0.39
958.99	0.00	0.34	1000.99	0.00	0.35	1042.99	0.00	0.37	1084.98	0.00	0.39
959.99	0.00	0.34	1001.99	0.00	0.36	1043.98	0.00	0.37	1085.98	0.00	0.39
960.99	0.00	0.34	1002.99	0.00	0.36	1044.98	0.00	0.37	1086.98	0.00	0.39
961.99	0.00	0.34	1003.99	0.00	0.36	1045.98	0.00	0.37	1087.98	0.00	0.39
962.99	0.00	0.34	1004.99	0.00	0.36	1046.98	0.00	0.37	1088.98	0.00	0.39

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1089.98	0.00	0.39	1131.98	0.00	0.41	1173.98	0.00	0.42	1215.98	0.00	0.45
1090.98	0.00	0.39	1132.98	0.00	0.41	1174.98	0.00	0.43	1216.98	0.00	0.45
1091.98	0.00	0.39	1133.98	0.00	0.41	1175.98	0.00	0.43	1217.98	0.00	0.45
1092.98	0.00	0.39	1134.98	0.00	0.41	1176.98	0.00	0.43	1218.98	0.00	0.45
1093.98	0.00	0.39	1135.98	0.00	0.41	1177.98	0.00	0.43	1219.98	0.00	0.45
1094.98	0.00	0.39	1136.98	0.00	0.41	1178.98	0.00	0.43	1220.98	0.00	0.45
1095.98	0.00	0.39	1137.98	0.00	0.41	1179.98	0.00	0.43	1221.98	0.00	0.45
1096.98	0.00	0.39	1138.98	0.00	0.41	1180.98	0.00	0.43	1222.98	0.00	0.45
1097.98	0.00	0.39	1139.98	0.00	0.41	1181.98	0.00	0.43	1223.98	0.00	0.45
1098.98	0.00	0.39	1140.98	0.00	0.41	1182.98	0.00	0.43	1224.98	0.00	0.45
1099.98	0.00	0.39	1141.98	0.00	0.41	1183.98	0.00	0.43	1225.98	0.00	0.45
1100.98	0.00	0.39	1142.98	0.00	0.41	1184.98	0.00	0.43	1226.98	0.00	0.45
1101.98	0.00	0.39	1143.98	0.00	0.41	1185.98	0.00	0.43	1227.98	0.00	0.45
1102.98	0.00	0.39	1144.98	0.00	0.41	1186.98	0.00	0.43	1228.98	0.00	0.45
1103.98	0.00	0.39	1145.98	0.00	0.41	1187.98	0.00	0.43	1229.98	0.00	0.45
1104.98	0.00	0.39	1146.98	0.00	0.41	1188.98	0.00	0.43	1230.98	0.00	0.45
1105.98	0.00	0.40	1147.98	0.00	0.41	1189.98	0.00	0.43	1231.98	0.00	0.45
1106.98	0.00	0.40	1148.98	0.00	0.41	1190.98	0.00	0.43	1232.98	0.00	0.45
1107.98	0.00	0.40	1149.98	0.00	0.41	1191.98	0.00	0.43	1233.98	0.00	0.45
1108.98	0.00	0.40	1150.98	0.00	0.41	1192.98	0.00	0.43	1234.98	0.00	0.45
1109.98	0.00	0.40	1151.98	0.00	0.41	1193.98	0.00	0.43	1235.98	0.00	0.46
1110.98	0.00	0.40	1152.98	0.00	0.42	1194.98	0.00	0.43	1236.98	0.00	0.46
1111.98	0.00	0.40	1153.98	0.00	0.42	1195.98	0.00	0.44	1237.98	0.00	0.46
1112.98	0.00	0.40	1154.98	0.00	0.42	1196.98	0.00	0.44	1238.98	0.00	0.46
1113.98	0.00	0.40	1155.98	0.00	0.42	1197.98	0.00	0.44	1239.98	0.00	0.46
1114.98	0.00	0.40	1156.98	0.00	0.42	1198.98	0.00	0.44	1240.98	0.00	0.46
1115.98	0.00	0.40	1157.98	0.00	0.42	1199.98	0.00	0.44	1241.98	0.00	0.46
1116.98	0.00	0.40	1158.98	0.00	0.42	1200.98	0.00	0.44	1242.98	0.00	0.46
1117.98	0.00	0.40	1159.98	0.00	0.42	1201.98	0.00	0.44	1243.98	0.00	0.46
1118.98	0.00	0.40	1160.98	0.00	0.42	1202.98	0.00	0.44	1244.98	0.00	0.46
1119.98	0.00	0.40	1161.98	0.00	0.42	1203.98	0.00	0.44	1245.98	0.00	0.46
1120.98	0.00	0.40	1162.98	0.00	0.42	1204.98	0.00	0.44	1246.98	0.00	0.46
1121.98	0.00	0.40	1163.98	0.00	0.42	1205.98	0.00	0.44	1247.98	0.00	0.46
1122.98	0.00	0.40	1164.98	0.00	0.42	1206.98	0.00	0.44	1248.98	0.00	0.46
1123.98	0.00	0.40	1165.98	0.00	0.42	1207.98	0.00	0.44	1249.98	0.00	0.46
1124.98	0.00	0.40	1166.98	0.00	0.42	1208.98	0.00	0.44	1250.98	0.00	0.46
1125.98	0.00	0.40	1167.98	0.00	0.42	1209.98	0.00	0.44	1251.98	0.00	0.46
1126.98	0.00	0.40	1168.98	0.00	0.42	1210.98	0.00	0.44	1252.98	0.00	0.46
1127.98	0.00	0.40	1169.98	0.00	0.42	1211.98	0.00	0.44	1253.98	0.00	0.46
1128.98	0.00	0.40	1170.98	0.00	0.42	1212.98	0.00	0.44	1254.98	0.00	0.46
1129.98	0.00	0.41	1171.98	0.00	0.42	1213.98	0.00	0.44	1255.98	0.00	0.47
1130.98	0.00	0.41	1172.98	0.00	0.42	1214.98	0.00	0.44	1256.98	0.00	0.47

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1257.98	0.00	0.47	1299.98	0.00	0.49	1341.98	0.00	0.51	1383.98	0.00	0.54
1258.98	0.00	0.47	1300.98	0.00	0.49	1342.98	0.00	0.52	1384.98	0.00	0.54
1259.98	0.00	0.47	1301.98	0.00	0.49	1343.98	0.00	0.52	1385.98	0.00	0.54
1260.98	0.00	0.47	1302.98	0.00	0.49	1344.98	0.00	0.52	1386.98	0.00	0.54
1261.98	0.00	0.47	1303.98	0.00	0.49	1345.98	0.00	0.52	1387.98	0.00	0.54
1262.98	0.00	0.47	1304.98	0.00	0.49	1346.98	0.00	0.52	1388.98	0.00	0.54
1263.98	0.00	0.47	1305.98	0.00	0.49	1347.98	0.00	0.52	1389.98	0.00	0.55
1264.98	0.00	0.47	1306.98	0.00	0.49	1348.98	0.00	0.52	1390.98	0.00	0.55
1265.98	0.00	0.47	1307.98	0.00	0.49	1349.98	0.00	0.52	1391.98	0.00	0.55
1266.98	0.00	0.47	1308.98	0.00	0.49	1350.98	0.00	0.52	1392.98	0.00	0.55
1267.98	0.00	0.47	1309.98	0.00	0.50	1351.98	0.00	0.52	1393.98	0.00	0.55
1268.98	0.00	0.47	1310.98	0.00	0.50	1352.98	0.00	0.52	1394.98	0.00	0.55
1269.98	0.00	0.47	1311.98	0.00	0.50	1353.98	0.00	0.52	1395.98	0.00	0.55
1270.98	0.00	0.47	1312.98	0.00	0.50	1354.98	0.00	0.52	1396.98	0.00	0.55
1271.98	0.00	0.47	1313.98	0.00	0.50	1355.98	0.00	0.52	1397.98	0.00	0.55
1272.98	0.00	0.47	1314.98	0.00	0.50	1356.98	0.00	0.52	1398.98	0.00	0.55
1273.98	0.00	0.48	1315.98	0.00	0.50	1357.98	0.00	0.52	1399.98	0.00	0.55
1274.98	0.00	0.48	1316.98	0.00	0.50	1358.98	0.00	0.53	1400.98	0.00	0.55
1275.98	0.00	0.48	1317.98	0.00	0.50	1359.98	0.00	0.53	1401.98	0.00	0.55
1276.98	0.00	0.48	1318.98	0.00	0.50	1360.98	0.00	0.53	1402.98	0.00	0.55
1277.98	0.00	0.48	1319.98	0.00	0.50	1361.98	0.00	0.53	1403.98	0.00	0.56
1278.98	0.00	0.48	1320.98	0.00	0.50	1362.98	0.00	0.53	1404.98	0.00	0.56
1279.98	0.00	0.48	1321.98	0.00	0.50	1363.98	0.00	0.53	1405.98	0.00	0.56
1280.98	0.00	0.48	1322.98	0.00	0.50	1364.98	0.00	0.53	1406.98	0.00	0.56
1281.98	0.00	0.48	1323.98	0.00	0.50	1365.98	0.00	0.53	1407.98	0.00	0.56
1282.98	0.00	0.48	1324.98	0.00	0.50	1366.98	0.00	0.53	1408.98	0.00	0.56
1283.98	0.00	0.48	1325.98	0.00	0.50	1367.98	0.00	0.53	1409.98	0.00	0.56
1284.98	0.00	0.48	1326.98	0.00	0.51	1368.98	0.00	0.53	1410.98	0.00	0.56
1285.98	0.00	0.48	1327.98	0.00	0.51	1369.98	0.00	0.53	1411.98	0.00	0.56
1286.98	0.00	0.48	1328.98	0.00	0.51	1370.98	0.00	0.53	1412.98	0.00	0.56
1287.98	0.00	0.48	1329.98	0.00	0.51	1371.98	0.00	0.53	1413.98	0.00	0.56
1288.98	0.00	0.48	1330.98	0.00	0.51	1372.98	0.00	0.53	1414.98	0.00	0.56
1289.98	0.00	0.48	1331.98	0.00	0.51	1373.98	0.00	0.54	1415.98	0.00	0.56
1290.98	0.00	0.48	1332.98	0.00	0.51	1374.98	0.00	0.54	1416.98	0.00	0.56
1291.98	0.00	0.49	1333.98	0.00	0.51	1375.98	0.00	0.54	1417.98	0.00	0.56
1292.98	0.00	0.49	1334.98	0.00	0.51	1376.98	0.00	0.54	1418.98	0.00	0.57
1293.98	0.00	0.49	1335.98	0.00	0.51	1377.98	0.00	0.54	1419.98	0.00	0.57
1294.98	0.00	0.49	1336.98	0.00	0.51	1378.98	0.00	0.54	1420.98	0.00	0.57
1295.98	0.00	0.49	1337.98	0.00	0.51	1379.98	0.00	0.54	1421.98	0.00	0.57
1296.98	0.00	0.49	1338.98	0.00	0.51	1380.98	0.00	0.54	1422.98	0.00	0.57
1297.98	0.00	0.49	1339.98	0.00	0.51	1381.98	0.00	0.54	1423.98	0.00	0.57
1298.98	0.00	0.49	1340.98	0.00	0.51	1382.98	0.00	0.54	1424.98	0.00	0.57

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1425.98	0.00	0.57	1467.97	0.00	0.60	1509.97	0.00	0.64	1551.97	0.00	0.67
1426.98	0.00	0.57	1468.97	0.00	0.60	1510.97	0.00	0.64	1552.97	0.00	0.67
1427.98	0.00	0.57	1469.97	0.00	0.60	1511.97	0.00	0.64	1553.97	0.00	0.68
1428.98	0.00	0.57	1470.97	0.00	0.60	1512.97	0.00	0.64	1554.97	0.00	0.68
1429.98	0.00	0.57	1471.97	0.00	0.61	1513.97	0.00	0.64	1555.97	0.00	0.68
1430.98	0.00	0.57	1472.97	0.00	0.61	1514.97	0.00	0.64	1556.97	0.00	0.68
1431.98	0.00	0.58	1473.97	0.00	0.61	1515.97	0.00	0.64	1557.97	0.00	0.68
1432.98	0.00	0.58	1474.97	0.00	0.61	1516.97	0.00	0.64	1558.97	0.00	0.68
1433.98	0.00	0.58	1475.97	0.00	0.61	1517.97	0.00	0.64	1559.97	0.00	0.68
1434.98	0.00	0.58	1476.97	0.00	0.61	1518.97	0.00	0.64	1560.97	0.00	0.68
1435.98	0.00	0.58	1477.97	0.00	0.61	1519.97	0.00	0.64	1561.97	0.00	0.68
1436.98	0.00	0.58	1478.97	0.00	0.61	1520.97	0.00	0.65	1562.97	0.00	0.68
1437.98	0.00	0.58	1479.97	0.00	0.61	1521.97	0.00	0.65	1563.97	0.00	0.68
1438.98	0.00	0.58	1480.97	0.00	0.61	1522.97	0.00	0.65	1564.97	0.00	0.69
1439.98	0.00	0.58	1481.97	0.00	0.61	1523.97	0.00	0.65	1565.97	0.00	0.69
1440.98	0.00	0.58	1482.97	0.00	0.61	1524.97	0.00	0.65	1566.97	0.00	0.69
1441.98	0.00	0.58	1483.97	0.00	0.61	1525.97	0.00	0.65	1567.97	0.00	0.69
1442.98	0.00	0.58	1484.97	0.00	0.62	1526.97	0.00	0.65	1568.97	0.00	0.69
1443.98	0.00	0.58	1485.97	0.00	0.62	1527.97	0.00	0.65	1569.97	0.00	0.69
1444.98	0.00	0.58	1486.97	0.00	0.62	1528.97	0.00	0.65	1570.97	0.00	0.69
1445.98	0.00	0.59	1487.97	0.00	0.62	1529.97	0.00	0.65	1571.97	0.00	0.69
1446.98	0.00	0.59	1488.97	0.00	0.62	1530.97	0.00	0.65	1572.97	0.00	0.69
1447.98	0.00	0.59	1489.97	0.00	0.62	1531.97	0.00	0.66	1573.97	0.00	0.69
1448.98	0.00	0.59	1490.97	0.00	0.62	1532.97	0.00	0.66	1574.97	0.00	0.70
1449.98	0.00	0.59	1491.97	0.00	0.62	1533.97	0.00	0.66	1575.97	0.00	0.70
1450.98	0.00	0.59	1492.97	0.00	0.62	1534.97	0.00	0.66	1576.97	0.00	0.70
1451.98	0.00	0.59	1493.97	0.00	0.62	1535.97	0.00	0.66	1577.97	0.00	0.70
1452.98	0.00	0.59	1494.97	0.00	0.62	1536.97	0.00	0.66	1578.97	0.00	0.70
1453.97	0.00	0.59	1495.97	0.00	0.62	1537.97	0.00	0.66	1579.97	0.00	0.70
1454.97	0.00	0.59	1496.97	0.00	0.63	1538.97	0.00	0.66	1580.97	0.00	0.70
1455.97	0.00	0.59	1497.97	0.00	0.63	1539.97	0.00	0.66	1581.97	0.00	0.70
1456.97	0.00	0.59	1498.97	0.00	0.63	1540.97	0.00	0.66	1582.97	0.00	0.70
1457.97	0.00	0.59	1499.97	0.00	0.63	1541.97	0.00	0.66	1583.97	0.00	0.70
1458.97	0.00	0.60	1500.97	0.00	0.63	1542.97	0.00	0.67	1584.97	0.00	0.71
1459.97	0.00	0.60	1501.97	0.00	0.63	1543.97	0.00	0.67	1585.97	0.00	0.71
1460.97	0.00	0.60	1502.97	0.00	0.63	1544.97	0.00	0.67	1586.97	0.00	0.71
1461.97	0.00	0.60	1503.97	0.00	0.63	1545.97	0.00	0.67	1587.97	0.00	0.71
1462.97	0.00	0.60	1504.97	0.00	0.63	1546.97	0.00	0.67	1588.97	0.00	0.71
1463.97	0.00	0.60	1505.97	0.00	0.63	1547.97	0.00	0.67	1589.97	0.00	0.71
1464.97	0.00	0.60	1506.97	0.00	0.63	1548.97	0.00	0.67	1590.97	0.00	0.71
1465.97	0.00	0.60	1507.97	0.00	0.63	1549.97	0.00	0.67	1591.97	0.00	0.71
1466.97	0.00	0.60	1508.97	0.00	0.64	1550.97	0.00	0.67	1592.97	0.00	0.71

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1593.97	0.00	0.71	1635.97	0.00	0.76	1677.97	0.00	0.81	1719.97	0.00	0.86
1594.97	0.00	0.72	1636.97	0.00	0.76	1678.97	0.00	0.81	1720.97	0.00	0.86
1595.97	0.00	0.72	1637.97	0.00	0.76	1679.97	0.00	0.81	1721.97	0.00	0.86
1596.97	0.00	0.72	1638.97	0.00	0.76	1680.97	0.00	0.81	1722.97	0.00	0.86
1597.97	0.00	0.72	1639.97	0.00	0.76	1681.97	0.00	0.81	1723.97	0.00	0.87
1598.97	0.00	0.72	1640.97	0.00	0.76	1682.97	0.00	0.81	1724.97	0.00	0.87
1599.97	0.00	0.72	1641.97	0.00	0.77	1683.97	0.00	0.81	1725.97	0.00	0.87
1600.97	0.00	0.72	1642.97	0.00	0.77	1684.97	0.00	0.82	1726.97	0.00	0.87
1601.97	0.00	0.72	1643.97	0.00	0.77	1685.97	0.00	0.82	1727.97	0.00	0.87
1602.97	0.00	0.72	1644.97	0.00	0.77	1686.97	0.00	0.82	1728.97	0.00	0.87
1603.97	0.00	0.72	1645.97	0.00	0.77	1687.97	0.00	0.82	1729.97	0.00	0.87
1604.97	0.00	0.73	1646.97	0.00	0.77	1688.97	0.00	0.82	1730.97	0.00	0.88
1605.97	0.00	0.73	1647.97	0.00	0.77	1689.97	0.00	0.82	1731.97	0.00	0.88
1606.97	0.00	0.73	1648.97	0.00	0.77	1690.97	0.00	0.82	1732.97	0.00	0.88
1607.97	0.00	0.73	1649.97	0.00	0.77	1691.97	0.00	0.82	1733.97	0.00	0.88
1608.97	0.00	0.73	1650.97	0.00	0.78	1692.97	0.00	0.83	1734.97	0.00	0.88
1609.97	0.00	0.73	1651.97	0.00	0.78	1693.97	0.00	0.83	1735.97	0.00	0.88
1610.97	0.00	0.73	1652.97	0.00	0.78	1694.97	0.00	0.83	1736.97	0.00	0.88
1611.97	0.00	0.73	1653.97	0.00	0.78	1695.97	0.00	0.83	1737.97	0.00	0.88
1612.97	0.00	0.73	1654.97	0.00	0.78	1696.97	0.00	0.83	1738.97	0.00	0.89
1613.97	0.00	0.73	1655.97	0.00	0.78	1697.97	0.00	0.83	1739.97	0.00	0.89
1614.97	0.00	0.74	1656.97	0.00	0.78	1698.97	0.00	0.83	1740.97	0.00	0.89
1615.97	0.00	0.74	1657.97	0.00	0.78	1699.97	0.00	0.83	1741.97	0.00	0.89
1616.97	0.00	0.74	1658.97	0.00	0.78	1700.97	0.00	0.84	1742.97	0.00	0.89
1617.97	0.00	0.74	1659.97	0.00	0.79	1701.97	0.00	0.84	1743.97	0.00	0.89
1618.97	0.00	0.74	1660.97	0.00	0.79	1702.97	0.00	0.84	1744.97	0.00	0.89
1619.97	0.00	0.74	1661.97	0.00	0.79	1703.97	0.00	0.84	1745.97	0.00	0.90
1620.97	0.00	0.74	1662.97	0.00	0.79	1704.97	0.00	0.84	1746.97	0.00	0.90
1621.97	0.00	0.74	1663.97	0.00	0.79	1705.97	0.00	0.84	1747.97	0.00	0.90
1622.97	0.00	0.74	1664.97	0.00	0.79	1706.97	0.00	0.84	1748.97	0.00	0.90
1623.97	0.00	0.75	1665.97	0.00	0.79	1707.97	0.00	0.84	1749.97	0.00	0.90
1624.97	0.00	0.75	1666.97	0.00	0.79	1708.97	0.00	0.85	1750.97	0.00	0.90
1625.97	0.00	0.75	1667.97	0.00	0.79	1709.97	0.00	0.85	1751.97	0.00	0.90
1626.97	0.00	0.75	1668.97	0.00	0.80	1710.97	0.00	0.85	1752.97	0.00	0.91
1627.97	0.00	0.75	1669.97	0.00	0.80	1711.97	0.00	0.85	1753.97	0.00	0.91
1628.97	0.00	0.75	1670.97	0.00	0.80	1712.97	0.00	0.85	1754.97	0.00	0.91
1629.97	0.00	0.75	1671.97	0.00	0.80	1713.97	0.00	0.85	1755.97	0.00	0.91
1630.97	0.00	0.75	1672.97	0.00	0.80	1714.97	0.00	0.85	1756.97	0.00	0.91
1631.97	0.00	0.75	1673.97	0.00	0.80	1715.97	0.00	0.85	1757.97	0.00	0.91
1632.97	0.00	0.76	1674.97	0.00	0.80	1716.97	0.00	0.86	1758.97	0.00	0.91
1633.97	0.00	0.76	1675.97	0.00	0.80	1717.97	0.00	0.86	1759.97	0.00	0.92
1634.97	0.00	0.76	1676.97	0.00	0.81	1718.97	0.00	0.86	1760.97	0.00	0.92

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1761.97	0.00	0.92	1803.97	0.00	0.98	1845.97	0.00	1.06	1887.96	0.01	1.14
1762.97	0.00	0.92	1804.97	0.00	0.99	1846.97	0.00	1.06	1888.96	0.01	1.14
1763.97	0.00	0.92	1805.97	0.00	0.99	1847.97	0.00	1.06	1889.96	0.01	1.14
1764.97	0.00	0.92	1806.97	0.00	0.99	1848.97	0.00	1.06	1890.96	0.01	1.14
1765.97	0.00	0.93	1807.97	0.00	0.99	1849.97	0.00	1.06	1891.96	0.01	1.15
1766.97	0.00	0.93	1808.97	0.00	0.99	1850.97	0.00	1.07	1892.96	0.01	1.15
1767.97	0.00	0.93	1809.97	0.00	0.99	1851.97	0.00	1.07	1893.96	0.01	1.15
1768.97	0.00	0.93	1810.97	0.00	1.00	1852.97	0.00	1.07	1894.96	0.01	1.15
1769.97	0.00	0.93	1811.97	0.00	1.00	1853.97	0.00	1.07	1895.96	0.01	1.15
1770.97	0.00	0.93	1812.97	0.00	1.00	1854.97	0.00	1.07	1896.96	0.01	1.16
1771.97	0.00	0.93	1813.97	0.00	1.00	1855.97	0.00	1.08	1897.96	0.01	1.16
1772.97	0.00	0.94	1814.97	0.00	1.00	1856.97	0.00	1.08	1898.96	0.01	1.16
1773.97	0.00	0.94	1815.97	0.00	1.00	1857.97	0.00	1.08	1899.96	0.01	1.16
1774.97	0.00	0.94	1816.97	0.00	1.01	1858.97	0.00	1.08	1900.96	0.01	1.16
1775.97	0.00	0.94	1817.97	0.00	1.01	1859.97	0.00	1.08	1901.96	0.01	1.17
1776.97	0.00	0.94	1818.97	0.00	1.01	1860.97	0.00	1.08	1902.96	0.01	1.17
1777.97	0.00	0.94	1819.97	0.00	1.01	1861.97	0.00	1.09	1903.96	0.01	1.17
1778.97	0.00	0.94	1820.97	0.00	1.01	1862.97	0.00	1.09	1904.96	0.01	1.17
1779.97	0.00	0.95	1821.97	0.00	1.01	1863.97	0.00	1.09	1905.96	0.01	1.17
1780.97	0.00	0.95	1822.97	0.00	1.02	1864.97	0.00	1.09	1906.96	0.01	1.18
1781.97	0.00	0.95	1823.97	0.00	1.02	1865.97	0.00	1.09	1907.96	0.01	1.18
1782.97	0.00	0.95	1824.97	0.00	1.02	1866.97	0.00	1.10	1908.96	0.01	1.18
1783.97	0.00	0.95	1825.97	0.00	1.02	1867.96	0.00	1.10	1909.96	0.01	1.18
1784.97	0.00	0.95	1826.97	0.00	1.02	1868.96	0.00	1.10	1910.96	0.01	1.19
1785.97	0.00	0.96	1827.97	0.00	1.02	1869.96	0.00	1.10	1911.96	0.01	1.19
1786.97	0.00	0.96	1828.97	0.00	1.03	1870.96	0.00	1.10	1912.96	0.01	1.19
1787.97	0.00	0.96	1829.97	0.00	1.03	1871.96	0.00	1.11	1913.96	0.01	1.19
1788.97	0.00	0.96	1830.97	0.00	1.03	1872.96	0.00	1.11	1914.96	0.01	1.19
1789.97	0.00	0.96	1831.97	0.00	1.03	1873.96	0.00	1.11	1915.96	0.01	1.20
1790.97	0.00	0.96	1832.97	0.00	1.03	1874.96	0.01	1.11	1916.96	0.01	1.20
1791.97	0.00	0.97	1833.97	0.00	1.04	1875.96	0.01	1.11	1917.96	0.01	1.20
1792.97	0.00	0.97	1834.97	0.00	1.04	1876.96	0.01	1.12	1918.96	0.01	1.20
1793.97	0.00	0.97	1835.97	0.00	1.04	1877.96	0.01	1.12	1919.96	0.01	1.21
1794.97	0.00	0.97	1836.97	0.00	1.04	1878.96	0.01	1.12	1920.96	0.01	1.21
1795.97	0.00	0.97	1837.97	0.00	1.04	1879.96	0.01	1.12	1921.96	0.01	1.21
1796.97	0.00	0.97	1838.97	0.00	1.04	1880.96	0.01	1.12	1922.96	0.01	1.21
1797.97	0.00	0.97	1839.97	0.00	1.05	1881.96	0.01	1.13	1923.96	0.01	1.21
1798.97	0.00	0.98	1840.97	0.00	1.05	1882.96	0.01	1.13	1924.96	0.01	1.22
1799.97	0.00	0.98	1841.97	0.00	1.05	1883.96	0.01	1.13	1925.96	0.01	1.22
1800.97	0.00	0.98	1842.97	0.00	1.05	1884.96	0.01	1.13	1926.96	0.01	1.22
1801.97	0.00	0.98	1843.97	0.00	1.05	1885.96	0.01	1.13	1927.96	0.01	1.22
1802.97	0.00	0.98	1844.97	0.00	1.05	1886.96	0.01	1.14	1928.96	0.01	1.23

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1929.96	0.01	1.23	1971.96	0.01	1.33	2013.96	0.01	1.44	2055.96	0.01	1.57
1930.96	0.01	1.23	1972.96	0.01	1.33	2014.96	0.01	1.45	2056.96	0.01	1.58
1931.96	0.01	1.23	1973.96	0.01	1.33	2015.96	0.01	1.45	2057.96	0.01	1.58
1932.96	0.01	1.23	1974.96	0.01	1.34	2016.96	0.01	1.45	2058.96	0.01	1.58
1933.96	0.01	1.24	1975.96	0.01	1.34	2017.96	0.01	1.46	2059.96	0.01	1.59
1934.96	0.01	1.24	1976.96	0.01	1.34	2018.96	0.01	1.46	2060.96	0.01	1.59
1935.96	0.01	1.24	1977.96	0.01	1.34	2019.96	0.01	1.46	2061.96	0.01	1.59
1936.96	0.01	1.24	1978.96	0.01	1.35	2020.96	0.01	1.46	2062.96	0.01	1.60
1937.96	0.01	1.25	1979.96	0.01	1.35	2021.96	0.01	1.47	2063.96	0.01	1.60
1938.96	0.01	1.25	1980.96	0.01	1.35	2022.96	0.01	1.47	2064.96	0.01	1.60
1939.96	0.01	1.25	1981.96	0.01	1.36	2023.96	0.01	1.47	2065.96	0.01	1.61
1940.96	0.01	1.25	1982.96	0.01	1.36	2024.96	0.01	1.48	2066.96	0.01	1.61
1941.96	0.01	1.26	1983.96	0.01	1.36	2025.96	0.01	1.48	2067.96	0.01	1.61
1942.96	0.01	1.26	1984.96	0.01	1.36	2026.96	0.01	1.48	2068.96	0.01	1.62
1943.96	0.01	1.26	1985.96	0.01	1.37	2027.96	0.01	1.49	2069.96	0.01	1.62
1944.96	0.01	1.26	1986.96	0.01	1.37	2028.96	0.01	1.49	2070.96	0.01	1.63
1945.96	0.01	1.26	1987.96	0.01	1.37	2029.96	0.01	1.49	2071.96	0.01	1.63
1946.96	0.01	1.27	1988.96	0.01	1.37	2030.96	0.01	1.49	2072.96	0.01	1.63
1947.96	0.01	1.27	1989.96	0.01	1.38	2031.96	0.01	1.50	2073.96	0.01	1.64
1948.96	0.01	1.27	1990.96	0.01	1.38	2032.96	0.01	1.50	2074.96	0.01	1.64
1949.96	0.01	1.27	1991.96	0.01	1.38	2033.96	0.01	1.50	2075.96	0.01	1.64
1950.96	0.01	1.28	1992.96	0.01	1.38	2034.96	0.01	1.51	2076.96	0.01	1.65
1951.96	0.01	1.28	1993.96	0.01	1.39	2035.96	0.01	1.51	2077.96	0.01	1.65
1952.96	0.01	1.28	1994.96	0.01	1.39	2036.96	0.01	1.51	2078.96	0.01	1.65
1953.96	0.01	1.28	1995.96	0.01	1.39	2037.96	0.01	1.52	2079.96	0.01	1.66
1954.96	0.01	1.29	1996.96	0.01	1.40	2038.96	0.01	1.52	2080.96	0.01	1.66
1955.96	0.01	1.29	1997.96	0.01	1.40	2039.96	0.01	1.52	2081.96	0.01	1.66
1956.96	0.01	1.29	1998.96	0.01	1.40	2040.96	0.01	1.53	2082.96	0.01	1.67
1957.96	0.01	1.29	1999.96	0.01	1.40	2041.96	0.01	1.53	2083.96	0.01	1.67
1958.96	0.01	1.30	2000.96	0.01	1.41	2042.96	0.01	1.53	2084.96	0.01	1.67
1959.96	0.01	1.30	2001.96	0.01	1.41	2043.96	0.01	1.54	2085.96	0.01	1.68
1960.96	0.01	1.30	2002.96	0.01	1.41	2044.96	0.01	1.54	2086.96	0.01	1.68
1961.96	0.01	1.30	2003.96	0.01	1.42	2045.96	0.01	1.54	2087.96	0.01	1.69
1962.96	0.01	1.31	2004.96	0.01	1.42	2046.96	0.01	1.54	2088.96	0.01	1.69
1963.96	0.01	1.31	2005.96	0.01	1.42	2047.96	0.01	1.55	2089.96	0.01	1.69
1964.96	0.01	1.31	2006.96	0.01	1.42	2048.96	0.01	1.55	2090.96	0.01	1.70
1965.96	0.01	1.31	2007.96	0.01	1.43	2049.96	0.01	1.55	2091.96	0.01	1.70
1966.96	0.01	1.32	2008.96	0.01	1.43	2050.96	0.01	1.56	2092.96	0.01	1.70
1967.96	0.01	1.32	2009.96	0.01	1.43	2051.96	0.01	1.56	2093.96	0.01	1.71
1968.96	0.01	1.32	2010.96	0.01	1.44	2052.96	0.01	1.56	2094.96	0.01	1.71
1969.96	0.01	1.32	2011.96	0.01	1.44	2053.96	0.01	1.57	2095.96	0.01	1.72
1970.96	0.01	1.33	2012.96	0.01	1.44	2054.96	0.01	1.57	2096.96	0.01	1.72

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2097.96	0.01	1.72	2139.96	0.01	1.89	2181.96	0.01	2.09	2223.96	0.01	2.32
2098.96	0.01	1.73	2140.96	0.01	1.90	2182.96	0.01	2.10	2224.96	0.01	2.33
2099.96	0.01	1.73	2141.96	0.01	1.90	2183.96	0.01	2.10	2225.96	0.01	2.33
2100.96	0.01	1.73	2142.96	0.01	1.91	2184.96	0.01	2.11	2226.96	0.01	2.34
2101.96	0.01	1.74	2143.96	0.01	1.91	2185.96	0.01	2.11	2227.96	0.01	2.35
2102.96	0.01	1.74	2144.96	0.01	1.92	2186.96	0.01	2.12	2228.96	0.01	2.35
2103.96	0.01	1.75	2145.96	0.01	1.92	2187.96	0.01	2.12	2229.96	0.01	2.36
2104.96	0.01	1.75	2146.96	0.01	1.93	2188.96	0.01	2.13	2230.96	0.01	2.37
2105.96	0.01	1.75	2147.96	0.01	1.93	2189.96	0.01	2.13	2231.96	0.01	2.37
2106.96	0.01	1.76	2148.96	0.01	1.93	2190.96	0.01	2.14	2232.96	0.01	2.38
2107.96	0.01	1.76	2149.96	0.01	1.94	2191.96	0.01	2.14	2233.96	0.01	2.38
2108.96	0.01	1.77	2150.96	0.01	1.94	2192.96	0.01	2.15	2234.96	0.01	2.39
2109.96	0.01	1.77	2151.96	0.01	1.95	2193.96	0.01	2.15	2235.96	0.01	2.40
2110.96	0.01	1.77	2152.96	0.01	1.95	2194.96	0.01	2.16	2236.96	0.01	2.40
2111.96	0.01	1.78	2153.96	0.01	1.96	2195.96	0.01	2.16	2237.96	0.01	2.41
2112.96	0.01	1.78	2154.96	0.01	1.96	2196.96	0.01	2.17	2238.96	0.01	2.41
2113.96	0.01	1.79	2155.96	0.01	1.97	2197.96	0.01	2.18	2239.96	0.01	2.42
2114.96	0.01	1.79	2156.96	0.01	1.97	2198.96	0.01	2.18	2240.96	0.01	2.43
2115.96	0.01	1.79	2157.96	0.01	1.98	2199.96	0.01	2.19	2241.96	0.01	2.43
2116.96	0.01	1.80	2158.96	0.01	1.98	2200.96	0.01	2.19	2242.96	0.01	2.44
2117.96	0.01	1.80	2159.96	0.01	1.98	2201.96	0.01	2.20	2243.96	0.01	2.45
2118.96	0.01	1.81	2160.96	0.01	1.99	2202.96	0.01	2.20	2244.96	0.01	2.45
2119.96	0.01	1.81	2161.96	0.01	1.99	2203.96	0.01	2.21	2245.96	0.01	2.46
2120.96	0.01	1.81	2162.96	0.01	2.00	2204.96	0.01	2.21	2246.96	0.01	2.47
2121.96	0.01	1.82	2163.96	0.01	2.00	2205.96	0.01	2.22	2247.96	0.01	2.47
2122.96	0.01	1.82	2164.96	0.01	2.01	2206.96	0.01	2.23	2248.96	0.01	2.48
2123.96	0.01	1.83	2165.96	0.01	2.01	2207.96	0.01	2.23	2249.96	0.01	2.49
2124.96	0.01	1.83	2166.96	0.01	2.02	2208.96	0.01	2.24	2250.96	0.01	2.49
2125.96	0.01	1.83	2167.96	0.01	2.02	2209.96	0.01	2.24	2251.96	0.01	2.50
2126.96	0.01	1.84	2168.96	0.01	2.03	2210.96	0.01	2.25	2252.96	0.01	2.51
2127.96	0.01	1.84	2169.96	0.01	2.03	2211.96	0.01	2.25	2253.96	0.01	2.51
2128.96	0.01	1.85	2170.96	0.01	2.04	2212.96	0.01	2.26	2254.96	0.01	2.52
2129.96	0.01	1.85	2171.96	0.01	2.04	2213.96	0.01	2.26	2255.96	0.01	2.53
2130.96	0.01	1.86	2172.96	0.01	2.05	2214.96	0.01	2.27	2256.96	0.01	2.53
2131.96	0.01	1.86	2173.96	0.01	2.05	2215.96	0.01	2.28	2257.96	0.01	2.54
2132.96	0.01	1.86	2174.96	0.01	2.06	2216.96	0.01	2.28	2258.96	0.01	2.55
2133.96	0.01	1.87	2175.96	0.01	2.06	2217.96	0.01	2.29	2259.96	0.01	2.55
2134.96	0.01	1.87	2176.96	0.01	2.07	2218.96	0.01	2.29	2260.96	0.01	2.56
2135.96	0.01	1.88	2177.96	0.01	2.07	2219.96	0.01	2.30	2261.96	0.01	2.57
2136.96	0.01	1.88	2178.96	0.01	2.08	2220.96	0.01	2.31	2262.96	0.01	2.57
2137.96	0.01	1.89	2179.96	0.01	2.08	2221.96	0.01	2.31	2263.96	0.01	2.58
2138.96	0.01	1.89	2180.96	0.01	2.09	2222.96	0.01	2.32	2264.96	0.01	2.59

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2265.96	0.01	2.59	2307.95	0.01	2.92	2349.95	0.01	3.30	2391.95	0.02	3.77
2266.96	0.01	2.60	2308.95	0.01	2.93	2350.95	0.01	3.31	2392.95	0.02	3.79
2267.96	0.01	2.61	2309.95	0.01	2.93	2351.95	0.01	3.32	2393.95	0.02	3.80
2268.96	0.01	2.62	2310.95	0.01	2.94	2352.95	0.01	3.33	2394.95	0.02	3.81
2269.96	0.01	2.62	2311.95	0.01	2.95	2353.95	0.01	3.34	2395.95	0.02	3.82
2270.96	0.01	2.63	2312.95	0.01	2.96	2354.95	0.02	3.35	2396.95	0.02	3.84
2271.96	0.01	2.64	2313.95	0.01	2.97	2355.95	0.02	3.37	2397.95	0.02	3.85
2272.96	0.01	2.64	2314.95	0.01	2.98	2356.95	0.02	3.38	2398.95	0.02	3.86
2273.96	0.01	2.65	2315.95	0.01	2.99	2357.95	0.02	3.39	2399.95	0.02	3.87
2274.96	0.01	2.66	2316.95	0.01	2.99	2358.95	0.02	3.40	2400.95	0.02	3.89
2275.96	0.01	2.67	2317.95	0.01	3.00	2359.95	0.02	3.41	2401.95	0.02	3.90
2276.96	0.01	2.67	2318.95	0.01	3.01	2360.95	0.02	3.42	2402.95	0.02	3.91
2277.96	0.01	2.68	2319.95	0.01	3.02	2361.95	0.02	3.43	2403.95	0.02	3.93
2278.96	0.01	2.69	2320.95	0.01	3.03	2362.95	0.02	3.44	2404.95	0.02	3.94
2279.95	0.01	2.70	2321.95	0.01	3.04	2363.95	0.02	3.45	2405.95	0.02	3.95
2280.95	0.01	2.70	2322.95	0.01	3.05	2364.95	0.02	3.46	2406.95	0.02	3.97
2281.95	0.01	2.71	2323.95	0.01	3.06	2365.95	0.02	3.47	2407.95	0.02	3.98
2282.95	0.01	2.72	2324.95	0.01	3.06	2366.95	0.02	3.48	2408.95	0.02	3.99
2283.95	0.01	2.73	2325.95	0.01	3.07	2367.95	0.02	3.49	2409.95	0.02	4.01
2284.95	0.01	2.73	2326.95	0.01	3.08	2368.95	0.02	3.50	2410.95	0.02	4.02
2285.95	0.01	2.74	2327.95	0.01	3.09	2369.95	0.02	3.52	2411.95	0.02	4.03
2286.95	0.01	2.75	2328.95	0.01	3.10	2370.95	0.02	3.53	2412.95	0.02	4.05
2287.95	0.01	2.76	2329.95	0.01	3.11	2371.95	0.02	3.54	2413.95	0.02	4.06
2288.95	0.01	2.76	2330.95	0.01	3.12	2372.95	0.02	3.55	2414.95	0.02	4.08
2289.95	0.01	2.77	2331.95	0.01	3.13	2373.95	0.02	3.56	2415.95	0.02	4.09
2290.95	0.01	2.78	2332.95	0.01	3.14	2374.95	0.02	3.57	2416.95	0.02	4.10
2291.95	0.01	2.79	2333.95	0.01	3.15	2375.95	0.02	3.58	2417.95	0.02	4.12
2292.95	0.01	2.80	2334.95	0.01	3.16	2376.95	0.02	3.59	2418.95	0.02	4.13
2293.95	0.01	2.80	2335.95	0.01	3.17	2377.95	0.02	3.61	2419.95	0.02	4.15
2294.95	0.01	2.81	2336.95	0.01	3.18	2378.95	0.02	3.62	2420.95	0.02	4.16
2295.95	0.01	2.82	2337.95	0.01	3.19	2379.95	0.02	3.63	2421.95	0.02	4.17
2296.95	0.01	2.83	2338.95	0.01	3.20	2380.95	0.02	3.64	2422.95	0.02	4.19
2297.95	0.01	2.83	2339.95	0.01	3.20	2381.95	0.02	3.65	2423.95	0.02	4.20
2298.95	0.01	2.84	2340.95	0.01	3.21	2382.95	0.02	3.66	2424.95	0.02	4.22
2299.95	0.01	2.85	2341.95	0.01	3.22	2383.95	0.02	3.68	2425.95	0.02	4.23
2300.95	0.01	2.86	2342.95	0.01	3.23	2384.95	0.02	3.69	2426.95	0.02	4.25
2301.95	0.01	2.87	2343.95	0.01	3.24	2385.95	0.02	3.70	2427.95	0.02	4.26
2302.95	0.01	2.88	2344.95	0.01	3.25	2386.95	0.02	3.71	2428.95	0.02	4.28
2303.95	0.01	2.88	2345.95	0.01	3.26	2387.95	0.02	3.72	2429.95	0.02	4.29
2304.95	0.01	2.89	2346.95	0.01	3.27	2388.95	0.02	3.74	2430.95	0.02	4.31
2305.95	0.01	2.90	2347.95	0.01	3.28	2389.95	0.02	3.75	2431.95	0.02	4.32
2306.95	0.01	2.91	2348.95	0.01	3.29	2390.95	0.02	3.76	2432.95	0.02	4.34

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2433.95	0.02	4.35	2475.95	0.02	5.08	2517.95	0.03	6.00	2559.95	0.03	7.21
2434.95	0.02	4.37	2476.95	0.02	5.10	2518.95	0.03	6.03	2560.95	0.03	7.24
2435.95	0.02	4.38	2477.95	0.02	5.12	2519.95	0.03	6.05	2561.95	0.03	7.27
2436.95	0.02	4.40	2478.95	0.02	5.14	2520.95	0.03	6.08	2562.95	0.03	7.31
2437.95	0.02	4.41	2479.95	0.02	5.16	2521.95	0.03	6.10	2563.95	0.03	7.34
2438.95	0.02	4.43	2480.95	0.02	5.18	2522.95	0.03	6.13	2564.95	0.03	7.37
2439.95	0.02	4.45	2481.95	0.02	5.20	2523.95	0.03	6.15	2565.95	0.03	7.41
2440.95	0.02	4.46	2482.95	0.02	5.22	2524.95	0.03	6.18	2566.95	0.03	7.44
2441.95	0.02	4.48	2483.95	0.02	5.24	2525.95	0.03	6.21	2567.95	0.03	7.48
2442.95	0.02	4.49	2484.95	0.02	5.26	2526.95	0.03	6.23	2568.95	0.03	7.51
2443.95	0.02	4.51	2485.95	0.02	5.28	2527.95	0.03	6.26	2569.95	0.03	7.55
2444.95	0.02	4.53	2486.95	0.02	5.30	2528.95	0.03	6.29	2570.95	0.03	7.58
2445.95	0.02	4.54	2487.95	0.02	5.32	2529.95	0.03	6.31	2571.95	0.03	7.62
2446.95	0.02	4.56	2488.95	0.02	5.34	2530.95	0.03	6.34	2572.95	0.03	7.66
2447.95	0.02	4.58	2489.95	0.02	5.36	2531.95	0.03	6.37	2573.95	0.03	7.69
2448.95	0.02	4.59	2490.95	0.02	5.38	2532.95	0.03	6.39	2574.95	0.03	7.73
2449.95	0.02	4.61	2491.95	0.02	5.40	2533.95	0.03	6.42	2575.95	0.03	7.76
2450.95	0.02	4.63	2492.95	0.02	5.42	2534.95	0.03	6.45	2576.95	0.03	7.80
2451.95	0.02	4.64	2493.95	0.02	5.45	2535.95	0.03	6.48	2577.95	0.03	7.84
2452.95	0.02	4.66	2494.95	0.02	5.47	2536.95	0.03	6.51	2578.95	0.03	7.88
2453.95	0.02	4.68	2495.95	0.02	5.49	2537.95	0.03	6.53	2579.95	0.03	7.91
2454.95	0.02	4.69	2496.95	0.02	5.51	2538.95	0.03	6.56	2580.95	0.04	7.95
2455.95	0.02	4.71	2497.95	0.02	5.53	2539.95	0.03	6.59	2581.95	0.04	7.99
2456.95	0.02	4.73	2498.95	0.02	5.55	2540.95	0.03	6.62	2582.95	0.04	8.03
2457.95	0.02	4.75	2499.95	0.02	5.58	2541.95	0.03	6.65	2583.95	0.04	8.07
2458.95	0.02	4.76	2500.95	0.02	5.60	2542.95	0.03	6.68	2584.95	0.04	8.11
2459.95	0.02	4.78	2501.95	0.02	5.62	2543.95	0.03	6.71	2585.95	0.04	8.15
2460.95	0.02	4.80	2502.95	0.03	5.64	2544.95	0.03	6.74	2586.95	0.04	8.19
2461.95	0.02	4.82	2503.95	0.03	5.67	2545.95	0.03	6.77	2587.95	0.04	8.23
2462.95	0.02	4.83	2504.95	0.03	5.69	2546.95	0.03	6.80	2588.95	0.04	8.27
2463.95	0.02	4.85	2505.95	0.03	5.71	2547.95	0.03	6.83	2589.95	0.04	8.31
2464.95	0.02	4.87	2506.95	0.03	5.74	2548.95	0.03	6.86	2590.95	0.04	8.35
2465.95	0.02	4.89	2507.95	0.03	5.76	2549.95	0.03	6.89	2591.95	0.04	8.39
2466.95	0.02	4.91	2508.95	0.03	5.78	2550.95	0.03	6.92	2592.95	0.04	8.43
2467.95	0.02	4.93	2509.95	0.03	5.81	2551.95	0.03	6.95	2593.95	0.04	8.47
2468.95	0.02	4.94	2510.95	0.03	5.83	2552.95	0.03	6.98	2594.95	0.04	8.52
2469.95	0.02	4.96	2511.95	0.03	5.85	2553.95	0.03	7.01	2595.95	0.04	8.56
2470.95	0.02	4.98	2512.95	0.03	5.88	2554.95	0.03	7.05	2596.95	0.04	8.60
2471.95	0.02	5.00	2513.95	0.03	5.90	2555.95	0.03	7.08	2597.95	0.04	8.65
2472.95	0.02	5.02	2514.95	0.03	5.93	2556.95	0.03	7.11	2598.95	0.04	8.69
2473.95	0.02	5.04	2515.95	0.03	5.95	2557.95	0.03	7.14	2599.95	0.04	8.73
2474.95	0.02	5.06	2516.95	0.03	5.98	2558.95	0.03	7.17	2600.95	0.04	8.78

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2601.95	0.04	8.82	2643.95	0.05	11.06	2685.95	0.06	14.29	2727.94	0.08	19.22
2602.95	0.04	8.87	2644.95	0.05	11.12	2686.95	0.06	14.38	2728.94	0.08	19.37
2603.95	0.04	8.91	2645.95	0.05	11.19	2687.95	0.06	14.48	2729.94	0.08	19.52
2604.95	0.04	8.96	2646.95	0.05	11.25	2688.95	0.06	14.58	2730.94	0.08	19.67
2605.95	0.04	9.00	2647.95	0.05	11.32	2689.94	0.06	14.67	2731.94	0.08	19.82
2606.95	0.04	9.05	2648.95	0.05	11.38	2690.94	0.06	14.77	2732.94	0.08	19.98
2607.95	0.04	9.10	2649.95	0.05	11.45	2691.94	0.06	14.87	2733.94	0.09	20.13
2608.95	0.04	9.14	2650.95	0.05	11.52	2692.94	0.06	14.97	2734.94	0.09	20.29
2609.95	0.04	9.19	2651.95	0.05	11.58	2693.94	0.06	15.07	2735.94	0.09	20.45
2610.95	0.04	9.24	2652.95	0.05	11.65	2694.94	0.07	15.17	2736.94	0.09	20.62
2611.95	0.04	9.29	2653.95	0.05	11.72	2695.94	0.07	15.27	2737.94	0.09	20.78
2612.95	0.04	9.34	2654.95	0.05	11.79	2696.94	0.07	15.38	2738.94	0.09	20.95
2613.95	0.04	9.39	2655.95	0.05	11.86	2697.94	0.07	15.48	2739.94	0.09	21.11
2614.95	0.04	9.43	2656.95	0.05	11.93	2698.94	0.07	15.59	2740.94	0.09	21.29
2615.95	0.04	9.48	2657.95	0.05	12.00	2699.94	0.07	15.70	2741.94	0.09	21.46
2616.95	0.04	9.53	2658.95	0.05	12.07	2700.94	0.07	15.80	2742.94	0.09	21.63
2617.95	0.04	9.59	2659.95	0.05	12.14	2701.94	0.07	15.91	2743.94	0.09	21.81
2618.95	0.04	9.64	2660.95	0.05	12.22	2702.94	0.07	16.02	2744.94	0.09	21.99
2619.95	0.04	9.69	2661.95	0.05	12.29	2703.94	0.07	16.14	2745.94	0.09	22.17
2620.95	0.04	9.74	2662.95	0.05	12.37	2704.94	0.07	16.25	2746.94	0.09	22.35
2621.95	0.04	9.79	2663.95	0.05	12.44	2705.94	0.07	16.36	2747.94	0.09	22.54
2622.95	0.04	9.84	2664.95	0.05	12.52	2706.94	0.07	16.48	2748.94	0.09	22.73
2623.95	0.04	9.90	2665.95	0.05	12.59	2707.94	0.07	16.60	2749.94	0.10	22.92
2624.95	0.04	9.95	2666.95	0.06	12.67	2708.94	0.07	16.71	2750.94	0.10	23.11
2625.95	0.04	10.01	2667.95	0.06	12.75	2709.94	0.07	16.83	2751.94	0.10	23.31
2626.95	0.04	10.06	2668.95	0.06	12.83	2710.94	0.07	16.95	2752.94	0.10	23.51
2627.95	0.04	10.11	2669.95	0.06	12.91	2711.94	0.07	17.07	2753.94	0.10	23.71
2628.95	0.04	10.17	2670.95	0.06	12.99	2712.94	0.07	17.20	2754.94	0.10	23.91
2629.95	0.04	10.23	2671.95	0.06	13.07	2713.94	0.07	17.32	2755.94	0.10	24.12
2630.95	0.05	10.28	2672.95	0.06	13.15	2714.94	0.07	17.45	2756.94	0.10	24.33
2631.95	0.05	10.34	2673.95	0.06	13.23	2715.94	0.08	17.58	2757.94	0.10	24.54
2632.95	0.05	10.40	2674.95	0.06	13.32	2716.94	0.08	17.70	2758.94	0.10	24.75
2633.95	0.05	10.45	2675.95	0.06	13.40	2717.94	0.08	17.83	2759.94	0.10	24.97
2634.95	0.05	10.51	2676.95	0.06	13.49	2718.94	0.08	17.97	2760.94	0.10	25.19
2635.95	0.05	10.57	2677.95	0.06	13.57	2719.94	0.08	18.10	2761.94	0.10	25.41
2636.95	0.05	10.63	2678.95	0.06	13.66	2720.94	0.08	18.23	2762.94	0.11	25.64
2637.95	0.05	10.69	2679.95	0.06	13.75	2721.94	0.08	18.37	2763.94	0.11	25.87
2638.95	0.05	10.75	2680.95	0.06	13.84	2722.94	0.08	18.51	2764.94	0.11	26.10
2639.95	0.05	10.81	2681.95	0.06	13.92	2723.94	0.08	18.65	2765.94	0.11	26.34
2640.95	0.05	10.87	2682.95	0.06	14.02	2724.94	0.08	18.79	2766.94	0.11	26.58
2641.95	0.05	10.93	2683.95	0.06	14.11	2725.94	0.08	18.93	2767.94	0.11	26.82
2642.95	0.05	11.00	2684.95	0.06	14.20	2726.94	0.08	19.08	2768.94	0.11	27.07

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2769.94	0.11	27.32	2811.94	0.16	42.06	2853.94	0.21	73.29	2895.94	0.06	155.67
2770.94	0.11	27.57	2812.94	0.16	42.55	2854.94	0.21	74.42	2896.94	0.07	158.98
2771.94	0.11	27.83	2813.94	0.16	43.04	2855.94	0.22	75.57	2897.94	0.08	162.38
2772.94	0.11	28.09	2814.94	0.16	43.55	2856.94	0.22	76.76	2898.94	0.09	165.87
2773.94	0.12	28.35	2815.94	0.16	44.06	2857.94	0.22	77.96	2899.94	0.11	169.47
2774.94	0.12	28.62	2816.94	0.17	44.59	2858.94	0.22	79.20	2900.94	0.13	173.16
2775.94	0.12	28.89	2817.94	0.17	45.12	2859.94	0.22	80.47	2901.94	0.16	176.96
2776.94	0.12	29.17	2818.94	0.17	45.67	2860.94	0.22	81.76	2902.94	0.18	180.87
2777.94	0.12	29.44	2819.94	0.17	46.22	2861.94	0.22	83.09	2903.94	0.21	184.89
2778.94	0.12	29.73	2820.94	0.17	46.79	2862.94	0.22	84.45	2904.94	0.25	189.02
2779.94	0.12	30.02	2821.94	0.17	47.36	2863.94	0.22	85.84	2905.94	0.28	193.26
2780.94	0.12	30.31	2822.94	0.17	47.95	2864.94	0.22	87.27	2906.94	0.32	197.62
2781.94	0.12	30.60	2823.94	0.18	48.54	2865.94	0.22	88.73	2907.94	0.36	202.10
2782.94	0.12	30.91	2824.94	0.18	49.15	2866.94	0.22	90.22	2908.94	0.41	206.71
2783.94	0.13	31.21	2825.94	0.18	49.77	2867.94	0.22	91.76	2909.94	0.46	211.43
2784.94	0.13	31.52	2826.94	0.18	50.40	2868.94	0.21	93.33	2910.94	0.51	216.28
2785.94	0.13	31.84	2827.94	0.18	51.05	2869.94	0.21	94.94	2911.94	0.56	221.26
2786.94	0.13	32.16	2828.94	0.18	51.70	2870.94	0.21	96.59	2912.94	0.62	226.36
2787.94	0.13	32.48	2829.94	0.18	52.37	2871.94	0.21	98.28	2913.94	0.69	231.59
2788.94	0.13	32.81	2830.94	0.19	53.05	2872.94	0.21	100.02	2914.94	0.75	236.95
2789.94	0.13	33.15	2831.94	0.19	53.75	2873.94	0.21	101.80	2915.94	0.82	242.43
2790.94	0.13	33.49	2832.94	0.19	54.46	2874.94	0.20	103.63	2916.94	0.90	248.03
2791.94	0.13	33.83	2833.94	0.19	55.18	2875.94	0.20	105.50	2917.94	0.98	253.76
2792.94	0.13	34.18	2834.94	0.19	55.92	2876.94	0.20	107.42	2918.94	1.06	259.60
2793.94	0.14	34.54	2835.94	0.19	56.67	2877.94	0.19	109.40	2919.94	1.15	265.56
2794.94	0.14	34.90	2836.94	0.19	57.44	2878.94	0.19	111.42	2920.94	1.25	271.62
2795.94	0.14	35.27	2837.94	0.20	58.22	2879.94	0.18	113.50	2921.94	1.35	277.77
2796.94	0.14	35.64	2838.94	0.20	59.02	2880.94	0.18	115.64	2922.94	1.45	284.02
2797.94	0.14	36.02	2839.94	0.20	59.84	2881.94	0.17	117.83	2923.94	1.56	290.34
2798.94	0.14	36.41	2840.94	0.20	60.67	2882.94	0.17	120.08	2924.94	1.68	296.72
2799.94	0.14	36.80	2841.94	0.20	61.52	2883.94	0.16	122.39	2925.94	1.80	303.15
2800.94	0.14	37.20	2842.94	0.20	62.39	2884.94	0.15	124.77	2926.94	1.93	309.61
2801.94	0.15	37.60	2843.94	0.20	63.28	2885.94	0.15	127.21	2927.94	2.06	316.08
2802.94	0.15	38.02	2844.94	0.20	64.18	2886.94	0.14	129.72	2928.94	2.19	322.53
2803.94	0.15	38.44	2845.94	0.21	65.11	2887.94	0.13	132.29	2929.94	2.33	328.94
2804.94	0.15	38.86	2846.94	0.21	66.06	2888.94	0.12	134.94	2930.94	2.48	335.28
2805.94	0.15	39.29	2847.94	0.21	67.02	2889.94	0.11	137.66	2931.94	2.63	341.52
2806.94	0.15	39.74	2848.94	0.21	68.01	2890.94	0.10	140.46	2932.94	2.78	347.63
2807.94	0.15	40.18	2849.94	0.21	69.02	2891.94	0.09	143.34	2933.94	2.93	353.56
2808.94	0.15	40.64	2850.94	0.21	70.05	2892.94	0.08	146.29	2934.94	3.08	359.29
2809.94	0.16	41.10	2851.94	0.21	71.11	2893.94	0.07	149.33	2935.94	3.24	364.78
2810.94	0.16	41.58	2852.94	0.21	72.19	2894.94	0.07	152.46	2936.94	3.39	369.98

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2937.94	3.54	374.87	2979.94	2.31	270.45	3021.94	0.05	113.44	3063.94	3.67	334.83
2938.94	3.69	379.41	2980.94	2.17	262.96	3022.94	0.07	114.68	3064.94	3.81	341.23
2939.94	3.84	383.56	2981.94	2.03	255.54	3023.94	0.08	116.17	3065.94	3.96	347.34
2940.94	3.98	387.32	2982.94	1.90	248.21	3024.94	0.10	117.90	3066.94	4.10	353.11
2941.94	4.12	390.64	2983.94	1.77	240.98	3025.94	0.12	119.87	3067.94	4.23	358.55
2942.94	4.25	393.52	2984.94	1.65	233.88	3026.94	0.14	122.08	3068.94	4.35	363.62
2943.94	4.37	395.96	2985.94	1.53	226.91	3027.94	0.16	124.53	3069.94	4.46	368.32
2944.94	4.48	397.95	2986.94	1.42	220.10	3028.94	0.19	127.22	3070.94	4.57	372.65
2945.94	4.58	399.50	2987.94	1.31	213.45	3029.94	0.22	130.13	3071.94	4.66	376.61
2946.94	4.67	400.62	2988.94	1.21	206.97	3030.94	0.25	133.27	3072.94	4.74	380.22
2947.94	4.76	401.34	2989.94	1.12	200.67	3031.94	0.29	136.64	3073.94	4.82	383.49
2948.94	4.83	401.69	2990.94	1.03	194.56	3032.94	0.33	140.23	3074.94	4.88	386.44
2949.94	4.89	401.68	2991.94	0.94	188.64	3033.94	0.37	144.04	3075.94	4.93	389.10
2950.94	4.94	401.35	2992.94	0.86	182.92	3034.94	0.42	148.07	3076.94	4.97	391.48
2951.94	4.98	400.73	2993.94	0.78	177.39	3035.94	0.47	152.32	3077.94	5.00	393.60
2952.94	5.00	399.84	2994.94	0.71	172.07	3036.94	0.52	156.77	3078.94	5.02	395.48
2953.94	5.02	398.69	2995.94	0.65	166.96	3037.94	0.58	161.45	3079.94	5.02	397.12
2954.94	5.02	397.31	2996.94	0.58	162.05	3038.94	0.64	166.33	3080.94	5.02	398.53
2955.94	5.02	395.70	2997.94	0.53	157.35	3039.94	0.70	171.41	3081.94	5.01	399.71
2956.94	5.00	393.85	2998.94	0.47	152.86	3040.94	0.77	176.71	3082.94	4.98	400.63
2957.94	4.97	391.76	2999.94	0.42	148.59	3041.94	0.85	182.21	3083.94	4.94	401.29
2958.94	4.94	389.41	3000.94	0.38	144.54	3042.94	0.93	187.91	3084.94	4.89	401.66
2959.94	4.89	386.79	3001.94	0.33	140.70	3043.94	1.01	193.80	3085.94	4.84	401.70
2960.94	4.83	383.88	3002.94	0.29	137.08	3044.94	1.10	199.89	3086.94	4.77	401.41
2961.94	4.75	380.65	3003.94	0.26	133.69	3045.94	1.20	206.16	3087.94	4.68	400.73
2962.94	4.67	377.08	3004.94	0.22	130.51	3046.94	1.30	212.62	3088.94	4.59	399.66
2963.94	4.58	373.17	3005.94	0.19	127.57	3047.94	1.41	219.25	3089.94	4.49	398.17
2964.94	4.48	368.88	3006.94	0.17	124.86	3048.94	1.52	226.04	3090.94	4.38	396.23
2965.94	4.36	364.23	3007.94	0.14	122.38	3049.94	1.63	232.99	3091.94	4.26	393.85
2966.94	4.24	359.20	3008.94	0.12	120.14	3050.94	1.75	240.08	3092.94	4.13	391.03
2967.94	4.11	353.82	3009.94	0.10	118.13	3051.94	1.88	247.29	3093.94	4.00	387.76
2968.94	3.98	348.08	3010.94	0.08	116.37	3052.94	2.01	254.61	3094.94	3.86	384.06
2969.94	3.83	342.02	3011.94	0.07	114.85	3053.94	2.15	262.02	3095.94	3.71	379.95
2970.94	3.69	335.65	3012.94	0.06	113.58	3054.94	2.29	269.50	3096.94	3.56	375.46
2971.94	3.53	329.02	3013.94	0.05	112.56	3055.94	2.44	277.02	3097.94	3.41	370.62
2972.94	3.38	322.14	3014.94	0.04	111.78	3056.94	2.59	284.55	3098.94	3.26	365.45
2973.94	3.23	315.07	3015.94	0.04	111.26	3057.94	2.74	292.06	3099.93	3.10	360.00
2974.94	3.07	307.83	3016.94	0.04	110.99	3058.94	2.89	299.53	3100.93	2.95	354.30
2975.94	2.91	300.46	3017.94	0.04	110.98	3059.94	3.05	306.91	3101.93	2.80	348.39
2976.94	2.76	293.01	3018.94	0.04	111.22	3060.94	3.21	314.16	3102.93	2.64	342.30
2977.94	2.61	285.50	3019.94	0.04	111.71	3061.94	3.36	321.26	3103.93	2.50	336.08
2978.94	2.46	277.97	3020.94	0.05	112.45	3062.94	3.52	328.16	3104.93	2.35	329.75

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3A- New Configuration Running North on West Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3105.93	2.21	323.34	3147.93	0.14	130.04	3189.93	0.20	64.30
3106.93	2.07	316.90	3148.93	0.15	127.52	3190.93	0.20	63.39
3107.93	1.94	310.43	3149.93	0.15	125.07	3191.93	0.20	62.50
3108.93	1.82	303.97	3150.93	0.16	122.69	3192.93	0.20	61.63
3109.93	1.69	297.53	3151.93	0.17	120.37	3193.93	0.20	60.78
3110.93	1.58	291.14	3152.93	0.17	118.11	3194.93	0.20	59.94
3111.93	1.47	284.81	3153.93	0.18	115.91	3195.93	0.20	59.12
3112.93	1.36	278.56	3154.93	0.18	113.77	3196.93	0.20	58.32
3113.93	1.26	272.39	3155.93	0.19	111.68	3197.93	0.19	57.54
3114.93	1.17	266.32	3156.93	0.19	109.65	3198.93	0.19	56.77
3115.93	1.07	260.35	3157.93	0.20	107.67	3199.93	0.19	56.01
3116.93	0.99	254.49	3158.93	0.20	105.74	3200.93	0.19	55.27
3117.93	0.91	248.75	3159.93	0.20	103.86	3201.93	0.19	54.55
3118.93	0.83	243.13	3160.93	0.20	102.03	3202.93	0.19	53.84
3119.93	0.76	237.63	3161.93	0.21	100.24	3203.93	0.19	53.14
3120.93	0.69	232.26	3162.93	0.21	98.50	3204.93	0.18	52.45
3121.93	0.63	227.01	3163.93	0.21	96.80	3205.93	0.18	51.78
3122.93	0.57	221.90	3164.93	0.21	95.14	3206.93	0.18	51.13
3123.93	0.52	216.90	3165.93	0.21	93.53	3207.93	0.18	50.48
3124.93	0.46	212.04	3166.93	0.22	91.95	3208.93	0.18	49.85
3125.93	0.42	207.30	3167.93	0.22	90.41	3209.93	0.18	49.23
3126.93	0.37	202.68	3168.93	0.22	88.91			
3127.93	0.33	198.18	3169.93	0.22	87.45			
3128.93	0.29	193.80	3170.93	0.22	86.02			
3129.93	0.25	189.55	3171.93	0.22	84.62			
3130.93	0.22	185.40	3172.93	0.22	83.26			
3131.93	0.19	181.37	3173.93	0.22	81.93			
3132.93	0.16	177.45	3174.93	0.22	80.63			
3133.93	0.13	173.64	3175.93	0.22	79.36			
3134.93	0.11	169.93	3176.93	0.22	78.12			
3135.93	0.09	166.32	3177.93	0.22	76.91			
3136.93	0.08	162.81	3178.93	0.22	75.72			
3137.93	0.07	159.40	3179.93	0.21	74.56			
3138.93	0.06	156.09	3180.93	0.21	73.43			
3139.93	0.07	152.86	3181.93	0.21	72.33			
3140.93	0.07	149.72	3182.93	0.21	71.24			
3141.93	0.08	146.67	3183.93	0.21	70.19			
3142.93	0.09	143.71	3184.93	0.21	69.15			
3143.93	0.10	140.82	3185.93	0.21	68.14			
3144.93	0.11	138.01	3186.93	0.21	67.15			
3145.93	0.12	135.28	3187.93	0.21	66.18			
3146.93	0.13	132.62	3188.93	0.21	65.23			

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3B- New Configuration Running East on North Side of Plant**

Circuit Name	Id	Dist From Left ROW (ft)	Dist From Circuit CL (ft)	Minimum Height (ft)	SubConductors			Maximum Voltage (kV)	Angle (Degrees)	MCR (Amps)
					# of	Diameter (in)	Spacing (in)			
230-1	1A1	41.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-1	1B1	41.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-1	1C1	41.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-1	1G1	44.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-2	2A1	58.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-2	2B1	58.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-2	2C1	58.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-2	2G1	56.00	6.00	90.00	1	0.50	0.00	0.0	0	0
230-3	3A1	166.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-3	3B1	166.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-3	3C1	166.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-3	3G1	169.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-4	4A1	183.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-4	4B1	183.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-4	4C1	183.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-4	4G1	181.00	6.00	90.00	1	0.50	0.00	0.0	0	0

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
0.00	0.25	189.27	16.00	1.25	271.99	38.00	4.25	393.69	60.00	4.47	368.61
805.00	0.01	3.07	17.00	1.35	278.15	39.00	4.37	396.09	61.00	4.36	363.93
-4.00	0.13	173.39	18.00	1.46	284.40	40.00	4.48	398.05	62.00	4.23	358.88
-3.00	0.16	177.20	19.00	1.57	290.73	41.00	4.59	399.58	63.00	4.10	353.47
-2.00	0.18	181.11	20.00	1.69	297.11	42.00	4.68	400.68	64.00	3.97	347.72
-1.00	0.22	185.13	21.00	1.81	303.55	43.00	4.76	401.38	65.00	3.82	341.63
0.00	0.25	189.27	22.00	1.93	310.01	44.00	4.83	401.70	66.00	3.68	335.25
1.00	0.29	193.52	23.00	2.07	316.47	45.00	4.89	401.67	67.00	3.53	328.60
2.00	0.32	197.89	24.00	2.20	322.92	46.00	4.94	401.32	68.00	3.37	321.71
3.00	0.37	202.38	25.00	2.34	329.33	47.00	4.98	400.68	69.00	3.22	314.63
4.00	0.41	206.99	26.00	2.49	335.67	48.00	5.00	399.77	70.00	3.06	307.38
5.00	0.46	211.72	27.00	2.63	341.90	49.00	5.02	398.62	71.00	2.90	300.01
6.00	0.51	216.58	28.00	2.79	347.99	50.00	5.02	397.22	72.00	2.75	292.55
7.00	0.57	221.56	29.00	2.94	353.92	51.00	5.02	395.59	73.00	2.60	285.03
8.00	0.63	226.67	30.00	3.09	359.63	52.00	5.00	393.73	74.00	2.45	277.50
9.00	0.69	231.91	31.00	3.25	365.10	53.00	4.97	391.62	75.00	2.30	269.98
10.00	0.76	237.28	32.00	3.40	370.29	54.00	4.93	389.26	76.00	2.16	262.50
11.00	0.83	242.77	33.00	3.55	375.16	55.00	4.88	386.62	77.00	2.02	255.08
12.00	0.90	248.38	34.00	3.70	379.67	56.00	4.82	383.69	78.00	1.89	247.76
13.00	0.98	254.11	35.00	3.85	383.81	57.00	4.75	380.44	79.00	1.76	240.53
14.00	1.07	259.96	36.00	3.99	387.53	58.00	4.67	376.85	80.00	1.64	233.44
15.00	1.16	265.92	37.00	4.13	390.83	59.00	4.57	372.91	81.00	1.52	226.48

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3B- New Configuration Running East on North Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
82.00	1.41	219.68	124.00	0.19	127.40	166.00	4.57	372.91	208.00	1.35	278.15
83.00	1.31	213.04	125.00	0.22	130.32	167.00	4.67	376.85	209.00	1.25	271.99
84.00	1.21	206.57	126.00	0.26	133.48	168.00	4.75	380.44	210.00	1.16	265.92
85.00	1.11	200.28	127.00	0.29	136.86	169.00	4.82	383.69	211.00	1.07	259.96
86.00	1.02	194.18	128.00	0.33	140.47	170.00	4.88	386.62	212.00	0.98	254.11
87.00	0.93	188.28	129.00	0.37	144.29	171.00	4.93	389.26	213.00	0.90	248.38
88.00	0.85	182.57	130.00	0.42	148.33	172.00	4.97	391.62	214.00	0.83	242.76
89.00	0.78	177.05	131.00	0.47	152.59	173.00	5.00	393.73	215.00	0.76	237.28
90.00	0.71	171.75	132.00	0.52	157.07	174.00	5.02	395.59	216.00	0.69	231.91
91.00	0.64	166.64	133.00	0.58	161.75	175.00	5.02	397.22	217.00	0.63	226.67
92.00	0.58	161.75	134.00	0.64	166.64	176.00	5.02	398.62	218.00	0.57	221.56
93.00	0.52	157.06	135.00	0.71	171.75	177.00	5.00	399.77	219.00	0.51	216.58
94.00	0.47	152.59	136.00	0.78	177.05	178.00	4.98	400.68	220.00	0.46	211.72
95.00	0.42	148.33	137.00	0.85	182.57	179.00	4.94	401.32	221.00	0.41	206.99
96.00	0.37	144.29	138.00	0.93	188.28	180.00	4.89	401.67	222.00	0.37	202.38
97.00	0.33	140.47	139.00	1.02	194.18	181.00	4.83	401.70	223.00	0.32	197.89
98.00	0.29	136.86	140.00	1.11	200.28	182.00	4.76	401.38	224.00	0.29	193.52
99.00	0.26	133.48	141.00	1.21	206.57	183.00	4.68	400.68	225.00	0.25	189.27
100.00	0.22	130.32	142.00	1.31	213.04	184.00	4.59	399.58	226.00	0.22	185.13
101.00	0.19	127.39	143.00	1.41	219.68	185.00	4.48	398.05	227.00	0.18	181.11
102.00	0.16	124.70	144.00	1.52	226.48	186.00	4.37	396.09	228.00	0.16	177.19
103.00	0.14	122.23	145.00	1.64	233.44	187.00	4.25	393.68	229.00	0.13	173.39
104.00	0.12	120.00	146.00	1.76	240.53	188.00	4.13	390.83	230.00	0.11	169.69
105.00	0.10	118.02	147.00	1.89	247.76	189.00	3.99	387.53	231.00	0.09	166.09
106.00	0.08	116.27	148.00	2.02	255.08	190.00	3.85	383.81	232.00	0.08	162.58
107.00	0.07	114.77	149.00	2.16	262.50	191.00	3.70	379.67	233.00	0.07	159.18
108.00	0.06	113.51	150.00	2.30	269.98	192.00	3.55	375.16	234.00	0.06	155.87
109.00	0.05	112.50	151.00	2.45	277.50	193.00	3.40	370.29	235.00	0.07	152.65
110.00	0.04	111.74	152.00	2.60	285.03	194.00	3.25	365.10	236.00	0.07	149.52
111.00	0.04	111.24	153.00	2.75	292.55	195.00	3.09	359.63	237.00	0.08	146.47
112.00	0.04	110.99	154.00	2.90	300.01	196.00	2.94	353.92	238.00	0.09	143.51
113.00	0.04	110.99	155.00	3.06	307.38	197.00	2.79	347.99	239.00	0.10	140.63
114.00	0.04	111.24	156.00	3.22	314.63	198.00	2.63	341.90	240.00	0.11	137.83
115.00	0.04	111.74	157.00	3.37	321.71	199.00	2.49	335.67	241.00	0.12	135.10
116.00	0.05	112.50	158.00	3.53	328.60	200.00	2.34	329.33	242.00	0.13	132.45
117.00	0.06	113.51	159.00	3.68	335.25	201.00	2.20	322.92	243.00	0.14	129.87
118.00	0.07	114.77	160.00	3.82	341.64	202.00	2.07	316.47	244.00	0.15	127.36
119.00	0.08	116.27	161.00	3.97	347.72	203.00	1.93	310.01	245.00	0.15	124.91
120.00	0.10	118.02	162.00	4.10	353.47	204.00	1.81	303.55	246.00	0.16	122.53
121.00	0.12	120.00	163.00	4.23	358.88	205.00	1.69	297.11	247.00	0.17	120.22
122.00	0.14	122.23	164.00	4.36	363.93	206.00	1.57	290.73	248.00	0.17	117.96
123.00	0.16	124.70	165.00	4.47	368.61	207.00	1.46	284.40	249.00	0.18	115.77

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3B- New Configuration Running East on North Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
250.00	0.18	113.63	292.00	0.20	58.27	334.00	0.14	35.29	376.00	0.10	23.72
251.00	0.19	111.55	293.00	0.19	57.48	335.00	0.14	34.92	377.00	0.10	23.52
252.00	0.19	109.52	294.00	0.19	56.71	336.00	0.14	34.56	378.00	0.10	23.32
253.00	0.20	107.54	295.00	0.19	55.96	337.00	0.14	34.20	379.00	0.10	23.12
254.00	0.20	105.61	296.00	0.19	55.22	338.00	0.13	33.85	380.00	0.10	22.93
255.00	0.20	103.74	297.00	0.19	54.50	339.00	0.13	33.50	381.00	0.10	22.74
256.00	0.21	101.91	298.00	0.19	53.79	340.00	0.13	33.16	382.00	0.09	22.55
257.00	0.21	100.12	299.00	0.19	53.09	341.00	0.13	32.83	383.00	0.09	22.36
258.00	0.21	98.38	300.00	0.18	52.41	342.00	0.13	32.50	384.00	0.09	22.18
259.00	0.21	96.69	301.00	0.18	51.74	343.00	0.13	32.17	385.00	0.09	22.00
260.00	0.21	95.03	302.00	0.18	51.08	344.00	0.13	31.85	386.00	0.09	21.82
261.00	0.21	93.42	303.00	0.18	50.44	345.00	0.13	31.54	387.00	0.09	21.64
262.00	0.22	91.85	304.00	0.18	49.81	346.00	0.13	31.23	388.00	0.09	21.47
263.00	0.22	90.31	305.00	0.18	49.19	347.00	0.12	30.92	389.00	0.09	21.29
264.00	0.22	88.81	306.00	0.18	48.58	348.00	0.12	30.62	390.00	0.09	21.12
265.00	0.22	87.35	307.00	0.17	47.98	349.00	0.12	30.33	391.00	0.09	20.96
266.00	0.22	85.92	308.00	0.17	47.39	350.00	0.12	30.03	392.00	0.09	20.79
267.00	0.22	84.53	309.00	0.17	46.82	351.00	0.12	29.74	393.00	0.09	20.62
268.00	0.22	83.17	310.00	0.17	46.25	352.00	0.12	29.46	394.00	0.09	20.46
269.00	0.22	81.84	311.00	0.17	45.70	353.00	0.12	29.18	395.00	0.09	20.30
270.00	0.22	80.54	312.00	0.17	45.16	354.00	0.12	28.91	396.00	0.09	20.14
271.00	0.22	79.28	313.00	0.17	44.62	355.00	0.12	28.63	397.00	0.08	19.99
272.00	0.22	78.04	314.00	0.16	44.10	356.00	0.12	28.37	398.00	0.08	19.83
273.00	0.22	76.83	315.00	0.16	43.58	357.00	0.11	28.10	399.00	0.08	19.68
274.00	0.22	75.64	316.00	0.16	43.07	358.00	0.11	27.84	400.00	0.08	19.53
275.00	0.21	74.49	317.00	0.16	42.57	359.00	0.11	27.58	401.00	0.08	19.38
276.00	0.21	73.36	318.00	0.16	42.08	360.00	0.11	27.33	402.00	0.08	19.23
277.00	0.21	72.25	319.00	0.16	41.60	361.00	0.11	27.08	403.00	0.08	19.08
278.00	0.21	71.17	320.00	0.16	41.13	362.00	0.11	26.84	404.00	0.08	18.94
279.00	0.21	70.11	321.00	0.15	40.67	363.00	0.11	26.59	405.00	0.08	18.80
280.00	0.21	69.08	322.00	0.15	40.21	364.00	0.11	26.35	406.00	0.08	18.66
281.00	0.21	68.07	323.00	0.15	39.76	365.00	0.11	26.12	407.00	0.08	18.52
282.00	0.21	67.08	324.00	0.15	39.32	366.00	0.11	25.88	408.00	0.08	18.38
283.00	0.21	66.11	325.00	0.15	38.89	367.00	0.11	25.65	409.00	0.08	18.24
284.00	0.21	65.17	326.00	0.15	38.46	368.00	0.10	25.43	410.00	0.08	18.11
285.00	0.20	64.24	327.00	0.15	38.04	369.00	0.10	25.20	411.00	0.08	17.97
286.00	0.20	63.33	328.00	0.15	37.63	370.00	0.10	24.98	412.00	0.08	17.84
287.00	0.20	62.44	329.00	0.14	37.22	371.00	0.10	24.77	413.00	0.08	17.71
288.00	0.20	61.57	330.00	0.14	36.82	372.00	0.10	24.55	414.00	0.08	17.58
289.00	0.20	60.72	331.00	0.14	36.43	373.00	0.10	24.34	415.00	0.07	17.46
290.00	0.20	59.89	332.00	0.14	36.04	374.00	0.10	24.13	416.00	0.07	17.33
291.00	0.20	59.07	333.00	0.14	35.66	375.00	0.10	23.92	417.00	0.07	17.20

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3B- New Configuration Running East on North Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
418.00	0.07	17.08	460.00	0.06	12.91	502.00	0.04	10.12	544.00	0.04	8.15
419.00	0.07	16.96	461.00	0.06	12.83	503.00	0.04	10.06	545.00	0.04	8.11
420.00	0.07	16.84	462.00	0.06	12.75	504.00	0.04	10.01	546.00	0.04	8.07
421.00	0.07	16.72	463.00	0.06	12.68	505.00	0.04	9.95	547.00	0.04	8.03
422.00	0.07	16.60	464.00	0.05	12.60	506.00	0.04	9.90	548.00	0.04	7.99
423.00	0.07	16.48	465.00	0.05	12.52	507.00	0.04	9.85	549.00	0.04	7.95
424.00	0.07	16.37	466.00	0.05	12.45	508.00	0.04	9.79	550.00	0.03	7.92
425.00	0.07	16.26	467.00	0.05	12.37	509.00	0.04	9.74	551.00	0.03	7.88
426.00	0.07	16.14	468.00	0.05	12.30	510.00	0.04	9.69	552.00	0.03	7.84
427.00	0.07	16.03	469.00	0.05	12.22	511.00	0.04	9.64	553.00	0.03	7.80
428.00	0.07	15.92	470.00	0.05	12.15	512.00	0.04	9.59	554.00	0.03	7.77
429.00	0.07	15.81	471.00	0.05	12.08	513.00	0.04	9.54	555.00	0.03	7.73
430.00	0.07	15.70	472.00	0.05	12.00	514.00	0.04	9.49	556.00	0.03	7.69
431.00	0.07	15.59	473.00	0.05	11.93	515.00	0.04	9.44	557.00	0.03	7.66
432.00	0.07	15.49	474.00	0.05	11.86	516.00	0.04	9.39	558.00	0.03	7.62
433.00	0.07	15.38	475.00	0.05	11.79	517.00	0.04	9.34	559.00	0.03	7.59
434.00	0.07	15.28	476.00	0.05	11.72	518.00	0.04	9.29	560.00	0.03	7.55
435.00	0.07	15.18	477.00	0.05	11.65	519.00	0.04	9.24	561.00	0.03	7.51
436.00	0.06	15.07	478.00	0.05	11.59	520.00	0.04	9.19	562.00	0.03	7.48
437.00	0.06	14.97	479.00	0.05	11.52	521.00	0.04	9.15	563.00	0.03	7.45
438.00	0.06	14.87	480.00	0.05	11.45	522.00	0.04	9.10	564.00	0.03	7.41
439.00	0.06	14.78	481.00	0.05	11.39	523.00	0.04	9.05	565.00	0.03	7.38
440.00	0.06	14.68	482.00	0.05	11.32	524.00	0.04	9.01	566.00	0.03	7.34
441.00	0.06	14.58	483.00	0.05	11.25	525.00	0.04	8.96	567.00	0.03	7.31
442.00	0.06	14.48	484.00	0.05	11.19	526.00	0.04	8.91	568.00	0.03	7.28
443.00	0.06	14.39	485.00	0.05	11.13	527.00	0.04	8.87	569.00	0.03	7.24
444.00	0.06	14.30	486.00	0.05	11.06	528.00	0.04	8.82	570.00	0.03	7.21
445.00	0.06	14.20	487.00	0.05	11.00	529.00	0.04	8.78	571.00	0.03	7.18
446.00	0.06	14.11	488.00	0.05	10.94	530.00	0.04	8.74	572.00	0.03	7.14
447.00	0.06	14.02	489.00	0.05	10.88	531.00	0.04	8.69	573.00	0.03	7.11
448.00	0.06	13.93	490.00	0.05	10.81	532.00	0.04	8.65	574.00	0.03	7.08
449.00	0.06	13.84	491.00	0.05	10.75	533.00	0.04	8.60	575.00	0.03	7.05
450.00	0.06	13.75	492.00	0.05	10.69	534.00	0.04	8.56	576.00	0.03	7.02
451.00	0.06	13.66	493.00	0.05	10.63	535.00	0.04	8.52	577.00	0.03	6.98
452.00	0.06	13.58	494.00	0.05	10.57	536.00	0.04	8.48	578.00	0.03	6.95
453.00	0.06	13.49	495.00	0.05	10.52	537.00	0.04	8.43	579.00	0.03	6.92
454.00	0.06	13.41	496.00	0.05	10.46	538.00	0.04	8.39	580.00	0.03	6.89
455.00	0.06	13.32	497.00	0.05	10.40	539.00	0.04	8.35	581.00	0.03	6.86
456.00	0.06	13.24	498.00	0.05	10.34	540.00	0.04	8.31	582.00	0.03	6.83
457.00	0.06	13.16	499.00	0.05	10.29	541.00	0.04	8.27	583.00	0.03	6.80
458.00	0.06	13.07	500.00	0.04	10.23	542.00	0.04	8.23	584.00	0.03	6.77
459.00	0.06	12.99	501.00	0.04	10.17	543.00	0.04	8.19	585.00	0.03	6.74

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3B- New Configuration Running East on North Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
586.00	0.03	6.71	628.00	0.02	5.62	669.99	0.02	4.78	711.99	0.02	4.12
587.00	0.03	6.68	629.00	0.02	5.60	670.99	0.02	4.76	712.99	0.02	4.10
588.00	0.03	6.65	630.00	0.02	5.58	671.99	0.02	4.75	713.99	0.02	4.09
589.00	0.03	6.62	631.00	0.02	5.56	672.99	0.02	4.73	714.99	0.02	4.08
590.00	0.03	6.59	632.00	0.02	5.53	673.99	0.02	4.71	715.99	0.02	4.06
591.00	0.03	6.56	632.99	0.02	5.51	674.99	0.02	4.69	716.99	0.02	4.05
592.00	0.03	6.54	633.99	0.02	5.49	675.99	0.02	4.68	717.99	0.02	4.03
593.00	0.03	6.51	634.99	0.02	5.47	676.99	0.02	4.66	718.99	0.02	4.02
594.00	0.03	6.48	635.99	0.02	5.45	677.99	0.02	4.64	719.99	0.02	4.01
595.00	0.03	6.45	636.99	0.02	5.42	678.99	0.02	4.63	720.99	0.02	3.99
596.00	0.03	6.42	637.99	0.02	5.40	679.99	0.02	4.61	721.99	0.02	3.98
597.00	0.03	6.40	638.99	0.02	5.38	680.99	0.02	4.59	722.99	0.02	3.97
598.00	0.03	6.37	639.99	0.02	5.36	681.99	0.02	4.58	723.99	0.02	3.95
599.00	0.03	6.34	640.99	0.02	5.34	682.99	0.02	4.56	724.99	0.02	3.94
600.00	0.03	6.31	641.99	0.02	5.32	683.99	0.02	4.54	725.99	0.02	3.93
601.00	0.03	6.29	642.99	0.02	5.30	684.99	0.02	4.53	726.99	0.02	3.91
602.00	0.03	6.26	643.99	0.02	5.28	685.99	0.02	4.51	727.99	0.02	3.90
603.00	0.03	6.23	644.99	0.02	5.26	686.99	0.02	4.50	728.99	0.02	3.89
604.00	0.03	6.21	645.99	0.02	5.24	687.99	0.02	4.48	729.99	0.02	3.88
605.00	0.03	6.18	646.99	0.02	5.22	688.99	0.02	4.46	730.99	0.02	3.86
606.00	0.03	6.16	647.99	0.02	5.20	689.99	0.02	4.45	731.99	0.02	3.85
607.00	0.03	6.13	648.99	0.02	5.18	690.99	0.02	4.43	732.99	0.02	3.84
608.00	0.03	6.10	649.99	0.02	5.16	691.99	0.02	4.42	733.99	0.02	3.82
609.00	0.03	6.08	650.99	0.02	5.14	692.99	0.02	4.40	734.99	0.02	3.81
610.00	0.03	6.05	651.99	0.02	5.12	693.99	0.02	4.38	735.99	0.02	3.80
611.00	0.03	6.03	652.99	0.02	5.10	694.99	0.02	4.37	736.99	0.02	3.79
612.00	0.03	6.00	653.99	0.02	5.08	695.99	0.02	4.35	737.99	0.02	3.77
613.00	0.03	5.98	654.99	0.02	5.06	696.99	0.02	4.34	738.99	0.02	3.76
614.00	0.03	5.95	655.99	0.02	5.04	697.99	0.02	4.32	739.99	0.02	3.75
615.00	0.03	5.93	656.99	0.02	5.02	698.99	0.02	4.31	740.99	0.02	3.74
616.00	0.03	5.90	657.99	0.02	5.00	699.99	0.02	4.29	741.99	0.02	3.73
617.00	0.03	5.88	658.99	0.02	4.98	700.99	0.02	4.28	742.99	0.02	3.71
618.00	0.03	5.86	659.99	0.02	4.96	701.99	0.02	4.26	743.99	0.02	3.70
619.00	0.03	5.83	660.99	0.02	4.95	702.99	0.02	4.25	744.99	0.02	3.69
620.00	0.03	5.81	661.99	0.02	4.93	703.99	0.02	4.23	745.99	0.02	3.68
621.00	0.03	5.78	662.99	0.02	4.91	704.99	0.02	4.22	746.99	0.02	3.67
622.00	0.03	5.76	663.99	0.02	4.89	705.99	0.02	4.20	747.99	0.02	3.65
623.00	0.03	5.74	664.99	0.02	4.87	706.99	0.02	4.19	748.99	0.02	3.64
624.00	0.03	5.71	665.99	0.02	4.85	707.99	0.02	4.18	749.99	0.02	3.63
625.00	0.03	5.69	666.99	0.02	4.84	708.99	0.02	4.16	750.99	0.02	3.62
626.00	0.03	5.67	667.99	0.02	4.82	709.99	0.02	4.15	751.99	0.02	3.61
627.00	0.03	5.65	668.99	0.02	4.80	710.99	0.02	4.13	752.99	0.02	3.60

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3B- New Configuration Running East on North Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
753.99	0.02	3.58	795.99	0.01	3.15
754.99	0.02	3.57	796.99	0.01	3.14
755.99	0.02	3.56	797.99	0.01	3.13
756.99	0.02	3.55	798.99	0.01	3.12
757.99	0.02	3.54	799.99	0.01	3.11
758.99	0.02	3.53	800.99	0.01	3.10
759.99	0.02	3.52	801.99	0.01	3.09
760.99	0.02	3.51	802.99	0.01	3.08
761.99	0.02	3.49	803.99	0.01	3.07
762.99	0.02	3.48	804.99	0.01	3.07
763.99	0.02	3.47	805.99	0.01	3.06
764.99	0.02	3.46	806.99	0.01	3.05
765.99	0.02	3.45	807.99	0.01	3.04
766.99	0.02	3.44	808.99	0.01	3.03
767.99	0.02	3.43	809.99	0.01	3.02
768.99	0.02	3.42			
769.99	0.02	3.41			
770.99	0.02	3.40			
771.99	0.02	3.39			
772.99	0.02	3.38			
773.99	0.02	3.37			
774.99	0.02	3.36			
775.99	0.01	3.35			
776.99	0.01	3.33			
777.99	0.01	3.32			
778.99	0.01	3.31			
779.99	0.01	3.30			
780.99	0.01	3.29			
781.99	0.01	3.28			
782.99	0.01	3.27			
783.99	0.01	3.26			
784.99	0.01	3.25			
785.99	0.01	3.24			
786.99	0.01	3.23			
787.99	0.01	3.22			
788.99	0.01	3.22			
789.99	0.01	3.21			
790.99	0.01	3.20			
791.99	0.01	3.19			
792.99	0.01	3.18			
793.99	0.01	3.17			
794.99	0.01	3.16			

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3C- New Configuration Running South on East Side of Plant**

Circuit Name	Id	Dist From Left ROW (ft)	Dist From Circuit CL (ft)	Minimum Height (ft)	SubConductors			Maximum Voltage (kV)	Angle (Degrees)	MCR (Amps)
					# of	Diameter (in)	Spacing (in)			
230-1	1A1	491.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-1	1B1	491.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-1	1C1	491.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-1	1G1	494.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-2	2A1	508.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-2	2B1	508.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-2	2C1	508.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-2	2G1	506.00	6.00	90.00	1	0.50	0.00	0.0	0	0
230-3	3A1	616.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-3	3B1	616.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-3	3C1	616.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-3	3G1	619.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-4	4A1	633.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-4	4B1	633.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-4	4C1	633.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-4	4G1	631.00	6.00	90.00	1	0.50	0.00	0.0	0	0

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
0.00	0.02	4.69	16.00	0.02	4.98	38.00	0.02	5.42	60.00	0.03	5.93
750.00	0.18	52.41	17.00	0.02	5.00	39.00	0.02	5.45	61.00	0.03	5.95
-4.00	0.02	4.63	18.00	0.02	5.02	40.00	0.02	5.47	62.00	0.03	5.98
-3.00	0.02	4.64	19.00	0.02	5.04	41.00	0.02	5.49	63.00	0.03	6.00
-2.00	0.02	4.66	20.00	0.02	5.06	42.00	0.02	5.51	64.00	0.03	6.03
-1.00	0.02	4.68	21.00	0.02	5.08	43.00	0.02	5.53	65.00	0.03	6.05
0.00	0.02	4.69	22.00	0.02	5.10	44.00	0.02	5.56	66.00	0.03	6.08
1.00	0.02	4.71	23.00	0.02	5.12	45.00	0.02	5.58	67.00	0.03	6.10
2.00	0.02	4.73	24.00	0.02	5.14	46.00	0.02	5.60	68.00	0.03	6.13
3.00	0.02	4.75	25.00	0.02	5.16	47.00	0.02	5.62	69.00	0.03	6.16
4.00	0.02	4.76	26.00	0.02	5.18	48.00	0.03	5.65	70.00	0.03	6.18
5.00	0.02	4.78	27.00	0.02	5.20	49.00	0.03	5.67	71.00	0.03	6.21
6.00	0.02	4.80	28.00	0.02	5.22	50.00	0.03	5.69	72.00	0.03	6.23
7.00	0.02	4.82	29.00	0.02	5.24	51.00	0.03	5.71	73.00	0.03	6.26
8.00	0.02	4.84	30.00	0.02	5.26	52.00	0.03	5.74	74.00	0.03	6.29
9.00	0.02	4.85	31.00	0.02	5.28	53.00	0.03	5.76	75.00	0.03	6.31
10.00	0.02	4.87	32.00	0.02	5.30	54.00	0.03	5.78	76.00	0.03	6.34
11.00	0.02	4.89	33.00	0.02	5.32	55.00	0.03	5.81	77.00	0.03	6.37
12.00	0.02	4.91	34.00	0.02	5.34	56.00	0.03	5.83	78.00	0.03	6.40
13.00	0.02	4.93	35.00	0.02	5.36	57.00	0.03	5.86	79.00	0.03	6.42
14.00	0.02	4.95	36.00	0.02	5.38	58.00	0.03	5.88	80.00	0.03	6.45
15.00	0.02	4.96	37.00	0.02	5.40	59.00	0.03	5.90	81.00	0.03	6.48

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3C- New Configuration Running South on East Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
82.00	0.03	6.51	124.00	0.03	7.88	166.00	0.04	9.74	208.00	0.05	12.37
83.00	0.03	6.54	125.00	0.03	7.92	167.00	0.04	9.79	209.00	0.05	12.45
84.00	0.03	6.56	126.00	0.04	7.95	168.00	0.04	9.85	210.00	0.05	12.52
85.00	0.03	6.59	127.00	0.04	7.99	169.00	0.04	9.90	211.00	0.05	12.60
86.00	0.03	6.62	128.00	0.04	8.03	170.00	0.04	9.95	212.00	0.06	12.68
87.00	0.03	6.65	129.00	0.04	8.07	171.00	0.04	10.01	213.00	0.06	12.75
88.00	0.03	6.68	130.00	0.04	8.11	172.00	0.04	10.06	214.00	0.06	12.83
89.00	0.03	6.71	131.00	0.04	8.15	173.00	0.04	10.12	215.00	0.06	12.91
90.00	0.03	6.74	132.00	0.04	8.19	174.00	0.04	10.17	216.00	0.06	12.99
91.00	0.03	6.77	133.00	0.04	8.23	175.00	0.04	10.23	217.00	0.06	13.07
92.00	0.03	6.80	134.00	0.04	8.27	176.00	0.05	10.29	218.00	0.06	13.16
93.00	0.03	6.83	135.00	0.04	8.31	177.00	0.05	10.34	219.00	0.06	13.24
94.00	0.03	6.86	136.00	0.04	8.35	178.00	0.05	10.40	220.00	0.06	13.32
95.00	0.03	6.89	137.00	0.04	8.39	179.00	0.05	10.46	221.00	0.06	13.41
96.00	0.03	6.92	138.00	0.04	8.43	180.00	0.05	10.52	222.00	0.06	13.49
97.00	0.03	6.95	139.00	0.04	8.48	181.00	0.05	10.57	223.00	0.06	13.58
98.00	0.03	6.98	140.00	0.04	8.52	182.00	0.05	10.63	224.00	0.06	13.66
99.00	0.03	7.01	141.00	0.04	8.56	183.00	0.05	10.69	225.00	0.06	13.75
100.00	0.03	7.05	142.00	0.04	8.60	184.00	0.05	10.75	226.00	0.06	13.84
101.00	0.03	7.08	143.00	0.04	8.65	185.00	0.05	10.81	227.00	0.06	13.93
102.00	0.03	7.11	144.00	0.04	8.69	186.00	0.05	10.88	228.00	0.06	14.02
103.00	0.03	7.14	145.00	0.04	8.74	187.00	0.05	10.94	229.00	0.06	14.11
104.00	0.03	7.18	146.00	0.04	8.78	188.00	0.05	11.00	230.00	0.06	14.20
105.00	0.03	7.21	147.00	0.04	8.82	189.00	0.05	11.06	231.00	0.06	14.30
106.00	0.03	7.24	148.00	0.04	8.87	190.00	0.05	11.13	232.00	0.06	14.39
107.00	0.03	7.27	149.00	0.04	8.91	191.00	0.05	11.19	233.00	0.06	14.48
108.00	0.03	7.31	150.00	0.04	8.96	192.00	0.05	11.25	234.00	0.06	14.58
109.00	0.03	7.34	151.00	0.04	9.01	193.00	0.05	11.32	235.00	0.06	14.68
110.00	0.03	7.38	152.00	0.04	9.05	194.00	0.05	11.39	236.00	0.06	14.78
111.00	0.03	7.41	153.00	0.04	9.10	195.00	0.05	11.45	237.00	0.06	14.87
112.00	0.03	7.45	154.00	0.04	9.15	196.00	0.05	11.52	238.00	0.06	14.97
113.00	0.03	7.48	155.00	0.04	9.19	197.00	0.05	11.59	239.00	0.06	15.07
114.00	0.03	7.51	156.00	0.04	9.24	198.00	0.05	11.65	240.00	0.07	15.18
115.00	0.03	7.55	157.00	0.04	9.29	199.00	0.05	11.72	241.00	0.07	15.28
116.00	0.03	7.59	158.00	0.04	9.34	200.00	0.05	11.79	242.00	0.07	15.38
117.00	0.03	7.62	159.00	0.04	9.39	201.00	0.05	11.86	243.00	0.07	15.49
118.00	0.03	7.66	160.00	0.04	9.44	202.00	0.05	11.93	244.00	0.07	15.59
119.00	0.03	7.69	161.00	0.04	9.49	203.00	0.05	12.00	245.00	0.07	15.70
120.00	0.03	7.73	162.00	0.04	9.54	204.00	0.05	12.08	246.00	0.07	15.81
121.00	0.03	7.77	163.00	0.04	9.59	205.00	0.05	12.15	247.00	0.07	15.92
122.00	0.03	7.80	164.00	0.04	9.64	206.00	0.05	12.22	248.00	0.07	16.03
123.00	0.03	7.84	165.00	0.04	9.69	207.00	0.05	12.30	249.00	0.07	16.14

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3C- New Configuration Running South on East Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
250.00	0.07	16.26	292.00	0.09	22.36	334.00	0.13	32.83	376.00	0.19	53.09
251.00	0.07	16.37	293.00	0.09	22.55	335.00	0.13	33.16	377.00	0.19	53.79
252.00	0.07	16.48	294.00	0.10	22.74	336.00	0.13	33.50	378.00	0.19	54.50
253.00	0.07	16.60	295.00	0.10	22.93	337.00	0.13	33.85	379.00	0.19	55.22
254.00	0.07	16.72	296.00	0.10	23.12	338.00	0.14	34.20	380.00	0.19	55.96
255.00	0.07	16.84	297.00	0.10	23.32	339.00	0.14	34.56	381.00	0.19	56.71
256.00	0.07	16.96	298.00	0.10	23.52	340.00	0.14	34.92	382.00	0.19	57.48
257.00	0.07	17.08	299.00	0.10	23.72	341.00	0.14	35.29	383.00	0.20	58.27
258.00	0.07	17.20	300.00	0.10	23.92	342.00	0.14	35.66	384.00	0.20	59.07
259.00	0.07	17.33	301.00	0.10	24.13	343.00	0.14	36.04	385.00	0.20	59.89
260.00	0.07	17.46	302.00	0.10	24.34	344.00	0.14	36.43	386.00	0.20	60.72
261.00	0.08	17.58	303.00	0.10	24.55	345.00	0.14	36.82	387.00	0.20	61.57
262.00	0.08	17.71	304.00	0.10	24.77	346.00	0.14	37.22	388.00	0.20	62.44
263.00	0.08	17.84	305.00	0.10	24.98	347.00	0.15	37.63	389.00	0.20	63.33
264.00	0.08	17.97	306.00	0.10	25.20	348.00	0.15	38.04	390.00	0.20	64.24
265.00	0.08	18.11	307.00	0.10	25.43	349.00	0.15	38.46	391.00	0.21	65.17
266.00	0.08	18.24	308.00	0.11	25.65	350.00	0.15	38.89	392.00	0.21	66.11
267.00	0.08	18.38	309.00	0.11	25.88	351.00	0.15	39.32	393.00	0.21	67.08
268.00	0.08	18.52	310.00	0.11	26.12	352.00	0.15	39.76	394.00	0.21	68.07
269.00	0.08	18.66	311.00	0.11	26.35	353.00	0.15	40.21	395.00	0.21	69.08
270.00	0.08	18.80	312.00	0.11	26.59	354.00	0.15	40.67	396.00	0.21	70.12
271.00	0.08	18.94	313.00	0.11	26.84	355.00	0.16	41.13	397.00	0.21	71.17
272.00	0.08	19.08	314.00	0.11	27.08	356.00	0.16	41.60	398.00	0.21	72.25
273.00	0.08	19.23	315.00	0.11	27.33	357.00	0.16	42.08	399.00	0.21	73.36
274.00	0.08	19.38	316.00	0.11	27.58	358.00	0.16	42.57	400.00	0.21	74.49
275.00	0.08	19.53	317.00	0.11	27.84	359.00	0.16	43.07	401.00	0.22	75.64
276.00	0.08	19.68	318.00	0.11	28.10	360.00	0.16	43.58	402.00	0.22	76.83
277.00	0.08	19.83	319.00	0.12	28.37	361.00	0.16	44.10	403.00	0.22	78.04
278.00	0.08	19.99	320.00	0.12	28.63	362.00	0.17	44.62	404.00	0.22	79.28
279.00	0.09	20.14	321.00	0.12	28.91	363.00	0.17	45.16	405.00	0.22	80.54
280.00	0.09	20.30	322.00	0.12	29.18	364.00	0.17	45.70	406.00	0.22	81.84
281.00	0.09	20.46	323.00	0.12	29.46	365.00	0.17	46.25	407.00	0.22	83.17
282.00	0.09	20.62	324.00	0.12	29.74	366.00	0.17	46.82	408.00	0.22	84.53
283.00	0.09	20.79	325.00	0.12	30.03	367.00	0.17	47.40	409.00	0.22	85.92
284.00	0.09	20.96	326.00	0.12	30.33	368.00	0.17	47.98	410.00	0.22	87.35
285.00	0.09	21.12	327.00	0.12	30.62	369.00	0.18	48.58	411.00	0.22	88.81
286.00	0.09	21.29	328.00	0.12	30.92	370.00	0.18	49.19	412.00	0.22	90.31
287.00	0.09	21.47	329.00	0.13	31.23	371.00	0.18	49.81	413.00	0.22	91.85
288.00	0.09	21.64	330.00	0.13	31.54	372.00	0.18	50.44	414.00	0.21	93.42
289.00	0.09	21.82	331.00	0.13	31.85	373.00	0.18	51.08	415.00	0.21	95.04
290.00	0.09	22.00	332.00	0.13	32.17	374.00	0.18	51.74	416.00	0.21	96.69
291.00	0.09	22.18	333.00	0.13	32.50	375.00	0.18	52.41	417.00	0.21	98.38

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3C- New Configuration Running South on East Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
418.00	0.21	100.12	460.00	0.76	237.27	502.00	5.00	393.73	544.00	0.47	152.60
419.00	0.21	101.91	461.00	0.83	242.76	503.00	4.97	391.63	545.00	0.42	148.35
420.00	0.20	103.74	462.00	0.90	248.37	504.00	4.93	389.27	546.00	0.37	144.30
421.00	0.20	105.61	463.00	0.98	254.11	505.00	4.88	386.63	547.00	0.33	140.48
422.00	0.20	107.54	464.00	1.07	259.96	506.00	4.82	383.70	548.00	0.29	136.87
423.00	0.19	109.52	465.00	1.16	265.92	507.00	4.75	380.45	549.00	0.26	133.49
424.00	0.19	111.55	466.00	1.25	271.98	508.00	4.67	376.86	550.00	0.22	130.33
425.00	0.18	113.63	467.00	1.35	278.14	509.00	4.57	372.92	551.00	0.19	127.40
426.00	0.18	115.77	468.00	1.46	284.39	510.00	4.47	368.62	552.00	0.16	124.70
427.00	0.17	117.96	469.00	1.57	290.72	511.00	4.36	363.94	553.00	0.14	122.24
428.00	0.17	120.22	470.00	1.69	297.11	512.00	4.23	358.89	554.00	0.12	120.01
429.00	0.16	122.53	471.00	1.81	303.54	513.00	4.10	353.49	555.00	0.10	118.02
430.00	0.15	124.91	472.00	1.93	310.00	514.00	3.97	347.73	556.00	0.08	116.27
431.00	0.15	127.36	473.00	2.07	316.47	515.00	3.82	341.65	557.00	0.07	114.77
432.00	0.14	129.87	474.00	2.20	322.92	516.00	3.68	335.27	558.00	0.06	113.51
433.00	0.13	132.45	475.00	2.34	329.32	517.00	3.53	328.61	559.00	0.05	112.50
434.00	0.12	135.10	476.00	2.49	335.66	518.00	3.37	321.73	560.00	0.04	111.75
435.00	0.11	137.83	477.00	2.63	341.89	519.00	3.22	314.64	561.00	0.04	111.24
436.00	0.10	140.63	478.00	2.79	347.99	520.00	3.06	307.39	562.00	0.04	110.99
437.00	0.09	143.51	479.00	2.94	353.91	521.00	2.90	300.02	563.00	0.04	110.99
438.00	0.08	146.47	480.00	3.09	359.63	522.00	2.75	292.56	564.00	0.04	111.24
439.00	0.07	149.52	481.00	3.25	365.10	523.00	2.60	285.05	565.00	0.04	111.74
440.00	0.07	152.65	482.00	3.40	370.28	524.00	2.45	277.52	566.00	0.05	112.50
441.00	0.06	155.87	483.00	3.55	375.15	525.00	2.30	270.00	567.00	0.06	113.51
442.00	0.07	159.18	484.00	3.70	379.67	526.00	2.16	262.52	568.00	0.07	114.76
443.00	0.08	162.58	485.00	3.85	383.80	527.00	2.02	255.10	569.00	0.08	116.26
444.00	0.09	166.08	486.00	3.99	387.53	528.00	1.89	247.77	570.00	0.10	118.01
445.00	0.11	169.68	487.00	4.13	390.82	529.00	1.76	240.55	571.00	0.12	120.00
446.00	0.13	173.39	488.00	4.25	393.68	530.00	1.64	233.46	572.00	0.14	122.22
447.00	0.16	177.19	489.00	4.37	396.09	531.00	1.52	226.50	573.00	0.16	124.69
448.00	0.18	181.11	490.00	4.48	398.05	532.00	1.41	219.69	574.00	0.19	127.39
449.00	0.22	185.13	491.00	4.59	399.58	533.00	1.31	213.05	575.00	0.22	130.31
450.00	0.25	189.27	492.00	4.68	400.68	534.00	1.21	206.59	576.00	0.26	133.47
451.00	0.29	193.52	493.00	4.76	401.37	535.00	1.11	200.30	577.00	0.29	136.85
452.00	0.32	197.89	494.00	4.83	401.70	536.00	1.02	194.20	578.00	0.33	140.45
453.00	0.37	202.38	495.00	4.89	401.67	537.00	0.94	188.29	579.00	0.37	144.28
454.00	0.41	206.99	496.00	4.94	401.32	538.00	0.85	182.58	580.00	0.42	148.32
455.00	0.46	211.72	497.00	4.98	400.68	539.00	0.78	177.07	581.00	0.47	152.58
456.00	0.51	216.58	498.00	5.00	399.78	540.00	0.71	171.76	582.00	0.52	157.05
457.00	0.57	221.56	499.00	5.02	398.62	541.00	0.64	166.66	583.00	0.58	161.73
458.00	0.63	226.67	500.00	5.02	397.22	542.00	0.58	161.76	584.00	0.64	166.62
459.00	0.69	231.91	501.00	5.02	395.59	543.00	0.52	157.08	585.00	0.71	171.73

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3C- New Configuration Running South on East Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
586.00	0.78	177.03	628.00	4.98	400.68	669.99	0.46	211.75	711.99	0.22	91.86
587.00	0.85	182.54	629.00	4.94	401.32	670.99	0.41	207.02	712.99	0.22	90.32
588.00	0.93	188.25	630.00	4.89	401.67	671.99	0.37	202.41	713.99	0.22	88.82
589.00	1.02	194.16	631.00	4.83	401.70	672.99	0.33	197.92	714.99	0.22	87.36
590.00	1.11	200.26	632.00	4.76	401.38	673.99	0.29	193.55	715.99	0.22	85.93
591.00	1.21	206.55	632.99	4.68	400.68	674.99	0.25	189.30	716.99	0.22	84.54
592.00	1.31	213.01	633.99	4.59	399.58	675.99	0.22	185.16	717.99	0.22	83.18
593.00	1.41	219.65	634.99	4.49	398.06	676.99	0.19	181.13	718.99	0.22	81.85
594.00	1.52	226.45	635.99	4.37	396.10	677.99	0.16	177.22	719.99	0.22	80.55
595.00	1.64	233.41	636.99	4.25	393.70	678.99	0.13	173.41	720.99	0.22	79.28
596.00	1.76	240.50	637.99	4.13	390.84	679.99	0.11	169.71	721.99	0.22	78.05
597.00	1.89	247.73	638.99	3.99	387.55	680.99	0.09	166.11	722.99	0.22	76.84
598.00	2.02	255.05	639.99	3.85	383.83	681.99	0.08	162.61	723.99	0.22	75.65
599.00	2.16	262.47	640.99	3.70	379.70	682.99	0.07	159.20	724.99	0.21	74.50
600.00	2.30	269.95	641.99	3.55	375.18	683.99	0.06	155.89	725.99	0.21	73.37
601.00	2.45	277.47	642.99	3.40	370.32	684.99	0.07	152.67	726.99	0.21	72.26
602.00	2.60	285.00	643.99	3.25	365.13	685.99	0.07	149.54	727.99	0.21	71.18
603.00	2.75	292.51	644.99	3.09	359.66	686.99	0.08	146.49	728.99	0.21	70.12
604.00	2.90	299.97	645.99	2.94	353.95	687.99	0.09	143.53	729.99	0.21	69.09
605.00	3.06	307.35	646.99	2.79	348.03	688.99	0.10	140.65	730.99	0.21	68.08
606.00	3.21	314.59	647.99	2.64	341.93	689.99	0.11	137.85	731.99	0.21	67.09
607.00	3.37	321.68	648.99	2.49	335.70	690.99	0.12	135.12	732.99	0.21	66.12
608.00	3.52	328.57	649.99	2.34	329.37	691.99	0.13	132.47	733.99	0.21	65.17
609.00	3.68	335.22	650.99	2.20	322.96	692.99	0.14	129.89	734.99	0.20	64.25
610.00	3.82	341.61	651.99	2.07	316.51	693.99	0.15	127.37	735.99	0.20	63.34
611.00	3.97	347.69	652.99	1.94	310.04	694.99	0.15	124.93	736.99	0.20	62.45
612.00	4.10	353.45	653.99	1.81	303.58	695.99	0.16	122.55	737.99	0.20	61.58
613.00	4.23	358.86	654.99	1.69	297.15	696.99	0.17	120.23	738.99	0.20	60.73
614.00	4.35	363.91	655.99	1.57	290.76	697.99	0.17	117.98	739.99	0.20	59.89
615.00	4.47	368.59	656.99	1.46	284.43	698.99	0.18	115.78	740.99	0.20	59.07
616.00	4.57	372.89	657.99	1.36	278.18	699.99	0.18	113.64	741.99	0.20	58.27
617.00	4.67	376.84	658.99	1.25	272.02	700.99	0.19	111.56	742.99	0.19	57.49
618.00	4.75	380.43	659.99	1.16	265.96	701.99	0.19	109.53	743.99	0.19	56.72
619.00	4.82	383.68	660.99	1.07	259.99	702.99	0.20	107.55	744.99	0.19	55.97
620.00	4.88	386.61	661.99	0.98	254.14	703.99	0.20	105.63	745.99	0.19	55.23
621.00	4.93	389.25	662.99	0.90	248.41	704.99	0.20	103.75	746.99	0.19	54.50
622.00	4.97	391.61	663.99	0.83	242.80	705.99	0.21	101.92	747.99	0.19	53.79
623.00	5.00	393.72	664.99	0.76	237.31	706.99	0.21	100.14	748.99	0.19	53.10
624.00	5.02	395.58	665.99	0.69	231.94	707.99	0.21	98.40	749.99	0.18	52.41
625.00	5.02	397.21	666.99	0.63	226.70	708.99	0.21	96.70	750.99	0.18	51.74
626.00	5.02	398.61	667.99	0.57	221.59	709.99	0.21	95.05	751.99	0.18	51.09
627.00	5.00	399.77	668.99	0.51	216.61	710.99	0.21	93.43	752.99	0.18	50.44

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **16** Conductors (**12** Energized Phases)
E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: **3C- New Configuration Running South on East Side of Plant**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
753.99	0.18	49.81
754.99	0.18	49.19

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Circuit Name	Id	Dist From Left ROW (ft)	Dist From Circuit CL (ft)	Minimum Height (ft)	SubConductors			Maximum Voltage (kV)	Angle (Degrees)	MCR (Amps)
					# of	Diameter (in)	Spacing (in)			
230-1	1A1	2916.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-1	1B1	2916.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-1	1C1	2916.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-1	1G1	2919.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-2	2A1	2933.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-2	2B1	2933.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-2	2C1	2933.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-2	2G1	2931.00	6.00	90.00	1	0.50	0.00	0.0	0	0
230-3	3A1	3041.30	-8.70	44.00	1	1.50	0.00	241.0	0	1980
230-3	3B1	3041.30	-8.70	60.00	1	1.50	0.00	241.0	120	1980
230-3	3C1	3041.30	-8.70	28.00	1	1.50	0.00	241.0	240	1980
230-3	3G1	3044.00	-6.00	90.00	1	0.50	0.00	0.0	0	0
230-4	4A1	3058.70	8.70	44.00	1	1.50	0.00	241.0	0	1980
230-4	4B1	3058.70	8.70	60.00	1	1.50	0.00	241.0	120	1980
230-4	4C1	3058.70	8.70	28.00	1	1.50	0.00	241.0	240	1980
230-4	4G1	3056.00	6.00	90.00	1	0.50	0.00	0.0	0	0
CR-B West	5A1	3651.00	41.00	40.00	2	1.76	18.00	550.0	0	4455
CR-B West	5B1	3610.00	0.00	40.00	2	1.76	18.00	550.0	120	4455
CR-B West	5C1	3569.00	-41.00	40.00	2	1.76	18.00	550.0	240	4455
CR-B West	5G1	3550.00	-60.00	85.00	1	0.50	0.00	0.0	0	0
CR-B West	5G2	3670.00	60.00	85.00	1	0.50	0.00	0.0	0	0
CR-B East	6A1	3844.00	41.00	40.00	2	1.76	18.00	550.0	0	4455
CR-B East	6B1	3803.00	0.00	40.00	2	1.76	18.00	550.0	120	4455
CR-B East	6C1	3762.00	-41.00	40.00	2	1.76	18.00	550.0	240	4455
CR-B East	6G1	3743.00	-60.00	85.00	1	0.50	0.00	0.0	0	0
CR-B East	6G2	3863.00	60.00	85.00	1	0.50	0.00	0.0	0	0
CR-CF_500	7A1	3960.00	41.00	40.00	2	1.76	18.00	550.0	0	4455
CR-CF_500	7B1	3919.00	0.00	40.00	2	1.76	18.00	550.0	120	4455
CR-CF_500	7C1	3878.00	-41.00	40.00	2	1.76	18.00	550.0	240	4455
CR-CF_500	7G2	3979.00	60.00	85.00	1	0.50	0.00	0.0	0	0
CR_E_230	8A1	4361.75	20.00	28.00	1	1.50	0.00	241.0	0	1980
CR E 230	8B1	4341.75	0.00	28.00	1	1.50	0.00	241.0	120	1980
CR E 230	8C1	4321.75	-20.00	28.00	1	1.50	0.00	241.0	240	1980
CR E 230	8G1	4315.00	-26.75	65.00	1	0.50	0.00	0.0	0	0
CR E 230	8G2	4369.00	27.25	65.00	1	0.50	0.00	0.0	0	0
CR-B 230	9A1	4416.25	20.00	28.00	1	1.50	0.00	241.0	0	1980
CR-B 230	9B1	4396.25	0.00	28.00	1	1.50	0.00	241.0	120	1980
CR-B 230	9C1	4376.25	-20.00	28.00	1	1.50	0.00	241.0	240	1980
CR-B 230	9G2	4423.05	26.80	65.00	1	0.50	0.00	0.0	0	0
CR-H #1	10A1	4469.75	20.00	28.00	1	1.50	0.00	241.0	0	1980
CR-H #1	10B1	4449.75	0.00	28.00	1	1.50	0.00	241.0	120	1980
CR-H #1	10C1	4429.75	-20.00	28.00	1	1.50	0.00	241.0	240	1980
CR-H #1	10G2	4476.95	27.20	65.00	1	0.50	0.00	0.0	0	0
CR-H #2	11A1	4524.25	20.00	28.00	1	1.50	0.00	241.0	0	1980
CR-H #2	11B1	4504.25	0.00	28.00	1	1.50	0.00	241.0	120	1980
CR-H #2	11C1	4484.25	-20.00	28.00	1	1.50	0.00	241.0	240	1980
CR-H #2	11G2	4531.05	26.80	65.00	1	0.50	0.00	0.0	0	0

July 13, 2014
 E2Emf (117)

New Configuration Entering Station - Near Plant Access Road

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
-3.00	0.00	0.54	39.00	0.00	0.55	81.00	0.00	0.56	123.00	0.00	0.57
-2.00	0.00	0.54	40.00	0.00	0.55	82.00	0.00	0.56	124.00	0.00	0.57
-1.00	0.00	0.54	41.00	0.00	0.55	83.00	0.00	0.56	125.00	0.00	0.57
0.00	0.00	0.54	42.00	0.00	0.55	84.00	0.00	0.56	126.00	0.00	0.57
1.00	0.00	0.54	43.00	0.00	0.55	85.00	0.00	0.56	127.00	0.00	0.57
2.00	0.00	0.54	44.00	0.00	0.55	86.00	0.00	0.56	128.00	0.00	0.57
3.00	0.00	0.54	45.00	0.00	0.55	87.00	0.00	0.56	129.00	0.00	0.58
4.00	0.00	0.54	46.00	0.00	0.55	88.00	0.00	0.56	130.00	0.00	0.58
5.00	0.00	0.54	47.00	0.00	0.55	89.00	0.00	0.56	131.00	0.00	0.58
6.00	0.00	0.54	48.00	0.00	0.55	90.00	0.00	0.56	132.00	0.00	0.58
7.00	0.00	0.54	49.00	0.00	0.55	91.00	0.00	0.56	133.00	0.00	0.58
8.00	0.00	0.54	50.00	0.00	0.55	92.00	0.00	0.56	134.00	0.00	0.58
9.00	0.00	0.54	51.00	0.00	0.55	93.00	0.00	0.56	135.00	0.00	0.58
10.00	0.00	0.54	52.00	0.00	0.55	94.00	0.00	0.56	136.00	0.00	0.58
11.00	0.00	0.54	53.00	0.00	0.55	95.00	0.00	0.56	137.00	0.00	0.58
12.00	0.00	0.54	54.00	0.00	0.55	96.00	0.00	0.56	138.00	0.00	0.58
13.00	0.00	0.54	55.00	0.00	0.55	97.00	0.00	0.57	139.00	0.00	0.58
14.00	0.00	0.54	56.00	0.00	0.55	98.00	0.00	0.57	140.00	0.00	0.58
15.00	0.00	0.54	57.00	0.00	0.55	99.00	0.00	0.57	141.00	0.00	0.58
16.00	0.00	0.54	58.00	0.00	0.55	100.00	0.00	0.57	142.00	0.00	0.58
17.00	0.00	0.54	59.00	0.00	0.55	101.00	0.00	0.57	143.00	0.00	0.58
18.00	0.00	0.54	60.00	0.00	0.55	102.00	0.00	0.57	144.00	0.00	0.58
19.00	0.00	0.54	61.00	0.00	0.55	103.00	0.00	0.57	145.00	0.00	0.58
20.00	0.00	0.54	62.00	0.00	0.55	104.00	0.00	0.57	146.00	0.00	0.58
21.00	0.00	0.54	63.00	0.00	0.56	105.00	0.00	0.57	147.00	0.00	0.58
22.00	0.00	0.54	64.00	0.00	0.56	106.00	0.00	0.57	148.00	0.00	0.58
23.00	0.00	0.54	65.00	0.00	0.56	107.00	0.00	0.57	149.00	0.00	0.58
24.00	0.00	0.54	66.00	0.00	0.56	108.00	0.00	0.57	150.00	0.00	0.58
25.00	0.00	0.54	67.00	0.00	0.56	109.00	0.00	0.57	151.00	0.00	0.58
26.00	0.00	0.54	68.00	0.00	0.56	110.00	0.00	0.57	152.00	0.00	0.58
27.00	0.00	0.54	69.00	0.00	0.56	111.00	0.00	0.57	153.00	0.00	0.58
28.00	0.00	0.54	70.00	0.00	0.56	112.00	0.00	0.57	154.00	0.00	0.58
29.00	0.00	0.55	71.00	0.00	0.56	113.00	0.00	0.57	155.00	0.00	0.58
30.00	0.00	0.55	72.00	0.00	0.56	114.00	0.00	0.57	156.00	0.00	0.58
31.00	0.00	0.55	73.00	0.00	0.56	115.00	0.00	0.57	157.00	0.00	0.58
32.00	0.00	0.55	74.00	0.00	0.56	116.00	0.00	0.57	158.00	0.00	0.58
33.00	0.00	0.55	75.00	0.00	0.56	117.00	0.00	0.57	159.00	0.00	0.58
34.00	0.00	0.55	76.00	0.00	0.56	118.00	0.00	0.57	160.00	0.00	0.58
35.00	0.00	0.55	77.00	0.00	0.56	119.00	0.00	0.57	161.00	0.00	0.59
36.00	0.00	0.55	78.00	0.00	0.56	120.00	0.00	0.57	162.00	0.00	0.59
37.00	0.00	0.55	79.00	0.00	0.56	121.00	0.00	0.57	163.00	0.00	0.59
38.00	0.00	0.55	80.00	0.00	0.56	122.00	0.00	0.57	164.00	0.00	0.59

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
165.00	0.00	0.59	207.00	0.00	0.60	249.00	0.00	0.61	291.00	0.00	0.63
166.00	0.00	0.59	208.00	0.00	0.60	250.00	0.00	0.61	292.00	0.00	0.63
167.00	0.00	0.59	209.00	0.00	0.60	251.00	0.00	0.62	293.00	0.00	0.63
168.00	0.00	0.59	210.00	0.00	0.60	252.00	0.00	0.62	294.00	0.00	0.63
169.00	0.00	0.59	211.00	0.00	0.60	253.00	0.00	0.62	295.00	0.00	0.63
170.00	0.00	0.59	212.00	0.00	0.60	254.00	0.00	0.62	296.00	0.00	0.63
171.00	0.00	0.59	213.00	0.00	0.60	255.00	0.00	0.62	297.00	0.00	0.63
172.00	0.00	0.59	214.00	0.00	0.60	256.00	0.00	0.62	298.00	0.00	0.63
173.00	0.00	0.59	215.00	0.00	0.60	257.00	0.00	0.62	299.00	0.00	0.63
174.00	0.00	0.59	216.00	0.00	0.60	258.00	0.00	0.62	300.00	0.00	0.63
175.00	0.00	0.59	217.00	0.00	0.60	259.00	0.00	0.62	301.00	0.00	0.63
176.00	0.00	0.59	218.00	0.00	0.60	260.00	0.00	0.62	302.00	0.00	0.63
177.00	0.00	0.59	219.00	0.00	0.60	261.00	0.00	0.62	303.00	0.00	0.63
178.00	0.00	0.59	220.00	0.00	0.60	262.00	0.00	0.62	304.00	0.00	0.63
179.00	0.00	0.59	221.00	0.00	0.60	263.00	0.00	0.62	305.00	0.00	0.63
180.00	0.00	0.59	222.00	0.00	0.61	264.00	0.00	0.62	306.00	0.00	0.63
181.00	0.00	0.59	223.00	0.00	0.61	265.00	0.00	0.62	307.00	0.00	0.63
182.00	0.00	0.59	224.00	0.00	0.61	266.00	0.00	0.62	308.00	0.00	0.64
183.00	0.00	0.59	225.00	0.00	0.61	267.00	0.00	0.62	309.00	0.00	0.64
184.00	0.00	0.59	226.00	0.00	0.61	268.00	0.00	0.62	310.00	0.00	0.64
185.00	0.00	0.59	227.00	0.00	0.61	269.00	0.00	0.62	311.00	0.00	0.64
186.00	0.00	0.59	228.00	0.00	0.61	270.00	0.00	0.62	312.00	0.00	0.64
187.00	0.00	0.59	229.00	0.00	0.61	271.00	0.00	0.62	313.00	0.00	0.64
188.00	0.00	0.59	230.00	0.00	0.61	272.00	0.00	0.62	314.00	0.00	0.64
189.00	0.00	0.59	231.00	0.00	0.61	273.00	0.00	0.62	315.00	0.00	0.64
190.00	0.00	0.59	232.00	0.00	0.61	274.00	0.00	0.62	316.00	0.00	0.64
191.00	0.00	0.59	233.00	0.00	0.61	275.00	0.00	0.62	317.00	0.00	0.64
192.00	0.00	0.60	234.00	0.00	0.61	276.00	0.00	0.62	318.00	0.00	0.64
193.00	0.00	0.60	235.00	0.00	0.61	277.00	0.00	0.62	319.00	0.00	0.64
194.00	0.00	0.60	236.00	0.00	0.61	278.00	0.00	0.62	320.00	0.00	0.64
195.00	0.00	0.60	237.00	0.00	0.61	279.00	0.00	0.62	321.00	0.00	0.64
196.00	0.00	0.60	238.00	0.00	0.61	280.00	0.00	0.63	322.00	0.00	0.64
197.00	0.00	0.60	239.00	0.00	0.61	281.00	0.00	0.63	323.00	0.00	0.64
198.00	0.00	0.60	240.00	0.00	0.61	282.00	0.00	0.63	324.00	0.00	0.64
199.00	0.00	0.60	241.00	0.00	0.61	283.00	0.00	0.63	325.00	0.00	0.64
200.00	0.00	0.60	242.00	0.00	0.61	284.00	0.00	0.63	326.00	0.00	0.64
201.00	0.00	0.60	243.00	0.00	0.61	285.00	0.00	0.63	327.00	0.00	0.64
202.00	0.00	0.60	244.00	0.00	0.61	286.00	0.00	0.63	328.00	0.00	0.64
203.00	0.00	0.60	245.00	0.00	0.61	287.00	0.00	0.63	329.00	0.00	0.64
204.00	0.00	0.60	246.00	0.00	0.61	288.00	0.00	0.63	330.00	0.00	0.64
205.00	0.00	0.60	247.00	0.00	0.61	289.00	0.00	0.63	331.00	0.00	0.64
206.00	0.00	0.60	248.00	0.00	0.61	290.00	0.00	0.63	332.00	0.00	0.64

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
333.00	0.00	0.64	375.00	0.00	0.66	417.00	0.00	0.68	459.00	0.00	0.69
334.00	0.00	0.64	376.00	0.00	0.66	418.00	0.00	0.68	460.00	0.00	0.69
335.00	0.00	0.65	377.00	0.00	0.66	419.00	0.00	0.68	461.00	0.00	0.69
336.00	0.00	0.65	378.00	0.00	0.66	420.00	0.00	0.68	462.00	0.00	0.69
337.00	0.00	0.65	379.00	0.00	0.66	421.00	0.00	0.68	463.00	0.00	0.70
338.00	0.00	0.65	380.00	0.00	0.66	422.00	0.00	0.68	464.00	0.00	0.70
339.00	0.00	0.65	381.00	0.00	0.66	423.00	0.00	0.68	465.00	0.00	0.70
340.00	0.00	0.65	382.00	0.00	0.66	424.00	0.00	0.68	466.00	0.00	0.70
341.00	0.00	0.65	383.00	0.00	0.66	425.00	0.00	0.68	467.00	0.00	0.70
342.00	0.00	0.65	384.00	0.00	0.66	426.00	0.00	0.68	468.00	0.00	0.70
343.00	0.00	0.65	385.00	0.00	0.66	427.00	0.00	0.68	469.00	0.00	0.70
344.00	0.00	0.65	386.00	0.00	0.66	428.00	0.00	0.68	470.00	0.00	0.70
345.00	0.00	0.65	387.00	0.00	0.66	429.00	0.00	0.68	471.00	0.00	0.70
346.00	0.00	0.65	388.00	0.00	0.67	430.00	0.00	0.68	472.00	0.00	0.70
347.00	0.00	0.65	389.00	0.00	0.67	431.00	0.00	0.68	473.00	0.00	0.70
348.00	0.00	0.65	390.00	0.00	0.67	432.00	0.00	0.68	474.00	0.00	0.70
349.00	0.00	0.65	391.00	0.00	0.67	433.00	0.00	0.68	475.00	0.00	0.70
350.00	0.00	0.65	392.00	0.00	0.67	434.00	0.00	0.68	476.00	0.00	0.70
351.00	0.00	0.65	393.00	0.00	0.67	435.00	0.00	0.68	477.00	0.00	0.70
352.00	0.00	0.65	394.00	0.00	0.67	436.00	0.00	0.68	478.00	0.00	0.70
353.00	0.00	0.65	395.00	0.00	0.67	437.00	0.00	0.68	479.00	0.00	0.70
354.00	0.00	0.65	396.00	0.00	0.67	438.00	0.00	0.69	480.00	0.00	0.70
355.00	0.00	0.65	397.00	0.00	0.67	439.00	0.00	0.69	481.00	0.00	0.70
356.00	0.00	0.65	398.00	0.00	0.67	440.00	0.00	0.69	482.00	0.00	0.70
357.00	0.00	0.65	399.00	0.00	0.67	441.00	0.00	0.69	483.00	0.00	0.70
358.00	0.00	0.65	400.00	0.00	0.67	442.00	0.00	0.69	484.00	0.00	0.70
359.00	0.00	0.65	401.00	0.00	0.67	443.00	0.00	0.69	485.00	0.00	0.70
360.00	0.00	0.65	402.00	0.00	0.67	444.00	0.00	0.69	486.00	0.00	0.70
361.00	0.00	0.65	403.00	0.00	0.67	445.00	0.00	0.69	487.00	0.00	0.71
362.00	0.00	0.66	404.00	0.00	0.67	446.00	0.00	0.69	488.00	0.00	0.71
363.00	0.00	0.66	405.00	0.00	0.67	447.00	0.00	0.69	489.00	0.00	0.71
364.00	0.00	0.66	406.00	0.00	0.67	448.00	0.00	0.69	490.00	0.00	0.71
365.00	0.00	0.66	407.00	0.00	0.67	449.00	0.00	0.69	491.00	0.00	0.71
366.00	0.00	0.66	408.00	0.00	0.67	450.00	0.00	0.69	492.00	0.00	0.71
367.00	0.00	0.66	409.00	0.00	0.67	451.00	0.00	0.69	493.00	0.00	0.71
368.00	0.00	0.66	410.00	0.00	0.67	452.00	0.00	0.69	494.00	0.00	0.71
369.00	0.00	0.66	411.00	0.00	0.67	453.00	0.00	0.69	495.00	0.00	0.71
370.00	0.00	0.66	412.00	0.00	0.67	454.00	0.00	0.69	496.00	0.00	0.71
371.00	0.00	0.66	413.00	0.00	0.67	455.00	0.00	0.69	497.00	0.00	0.71
372.00	0.00	0.66	414.00	0.00	0.68	456.00	0.00	0.69	498.00	0.00	0.71
373.00	0.00	0.66	415.00	0.00	0.68	457.00	0.00	0.69	499.00	0.00	0.71
374.00	0.00	0.66	416.00	0.00	0.68	458.00	0.00	0.69	500.00	0.00	0.71

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
501.00	0.00	0.71	543.00	0.00	0.73	585.00	0.00	0.75	627.00	0.00	0.77
502.00	0.00	0.71	544.00	0.00	0.73	586.00	0.00	0.75	628.00	0.00	0.77
503.00	0.00	0.71	545.00	0.00	0.73	587.00	0.00	0.75	629.00	0.00	0.77
504.00	0.00	0.71	546.00	0.00	0.73	588.00	0.00	0.75	630.00	0.00	0.77
505.00	0.00	0.71	547.00	0.00	0.73	589.00	0.00	0.75	631.00	0.00	0.77
506.00	0.00	0.71	548.00	0.00	0.73	590.00	0.00	0.75	632.00	0.00	0.77
507.00	0.00	0.71	549.00	0.00	0.73	591.00	0.00	0.75	632.99	0.00	0.77
508.00	0.00	0.71	550.00	0.00	0.73	592.00	0.00	0.75	633.99	0.00	0.77
509.00	0.00	0.71	551.00	0.00	0.73	593.00	0.00	0.75	634.99	0.00	0.77
510.00	0.00	0.72	552.00	0.00	0.73	594.00	0.00	0.75	635.99	0.00	0.77
511.00	0.00	0.72	553.00	0.00	0.73	595.00	0.00	0.75	636.99	0.00	0.77
512.00	0.00	0.72	554.00	0.00	0.73	596.00	0.00	0.75	637.99	0.00	0.77
513.00	0.00	0.72	555.00	0.00	0.74	597.00	0.00	0.75	638.99	0.00	0.77
514.00	0.00	0.72	556.00	0.00	0.74	598.00	0.00	0.75	639.99	0.00	0.78
515.00	0.00	0.72	557.00	0.00	0.74	599.00	0.00	0.76	640.99	0.00	0.78
516.00	0.00	0.72	558.00	0.00	0.74	600.00	0.00	0.76	641.99	0.00	0.78
517.00	0.00	0.72	559.00	0.00	0.74	601.00	0.00	0.76	642.99	0.00	0.78
518.00	0.00	0.72	560.00	0.00	0.74	602.00	0.00	0.76	643.99	0.00	0.78
519.00	0.00	0.72	561.00	0.00	0.74	603.00	0.00	0.76	644.99	0.00	0.78
520.00	0.00	0.72	562.00	0.00	0.74	604.00	0.00	0.76	645.99	0.00	0.78
521.00	0.00	0.72	563.00	0.00	0.74	605.00	0.00	0.76	646.99	0.00	0.78
522.00	0.00	0.72	564.00	0.00	0.74	606.00	0.00	0.76	647.99	0.00	0.78
523.00	0.00	0.72	565.00	0.00	0.74	607.00	0.00	0.76	648.99	0.00	0.78
524.00	0.00	0.72	566.00	0.00	0.74	608.00	0.00	0.76	649.99	0.00	0.78
525.00	0.00	0.72	567.00	0.00	0.74	609.00	0.00	0.76	650.99	0.00	0.78
526.00	0.00	0.72	568.00	0.00	0.74	610.00	0.00	0.76	651.99	0.00	0.78
527.00	0.00	0.72	569.00	0.00	0.74	611.00	0.00	0.76	652.99	0.00	0.78
528.00	0.00	0.72	570.00	0.00	0.74	612.00	0.00	0.76	653.99	0.00	0.78
529.00	0.00	0.72	571.00	0.00	0.74	613.00	0.00	0.76	654.99	0.00	0.78
530.00	0.00	0.72	572.00	0.00	0.74	614.00	0.00	0.76	655.99	0.00	0.78
531.00	0.00	0.72	573.00	0.00	0.74	615.00	0.00	0.76	656.99	0.00	0.78
532.00	0.00	0.72	574.00	0.00	0.74	616.00	0.00	0.76	657.99	0.00	0.78
533.00	0.00	0.73	575.00	0.00	0.74	617.00	0.00	0.76	658.99	0.00	0.78
534.00	0.00	0.73	576.00	0.00	0.74	618.00	0.00	0.76	659.99	0.00	0.79
535.00	0.00	0.73	577.00	0.00	0.75	619.00	0.00	0.76	660.99	0.00	0.79
536.00	0.00	0.73	578.00	0.00	0.75	620.00	0.00	0.77	661.99	0.00	0.79
537.00	0.00	0.73	579.00	0.00	0.75	621.00	0.00	0.77	662.99	0.00	0.79
538.00	0.00	0.73	580.00	0.00	0.75	622.00	0.00	0.77	663.99	0.00	0.79
539.00	0.00	0.73	581.00	0.00	0.75	623.00	0.00	0.77	664.99	0.00	0.79
540.00	0.00	0.73	582.00	0.00	0.75	624.00	0.00	0.77	665.99	0.00	0.79
541.00	0.00	0.73	583.00	0.00	0.75	625.00	0.00	0.77	666.99	0.00	0.79
542.00	0.00	0.73	584.00	0.00	0.75	626.00	0.00	0.77	667.99	0.00	0.79

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
668.99	0.00	0.79	710.99	0.00	0.81	752.99	0.00	0.83	794.99	0.00	0.86
669.99	0.00	0.79	711.99	0.00	0.81	753.99	0.00	0.83	795.99	0.00	0.86
670.99	0.00	0.79	712.99	0.00	0.81	754.99	0.00	0.83	796.99	0.00	0.86
671.99	0.00	0.79	713.99	0.00	0.81	755.99	0.00	0.84	797.99	0.00	0.86
672.99	0.00	0.79	714.99	0.00	0.81	756.99	0.00	0.84	798.99	0.00	0.86
673.99	0.00	0.79	715.99	0.00	0.81	757.99	0.00	0.84	799.99	0.00	0.86
674.99	0.00	0.79	716.99	0.00	0.81	758.99	0.00	0.84	800.99	0.00	0.86
675.99	0.00	0.79	717.99	0.00	0.81	759.99	0.00	0.84	801.99	0.00	0.86
676.99	0.00	0.79	718.99	0.00	0.82	760.99	0.00	0.84	802.99	0.00	0.86
677.99	0.00	0.79	719.99	0.00	0.82	761.99	0.00	0.84	803.99	0.00	0.86
678.99	0.00	0.79	720.99	0.00	0.82	762.99	0.00	0.84	804.99	0.00	0.86
679.99	0.00	0.80	721.99	0.00	0.82	763.99	0.00	0.84	805.99	0.00	0.86
680.99	0.00	0.80	722.99	0.00	0.82	764.99	0.00	0.84	806.99	0.00	0.86
681.99	0.00	0.80	723.99	0.00	0.82	765.99	0.00	0.84	807.99	0.00	0.86
682.99	0.00	0.80	724.99	0.00	0.82	766.99	0.00	0.84	808.99	0.00	0.87
683.99	0.00	0.80	725.99	0.00	0.82	767.99	0.00	0.84	809.99	0.00	0.87
684.99	0.00	0.80	726.99	0.00	0.82	768.99	0.00	0.84	810.99	0.00	0.87
685.99	0.00	0.80	727.99	0.00	0.82	769.99	0.00	0.84	811.99	0.00	0.87
686.99	0.00	0.80	728.99	0.00	0.82	770.99	0.00	0.84	812.99	0.00	0.87
687.99	0.00	0.80	729.99	0.00	0.82	771.99	0.00	0.84	813.99	0.00	0.87
688.99	0.00	0.80	730.99	0.00	0.82	772.99	0.00	0.84	814.99	0.00	0.87
689.99	0.00	0.80	731.99	0.00	0.82	773.99	0.00	0.85	815.99	0.00	0.87
690.99	0.00	0.80	732.99	0.00	0.82	774.99	0.00	0.85	816.99	0.00	0.87
691.99	0.00	0.80	733.99	0.00	0.82	775.99	0.00	0.85	817.99	0.00	0.87
692.99	0.00	0.80	734.99	0.00	0.82	776.99	0.00	0.85	818.99	0.00	0.87
693.99	0.00	0.80	735.99	0.00	0.82	777.99	0.00	0.85	819.99	0.00	0.87
694.99	0.00	0.80	736.99	0.00	0.82	778.99	0.00	0.85	820.99	0.00	0.87
695.99	0.00	0.80	737.99	0.00	0.83	779.99	0.00	0.85	821.99	0.00	0.87
696.99	0.00	0.80	738.99	0.00	0.83	780.99	0.00	0.85	822.99	0.00	0.87
697.99	0.00	0.80	739.99	0.00	0.83	781.99	0.00	0.85	823.99	0.00	0.87
698.99	0.00	0.80	740.99	0.00	0.83	782.99	0.00	0.85	824.99	0.00	0.87
699.99	0.00	0.81	741.99	0.00	0.83	783.99	0.00	0.85	825.99	0.00	0.88
700.99	0.00	0.81	742.99	0.00	0.83	784.99	0.00	0.85	826.99	0.00	0.88
701.99	0.00	0.81	743.99	0.00	0.83	785.99	0.00	0.85	827.99	0.00	0.88
702.99	0.00	0.81	744.99	0.00	0.83	786.99	0.00	0.85	828.99	0.00	0.88
703.99	0.00	0.81	745.99	0.00	0.83	787.99	0.00	0.85	829.99	0.00	0.88
704.99	0.00	0.81	746.99	0.00	0.83	788.99	0.00	0.85	830.99	0.00	0.88
705.99	0.00	0.81	747.99	0.00	0.83	789.99	0.00	0.85	831.99	0.00	0.88
706.99	0.00	0.81	748.99	0.00	0.83	790.99	0.00	0.85	832.99	0.00	0.88
707.99	0.00	0.81	749.99	0.00	0.83	791.99	0.00	0.86	833.99	0.00	0.88
708.99	0.00	0.81	750.99	0.00	0.83	792.99	0.00	0.86	834.99	0.00	0.88
709.99	0.00	0.81	751.99	0.00	0.83	793.99	0.00	0.86	835.99	0.00	0.88

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
836.99	0.00	0.88	878.99	0.00	0.91	920.99	0.00	0.93	962.99	0.00	0.96
837.99	0.00	0.88	879.99	0.00	0.91	921.99	0.00	0.93	963.99	0.00	0.96
838.99	0.00	0.88	880.99	0.00	0.91	922.99	0.00	0.94	964.99	0.00	0.96
839.99	0.00	0.88	881.99	0.00	0.91	923.99	0.00	0.94	965.99	0.00	0.96
840.99	0.00	0.88	882.99	0.00	0.91	924.99	0.00	0.94	966.99	0.00	0.96
841.99	0.00	0.88	883.99	0.00	0.91	925.99	0.00	0.94	967.99	0.00	0.97
842.99	0.00	0.89	884.99	0.00	0.91	926.99	0.00	0.94	968.99	0.00	0.97
843.99	0.00	0.89	885.99	0.00	0.91	927.99	0.00	0.94	969.99	0.00	0.97
844.99	0.00	0.89	886.99	0.00	0.91	928.99	0.00	0.94	970.99	0.00	0.97
845.99	0.00	0.89	887.99	0.00	0.91	929.99	0.00	0.94	971.99	0.00	0.97
846.99	0.00	0.89	888.99	0.00	0.91	930.99	0.00	0.94	972.99	0.00	0.97
847.99	0.00	0.89	889.99	0.00	0.91	931.99	0.00	0.94	973.99	0.00	0.97
848.99	0.00	0.89	890.99	0.00	0.91	932.99	0.00	0.94	974.99	0.00	0.97
849.99	0.00	0.89	891.99	0.00	0.92	933.99	0.00	0.94	975.99	0.00	0.97
850.99	0.00	0.89	892.99	0.00	0.92	934.99	0.00	0.94	976.99	0.00	0.97
851.99	0.00	0.89	893.99	0.00	0.92	935.99	0.00	0.94	977.99	0.00	0.97
852.99	0.00	0.89	894.99	0.00	0.92	936.99	0.00	0.94	978.99	0.00	0.97
853.99	0.00	0.89	895.99	0.00	0.92	937.99	0.00	0.95	979.99	0.00	0.97
854.99	0.00	0.89	896.99	0.00	0.92	938.99	0.00	0.95	980.99	0.00	0.97
855.99	0.00	0.89	897.99	0.00	0.92	939.99	0.00	0.95	981.99	0.00	0.98
856.99	0.00	0.89	898.99	0.00	0.92	940.99	0.00	0.95	982.99	0.00	0.98
857.99	0.00	0.89	899.99	0.00	0.92	941.99	0.00	0.95	983.99	0.00	0.98
858.99	0.00	0.89	900.99	0.00	0.92	942.99	0.00	0.95	984.99	0.00	0.98
859.99	0.00	0.90	901.99	0.00	0.92	943.99	0.00	0.95	985.99	0.00	0.98
860.99	0.00	0.90	902.99	0.00	0.92	944.99	0.00	0.95	986.99	0.00	0.98
861.99	0.00	0.90	903.99	0.00	0.92	945.99	0.00	0.95	987.99	0.00	0.98
862.99	0.00	0.90	904.99	0.00	0.92	946.99	0.00	0.95	988.99	0.00	0.98
863.99	0.00	0.90	905.99	0.00	0.92	947.99	0.00	0.95	989.99	0.00	0.98
864.99	0.00	0.90	906.99	0.00	0.92	948.99	0.00	0.95	990.99	0.00	0.98
865.99	0.00	0.90	907.99	0.00	0.93	949.99	0.00	0.95	991.99	0.00	0.98
866.99	0.00	0.90	908.99	0.00	0.93	950.99	0.00	0.95	992.99	0.00	0.98
867.99	0.00	0.90	909.99	0.00	0.93	951.99	0.00	0.95	993.99	0.00	0.98
868.99	0.00	0.90	910.99	0.00	0.93	952.99	0.00	0.96	994.99	0.00	0.98
869.99	0.00	0.90	911.99	0.00	0.93	953.99	0.00	0.96	995.99	0.00	0.98
870.99	0.00	0.90	912.99	0.00	0.93	954.99	0.00	0.96	996.99	0.00	0.99
871.99	0.00	0.90	913.99	0.00	0.93	955.99	0.00	0.96	997.99	0.00	0.99
872.99	0.00	0.90	914.99	0.00	0.93	956.99	0.00	0.96	998.99	0.00	0.99
873.99	0.00	0.90	915.99	0.00	0.93	957.99	0.00	0.96	999.99	0.00	0.99
874.99	0.00	0.90	916.99	0.00	0.93	958.99	0.00	0.96	1000.99	0.00	0.99
875.99	0.00	0.91	917.99	0.00	0.93	959.99	0.00	0.96	1001.99	0.00	0.99
876.99	0.00	0.91	918.99	0.00	0.93	960.99	0.00	0.96	1002.99	0.00	0.99
877.99	0.00	0.91	919.99	0.00	0.93	961.99	0.00	0.96	1003.99	0.00	0.99

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1004.99	0.00	0.99	1046.98	0.00	1.02	1088.98	0.00	1.05	1130.98	0.00	1.09
1005.99	0.00	0.99	1047.98	0.00	1.02	1089.98	0.00	1.05	1131.98	0.00	1.09
1006.99	0.00	0.99	1048.98	0.00	1.02	1090.98	0.00	1.06	1132.98	0.00	1.09
1007.99	0.00	0.99	1049.98	0.00	1.02	1091.98	0.00	1.06	1133.98	0.00	1.09
1008.99	0.00	0.99	1050.98	0.00	1.02	1092.98	0.00	1.06	1134.98	0.00	1.09
1009.99	0.00	0.99	1051.98	0.00	1.03	1093.98	0.00	1.06	1135.98	0.00	1.09
1010.99	0.00	1.00	1052.98	0.00	1.03	1094.98	0.00	1.06	1136.98	0.00	1.09
1011.99	0.00	1.00	1053.98	0.00	1.03	1095.98	0.00	1.06	1137.98	0.00	1.09
1012.99	0.00	1.00	1054.98	0.00	1.03	1096.98	0.00	1.06	1138.98	0.00	1.09
1013.99	0.00	1.00	1055.98	0.00	1.03	1097.98	0.00	1.06	1139.98	0.00	1.10
1014.99	0.00	1.00	1056.98	0.00	1.03	1098.98	0.00	1.06	1140.98	0.00	1.10
1015.99	0.00	1.00	1057.98	0.00	1.03	1099.98	0.00	1.06	1141.98	0.00	1.10
1016.99	0.00	1.00	1058.98	0.00	1.03	1100.98	0.00	1.06	1142.98	0.00	1.10
1017.99	0.00	1.00	1059.98	0.00	1.03	1101.98	0.00	1.06	1143.98	0.00	1.10
1018.99	0.00	1.00	1060.98	0.00	1.03	1102.98	0.00	1.07	1144.98	0.00	1.10
1019.99	0.00	1.00	1061.98	0.00	1.03	1103.98	0.00	1.07	1145.98	0.00	1.10
1020.99	0.00	1.00	1062.98	0.00	1.03	1104.98	0.00	1.07	1146.98	0.00	1.10
1021.99	0.00	1.00	1063.98	0.00	1.03	1105.98	0.00	1.07	1147.98	0.00	1.10
1022.99	0.00	1.00	1064.98	0.00	1.04	1106.98	0.00	1.07	1148.98	0.00	1.10
1023.99	0.00	1.00	1065.98	0.00	1.04	1107.98	0.00	1.07	1149.98	0.00	1.10
1024.99	0.00	1.01	1066.98	0.00	1.04	1108.98	0.00	1.07	1150.98	0.00	1.10
1025.99	0.00	1.01	1067.98	0.00	1.04	1109.98	0.00	1.07	1151.98	0.00	1.11
1026.99	0.00	1.01	1068.98	0.00	1.04	1110.98	0.00	1.07	1152.98	0.00	1.11
1027.99	0.00	1.01	1069.98	0.00	1.04	1111.98	0.00	1.07	1153.98	0.00	1.11
1028.99	0.00	1.01	1070.98	0.00	1.04	1112.98	0.00	1.07	1154.98	0.00	1.11
1029.99	0.00	1.01	1071.98	0.00	1.04	1113.98	0.00	1.07	1155.98	0.00	1.11
1030.99	0.00	1.01	1072.98	0.00	1.04	1114.98	0.00	1.07	1156.98	0.00	1.11
1031.99	0.00	1.01	1073.98	0.00	1.04	1115.98	0.00	1.08	1157.98	0.00	1.11
1032.99	0.00	1.01	1074.98	0.00	1.04	1116.98	0.00	1.08	1158.98	0.00	1.11
1033.99	0.00	1.01	1075.98	0.00	1.04	1117.98	0.00	1.08	1159.98	0.00	1.11
1034.99	0.00	1.01	1076.98	0.00	1.04	1118.98	0.00	1.08	1160.98	0.00	1.11
1035.99	0.00	1.01	1077.98	0.00	1.05	1119.98	0.00	1.08	1161.98	0.00	1.11
1036.99	0.00	1.01	1078.98	0.00	1.05	1120.98	0.00	1.08	1162.98	0.00	1.11
1037.99	0.00	1.02	1079.98	0.00	1.05	1121.98	0.00	1.08	1163.98	0.00	1.12
1038.99	0.00	1.02	1080.98	0.00	1.05	1122.98	0.00	1.08	1164.98	0.00	1.12
1039.99	0.00	1.02	1081.98	0.00	1.05	1123.98	0.00	1.08	1165.98	0.00	1.12
1040.99	0.00	1.02	1082.98	0.00	1.05	1124.98	0.00	1.08	1166.98	0.00	1.12
1041.99	0.00	1.02	1083.98	0.00	1.05	1125.98	0.00	1.08	1167.98	0.00	1.12
1042.99	0.00	1.02	1084.98	0.00	1.05	1126.98	0.00	1.08	1168.98	0.00	1.12
1043.98	0.00	1.02	1085.98	0.00	1.05	1127.98	0.00	1.09	1169.98	0.00	1.12
1044.98	0.00	1.02	1086.98	0.00	1.05	1128.98	0.00	1.09	1170.98	0.00	1.12
1045.98	0.00	1.02	1087.98	0.00	1.05	1129.98	0.00	1.09	1171.98	0.00	1.12

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1172.98	0.00	1.12	1214.98	0.00	1.16	1256.98	0.00	1.20	1298.98	0.00	1.24
1173.98	0.00	1.12	1215.98	0.00	1.16	1257.98	0.00	1.20	1299.98	0.00	1.24
1174.98	0.00	1.13	1216.98	0.00	1.16	1258.98	0.00	1.20	1300.98	0.00	1.24
1175.98	0.00	1.13	1217.98	0.00	1.16	1259.98	0.00	1.20	1301.98	0.00	1.24
1176.98	0.00	1.13	1218.98	0.00	1.16	1260.98	0.00	1.20	1302.98	0.00	1.25
1177.98	0.00	1.13	1219.98	0.00	1.17	1261.98	0.00	1.20	1303.98	0.00	1.25
1178.98	0.00	1.13	1220.98	0.00	1.17	1262.98	0.00	1.21	1304.98	0.00	1.25
1179.98	0.00	1.13	1221.98	0.00	1.17	1263.98	0.00	1.21	1305.98	0.00	1.25
1180.98	0.00	1.13	1222.98	0.00	1.17	1264.98	0.00	1.21	1306.98	0.00	1.25
1181.98	0.00	1.13	1223.98	0.00	1.17	1265.98	0.00	1.21	1307.98	0.00	1.25
1182.98	0.00	1.13	1224.98	0.00	1.17	1266.98	0.00	1.21	1308.98	0.00	1.25
1183.98	0.00	1.13	1225.98	0.00	1.17	1267.98	0.00	1.21	1309.98	0.00	1.25
1184.98	0.00	1.13	1226.98	0.00	1.17	1268.98	0.00	1.21	1310.98	0.00	1.25
1185.98	0.00	1.13	1227.98	0.00	1.17	1269.98	0.00	1.21	1311.98	0.00	1.25
1186.98	0.00	1.14	1228.98	0.00	1.17	1270.98	0.00	1.21	1312.98	0.00	1.26
1187.98	0.00	1.14	1229.98	0.00	1.17	1271.98	0.00	1.21	1313.98	0.00	1.26
1188.98	0.00	1.14	1230.98	0.00	1.18	1272.98	0.00	1.22	1314.98	0.00	1.26
1189.98	0.00	1.14	1231.98	0.00	1.18	1273.98	0.00	1.22	1315.98	0.00	1.26
1190.98	0.00	1.14	1232.98	0.00	1.18	1274.98	0.00	1.22	1316.98	0.00	1.26
1191.98	0.00	1.14	1233.98	0.00	1.18	1275.98	0.00	1.22	1317.98	0.00	1.26
1192.98	0.00	1.14	1234.98	0.00	1.18	1276.98	0.00	1.22	1318.98	0.00	1.26
1193.98	0.00	1.14	1235.98	0.00	1.18	1277.98	0.00	1.22	1319.98	0.00	1.26
1194.98	0.00	1.14	1236.98	0.00	1.18	1278.98	0.00	1.22	1320.98	0.00	1.26
1195.98	0.00	1.14	1237.98	0.00	1.18	1279.98	0.00	1.22	1321.98	0.00	1.26
1196.98	0.00	1.14	1238.98	0.00	1.18	1280.98	0.00	1.22	1322.98	0.00	1.27
1197.98	0.00	1.15	1239.98	0.00	1.18	1281.98	0.00	1.22	1323.98	0.00	1.27
1198.98	0.00	1.15	1240.98	0.00	1.18	1282.98	0.00	1.23	1324.98	0.00	1.27
1199.98	0.00	1.15	1241.98	0.00	1.19	1283.98	0.00	1.23	1325.98	0.00	1.27
1200.98	0.00	1.15	1242.98	0.00	1.19	1284.98	0.00	1.23	1326.98	0.00	1.27
1201.98	0.00	1.15	1243.98	0.00	1.19	1285.98	0.00	1.23	1327.98	0.00	1.27
1202.98	0.00	1.15	1244.98	0.00	1.19	1286.98	0.00	1.23	1328.98	0.00	1.27
1203.98	0.00	1.15	1245.98	0.00	1.19	1287.98	0.00	1.23	1329.98	0.00	1.27
1204.98	0.00	1.15	1246.98	0.00	1.19	1288.98	0.00	1.23	1330.98	0.00	1.27
1205.98	0.00	1.15	1247.98	0.00	1.19	1289.98	0.00	1.23	1331.98	0.00	1.28
1206.98	0.00	1.15	1248.98	0.00	1.19	1290.98	0.00	1.23	1332.98	0.00	1.28
1207.98	0.00	1.15	1249.98	0.00	1.19	1291.98	0.00	1.23	1333.98	0.00	1.28
1208.98	0.00	1.16	1250.98	0.00	1.19	1292.98	0.00	1.24	1334.98	0.00	1.28
1209.98	0.00	1.16	1251.98	0.00	1.20	1293.98	0.00	1.24	1335.98	0.00	1.28
1210.98	0.00	1.16	1252.98	0.00	1.20	1294.98	0.00	1.24	1336.98	0.00	1.28
1211.98	0.00	1.16	1253.98	0.00	1.20	1295.98	0.00	1.24	1337.98	0.00	1.28
1212.98	0.00	1.16	1254.98	0.00	1.20	1296.98	0.00	1.24	1338.98	0.00	1.28
1213.98	0.00	1.16	1255.98	0.00	1.20	1297.98	0.00	1.24	1339.98	0.00	1.28

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1340.98	0.00	1.28	1382.98	0.00	1.33	1424.98	0.00	1.38	1466.97	0.00	1.43
1341.98	0.00	1.29	1383.98	0.00	1.33	1425.98	0.00	1.38	1467.97	0.00	1.43
1342.98	0.00	1.29	1384.98	0.00	1.33	1426.98	0.00	1.38	1468.97	0.00	1.43
1343.98	0.00	1.29	1385.98	0.00	1.33	1427.98	0.00	1.38	1469.97	0.00	1.44
1344.98	0.00	1.29	1386.98	0.00	1.34	1428.98	0.00	1.38	1470.97	0.00	1.44
1345.98	0.00	1.29	1387.98	0.00	1.34	1429.98	0.00	1.39	1471.97	0.00	1.44
1346.98	0.00	1.29	1388.98	0.00	1.34	1430.98	0.00	1.39	1472.97	0.00	1.44
1347.98	0.00	1.29	1389.98	0.00	1.34	1431.98	0.00	1.39	1473.97	0.00	1.44
1348.98	0.00	1.29	1390.98	0.00	1.34	1432.98	0.00	1.39	1474.97	0.00	1.44
1349.98	0.00	1.29	1391.98	0.00	1.34	1433.98	0.00	1.39	1475.97	0.00	1.44
1350.98	0.00	1.30	1392.98	0.00	1.34	1434.98	0.00	1.39	1476.97	0.00	1.44
1351.98	0.00	1.30	1393.98	0.00	1.34	1435.98	0.00	1.39	1477.97	0.00	1.45
1352.98	0.00	1.30	1394.98	0.00	1.34	1436.98	0.00	1.39	1478.97	0.00	1.45
1353.98	0.00	1.30	1395.98	0.00	1.35	1437.98	0.00	1.40	1479.97	0.00	1.45
1354.98	0.00	1.30	1396.98	0.00	1.35	1438.98	0.00	1.40	1480.97	0.00	1.45
1355.98	0.00	1.30	1397.98	0.00	1.35	1439.98	0.00	1.40	1481.97	0.00	1.45
1356.98	0.00	1.30	1398.98	0.00	1.35	1440.98	0.00	1.40	1482.97	0.00	1.45
1357.98	0.00	1.30	1399.98	0.00	1.35	1441.98	0.00	1.40	1483.97	0.00	1.45
1358.98	0.00	1.30	1400.98	0.00	1.35	1442.98	0.00	1.40	1484.97	0.00	1.45
1359.98	0.00	1.31	1401.98	0.00	1.35	1443.98	0.00	1.40	1485.97	0.00	1.46
1360.98	0.00	1.31	1402.98	0.00	1.35	1444.98	0.00	1.40	1486.97	0.00	1.46
1361.98	0.00	1.31	1403.98	0.00	1.35	1445.98	0.00	1.41	1487.97	0.00	1.46
1362.98	0.00	1.31	1404.98	0.00	1.36	1446.98	0.00	1.41	1488.97	0.00	1.46
1363.98	0.00	1.31	1405.98	0.00	1.36	1447.98	0.00	1.41	1489.97	0.00	1.46
1364.98	0.00	1.31	1406.98	0.00	1.36	1448.98	0.00	1.41	1490.97	0.00	1.46
1365.98	0.00	1.31	1407.98	0.00	1.36	1449.98	0.00	1.41	1491.97	0.00	1.46
1366.98	0.00	1.31	1408.98	0.00	1.36	1450.98	0.00	1.41	1492.97	0.00	1.46
1367.98	0.00	1.31	1409.98	0.00	1.36	1451.98	0.00	1.41	1493.97	0.00	1.47
1368.98	0.00	1.32	1410.98	0.00	1.36	1452.98	0.00	1.41	1494.97	0.00	1.47
1369.98	0.00	1.32	1411.98	0.00	1.36	1453.97	0.00	1.42	1495.97	0.00	1.47
1370.98	0.00	1.32	1412.98	0.00	1.37	1454.97	0.00	1.42	1496.97	0.00	1.47
1371.98	0.00	1.32	1413.98	0.00	1.37	1455.97	0.00	1.42	1497.97	0.00	1.47
1372.98	0.00	1.32	1414.98	0.00	1.37	1456.97	0.00	1.42	1498.97	0.00	1.47
1373.98	0.00	1.32	1415.98	0.00	1.37	1457.97	0.00	1.42	1499.97	0.00	1.47
1374.98	0.00	1.32	1416.98	0.00	1.37	1458.97	0.00	1.42	1500.97	0.00	1.48
1375.98	0.00	1.32	1417.98	0.00	1.37	1459.97	0.00	1.42	1501.97	0.00	1.48
1376.98	0.00	1.32	1418.98	0.00	1.37	1460.97	0.00	1.42	1502.97	0.00	1.48
1377.98	0.00	1.33	1419.98	0.00	1.37	1461.97	0.00	1.43	1503.97	0.00	1.48
1378.98	0.00	1.33	1420.98	0.00	1.37	1462.97	0.00	1.43	1504.97	0.00	1.48
1379.98	0.00	1.33	1421.98	0.00	1.38	1463.97	0.00	1.43	1505.97	0.00	1.48
1380.98	0.00	1.33	1422.98	0.00	1.38	1464.97	0.00	1.43	1506.97	0.00	1.48
1381.98	0.00	1.33	1423.98	0.00	1.38	1465.97	0.00	1.43	1507.97	0.00	1.48

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1508.97	0.00	1.49	1550.97	0.00	1.54	1592.97	0.00	1.61	1634.97	0.00	1.67
1509.97	0.00	1.49	1551.97	0.00	1.55	1593.97	0.00	1.61	1635.97	0.00	1.67
1510.97	0.00	1.49	1552.97	0.00	1.55	1594.97	0.00	1.61	1636.97	0.00	1.68
1511.97	0.00	1.49	1553.97	0.00	1.55	1595.97	0.00	1.61	1637.97	0.00	1.68
1512.97	0.00	1.49	1554.97	0.00	1.55	1596.97	0.00	1.61	1638.97	0.00	1.68
1513.97	0.00	1.49	1555.97	0.00	1.55	1597.97	0.00	1.61	1639.97	0.00	1.68
1514.97	0.00	1.49	1556.97	0.00	1.55	1598.97	0.00	1.62	1640.97	0.00	1.68
1515.97	0.00	1.50	1557.97	0.00	1.55	1599.97	0.00	1.62	1641.97	0.00	1.68
1516.97	0.00	1.50	1558.97	0.00	1.56	1600.97	0.00	1.62	1642.97	0.00	1.69
1517.97	0.00	1.50	1559.97	0.00	1.56	1601.97	0.00	1.62	1643.97	0.00	1.69
1518.97	0.00	1.50	1560.97	0.00	1.56	1602.97	0.00	1.62	1644.97	0.00	1.69
1519.97	0.00	1.50	1561.97	0.00	1.56	1603.97	0.00	1.62	1645.97	0.00	1.69
1520.97	0.00	1.50	1562.97	0.00	1.56	1604.97	0.00	1.62	1646.97	0.00	1.69
1521.97	0.00	1.50	1563.97	0.00	1.56	1605.97	0.00	1.63	1647.97	0.00	1.69
1522.97	0.00	1.51	1564.97	0.00	1.56	1606.97	0.00	1.63	1648.97	0.00	1.70
1523.97	0.00	1.51	1565.97	0.00	1.57	1607.97	0.00	1.63	1649.97	0.00	1.70
1524.97	0.00	1.51	1566.97	0.00	1.57	1608.97	0.00	1.63	1650.97	0.00	1.70
1525.97	0.00	1.51	1567.97	0.00	1.57	1609.97	0.00	1.63	1651.97	0.00	1.70
1526.97	0.00	1.51	1568.97	0.00	1.57	1610.97	0.00	1.63	1652.97	0.00	1.70
1527.97	0.00	1.51	1569.97	0.00	1.57	1611.97	0.00	1.64	1653.97	0.00	1.70
1528.97	0.00	1.51	1570.97	0.00	1.57	1612.97	0.00	1.64	1654.97	0.00	1.71
1529.97	0.00	1.51	1571.97	0.00	1.57	1613.97	0.00	1.64	1655.97	0.00	1.71
1530.97	0.00	1.52	1572.97	0.00	1.58	1614.97	0.00	1.64	1656.97	0.00	1.71
1531.97	0.00	1.52	1573.97	0.00	1.58	1615.97	0.00	1.64	1657.97	0.00	1.71
1532.97	0.00	1.52	1574.97	0.00	1.58	1616.97	0.00	1.64	1658.97	0.00	1.71
1533.97	0.00	1.52	1575.97	0.00	1.58	1617.97	0.00	1.64	1659.97	0.00	1.71
1534.97	0.00	1.52	1576.97	0.00	1.58	1618.97	0.00	1.65	1660.97	0.00	1.72
1535.97	0.00	1.52	1577.97	0.00	1.58	1619.97	0.00	1.65	1661.97	0.00	1.72
1536.97	0.00	1.52	1578.97	0.00	1.59	1620.97	0.00	1.65	1662.97	0.00	1.72
1537.97	0.00	1.53	1579.97	0.00	1.59	1621.97	0.00	1.65	1663.97	0.00	1.72
1538.97	0.00	1.53	1580.97	0.00	1.59	1622.97	0.00	1.65	1664.97	0.00	1.72
1539.97	0.00	1.53	1581.97	0.00	1.59	1623.97	0.00	1.65	1665.97	0.00	1.72
1540.97	0.00	1.53	1582.97	0.00	1.59	1624.97	0.00	1.66	1666.97	0.00	1.73
1541.97	0.00	1.53	1583.97	0.00	1.59	1625.97	0.00	1.66	1667.97	0.00	1.73
1542.97	0.00	1.53	1584.97	0.00	1.59	1626.97	0.00	1.66	1668.97	0.00	1.73
1543.97	0.00	1.53	1585.97	0.00	1.60	1627.97	0.00	1.66	1669.97	0.00	1.73
1544.97	0.00	1.54	1586.97	0.00	1.60	1628.97	0.00	1.66	1670.97	0.00	1.73
1545.97	0.00	1.54	1587.97	0.00	1.60	1629.97	0.00	1.66	1671.97	0.00	1.73
1546.97	0.00	1.54	1588.97	0.00	1.60	1630.97	0.00	1.67	1672.97	0.00	1.74
1547.97	0.00	1.54	1589.97	0.00	1.60	1631.97	0.00	1.67	1673.97	0.00	1.74
1548.97	0.00	1.54	1590.97	0.00	1.60	1632.97	0.00	1.67	1674.97	0.00	1.74
1549.97	0.00	1.54	1591.97	0.00	1.60	1633.97	0.00	1.67	1675.97	0.00	1.74

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1676.97	0.00	1.74	1718.97	0.00	1.82	1760.97	0.00	1.90	1802.97	0.00	1.99
1677.97	0.00	1.74	1719.97	0.00	1.82	1761.97	0.00	1.90	1803.97	0.00	1.99
1678.97	0.00	1.75	1720.97	0.00	1.82	1762.97	0.00	1.90	1804.97	0.00	1.99
1679.97	0.00	1.75	1721.97	0.00	1.82	1763.97	0.00	1.91	1805.97	0.00	1.99
1680.97	0.00	1.75	1722.97	0.00	1.83	1764.97	0.00	1.91	1806.97	0.00	2.00
1681.97	0.00	1.75	1723.97	0.00	1.83	1765.97	0.00	1.91	1807.97	0.00	2.00
1682.97	0.00	1.75	1724.97	0.00	1.83	1766.97	0.00	1.91	1808.97	0.00	2.00
1683.97	0.00	1.75	1725.97	0.00	1.83	1767.97	0.00	1.91	1809.97	0.00	2.00
1684.97	0.00	1.76	1726.97	0.00	1.83	1768.97	0.00	1.92	1810.97	0.00	2.00
1685.97	0.00	1.76	1727.97	0.00	1.84	1769.97	0.00	1.92	1811.97	0.00	2.01
1686.97	0.00	1.76	1728.97	0.00	1.84	1770.97	0.00	1.92	1812.97	0.00	2.01
1687.97	0.00	1.76	1729.97	0.00	1.84	1771.97	0.00	1.92	1813.97	0.00	2.01
1688.97	0.00	1.76	1730.97	0.00	1.84	1772.97	0.00	1.92	1814.97	0.00	2.01
1689.97	0.00	1.77	1731.97	0.00	1.84	1773.97	0.00	1.93	1815.97	0.00	2.01
1690.97	0.00	1.77	1732.97	0.00	1.84	1774.97	0.00	1.93	1816.97	0.00	2.02
1691.97	0.00	1.77	1733.97	0.00	1.85	1775.97	0.00	1.93	1817.97	0.00	2.02
1692.97	0.00	1.77	1734.97	0.00	1.85	1776.97	0.00	1.93	1818.97	0.00	2.02
1693.97	0.00	1.77	1735.97	0.00	1.85	1777.97	0.00	1.93	1819.97	0.00	2.02
1694.97	0.00	1.77	1736.97	0.00	1.85	1778.97	0.00	1.94	1820.97	0.00	2.03
1695.97	0.00	1.78	1737.97	0.00	1.85	1779.97	0.00	1.94	1821.97	0.00	2.03
1696.97	0.00	1.78	1738.97	0.00	1.86	1780.97	0.00	1.94	1822.97	0.00	2.03
1697.97	0.00	1.78	1739.97	0.00	1.86	1781.97	0.00	1.94	1823.97	0.00	2.03
1698.97	0.00	1.78	1740.97	0.00	1.86	1782.97	0.00	1.94	1824.97	0.00	2.04
1699.97	0.00	1.78	1741.97	0.00	1.86	1783.97	0.00	1.95	1825.97	0.00	2.04
1700.97	0.00	1.79	1742.97	0.00	1.86	1784.97	0.00	1.95	1826.97	0.00	2.04
1701.97	0.00	1.79	1743.97	0.00	1.87	1785.97	0.00	1.95	1827.97	0.00	2.04
1702.97	0.00	1.79	1744.97	0.00	1.87	1786.97	0.00	1.95	1828.97	0.00	2.04
1703.97	0.00	1.79	1745.97	0.00	1.87	1787.97	0.00	1.95	1829.97	0.00	2.05
1704.97	0.00	1.79	1746.97	0.00	1.87	1788.97	0.00	1.96	1830.97	0.00	2.05
1705.97	0.00	1.79	1747.97	0.00	1.87	1789.97	0.00	1.96	1831.97	0.00	2.05
1706.97	0.00	1.80	1748.97	0.00	1.88	1790.97	0.00	1.96	1832.97	0.00	2.05
1707.97	0.00	1.80	1749.97	0.00	1.88	1791.97	0.00	1.96	1833.97	0.00	2.06
1708.97	0.00	1.80	1750.97	0.00	1.88	1792.97	0.00	1.97	1834.97	0.00	2.06
1709.97	0.00	1.80	1751.97	0.00	1.88	1793.97	0.00	1.97	1835.97	0.00	2.06
1710.97	0.00	1.80	1752.97	0.00	1.88	1794.97	0.00	1.97	1836.97	0.00	2.06
1711.97	0.00	1.81	1753.97	0.00	1.89	1795.97	0.00	1.97	1837.97	0.00	2.06
1712.97	0.00	1.81	1754.97	0.00	1.89	1796.97	0.00	1.97	1838.97	0.00	2.07
1713.97	0.00	1.81	1755.97	0.00	1.89	1797.97	0.00	1.98	1839.97	0.00	2.07
1714.97	0.00	1.81	1756.97	0.00	1.89	1798.97	0.00	1.98	1840.97	0.00	2.07
1715.97	0.00	1.81	1757.97	0.00	1.89	1799.97	0.00	1.98	1841.97	0.00	2.07
1716.97	0.00	1.81	1758.97	0.00	1.90	1800.97	0.00	1.98	1842.97	0.00	2.08
1717.97	0.00	1.82	1759.97	0.00	1.90	1801.97	0.00	1.98	1843.97	0.00	2.08

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
1844.97	0.00	2.08	1886.96	0.01	2.18	1928.96	0.01	2.29	1970.96	0.01	2.42
1845.97	0.00	2.08	1887.96	0.01	2.19	1929.96	0.01	2.30	1971.96	0.01	2.42
1846.97	0.00	2.09	1888.96	0.01	2.19	1930.96	0.01	2.30	1972.96	0.01	2.42
1847.97	0.00	2.09	1889.96	0.01	2.19	1931.96	0.01	2.30	1973.96	0.01	2.43
1848.97	0.00	2.09	1890.96	0.01	2.19	1932.96	0.01	2.31	1974.96	0.01	2.43
1849.97	0.00	2.09	1891.96	0.01	2.20	1933.96	0.01	2.31	1975.96	0.01	2.43
1850.97	0.00	2.09	1892.96	0.01	2.20	1934.96	0.01	2.31	1976.96	0.01	2.43
1851.97	0.00	2.10	1893.96	0.01	2.20	1935.96	0.01	2.31	1977.96	0.01	2.44
1852.97	0.00	2.10	1894.96	0.01	2.20	1936.96	0.01	2.32	1978.96	0.01	2.44
1853.97	0.00	2.10	1895.96	0.01	2.21	1937.96	0.01	2.32	1979.96	0.01	2.44
1854.97	0.00	2.10	1896.96	0.01	2.21	1938.96	0.01	2.32	1980.96	0.01	2.45
1855.97	0.00	2.11	1897.96	0.01	2.21	1939.96	0.01	2.33	1981.96	0.01	2.45
1856.97	0.00	2.11	1898.96	0.01	2.21	1940.96	0.01	2.33	1982.96	0.01	2.45
1857.97	0.00	2.11	1899.96	0.01	2.22	1941.96	0.01	2.33	1983.96	0.01	2.46
1858.97	0.00	2.11	1900.96	0.01	2.22	1942.96	0.01	2.33	1984.96	0.01	2.46
1859.97	0.00	2.12	1901.96	0.01	2.22	1943.96	0.01	2.34	1985.96	0.01	2.46
1860.97	0.00	2.12	1902.96	0.01	2.22	1944.96	0.01	2.34	1986.96	0.01	2.47
1861.97	0.00	2.12	1903.96	0.01	2.23	1945.96	0.01	2.34	1987.96	0.01	2.47
1862.97	0.00	2.12	1904.96	0.01	2.23	1946.96	0.01	2.35	1988.96	0.01	2.47
1863.97	0.00	2.13	1905.96	0.01	2.23	1947.96	0.01	2.35	1989.96	0.01	2.48
1864.97	0.00	2.13	1906.96	0.01	2.23	1948.96	0.01	2.35	1990.96	0.01	2.48
1865.97	0.00	2.13	1907.96	0.01	2.24	1949.96	0.01	2.35	1991.96	0.01	2.48
1866.97	0.00	2.13	1908.96	0.01	2.24	1950.96	0.01	2.36	1992.96	0.01	2.49
1867.96	0.00	2.14	1909.96	0.01	2.24	1951.96	0.01	2.36	1993.96	0.01	2.49
1868.96	0.00	2.14	1910.96	0.01	2.25	1952.96	0.01	2.36	1994.96	0.01	2.49
1869.96	0.00	2.14	1911.96	0.01	2.25	1953.96	0.01	2.37	1995.96	0.01	2.49
1870.96	0.00	2.14	1912.96	0.01	2.25	1954.96	0.01	2.37	1996.96	0.01	2.50
1871.96	0.00	2.15	1913.96	0.01	2.25	1955.96	0.01	2.37	1997.96	0.01	2.50
1872.96	0.00	2.15	1914.96	0.01	2.26	1956.96	0.01	2.37	1998.96	0.01	2.50
1873.96	0.00	2.15	1915.96	0.01	2.26	1957.96	0.01	2.38	1999.96	0.01	2.51
1874.96	0.00	2.15	1916.96	0.01	2.26	1958.96	0.01	2.38	2000.96	0.01	2.51
1875.96	0.01	2.16	1917.96	0.01	2.26	1959.96	0.01	2.38	2001.96	0.01	2.51
1876.96	0.01	2.16	1918.96	0.01	2.27	1960.96	0.01	2.39	2002.96	0.01	2.52
1877.96	0.01	2.16	1919.96	0.01	2.27	1961.96	0.01	2.39	2003.96	0.01	2.52
1878.96	0.01	2.16	1920.96	0.01	2.27	1962.96	0.01	2.39	2004.96	0.01	2.52
1879.96	0.01	2.17	1921.96	0.01	2.28	1963.96	0.01	2.40	2005.96	0.01	2.53
1880.96	0.01	2.17	1922.96	0.01	2.28	1964.96	0.01	2.40	2006.96	0.01	2.53
1881.96	0.01	2.17	1923.96	0.01	2.28	1965.96	0.01	2.40	2007.96	0.01	2.53
1882.96	0.01	2.17	1924.96	0.01	2.28	1966.96	0.01	2.40	2008.96	0.01	2.54
1883.96	0.01	2.18	1925.96	0.01	2.29	1967.96	0.01	2.41	2009.96	0.01	2.54
1884.96	0.01	2.18	1926.96	0.01	2.29	1968.96	0.01	2.41	2010.96	0.01	2.54
1885.96	0.01	2.18	1927.96	0.01	2.29	1969.96	0.01	2.41	2011.96	0.01	2.55

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2012.96	0.01	2.55	2054.96	0.01	2.70	2096.96	0.01	2.87	2138.96	0.01	3.05
2013.96	0.01	2.55	2055.96	0.01	2.70	2097.96	0.01	2.87	2139.96	0.01	3.06
2014.96	0.01	2.56	2056.96	0.01	2.71	2098.96	0.01	2.87	2140.96	0.01	3.06
2015.96	0.01	2.56	2057.96	0.01	2.71	2099.96	0.01	2.88	2141.96	0.01	3.07
2016.96	0.01	2.56	2058.96	0.01	2.71	2100.96	0.01	2.88	2142.96	0.01	3.07
2017.96	0.01	2.57	2059.96	0.01	2.72	2101.96	0.01	2.89	2143.96	0.01	3.08
2018.96	0.01	2.57	2060.96	0.01	2.72	2102.96	0.01	2.89	2144.96	0.01	3.08
2019.96	0.01	2.57	2061.96	0.01	2.73	2103.96	0.01	2.90	2145.96	0.01	3.09
2020.96	0.01	2.58	2062.96	0.01	2.73	2104.96	0.01	2.90	2146.96	0.01	3.09
2021.96	0.01	2.58	2063.96	0.01	2.73	2105.96	0.01	2.90	2147.96	0.01	3.10
2022.96	0.01	2.58	2064.96	0.01	2.74	2106.96	0.01	2.91	2148.96	0.01	3.10
2023.96	0.01	2.59	2065.96	0.01	2.74	2107.96	0.01	2.91	2149.96	0.01	3.11
2024.96	0.01	2.59	2066.96	0.01	2.75	2108.96	0.01	2.92	2150.96	0.01	3.11
2025.96	0.01	2.60	2067.96	0.01	2.75	2109.96	0.01	2.92	2151.96	0.01	3.12
2026.96	0.01	2.60	2068.96	0.01	2.75	2110.96	0.01	2.93	2152.96	0.01	3.12
2027.96	0.01	2.60	2069.96	0.01	2.76	2111.96	0.01	2.93	2153.96	0.01	3.13
2028.96	0.01	2.61	2070.96	0.01	2.76	2112.96	0.01	2.93	2154.96	0.01	3.13
2029.96	0.01	2.61	2071.96	0.01	2.76	2113.96	0.01	2.94	2155.96	0.01	3.14
2030.96	0.01	2.61	2072.96	0.01	2.77	2114.96	0.01	2.94	2156.96	0.01	3.14
2031.96	0.01	2.62	2073.96	0.01	2.77	2115.96	0.01	2.95	2157.96	0.01	3.15
2032.96	0.01	2.62	2074.96	0.01	2.78	2116.96	0.01	2.95	2158.96	0.01	3.15
2033.96	0.01	2.62	2075.96	0.01	2.78	2117.96	0.01	2.96	2159.96	0.01	3.16
2034.96	0.01	2.63	2076.96	0.01	2.78	2118.96	0.01	2.96	2160.96	0.01	3.16
2035.96	0.01	2.63	2077.96	0.01	2.79	2119.96	0.01	2.97	2161.96	0.01	3.17
2036.96	0.01	2.63	2078.96	0.01	2.79	2120.96	0.01	2.97	2162.96	0.01	3.17
2037.96	0.01	2.64	2079.96	0.01	2.80	2121.96	0.01	2.97	2163.96	0.01	3.18
2038.96	0.01	2.64	2080.96	0.01	2.80	2122.96	0.01	2.98	2164.96	0.01	3.18
2039.96	0.01	2.64	2081.96	0.01	2.80	2123.96	0.01	2.98	2165.96	0.01	3.19
2040.96	0.01	2.65	2082.96	0.01	2.81	2124.96	0.01	2.99	2166.96	0.01	3.19
2041.96	0.01	2.65	2083.96	0.01	2.81	2125.96	0.01	2.99	2167.96	0.01	3.20
2042.96	0.01	2.66	2084.96	0.01	2.82	2126.96	0.01	3.00	2168.96	0.01	3.20
2043.96	0.01	2.66	2085.96	0.01	2.82	2127.96	0.01	3.00	2169.96	0.01	3.21
2044.96	0.01	2.66	2086.96	0.01	2.82	2128.96	0.01	3.01	2170.96	0.01	3.21
2045.96	0.01	2.67	2087.96	0.01	2.83	2129.96	0.01	3.01	2171.96	0.01	3.22
2046.96	0.01	2.67	2088.96	0.01	2.83	2130.96	0.01	3.02	2172.96	0.01	3.22
2047.96	0.01	2.67	2089.96	0.01	2.84	2131.96	0.01	3.02	2173.96	0.01	3.23
2048.96	0.01	2.68	2090.96	0.01	2.84	2132.96	0.01	3.03	2174.96	0.01	3.23
2049.96	0.01	2.68	2091.96	0.01	2.85	2133.96	0.01	3.03	2175.96	0.01	3.24
2050.96	0.01	2.68	2092.96	0.01	2.85	2134.96	0.01	3.03	2176.96	0.01	3.25
2051.96	0.01	2.69	2093.96	0.01	2.85	2135.96	0.01	3.04	2177.96	0.01	3.25
2052.96	0.01	2.69	2094.96	0.01	2.86	2136.96	0.01	3.04	2178.96	0.01	3.26
2053.96	0.01	2.70	2095.96	0.01	2.86	2137.96	0.01	3.05	2179.96	0.01	3.26

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2180.96	0.01	3.27	2222.96	0.01	3.51	2264.96	0.01	3.80	2306.95	0.01	4.15
2181.96	0.01	3.27	2223.96	0.01	3.52	2265.96	0.01	3.81	2307.95	0.01	4.16
2182.96	0.01	3.28	2224.96	0.01	3.53	2266.96	0.01	3.82	2308.95	0.01	4.17
2183.96	0.01	3.28	2225.96	0.01	3.53	2267.96	0.01	3.83	2309.95	0.01	4.18
2184.96	0.01	3.29	2226.96	0.01	3.54	2268.96	0.01	3.83	2310.95	0.01	4.19
2185.96	0.01	3.29	2227.96	0.01	3.55	2269.96	0.01	3.84	2311.95	0.01	4.20
2186.96	0.01	3.30	2228.96	0.01	3.55	2270.96	0.01	3.85	2312.95	0.01	4.20
2187.96	0.01	3.31	2229.96	0.01	3.56	2271.96	0.01	3.86	2313.95	0.01	4.21
2188.96	0.01	3.31	2230.96	0.01	3.57	2272.96	0.01	3.87	2314.95	0.01	4.22
2189.96	0.01	3.32	2231.96	0.01	3.57	2273.96	0.01	3.87	2315.95	0.01	4.23
2190.96	0.01	3.32	2232.96	0.01	3.58	2274.96	0.01	3.88	2316.95	0.01	4.24
2191.96	0.01	3.33	2233.96	0.01	3.59	2275.96	0.01	3.89	2317.95	0.01	4.25
2192.96	0.01	3.33	2234.96	0.01	3.59	2276.96	0.01	3.90	2318.95	0.01	4.26
2193.96	0.01	3.34	2235.96	0.01	3.60	2277.96	0.01	3.90	2319.95	0.01	4.27
2194.96	0.01	3.35	2236.96	0.01	3.61	2278.96	0.01	3.91	2320.95	0.01	4.28
2195.96	0.01	3.35	2237.96	0.01	3.61	2279.95	0.01	3.92	2321.95	0.01	4.29
2196.96	0.01	3.36	2238.96	0.01	3.62	2280.95	0.01	3.93	2322.95	0.01	4.30
2197.96	0.01	3.36	2239.96	0.01	3.63	2281.95	0.01	3.94	2323.95	0.01	4.31
2198.96	0.01	3.37	2240.96	0.01	3.63	2282.95	0.01	3.94	2324.95	0.01	4.32
2199.96	0.01	3.37	2241.96	0.01	3.64	2283.95	0.01	3.95	2325.95	0.01	4.33
2200.96	0.01	3.38	2242.96	0.01	3.65	2284.95	0.01	3.96	2326.95	0.01	4.34
2201.96	0.01	3.39	2243.96	0.01	3.65	2285.95	0.01	3.97	2327.95	0.01	4.35
2202.96	0.01	3.39	2244.96	0.01	3.66	2286.95	0.01	3.98	2328.95	0.01	4.36
2203.96	0.01	3.40	2245.96	0.01	3.67	2287.95	0.01	3.99	2329.95	0.01	4.37
2204.96	0.01	3.40	2246.96	0.01	3.67	2288.95	0.01	3.99	2330.95	0.01	4.38
2205.96	0.01	3.41	2247.96	0.01	3.68	2289.95	0.01	4.00	2331.95	0.01	4.39
2206.96	0.01	3.42	2248.96	0.01	3.69	2290.95	0.01	4.01	2332.95	0.01	4.40
2207.96	0.01	3.42	2249.96	0.01	3.70	2291.95	0.01	4.02	2333.95	0.01	4.41
2208.96	0.01	3.43	2250.96	0.01	3.70	2292.95	0.01	4.03	2334.95	0.01	4.42
2209.96	0.01	3.43	2251.96	0.01	3.71	2293.95	0.01	4.04	2335.95	0.01	4.43
2210.96	0.01	3.44	2252.96	0.01	3.72	2294.95	0.01	4.04	2336.95	0.01	4.44
2211.96	0.01	3.45	2253.96	0.01	3.72	2295.95	0.01	4.05	2337.95	0.01	4.45
2212.96	0.01	3.45	2254.96	0.01	3.73	2296.95	0.01	4.06	2338.95	0.02	4.46
2213.96	0.01	3.46	2255.96	0.01	3.74	2297.95	0.01	4.07	2339.95	0.02	4.47
2214.96	0.01	3.46	2256.96	0.01	3.75	2298.95	0.01	4.08	2340.95	0.02	4.48
2215.96	0.01	3.47	2257.96	0.01	3.75	2299.95	0.01	4.09	2341.95	0.02	4.49
2216.96	0.01	3.48	2258.96	0.01	3.76	2300.95	0.01	4.10	2342.95	0.02	4.50
2217.96	0.01	3.48	2259.96	0.01	3.77	2301.95	0.01	4.11	2343.95	0.02	4.51
2218.96	0.01	3.49	2260.96	0.01	3.77	2302.95	0.01	4.11	2344.95	0.02	4.53
2219.96	0.01	3.50	2261.96	0.01	3.78	2303.95	0.01	4.12	2345.95	0.02	4.54
2220.96	0.01	3.50	2262.96	0.01	3.79	2304.95	0.01	4.13	2346.95	0.02	4.55
2221.96	0.01	3.51	2263.96	0.01	3.80	2305.95	0.01	4.14	2347.95	0.02	4.56

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2348.95	0.02	4.57	2390.95	0.02	5.09	2432.95	0.02	5.74	2474.95	0.02	6.58
2349.95	0.02	4.58	2391.95	0.02	5.10	2433.95	0.02	5.76	2475.95	0.02	6.60
2350.95	0.02	4.59	2392.95	0.02	5.11	2434.95	0.02	5.78	2476.95	0.02	6.62
2351.95	0.02	4.60	2393.95	0.02	5.13	2435.95	0.02	5.79	2477.95	0.02	6.65
2352.95	0.02	4.61	2394.95	0.02	5.14	2436.95	0.02	5.81	2478.95	0.02	6.67
2353.95	0.02	4.62	2395.95	0.02	5.16	2437.95	0.02	5.83	2479.95	0.02	6.69
2354.95	0.02	4.64	2396.95	0.02	5.17	2438.95	0.02	5.85	2480.95	0.02	6.72
2355.95	0.02	4.65	2397.95	0.02	5.19	2439.95	0.02	5.87	2481.95	0.03	6.74
2356.95	0.02	4.66	2398.95	0.02	5.20	2440.95	0.02	5.88	2482.95	0.03	6.77
2357.95	0.02	4.67	2399.95	0.02	5.21	2441.95	0.02	5.90	2483.95	0.03	6.79
2358.95	0.02	4.68	2400.95	0.02	5.23	2442.95	0.02	5.92	2484.95	0.03	6.81
2359.95	0.02	4.69	2401.95	0.02	5.24	2443.95	0.02	5.94	2485.95	0.03	6.84
2360.95	0.02	4.71	2402.95	0.02	5.26	2444.95	0.02	5.96	2486.95	0.03	6.86
2361.95	0.02	4.72	2403.95	0.02	5.27	2445.95	0.02	5.98	2487.95	0.03	6.89
2362.95	0.02	4.73	2404.95	0.02	5.29	2446.95	0.02	6.00	2488.95	0.03	6.91
2363.95	0.02	4.74	2405.95	0.02	5.30	2447.95	0.02	6.01	2489.95	0.03	6.94
2364.95	0.02	4.75	2406.95	0.02	5.32	2448.95	0.02	6.03	2490.95	0.03	6.96
2365.95	0.02	4.77	2407.95	0.02	5.33	2449.95	0.02	6.05	2491.95	0.03	6.99
2366.95	0.02	4.78	2408.95	0.02	5.35	2450.95	0.02	6.07	2492.95	0.03	7.01
2367.95	0.02	4.79	2409.95	0.02	5.36	2451.95	0.02	6.09	2493.95	0.03	7.04
2368.95	0.02	4.80	2410.95	0.02	5.38	2452.95	0.02	6.11	2494.95	0.03	7.06
2369.95	0.02	4.81	2411.95	0.02	5.39	2453.95	0.02	6.13	2495.95	0.03	7.09
2370.95	0.02	4.83	2412.95	0.02	5.41	2454.95	0.02	6.15	2496.95	0.03	7.12
2371.95	0.02	4.84	2413.95	0.02	5.43	2455.95	0.02	6.17	2497.95	0.03	7.14
2372.95	0.02	4.85	2414.95	0.02	5.44	2456.95	0.02	6.19	2498.95	0.03	7.17
2373.95	0.02	4.86	2415.95	0.02	5.46	2457.95	0.02	6.21	2499.95	0.03	7.20
2374.95	0.02	4.88	2416.95	0.02	5.47	2458.95	0.02	6.23	2500.95	0.03	7.22
2375.95	0.02	4.89	2417.95	0.02	5.49	2459.95	0.02	6.25	2501.95	0.03	7.25
2376.95	0.02	4.90	2418.95	0.02	5.50	2460.95	0.02	6.27	2502.95	0.03	7.28
2377.95	0.02	4.91	2419.95	0.02	5.52	2461.95	0.02	6.30	2503.95	0.03	7.30
2378.95	0.02	4.93	2420.95	0.02	5.54	2462.95	0.02	6.32	2504.95	0.03	7.33
2379.95	0.02	4.94	2421.95	0.02	5.55	2463.95	0.02	6.34	2505.95	0.03	7.36
2380.95	0.02	4.95	2422.95	0.02	5.57	2464.95	0.02	6.36	2506.95	0.03	7.39
2381.95	0.02	4.97	2423.95	0.02	5.59	2465.95	0.02	6.38	2507.95	0.03	7.42
2382.95	0.02	4.98	2424.95	0.02	5.60	2466.95	0.02	6.40	2508.95	0.03	7.44
2383.95	0.02	4.99	2425.95	0.02	5.62	2467.95	0.02	6.42	2509.95	0.03	7.47
2384.95	0.02	5.01	2426.95	0.02	5.64	2468.95	0.02	6.44	2510.95	0.03	7.50
2385.95	0.02	5.02	2427.95	0.02	5.65	2469.95	0.02	6.47	2511.95	0.03	7.53
2386.95	0.02	5.03	2428.95	0.02	5.67	2470.95	0.02	6.49	2512.95	0.03	7.56
2387.95	0.02	5.05	2429.95	0.02	5.69	2471.95	0.02	6.51	2513.95	0.03	7.59
2388.95	0.02	5.06	2430.95	0.02	5.71	2472.95	0.02	6.53	2514.95	0.03	7.62
2389.95	0.02	5.07	2431.95	0.02	5.72	2473.95	0.02	6.56	2515.95	0.03	7.65

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2516.95	0.03	7.68	2558.95	0.04	9.16	2600.95	0.04	11.20	2642.95	0.06	14.13
2517.95	0.03	7.71	2559.95	0.04	9.20	2601.95	0.04	11.26	2643.95	0.06	14.22
2518.95	0.03	7.74	2560.95	0.04	9.24	2602.95	0.04	11.32	2644.95	0.06	14.30
2519.95	0.03	7.77	2561.95	0.04	9.28	2603.95	0.04	11.38	2645.95	0.06	14.39
2520.95	0.03	7.80	2562.95	0.04	9.32	2604.95	0.04	11.44	2646.95	0.06	14.48
2521.95	0.03	7.83	2563.95	0.04	9.37	2605.95	0.05	11.50	2647.95	0.06	14.56
2522.95	0.03	7.86	2564.95	0.04	9.41	2606.95	0.05	11.56	2648.95	0.06	14.65
2523.95	0.03	7.90	2565.95	0.04	9.45	2607.95	0.05	11.62	2649.95	0.06	14.74
2524.95	0.03	7.93	2566.95	0.04	9.50	2608.95	0.05	11.68	2650.95	0.06	14.83
2525.95	0.03	7.96	2567.95	0.04	9.54	2609.95	0.05	11.74	2651.95	0.06	14.93
2526.95	0.03	7.99	2568.95	0.04	9.58	2610.95	0.05	11.80	2652.95	0.06	15.02
2527.95	0.03	8.02	2569.95	0.04	9.63	2611.95	0.05	11.87	2653.95	0.06	15.11
2528.95	0.03	8.06	2570.95	0.04	9.67	2612.95	0.05	11.93	2654.95	0.06	15.21
2529.95	0.03	8.09	2571.95	0.04	9.72	2613.95	0.05	11.99	2655.95	0.06	15.30
2530.95	0.03	8.12	2572.95	0.04	9.76	2614.95	0.05	12.06	2656.95	0.06	15.40
2531.95	0.03	8.16	2573.95	0.04	9.81	2615.95	0.05	12.12	2657.95	0.06	15.49
2532.95	0.03	8.19	2574.95	0.04	9.86	2616.95	0.05	12.19	2658.95	0.06	15.59
2533.95	0.03	8.22	2575.95	0.04	9.90	2617.95	0.05	12.26	2659.95	0.06	15.69
2534.95	0.03	8.26	2576.95	0.04	9.95	2618.95	0.05	12.32	2660.95	0.06	15.79
2535.95	0.03	8.29	2577.95	0.04	10.00	2619.95	0.05	12.39	2661.95	0.06	15.89
2536.95	0.03	8.33	2578.95	0.04	10.04	2620.95	0.05	12.46	2662.95	0.06	16.00
2537.95	0.03	8.36	2579.95	0.04	10.09	2621.95	0.05	12.53	2663.95	0.06	16.10
2538.95	0.03	8.40	2580.95	0.04	10.14	2622.95	0.05	12.60	2664.95	0.06	16.20
2539.95	0.03	8.43	2581.95	0.04	10.19	2623.95	0.05	12.67	2665.95	0.06	16.31
2540.95	0.03	8.47	2582.95	0.04	10.24	2624.95	0.05	12.74	2666.95	0.06	16.42
2541.95	0.03	8.50	2583.95	0.04	10.29	2625.95	0.05	12.81	2667.95	0.07	16.52
2542.95	0.03	8.54	2584.95	0.04	10.34	2626.95	0.05	12.88	2668.95	0.07	16.63
2543.95	0.03	8.58	2585.95	0.04	10.39	2627.95	0.05	12.96	2669.95	0.07	16.74
2544.95	0.03	8.61	2586.95	0.04	10.44	2628.95	0.05	13.03	2670.95	0.07	16.85
2545.95	0.03	8.65	2587.95	0.04	10.49	2629.95	0.05	13.10	2671.95	0.07	16.97
2546.95	0.03	8.69	2588.95	0.04	10.54	2630.95	0.05	13.18	2672.95	0.07	17.08
2547.95	0.03	8.72	2589.95	0.04	10.60	2631.95	0.05	13.25	2673.95	0.07	17.19
2548.95	0.03	8.76	2590.95	0.04	10.65	2632.95	0.05	13.33	2674.95	0.07	17.31
2549.95	0.03	8.80	2591.95	0.04	10.70	2633.95	0.05	13.41	2675.95	0.07	17.43
2550.95	0.03	8.84	2592.95	0.04	10.76	2634.95	0.05	13.48	2676.95	0.07	17.55
2551.95	0.03	8.88	2593.95	0.04	10.81	2635.95	0.05	13.56	2677.95	0.07	17.67
2552.95	0.03	8.92	2594.95	0.04	10.86	2636.95	0.05	13.64	2678.95	0.07	17.79
2553.95	0.03	8.96	2595.95	0.04	10.92	2637.95	0.05	13.72	2679.95	0.07	17.91
2554.95	0.03	9.00	2596.95	0.04	10.97	2638.95	0.05	13.80	2680.95	0.07	18.03
2555.95	0.03	9.04	2597.95	0.04	11.03	2639.95	0.05	13.88	2681.95	0.07	18.16
2556.95	0.04	9.08	2598.95	0.04	11.09	2640.95	0.06	13.97	2682.95	0.07	18.29
2557.95	0.04	9.12	2599.95	0.04	11.14	2641.95	0.06	14.05	2683.95	0.07	18.41

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2684.95	0.07	18.54	2726.94	0.10	25.62	2768.94	0.14	38.06	2810.94	0.20	63.01
2685.95	0.07	18.67	2727.94	0.10	25.84	2769.94	0.14	38.47	2811.94	0.20	63.89
2686.95	0.07	18.81	2728.94	0.10	26.06	2770.94	0.14	38.88	2812.94	0.20	64.78
2687.95	0.07	18.94	2729.94	0.10	26.29	2771.94	0.14	39.29	2813.94	0.20	65.69
2688.95	0.08	19.08	2730.94	0.10	26.51	2772.94	0.14	39.72	2814.94	0.20	66.62
2689.94	0.08	19.21	2731.94	0.10	26.74	2773.94	0.15	40.15	2815.94	0.20	67.57
2690.94	0.08	19.35	2732.94	0.10	26.98	2774.94	0.15	40.59	2816.94	0.20	68.54
2691.94	0.08	19.49	2733.94	0.10	27.21	2775.94	0.15	41.04	2817.94	0.21	69.54
2692.94	0.08	19.63	2734.94	0.11	27.45	2776.94	0.15	41.49	2818.94	0.21	70.55
2693.94	0.08	19.78	2735.94	0.11	27.70	2777.94	0.15	41.95	2819.94	0.21	71.59
2694.94	0.08	19.92	2736.94	0.11	27.94	2778.94	0.15	42.42	2820.94	0.21	72.64
2695.94	0.08	20.07	2737.94	0.11	28.19	2779.94	0.15	42.90	2821.94	0.21	73.73
2696.94	0.08	20.22	2738.94	0.11	28.45	2780.94	0.16	43.38	2822.94	0.21	74.83
2697.94	0.08	20.37	2739.94	0.11	28.70	2781.94	0.16	43.88	2823.94	0.21	75.97
2698.94	0.08	20.52	2740.94	0.11	28.96	2782.94	0.16	44.38	2824.94	0.21	77.12
2699.94	0.08	20.67	2741.94	0.11	29.23	2783.94	0.16	44.89	2825.94	0.21	78.31
2700.94	0.08	20.83	2742.94	0.11	29.49	2784.94	0.16	45.41	2826.94	0.21	79.52
2701.94	0.08	20.99	2743.94	0.11	29.77	2785.94	0.16	45.94	2827.94	0.21	80.76
2702.94	0.08	21.15	2744.94	0.11	30.04	2786.94	0.16	46.48	2828.94	0.21	82.03
2703.94	0.08	21.31	2745.94	0.12	30.32	2787.94	0.16	47.03	2829.94	0.22	83.32
2704.94	0.08	21.47	2746.94	0.12	30.61	2788.94	0.17	47.59	2830.94	0.22	84.65
2705.94	0.08	21.63	2747.94	0.12	30.89	2789.94	0.17	48.16	2831.94	0.22	86.01
2706.94	0.09	21.80	2748.94	0.12	31.19	2790.94	0.17	48.74	2832.94	0.22	87.41
2707.94	0.09	21.97	2749.94	0.12	31.48	2791.94	0.17	49.33	2833.94	0.22	88.83
2708.94	0.09	22.14	2750.94	0.12	31.78	2792.94	0.17	49.94	2834.94	0.21	90.29
2709.94	0.09	22.32	2751.94	0.12	32.09	2793.94	0.17	50.55	2835.94	0.21	91.79
2710.94	0.09	22.49	2752.94	0.12	32.40	2794.94	0.17	51.17	2836.94	0.21	93.32
2711.94	0.09	22.67	2753.94	0.12	32.71	2795.94	0.18	51.81	2837.94	0.21	94.89
2712.94	0.09	22.85	2754.94	0.12	33.03	2796.94	0.18	52.46	2838.94	0.21	96.50
2713.94	0.09	23.03	2755.94	0.13	33.36	2797.94	0.18	53.12	2839.94	0.21	98.15
2714.94	0.09	23.22	2756.94	0.13	33.69	2798.94	0.18	53.80	2840.94	0.21	99.84
2715.94	0.09	23.40	2757.94	0.13	34.02	2799.94	0.18	54.48	2841.94	0.21	101.57
2716.94	0.09	23.59	2758.94	0.13	34.36	2800.94	0.18	55.18	2842.94	0.21	103.35
2717.94	0.09	23.78	2759.94	0.13	34.70	2801.94	0.18	55.90	2843.94	0.20	105.17
2718.94	0.09	23.98	2760.94	0.13	35.05	2802.94	0.19	56.63	2844.94	0.20	107.04
2719.94	0.09	24.17	2761.94	0.13	35.41	2803.94	0.19	57.37	2845.94	0.20	108.96
2720.94	0.09	24.37	2762.94	0.13	35.77	2804.94	0.19	58.13	2846.94	0.19	110.92
2721.94	0.10	24.57	2763.94	0.13	36.14	2805.94	0.19	58.90	2847.94	0.19	112.94
2722.94	0.10	24.78	2764.94	0.14	36.51	2806.94	0.19	59.69	2848.94	0.19	115.01
2723.94	0.10	24.99	2765.94	0.14	36.89	2807.94	0.19	60.50	2849.94	0.18	117.14
2724.94	0.10	25.20	2766.94	0.14	37.27	2808.94	0.19	61.32	2850.94	0.18	119.32
2725.94	0.10	25.41	2767.94	0.14	37.67	2809.94	0.20	62.16	2851.94	0.17	121.56

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
2852.94	0.17	123.86	2894.94	1.68	302.81	2936.94	4.24	356.22	2978.94	0.12	115.52
2853.94	0.16	126.22	2895.94	1.80	309.25	2937.94	4.11	350.49	2979.94	0.10	113.91
2854.94	0.15	128.65	2896.94	1.93	315.71	2938.94	3.98	344.43	2980.94	0.08	112.57
2855.94	0.15	131.14	2897.94	2.06	322.17	2939.94	3.83	338.05	2981.94	0.07	111.50
2856.94	0.14	133.70	2898.94	2.20	328.61	2940.94	3.69	331.37	2982.94	0.06	110.70
2857.94	0.13	136.33	2899.94	2.34	334.99	2941.94	3.54	324.44	2983.94	0.05	110.17
2858.94	0.12	139.03	2900.94	2.48	341.29	2942.94	3.38	317.28	2984.94	0.04	109.91
2859.94	0.11	141.81	2901.94	2.63	347.48	2943.94	3.23	309.94	2985.94	0.04	109.91
2860.94	0.10	144.66	2902.94	2.78	353.52	2944.94	3.07	302.44	2986.94	0.03	110.17
2861.94	0.09	147.59	2903.94	2.93	359.37	2945.94	2.91	294.83	2987.94	0.03	110.70
2862.94	0.08	150.61	2904.94	3.08	365.01	2946.94	2.76	287.15	2988.94	0.04	111.48
2863.94	0.07	153.71	2905.94	3.24	370.39	2947.94	2.61	279.43	2989.94	0.04	112.51
2864.94	0.07	156.89	2906.94	3.39	375.47	2948.94	2.46	271.70	2990.94	0.05	113.79
2865.94	0.06	160.17	2907.94	3.55	380.22	2949.94	2.31	264.00	2991.94	0.06	115.31
2866.94	0.07	163.53	2908.94	3.70	384.60	2950.94	2.17	256.35	2992.94	0.07	117.07
2867.94	0.08	166.99	2909.94	3.84	388.59	2951.94	2.03	248.78	2993.94	0.08	119.06
2868.94	0.09	170.55	2910.94	3.98	392.16	2952.94	1.90	241.31	2994.94	0.10	121.28
2869.94	0.11	174.20	2911.94	4.12	395.28	2953.94	1.77	233.96	2995.94	0.12	123.72
2870.94	0.13	177.96	2912.94	4.25	397.95	2954.94	1.65	226.75	2996.94	0.14	126.38
2871.94	0.16	181.83	2913.94	4.37	400.16	2955.94	1.53	219.70	2997.94	0.17	129.25
2872.94	0.18	185.80	2914.94	4.48	401.91	2956.94	1.42	212.81	2998.94	0.19	132.34
2873.94	0.22	189.88	2915.94	4.58	403.21	2957.94	1.31	206.10	2999.94	0.22	135.63
2874.94	0.25	194.08	2916.94	4.67	404.08	2958.94	1.21	199.57	3000.94	0.26	139.14
2875.94	0.29	198.39	2917.94	4.76	404.53	2959.94	1.12	193.24	3001.94	0.29	142.84
2876.94	0.32	202.81	2918.94	4.83	404.59	2960.94	1.03	187.11	3002.94	0.33	146.75
2877.94	0.37	207.36	2919.94	4.89	404.30	2961.94	0.94	181.18	3003.94	0.37	150.86
2878.94	0.41	212.03	2920.94	4.94	403.68	2962.94	0.86	175.47	3004.94	0.42	155.16
2879.94	0.46	216.81	2921.94	4.98	402.76	2963.94	0.79	169.97	3005.94	0.47	159.66
2880.94	0.51	221.73	2922.94	5.00	401.56	2964.94	0.72	164.69	3006.94	0.52	164.36
2881.94	0.57	226.77	2923.94	5.02	400.10	2965.94	0.65	159.63	3007.94	0.58	169.24
2882.94	0.62	231.93	2924.94	5.03	398.40	2966.94	0.59	154.80	3008.94	0.64	174.33
2883.94	0.69	237.22	2925.94	5.02	396.47	2967.94	0.53	150.19	3009.94	0.71	179.59
2884.94	0.75	242.64	2926.94	5.00	394.29	2968.94	0.47	145.82	3010.94	0.78	185.06
2885.94	0.83	248.18	2927.94	4.98	391.87	2969.94	0.42	141.68	3011.94	0.85	190.70
2886.94	0.90	253.84	2928.94	4.94	389.19	2970.94	0.38	137.78	3012.94	0.93	196.53
2887.94	0.98	259.61	2929.94	4.89	386.23	2971.94	0.34	134.11	3013.94	1.02	202.54
2888.94	1.07	265.50	2930.94	4.83	382.97	2972.94	0.30	130.70	3014.94	1.11	208.73
2889.94	1.16	271.50	2931.94	4.75	379.39	2973.94	0.26	127.53	3015.94	1.20	215.09
2890.94	1.25	277.60	2932.94	4.67	375.48	2974.94	0.23	124.61	3016.94	1.30	221.61
2891.94	1.35	283.79	2933.94	4.58	371.21	2975.94	0.20	121.94	3017.94	1.41	228.29
2892.94	1.46	290.07	2934.94	4.48	366.58	2976.94	0.17	119.54	3018.94	1.52	235.12
2893.94	1.57	296.41	2935.94	4.36	361.58	2977.94	0.14	117.40	3019.94	1.64	242.08

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3020.94	1.76	249.16	3062.94	4.14	385.84	3104.93	0.12	160.84	3146.93	0.20	71.16
3021.94	1.88	256.35	3063.94	4.00	382.18	3105.93	0.10	157.28	3147.93	0.20	69.99
3022.94	2.02	263.63	3064.94	3.86	378.11	3106.93	0.08	153.83	3148.93	0.20	68.85
3023.94	2.15	270.99	3065.94	3.72	373.64	3107.93	0.07	150.47	3149.93	0.20	67.73
3024.94	2.30	278.38	3066.94	3.57	368.81	3108.93	0.06	147.21	3150.93	0.20	66.64
3025.94	2.44	285.80	3067.94	3.42	363.64	3109.93	0.06	144.04	3151.93	0.20	65.58
3026.94	2.59	293.21	3068.94	3.26	358.17	3110.93	0.07	140.96	3152.93	0.20	64.53
3027.94	2.74	300.57	3069.94	3.11	352.44	3111.93	0.07	137.97	3153.93	0.20	63.51
3028.94	2.90	307.87	3070.94	2.95	346.48	3112.93	0.08	135.05	3154.93	0.20	62.52
3029.94	3.05	315.05	3071.94	2.80	340.33	3113.93	0.09	132.22	3155.93	0.20	61.54
3030.94	3.21	322.09	3072.94	2.65	334.02	3114.93	0.10	129.47	3156.93	0.20	60.59
3031.94	3.36	328.95	3073.94	2.50	327.60	3115.93	0.11	126.80	3157.93	0.19	59.66
3032.94	3.52	335.59	3074.94	2.36	321.09	3116.93	0.12	124.20	3158.93	0.19	58.75
3033.94	3.67	341.98	3075.94	2.22	314.52	3117.93	0.13	121.67	3159.93	0.19	57.85
3034.94	3.82	348.07	3076.94	2.08	307.93	3118.93	0.14	119.20	3160.93	0.19	56.98
3035.94	3.96	353.85	3077.94	1.95	301.34	3119.93	0.14	116.81	3161.93	0.19	56.13
3036.94	4.10	359.28	3078.94	1.82	294.76	3120.93	0.15	114.48	3162.93	0.19	55.29
3037.94	4.23	364.34	3079.94	1.70	288.23	3121.93	0.16	112.22	3163.93	0.19	54.47
3038.94	4.35	369.03	3080.94	1.58	281.76	3122.93	0.16	110.01	3164.93	0.18	53.67
3039.94	4.46	373.34	3081.94	1.47	275.36	3123.93	0.17	107.86	3165.93	0.18	52.89
3040.94	4.57	377.26	3082.94	1.37	269.05	3124.93	0.17	105.77	3166.93	0.18	52.12
3041.94	4.66	380.80	3083.94	1.27	262.83	3125.93	0.18	103.74	3167.93	0.18	51.37
3042.94	4.75	383.98	3084.94	1.17	256.72	3126.93	0.18	101.76	3168.93	0.18	50.63
3043.94	4.82	386.82	3085.94	1.08	250.73	3127.93	0.19	99.83	3169.93	0.18	49.91
3044.94	4.88	389.33	3086.94	1.00	244.85	3128.93	0.19	97.95	3170.93	0.18	49.20
3045.94	4.93	391.54	3087.94	0.92	239.11	3129.93	0.19	96.12	3171.93	0.17	48.51
3046.94	4.97	393.47	3088.94	0.84	233.48	3130.93	0.19	94.34	3172.93	0.17	47.83
3047.94	5.00	395.14	3089.94	0.77	227.99	3131.93	0.20	92.60	3173.93	0.17	47.17
3048.94	5.02	396.56	3090.94	0.70	222.63	3132.93	0.20	90.91	3174.93	0.17	46.52
3049.94	5.03	397.75	3091.94	0.64	217.40	3133.93	0.20	89.26	3175.93	0.17	45.88
3050.94	5.02	398.70	3092.94	0.58	212.30	3134.93	0.20	87.65	3176.93	0.17	45.25
3051.94	5.01	399.41	3093.94	0.52	207.34	3135.93	0.20	86.08	3177.93	0.17	44.64
3052.94	4.98	399.88	3094.94	0.47	202.50	3136.93	0.20	84.55	3178.93	0.16	44.03
3053.94	4.95	400.08	3095.94	0.42	197.79	3137.93	0.20	83.06	3179.93	0.16	43.44
3054.94	4.90	399.98	3096.94	0.38	193.21	3138.93	0.20	81.61	3180.93	0.16	42.86
3055.94	4.84	399.57	3097.94	0.34	188.76	3139.93	0.21	80.19	3181.93	0.16	42.29
3056.94	4.77	398.82	3098.94	0.30	184.42	3140.93	0.21	78.80	3182.93	0.16	41.74
3057.94	4.69	397.69	3099.93	0.26	180.21	3141.93	0.21	77.45	3183.93	0.16	41.19
3058.94	4.60	396.17	3100.93	0.23	176.11	3142.93	0.21	76.13	3184.93	0.16	40.65
3059.94	4.50	394.24	3101.93	0.19	172.13	3143.93	0.21	74.85	3185.93	0.15	40.13
3060.94	4.38	391.88	3102.93	0.17	168.26	3144.93	0.21	73.59	3186.93	0.15	39.61
3061.94	4.27	389.08	3103.93	0.14	164.49	3145.93	0.21	72.36	3187.93	0.15	39.10

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3188.93	0.15	38.60	3230.93	0.10	24.10	3272.93	0.07	29.27	3314.93	0.08	37.32
3189.93	0.15	38.12	3231.93	0.10	23.99	3273.93	0.07	29.44	3315.93	0.08	37.55
3190.93	0.15	37.64	3232.93	0.10	23.96	3274.93	0.07	29.60	3316.93	0.08	37.78
3191.93	0.15	37.16	3233.93	0.10	23.98	3275.93	0.07	29.77	3317.93	0.08	38.01
3192.93	0.14	36.70	3234.93	0.10	24.05	3276.93	0.07	29.93	3318.93	0.08	38.24
3193.93	0.14	36.25	3235.93	0.10	24.14	3277.93	0.07	30.10	3319.93	0.08	38.48
3194.93	0.14	35.80	3236.93	0.09	24.24	3278.93	0.07	30.27	3320.93	0.08	38.72
3195.93	0.14	35.36	3237.93	0.09	24.35	3279.93	0.07	30.44	3321.93	0.08	38.95
3196.93	0.14	34.93	3238.93	0.09	24.46	3280.93	0.07	30.61	3322.93	0.08	39.20
3197.93	0.14	34.51	3239.93	0.09	24.58	3281.93	0.07	30.78	3323.93	0.08	39.44
3198.93	0.14	34.09	3240.93	0.09	24.70	3282.93	0.07	30.96	3324.93	0.08	39.69
3199.93	0.13	33.68	3241.93	0.09	24.82	3283.93	0.07	31.13	3325.93	0.08	39.93
3200.93	0.13	33.28	3242.93	0.09	24.94	3284.93	0.07	31.31	3326.93	0.09	40.18
3201.93	0.13	32.89	3243.93	0.09	25.07	3285.93	0.07	31.49	3327.93	0.09	40.44
3202.93	0.13	32.50	3244.93	0.09	25.20	3286.93	0.07	31.67	3328.93	0.09	40.69
3203.93	0.13	32.12	3245.93	0.09	25.33	3287.93	0.07	31.85	3329.93	0.09	40.95
3204.93	0.13	31.74	3246.93	0.09	25.46	3288.93	0.07	32.03	3330.93	0.09	41.21
3205.93	0.13	31.37	3247.93	0.09	25.59	3289.93	0.07	32.21	3331.93	0.09	41.47
3206.93	0.13	31.01	3248.93	0.09	25.73	3290.93	0.07	32.40	3332.93	0.09	41.73
3207.93	0.12	30.66	3249.93	0.08	25.86	3291.93	0.07	32.58	3333.93	0.09	42.00
3208.93	0.12	30.31	3250.93	0.08	26.00	3292.93	0.07	32.77	3334.93	0.09	42.27
3209.93	0.12	29.96	3251.93	0.08	26.13	3293.93	0.07	32.96	3335.93	0.09	42.54
3210.93	0.12	29.62	3252.93	0.08	26.27	3294.93	0.07	33.15	3336.93	0.09	42.82
3211.93	0.12	29.29	3253.93	0.08	26.41	3295.93	0.07	33.35	3337.93	0.10	43.09
3212.93	0.12	28.96	3254.93	0.08	26.55	3296.93	0.07	33.54	3338.93	0.10	43.37
3213.93	0.12	28.64	3255.93	0.08	26.69	3297.93	0.07	33.74	3339.93	0.10	43.65
3214.93	0.12	28.32	3256.93	0.08	26.84	3298.93	0.07	33.93	3340.93	0.10	43.94
3215.93	0.11	28.01	3257.93	0.08	26.98	3299.93	0.07	34.13	3341.93	0.10	44.23
3216.93	0.11	27.71	3258.93	0.08	27.12	3300.93	0.07	34.33	3342.93	0.10	44.52
3217.93	0.11	27.41	3259.93	0.08	27.27	3301.93	0.07	34.54	3343.93	0.10	44.81
3218.93	0.11	27.11	3260.93	0.08	27.42	3302.93	0.07	34.74	3344.93	0.10	45.11
3219.93	0.11	26.82	3261.93	0.08	27.57	3303.93	0.07	34.94	3345.93	0.10	45.41
3220.93	0.11	26.53	3262.93	0.08	27.72	3304.93	0.07	35.15	3346.93	0.11	45.71
3221.93	0.11	26.25	3263.93	0.08	27.87	3305.93	0.07	35.36	3347.93	0.11	46.01
3222.93	0.11	25.98	3264.93	0.08	28.02	3306.93	0.07	35.57	3348.93	0.11	46.32
3223.93	0.11	25.71	3265.93	0.08	28.17	3307.93	0.07	35.78	3349.93	0.11	46.63
3224.93	0.11	25.45	3266.93	0.08	28.32	3308.93	0.08	36.00	3350.93	0.11	46.94
3225.93	0.10	25.19	3267.93	0.08	28.48	3309.93	0.08	36.21	3351.93	0.11	47.26
3226.93	0.10	24.94	3268.93	0.07	28.64	3310.93	0.08	36.43	3352.93	0.11	47.58
3227.93	0.10	24.70	3269.93	0.07	28.79	3311.93	0.08	36.65	3353.93	0.12	47.91
3228.93	0.10	24.48	3270.93	0.07	28.95	3312.93	0.08	36.87	3354.93	0.12	48.23
3229.93	0.10	24.27	3271.93	0.07	29.11	3313.93	0.08	37.10	3355.93	0.12	48.56

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3356.93	0.12	48.90	3398.94	0.22	66.82	3440.94	0.43	97.63	3482.95	1.05	159.32
3357.93	0.12	49.23	3399.94	0.22	67.36	3441.94	0.44	98.62	3483.95	1.07	161.50
3358.93	0.12	49.57	3400.94	0.22	67.92	3442.94	0.45	99.63	3484.95	1.10	163.72
3359.93	0.12	49.92	3401.94	0.23	68.47	3443.94	0.46	100.66	3485.95	1.13	165.99
3360.93	0.13	50.27	3402.94	0.23	69.04	3444.94	0.47	101.71	3486.95	1.15	168.31
3361.93	0.13	50.62	3403.94	0.23	69.61	3445.94	0.48	102.77	3487.95	1.18	170.68
3362.93	0.13	50.97	3404.94	0.24	70.20	3446.94	0.49	103.85	3488.95	1.21	173.11
3363.93	0.13	51.33	3405.94	0.24	70.79	3447.94	0.50	104.95	3489.95	1.24	175.59
3364.93	0.13	51.69	3406.94	0.24	71.38	3448.94	0.50	106.07	3490.95	1.27	178.12
3365.93	0.13	52.06	3407.94	0.25	71.99	3449.94	0.51	107.21	3491.95	1.31	180.71
3366.93	0.14	52.43	3408.94	0.25	72.60	3450.94	0.52	108.37	3492.95	1.34	183.36
3367.93	0.14	52.81	3409.94	0.26	73.22	3451.95	0.54	109.54	3493.95	1.37	186.07
3368.93	0.14	53.18	3410.94	0.26	73.85	3452.95	0.55	110.74	3494.95	1.41	188.84
3369.93	0.14	53.57	3411.94	0.26	74.49	3453.95	0.56	111.96	3495.95	1.45	191.68
3370.93	0.14	53.95	3412.94	0.27	75.14	3454.95	0.57	113.20	3496.95	1.49	194.58
3371.93	0.15	54.35	3413.94	0.27	75.79	3455.95	0.58	114.46	3497.95	1.52	197.55
3372.93	0.15	54.74	3414.94	0.28	76.46	3456.95	0.59	115.75	3498.95	1.57	200.60
3373.93	0.15	55.14	3415.94	0.28	77.13	3457.95	0.60	117.05	3499.95	1.61	203.71
3374.93	0.15	55.55	3416.94	0.29	77.81	3458.95	0.62	118.39	3500.95	1.65	206.89
3375.93	0.15	55.96	3417.94	0.29	78.51	3459.95	0.63	119.74	3501.95	1.70	210.16
3376.93	0.16	56.37	3418.94	0.30	79.21	3460.95	0.64	121.12	3502.95	1.74	213.50
3377.93	0.16	56.79	3419.94	0.30	79.92	3461.95	0.66	122.53	3503.95	1.79	216.92
3378.93	0.16	57.21	3420.94	0.31	80.65	3462.95	0.67	123.96	3504.95	1.84	220.43
3379.93	0.16	57.64	3421.94	0.31	81.38	3463.95	0.68	125.42	3505.95	1.89	224.02
3380.93	0.17	58.07	3422.94	0.32	82.13	3464.95	0.70	126.91	3506.95	1.94	227.70
3381.93	0.17	58.51	3423.94	0.32	82.88	3465.95	0.71	128.42	3507.95	2.00	231.46
3382.93	0.17	58.95	3424.94	0.33	83.65	3466.95	0.73	129.97	3508.96	2.05	235.33
3383.93	0.17	59.40	3425.94	0.33	84.43	3467.95	0.74	131.54	3509.96	2.11	239.28
3384.93	0.18	59.86	3426.94	0.34	85.21	3468.95	0.76	133.15	3510.96	2.17	243.34
3385.93	0.18	60.32	3427.94	0.34	86.02	3469.95	0.78	134.78	3511.96	2.23	247.50
3386.93	0.18	60.78	3428.94	0.35	86.83	3470.95	0.79	136.45	3512.96	2.30	251.76
3387.93	0.18	61.25	3429.94	0.36	87.65	3471.95	0.81	138.15	3513.96	2.36	256.13
3388.93	0.19	61.73	3430.94	0.36	88.49	3472.95	0.83	139.89	3514.96	2.43	260.60
3389.93	0.19	62.21	3431.94	0.37	89.34	3473.95	0.85	141.66	3515.96	2.50	265.19
3390.93	0.19	62.69	3432.94	0.38	90.21	3474.95	0.87	143.47	3516.96	2.58	269.90
3391.93	0.19	63.19	3433.94	0.38	91.08	3475.95	0.89	145.31	3517.96	2.65	274.72
3392.93	0.20	63.69	3434.94	0.39	91.98	3476.95	0.91	147.19	3518.96	2.73	279.67
3393.93	0.20	64.19	3435.94	0.40	92.88	3477.95	0.93	149.11	3519.96	2.81	284.74
3394.93	0.20	64.71	3436.94	0.40	93.80	3478.95	0.95	151.07	3520.96	2.89	289.93
3395.94	0.21	65.22	3437.94	0.41	94.73	3479.95	0.98	153.07	3521.96	2.98	295.26
3396.94	0.21	65.75	3438.94	0.42	95.68	3480.95	1.00	155.11	3522.96	3.06	300.71
3397.94	0.21	66.28	3439.94	0.43	96.65	3481.95	1.02	157.20	3523.96	3.15	306.31

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3524.96	3.25	312.04	3566.97	7.37	638.60	3608.97	5.48	611.76	3650.98	6.91	579.03
3525.96	3.34	317.91	3567.97	7.34	644.40	3609.97	5.48	611.15	3651.98	6.95	573.21
3526.96	3.44	323.93	3568.97	7.29	649.80	3610.97	5.47	611.02	3652.98	6.98	567.16
3527.96	3.54	330.09	3569.97	7.23	654.80	3611.97	5.45	611.34	3653.98	6.99	560.89
3528.96	3.65	336.40	3570.97	7.16	659.38	3612.97	5.42	612.06	3654.98	6.99	554.42
3529.96	3.75	342.85	3571.97	7.07	663.53	3613.97	5.38	613.13	3655.98	6.98	547.78
3530.96	3.86	349.46	3572.97	6.98	667.25	3614.97	5.33	614.47	3656.98	6.95	540.98
3531.96	3.98	356.22	3573.97	6.87	670.54	3615.97	5.28	616.04	3657.98	6.91	534.05
3532.96	4.09	363.13	3574.97	6.76	673.39	3616.97	5.22	617.76	3658.98	6.86	527.01
3533.96	4.21	370.19	3575.97	6.63	675.80	3617.97	5.15	619.57	3659.98	6.79	519.88
3534.96	4.33	377.41	3576.97	6.50	677.79	3618.97	5.08	621.43	3660.98	6.72	512.69
3535.96	4.45	384.78	3577.97	6.37	679.35	3619.97	5.01	623.28	3661.98	6.64	505.45
3536.96	4.57	392.29	3578.97	6.23	680.50	3620.97	4.94	625.09	3662.98	6.54	498.20
3537.96	4.70	399.96	3579.97	6.09	681.25	3621.97	4.88	626.82	3663.98	6.44	490.96
3538.96	4.83	407.77	3580.97	5.94	681.60	3622.98	4.82	628.43	3664.98	6.33	483.74
3539.96	4.96	415.72	3581.97	5.80	681.58	3623.98	4.76	629.92	3665.98	6.21	476.56
3540.96	5.09	423.81	3582.97	5.66	681.18	3624.98	4.72	631.25	3666.98	6.09	469.46
3541.96	5.22	432.04	3583.97	5.53	680.44	3625.98	4.69	632.41	3667.98	5.95	462.43
3542.96	5.36	440.38	3584.97	5.41	679.36	3626.98	4.67	633.38	3668.98	5.82	455.51
3543.96	5.49	448.85	3585.97	5.29	677.96	3627.98	4.67	634.16	3669.98	5.68	448.71
3544.96	5.63	457.42	3586.97	5.18	676.26	3628.98	4.68	634.72	3670.98	5.54	442.04
3545.96	5.76	466.09	3587.97	5.09	674.28	3629.98	4.72	635.06	3671.98	5.39	435.52
3546.96	5.89	474.85	3588.97	5.02	672.02	3630.98	4.77	635.16	3672.98	5.24	429.16
3547.96	6.02	483.68	3589.97	4.96	669.52	3631.98	4.83	635.03	3673.98	5.09	422.97
3548.96	6.15	492.57	3590.97	4.91	666.78	3632.98	4.91	634.65	3674.98	4.94	416.96
3549.96	6.28	501.50	3591.97	4.88	663.83	3633.98	5.01	634.02	3675.98	4.79	411.13
3550.96	6.41	510.46	3592.97	4.87	660.69	3634.98	5.12	633.12	3676.98	4.64	405.50
3551.96	6.53	519.42	3593.97	4.87	657.37	3635.98	5.24	631.95	3677.98	4.48	400.08
3552.96	6.64	528.37	3594.97	4.89	653.91	3636.98	5.36	630.50	3678.98	4.33	394.86
3553.96	6.75	537.29	3595.97	4.92	650.34	3637.98	5.49	628.76	3679.99	4.18	389.86
3554.96	6.86	546.14	3596.97	4.96	646.67	3638.98	5.63	626.74	3680.99	4.03	385.07
3555.96	6.95	554.92	3597.97	5.00	642.94	3639.98	5.77	624.42	3681.99	3.88	380.50
3556.96	7.04	563.58	3598.97	5.06	639.19	3640.98	5.90	621.80	3682.99	3.74	376.15
3557.96	7.12	572.12	3599.97	5.11	635.47	3641.98	6.04	618.88	3683.99	3.60	372.03
3558.96	7.20	580.49	3600.97	5.17	631.81	3642.98	6.17	615.64	3684.99	3.45	368.14
3559.96	7.26	588.68	3601.97	5.23	628.27	3643.98	6.29	612.11	3685.99	3.32	364.47
3560.96	7.31	596.65	3602.97	5.28	624.91	3644.98	6.41	608.26	3686.99	3.18	361.03
3561.96	7.35	604.39	3603.97	5.34	621.79	3645.98	6.52	604.12	3687.99	3.05	357.81
3562.96	7.38	611.86	3604.97	5.38	618.97	3646.98	6.62	599.67	3688.99	2.92	354.82
3563.96	7.40	619.04	3605.97	5.42	616.51	3647.98	6.71	594.93	3689.99	2.79	352.06
3564.96	7.40	625.91	3606.97	5.45	614.46	3648.98	6.79	589.90	3690.99	2.67	349.52
3565.97	7.39	632.43	3607.97	5.47	612.87	3649.98	6.86	584.59	3691.99	2.55	347.20

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3692.99	2.44	345.11	3734.99	4.61	441.18	3777.00	5.49	612.63	3819.01	3.86	541.17
3693.99	2.33	343.24	3735.99	4.76	447.39	3778.00	5.38	610.22	3820.01	3.76	540.04
3694.99	2.22	341.59	3737.00	4.91	453.72	3779.00	5.27	607.51	3821.01	3.68	538.56
3695.99	2.12	340.15	3738.00	5.07	460.17	3780.00	5.17	604.50	3822.01	3.62	536.75
3696.99	2.03	338.94	3739.00	5.22	466.73	3781.00	5.09	601.22	3823.01	3.57	534.59
3697.99	1.94	337.94	3740.00	5.37	473.38	3782.00	5.02	597.68	3824.01	3.54	532.08
3698.99	1.86	337.15	3741.00	5.52	480.11	3783.00	4.96	593.89	3825.01	3.53	529.22
3699.99	1.79	336.58	3742.00	5.67	486.91	3784.00	4.92	589.87	3826.01	3.54	525.99
3700.99	1.73	336.22	3743.00	5.81	493.76	3785.00	4.90	585.65	3827.01	3.56	522.41
3701.99	1.68	336.06	3744.00	5.96	500.64	3786.00	4.89	581.23	3828.01	3.61	518.46
3702.99	1.63	336.12	3745.00	6.09	507.54	3787.00	4.89	576.66	3829.01	3.67	514.14
3703.99	1.60	336.38	3746.00	6.22	514.42	3788.00	4.91	571.96	3830.01	3.74	509.45
3704.99	1.58	336.84	3747.00	6.35	521.29	3789.00	4.93	567.15	3831.01	3.81	504.39
3705.99	1.58	337.51	3748.00	6.47	528.10	3790.00	4.97	562.29	3832.01	3.90	498.97
3706.99	1.58	338.38	3749.00	6.58	534.84	3791.00	5.01	557.42	3833.01	3.98	493.18
3707.99	1.60	339.46	3750.00	6.69	541.48	3792.00	5.06	552.60	3834.01	4.07	487.03
3708.99	1.63	340.73	3751.00	6.79	548.00	3793.00	5.11	547.91	3835.01	4.16	480.53
3709.99	1.67	342.21	3752.00	6.87	554.38	3794.01	5.16	543.43	3836.01	4.24	473.69
3710.99	1.72	343.88	3753.00	6.95	560.58	3795.01	5.21	539.26	3837.01	4.32	466.51
3711.99	1.79	345.75	3754.00	7.02	566.59	3796.01	5.25	535.51	3838.01	4.39	459.01
3712.99	1.86	347.82	3755.00	7.07	572.38	3797.01	5.29	532.28	3839.01	4.45	451.21
3713.99	1.94	350.08	3756.00	7.11	577.92	3798.01	5.33	529.68	3840.01	4.50	443.14
3714.99	2.02	352.54	3757.00	7.14	583.19	3799.01	5.35	527.78	3841.01	4.54	434.81
3715.99	2.11	355.20	3758.00	7.16	588.18	3800.01	5.37	526.61	3842.01	4.58	426.26
3716.99	2.21	358.05	3759.00	7.16	592.85	3801.01	5.37	526.14	3843.01	4.60	417.53
3717.99	2.32	361.09	3760.00	7.16	597.19	3802.01	5.37	526.32	3844.01	4.60	408.64
3718.99	2.42	364.33	3761.00	7.13	601.19	3803.01	5.35	527.03	3845.01	4.60	399.65
3719.99	2.54	367.76	3762.00	7.10	604.82	3804.01	5.32	528.16	3846.01	4.58	390.61
3720.99	2.65	371.38	3763.00	7.05	608.08	3805.01	5.28	529.60	3847.01	4.56	381.56
3721.99	2.77	375.20	3764.00	6.99	610.95	3806.01	5.22	531.22	3848.01	4.53	372.57
3722.99	2.90	379.20	3765.00	6.91	613.43	3807.01	5.16	532.94	3849.01	4.48	363.71
3723.99	3.03	383.39	3766.00	6.83	615.52	3808.01	5.08	534.66	3850.01	4.43	355.03
3724.99	3.16	387.77	3767.00	6.74	617.19	3809.01	4.99	536.32	3851.02	4.37	346.63
3725.99	3.29	392.33	3768.00	6.63	618.47	3810.01	4.90	537.87	3852.02	4.31	338.57
3726.99	3.43	397.07	3769.00	6.52	619.34	3811.01	4.79	539.25	3853.02	4.25	330.95
3727.99	3.57	402.00	3770.00	6.40	619.82	3812.01	4.68	540.43	3854.02	4.19	323.85
3728.99	3.71	407.10	3771.00	6.27	619.90	3813.01	4.56	541.38	3855.02	4.13	317.36
3729.99	3.86	412.37	3772.00	6.14	619.60	3814.01	4.44	542.08	3856.02	4.07	311.58
3730.99	4.00	417.82	3773.00	6.01	618.92	3815.01	4.32	542.50	3857.02	4.02	306.60
3731.99	4.15	423.43	3774.00	5.88	617.87	3816.01	4.20	542.63	3858.02	3.98	302.49
3732.99	4.30	429.20	3775.00	5.75	616.46	3817.01	4.08	542.46	3859.02	3.95	299.35
3733.99	4.45	435.12	3776.00	5.62	614.71	3818.01	3.97	541.98	3860.02	3.93	297.22

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
3861.02	3.92	296.15	3903.02	3.83	562.07	3945.03	5.72	665.40	3987.04	5.30	463.08
3862.02	3.92	296.17	3904.02	3.94	564.01	3946.03	5.85	668.22	3988.04	5.16	454.97
3863.02	3.94	297.28	3905.02	4.06	565.60	3947.03	5.99	670.68	3989.04	5.03	446.98
3864.02	3.97	299.46	3906.02	4.18	566.87	3948.03	6.12	672.73	3990.04	4.90	439.10
3865.02	4.01	302.66	3907.02	4.31	567.83	3949.03	6.26	674.37	3991.04	4.77	431.35
3866.02	4.05	306.83	3908.03	4.43	568.48	3950.03	6.40	675.59	3992.04	4.64	423.72
3867.02	4.11	311.91	3909.03	4.56	568.83	3951.03	6.54	676.36	3993.04	4.52	416.22
3868.02	4.16	317.80	3910.03	4.68	568.93	3952.03	6.67	676.68	3994.04	4.39	408.86
3869.02	4.22	324.42	3911.03	4.79	568.78	3953.03	6.79	676.53	3995.04	4.27	401.63
3870.02	4.28	331.69	3912.03	4.90	568.41	3954.03	6.91	675.90	3996.04	4.15	394.55
3871.02	4.34	339.51	3913.03	5.00	567.88	3955.03	7.02	674.80	3997.04	4.04	387.61
3872.02	4.39	347.81	3914.03	5.09	567.22	3956.03	7.12	673.20	3998.04	3.93	380.80
3873.02	4.44	356.48	3915.03	5.17	566.48	3957.03	7.22	671.12	3999.04	3.82	374.14
3874.02	4.48	365.47	3916.03	5.24	565.74	3958.03	7.30	668.56	4000.04	3.71	367.62
3875.02	4.51	374.68	3917.03	5.30	565.06	3959.03	7.36	665.51	4001.04	3.60	361.24
3876.02	4.54	384.06	3918.03	5.35	564.54	3960.03	7.42	661.98	4002.04	3.50	355.00
3877.02	4.55	393.53	3919.03	5.38	564.26	3961.03	7.46	658.00	4003.04	3.40	348.90
3878.02	4.55	403.04	3920.03	5.40	564.32	3962.03	7.50	653.56	4004.04	3.31	342.94
3879.02	4.54	412.53	3921.03	5.42	564.82	3963.03	7.51	648.68	4005.04	3.21	337.11
3880.02	4.52	421.94	3922.03	5.42	565.83	3964.03	7.52	643.38	4006.04	3.12	331.42
3881.02	4.49	431.25	3923.03	5.41	567.42	3965.04	7.51	637.69	4007.04	3.03	325.86
3882.02	4.44	440.39	3924.03	5.39	569.63	3966.04	7.49	631.62	4008.04	2.95	320.43
3883.02	4.39	449.35	3925.03	5.36	572.45	3967.04	7.46	625.20	4009.04	2.86	315.12
3884.02	4.32	458.08	3926.03	5.33	575.85	3968.04	7.42	618.45	4010.04	2.78	309.94
3885.02	4.25	466.56	3927.03	5.29	579.79	3969.04	7.36	611.41	4011.04	2.70	304.88
3886.02	4.17	474.77	3928.03	5.24	584.18	3970.04	7.30	604.09	4012.04	2.63	299.94
3887.02	4.09	482.68	3929.03	5.20	588.95	3971.04	7.22	596.53	4013.04	2.56	295.12
3888.02	4.00	490.28	3930.03	5.16	594.01	3972.04	7.14	588.75	4014.04	2.48	290.41
3889.02	3.91	497.55	3931.03	5.12	599.28	3973.04	7.05	580.78	4015.04	2.42	285.81
3890.02	3.82	504.48	3932.03	5.09	604.69	3974.04	6.95	572.66	4016.04	2.35	281.33
3891.02	3.74	511.07	3933.03	5.06	610.17	3975.04	6.84	564.40	4017.04	2.28	276.95
3892.02	3.66	517.31	3934.03	5.04	615.65	3976.04	6.73	556.03	4018.04	2.22	272.67
3893.02	3.59	523.19	3935.03	5.04	621.10	3977.04	6.61	547.58	4019.04	2.16	268.50
3894.02	3.54	528.71	3936.03	5.04	626.46	3978.04	6.49	539.07	4020.04	2.10	264.42
3895.02	3.49	533.86	3937.03	5.06	631.69	3979.04	6.36	530.53	4021.04	2.04	260.44
3896.02	3.47	538.65	3938.03	5.10	636.76	3980.04	6.24	521.97	4022.05	1.99	256.55
3897.02	3.46	543.07	3939.03	5.15	641.64	3981.04	6.10	513.41	4023.05	1.94	252.76
3898.02	3.48	547.14	3940.03	5.21	646.30	3982.04	5.97	504.88	4024.05	1.88	249.06
3899.02	3.51	550.84	3941.03	5.29	650.71	3983.04	5.84	496.39	4025.05	1.83	245.44
3900.02	3.57	554.18	3942.03	5.38	654.84	3984.04	5.70	487.95	4026.05	1.79	241.90
3901.02	3.64	557.16	3943.03	5.49	658.68	3985.04	5.57	479.57	4027.05	1.74	238.45
3902.02	3.73	559.79	3944.03	5.60	662.21	3986.04	5.43	471.28	4028.05	1.69	235.08

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
4029.05	1.65	231.79	4071.05	0.63	142.61	4113.06	0.29	104.20	4155.07	0.13	88.19
4030.05	1.61	228.57	4072.05	0.61	141.29	4114.06	0.28	103.61	4156.07	0.13	88.00
4031.05	1.57	225.42	4073.05	0.60	140.00	4115.06	0.28	103.04	4157.07	0.12	87.82
4032.05	1.53	222.35	4074.05	0.59	138.73	4116.06	0.27	102.47	4158.07	0.12	87.65
4033.05	1.49	219.35	4075.05	0.58	137.49	4117.06	0.27	101.92	4159.07	0.12	87.48
4034.05	1.45	216.41	4076.05	0.57	136.27	4118.06	0.26	101.38	4160.07	0.12	87.33
4035.05	1.41	213.55	4077.05	0.56	135.07	4119.06	0.26	100.85	4161.07	0.11	87.18
4036.05	1.38	210.74	4078.05	0.54	133.90	4120.06	0.25	100.33	4162.07	0.11	87.04
4037.05	1.35	208.00	4079.06	0.53	132.75	4121.06	0.25	99.82	4163.07	0.11	86.91
4038.05	1.31	205.32	4080.06	0.52	131.62	4122.06	0.24	99.32	4164.07	0.10	86.78
4039.05	1.28	202.70	4081.06	0.51	130.51	4123.06	0.24	98.83	4165.07	0.10	86.67
4040.05	1.25	200.14	4082.06	0.50	129.42	4124.06	0.24	98.35	4166.07	0.10	86.56
4041.05	1.22	197.63	4083.06	0.49	128.35	4125.06	0.23	97.88	4167.07	0.10	86.46
4042.05	1.19	195.18	4084.06	0.49	127.31	4126.06	0.23	97.43	4168.07	0.09	86.37
4043.05	1.16	192.78	4085.06	0.48	126.28	4127.06	0.22	96.98	4169.07	0.09	86.29
4044.05	1.13	190.44	4086.06	0.47	125.27	4128.06	0.22	96.54	4170.07	0.09	86.22
4045.05	1.11	188.14	4087.06	0.46	124.29	4129.06	0.22	96.11	4171.07	0.09	86.16
4046.05	1.08	185.89	4088.06	0.45	123.32	4130.06	0.21	95.69	4172.07	0.08	86.10
4047.05	1.06	183.70	4089.06	0.44	122.36	4131.06	0.21	95.29	4173.07	0.08	86.05
4048.05	1.03	181.54	4090.06	0.43	121.43	4132.06	0.20	94.89	4174.07	0.08	86.01
4049.05	1.01	179.44	4091.06	0.43	120.51	4133.06	0.20	94.50	4175.07	0.08	85.98
4050.05	0.99	177.38	4092.06	0.42	119.61	4134.06	0.20	94.12	4176.07	0.07	85.96
4051.05	0.96	175.36	4093.06	0.41	118.73	4135.06	0.19	93.75	4177.07	0.07	85.95
4052.05	0.94	173.38	4094.06	0.40	117.87	4136.07	0.19	93.39	4178.07	0.07	85.94
4053.05	0.92	171.45	4095.06	0.40	117.02	4137.07	0.19	93.03	4179.07	0.07	85.94
4054.05	0.90	169.55	4096.06	0.39	116.18	4138.07	0.18	92.69	4180.07	0.06	85.96
4055.05	0.88	167.70	4097.06	0.38	115.36	4139.07	0.18	92.36	4181.07	0.06	85.98
4056.05	0.86	165.88	4098.06	0.37	114.56	4140.07	0.18	92.03	4182.07	0.06	86.01
4057.05	0.84	164.10	4099.06	0.37	113.77	4141.07	0.17	91.72	4183.07	0.06	86.05
4058.05	0.82	162.35	4100.06	0.36	113.00	4142.07	0.17	91.41	4184.07	0.06	86.10
4059.05	0.81	160.64	4101.06	0.35	112.24	4143.07	0.17	91.11	4185.07	0.05	86.16
4060.05	0.79	158.97	4102.06	0.35	111.50	4144.07	0.16	90.82	4186.07	0.05	86.22
4061.05	0.77	157.33	4103.06	0.34	110.77	4145.07	0.16	90.54	4187.07	0.05	86.30
4062.05	0.76	155.72	4104.06	0.34	110.06	4146.07	0.16	90.26	4188.07	0.05	86.39
4063.05	0.74	154.15	4105.06	0.33	109.35	4147.07	0.15	90.00	4189.07	0.05	86.48
4064.05	0.72	152.60	4106.06	0.32	108.66	4148.07	0.15	89.74	4190.07	0.04	86.59
4065.05	0.71	151.09	4107.06	0.32	107.99	4149.07	0.15	89.50	4191.07	0.04	86.70
4066.05	0.69	149.60	4108.06	0.31	107.33	4150.07	0.14	89.26	4192.08	0.04	86.83
4067.05	0.68	148.15	4109.06	0.31	106.68	4151.07	0.14	89.03	4193.08	0.04	86.97
4068.05	0.67	146.72	4110.06	0.30	106.04	4152.07	0.14	88.80	4194.08	0.04	87.11
4069.05	0.65	145.32	4111.06	0.30	105.42	4153.07	0.14	88.59	4195.08	0.04	87.27
4070.05	0.64	143.95	4112.06	0.29	104.80	4154.07	0.13	88.39	4196.08	0.04	87.43

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
4197.08	0.04	87.61	4239.08	0.21	107.90	4281.09	1.02	186.91	4323.10	3.29	401.23
4198.08	0.04	87.80	4240.08	0.22	108.81	4282.09	1.07	190.48	4324.10	3.22	401.23
4199.08	0.04	88.00	4241.08	0.23	109.75	4283.09	1.11	194.17	4325.10	3.15	400.54
4200.08	0.04	88.21	4242.08	0.23	110.72	4284.09	1.16	197.99	4326.10	3.07	399.16
4201.08	0.04	88.43	4243.08	0.24	111.72	4285.09	1.21	201.95	4327.10	2.98	397.14
4202.08	0.04	88.66	4244.08	0.25	112.75	4286.09	1.26	206.05	4328.10	2.89	394.52
4203.08	0.04	88.91	4245.08	0.26	113.81	4287.09	1.31	210.29	4329.10	2.80	391.34
4204.08	0.04	89.16	4246.08	0.27	114.90	4288.09	1.37	214.68	4330.10	2.70	387.66
4205.08	0.05	89.43	4247.08	0.28	116.03	4289.09	1.43	219.22	4331.10	2.61	383.56
4206.08	0.05	89.71	4248.08	0.29	117.20	4290.09	1.49	223.91	4332.10	2.52	379.12
4207.08	0.05	90.01	4249.08	0.30	118.40	4291.09	1.55	228.76	4333.10	2.44	374.42
4208.08	0.05	90.31	4250.09	0.31	119.64	4292.09	1.61	233.78	4334.10	2.36	369.53
4209.08	0.06	90.63	4251.09	0.33	120.92	4293.09	1.68	238.96	4335.10	2.29	364.54
4210.08	0.06	90.96	4252.09	0.34	122.24	4294.09	1.75	244.30	4336.10	2.22	359.53
4211.08	0.06	91.31	4253.09	0.35	123.60	4295.09	1.83	249.81	4337.10	2.15	354.56
4212.08	0.06	91.67	4254.09	0.36	125.00	4296.09	1.90	255.48	4338.10	2.09	349.66
4213.08	0.07	92.04	4255.09	0.38	126.45	4297.09	1.98	261.32	4339.10	2.03	344.85
4214.08	0.07	92.43	4256.09	0.39	127.95	4298.09	2.06	267.32	4340.10	1.96	340.13
4215.08	0.08	92.83	4257.09	0.41	129.49	4299.09	2.14	273.47	4341.10	1.90	335.46
4216.08	0.08	93.25	4258.09	0.42	131.09	4300.09	2.23	279.77	4342.10	1.82	330.78
4217.08	0.08	93.68	4259.09	0.44	132.73	4301.09	2.31	286.21	4343.10	1.75	326.03
4218.08	0.09	94.13	4260.09	0.45	134.43	4302.09	2.40	292.77	4344.10	1.66	321.11
4219.08	0.09	94.59	4261.09	0.47	136.18	4303.09	2.49	299.44	4345.10	1.57	315.97
4220.08	0.10	95.07	4262.09	0.49	138.00	4304.09	2.58	306.21	4346.10	1.48	310.50
4221.08	0.10	95.57	4263.09	0.51	139.87	4305.09	2.67	313.04	4347.10	1.38	304.66
4222.08	0.11	96.08	4264.09	0.53	141.80	4306.10	2.76	319.92	4348.10	1.28	298.36
4223.08	0.11	96.61	4265.09	0.55	143.80	4307.10	2.84	326.82	4349.10	1.18	291.57
4224.08	0.11	97.16	4266.09	0.57	145.87	4308.10	2.93	333.69	4350.10	1.08	284.26
4225.08	0.12	97.73	4267.09	0.59	148.00	4309.10	3.01	340.50	4351.10	0.98	276.39
4226.08	0.13	98.32	4268.09	0.61	150.21	4310.10	3.09	347.21	4352.10	0.90	267.97
4227.08	0.13	98.92	4269.09	0.64	152.49	4311.10	3.16	353.77	4353.10	0.82	258.99
4228.08	0.14	99.55	4270.09	0.66	154.85	4312.10	3.22	360.12	4354.10	0.77	249.48
4229.08	0.14	100.20	4271.09	0.69	157.30	4313.10	3.28	366.22	4355.10	0.75	239.46
4230.08	0.15	100.86	4272.09	0.72	159.82	4314.10	3.33	372.01	4356.10	0.76	228.99
4231.08	0.15	101.55	4273.09	0.74	162.43	4315.10	3.37	377.42	4357.10	0.79	218.14
4232.08	0.16	102.26	4274.09	0.77	165.14	4316.10	3.40	382.41	4358.10	0.83	206.99
4233.08	0.17	102.99	4275.09	0.80	167.93	4317.10	3.42	386.91	4359.10	0.87	195.65
4234.08	0.17	103.75	4276.09	0.84	170.83	4318.10	3.43	390.88	4360.10	0.91	184.29
4235.08	0.18	104.53	4277.09	0.87	173.83	4319.10	3.43	394.26	4361.10	0.95	173.10
4236.08	0.19	105.33	4278.09	0.91	176.93	4320.10	3.41	397.02	4362.10	0.98	162.34
4237.08	0.19	106.16	4279.09	0.94	180.14	4321.10	3.38	399.11	4363.10	1.02	152.37
4238.08	0.20	107.02	4280.09	0.98	183.47	4322.10	3.34	400.52	4364.11	1.04	143.69

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
4365.11	1.07	136.95	4407.11	1.04	225.06	4449.12	1.51	239.12	4491.13	0.74	248.74
4366.11	1.09	132.83	4408.11	1.01	221.13	4450.12	1.52	239.33	4492.13	0.77	259.11
4367.11	1.11	131.78	4409.11	0.99	216.55	4451.12	1.51	239.81	4493.13	0.83	268.93
4368.11	1.13	133.73	4410.11	0.99	211.32	4452.12	1.50	240.60	4494.13	0.91	278.19
4369.11	1.15	138.13	4411.11	0.99	205.49	4453.12	1.47	241.63	4495.13	1.00	286.86
4370.11	1.17	144.28	4412.11	1.01	199.10	4454.12	1.44	242.78	4496.13	1.10	294.94
4371.11	1.19	151.58	4413.11	1.03	192.23	4455.12	1.40	243.92	4497.13	1.20	302.45
4372.11	1.20	159.56	4414.11	1.04	184.96	4456.12	1.36	244.89	4498.13	1.30	309.42
4373.11	1.22	167.88	4415.11	1.06	177.42	4457.12	1.32	245.55	4499.13	1.41	315.89
4374.11	1.23	176.30	4416.11	1.07	169.75	4458.12	1.27	245.78	4500.13	1.51	321.90
4375.11	1.23	184.61	4417.11	1.08	162.12	4459.12	1.24	245.48	4501.13	1.60	327.52
4376.11	1.24	192.65	4418.11	1.09	154.77	4460.12	1.21	244.56	4502.13	1.69	332.82
4377.11	1.23	200.30	4419.11	1.10	147.96	4461.12	1.19	242.97	4503.13	1.77	337.89
4378.11	1.22	207.45	4420.12	1.10	142.04	4462.12	1.18	240.66	4504.13	1.85	342.80
4379.11	1.21	214.01	4421.12	1.10	137.39	4463.12	1.18	237.58	4505.13	1.92	347.63
4380.11	1.20	219.93	4422.12	1.10	134.41	4464.12	1.18	233.74	4506.13	1.99	352.45
4381.11	1.18	225.14	4423.12	1.10	133.40	4465.12	1.20	229.13	4507.13	2.05	357.31
4382.11	1.17	229.63	4424.12	1.10	134.48	4466.12	1.21	223.77	4508.13	2.12	362.22
4383.11	1.17	233.38	4425.12	1.10	137.56	4467.12	1.22	217.68	4509.13	2.18	367.21
4384.11	1.17	236.38	4426.12	1.10	142.31	4468.12	1.23	210.92	4510.13	2.25	372.24
4385.11	1.18	238.64	4427.12	1.09	148.35	4469.12	1.24	203.54	4511.13	2.32	377.26
4386.11	1.21	240.20	4428.12	1.09	155.28	4470.12	1.24	195.64	4512.13	2.39	382.21
4387.11	1.24	241.10	4429.12	1.08	162.78	4471.12	1.24	187.31	4513.13	2.47	387.01
4388.11	1.28	241.40	4430.12	1.07	170.56	4472.12	1.23	178.69	4514.13	2.56	391.59
4389.11	1.32	241.17	4431.12	1.05	178.40	4473.12	1.22	169.93	4515.13	2.65	395.84
4390.11	1.37	240.52	4432.12	1.03	186.10	4474.12	1.20	161.23	4516.13	2.74	399.71
4391.11	1.41	239.58	4433.12	1.01	193.54	4475.13	1.19	152.86	4517.13	2.84	403.09
4392.11	1.45	238.47	4434.12	1.00	200.59	4476.13	1.17	145.17	4518.13	2.93	405.94
4393.11	1.48	237.35	4435.12	0.98	207.15	4477.13	1.15	138.67	4519.13	3.02	408.18
4394.11	1.50	236.38	4436.12	0.98	213.16	4478.13	1.12	134.09	4520.13	3.11	409.77
4395.11	1.51	235.67	4437.12	0.99	218.56	4479.13	1.10	132.30	4521.13	3.19	410.67
4396.11	1.51	235.28	4438.12	1.01	223.32	4480.13	1.08	133.97	4522.13	3.26	410.85
4397.11	1.51	235.18	4439.12	1.04	227.41	4481.13	1.06	139.08	4523.13	3.32	410.30
4398.11	1.48	235.31	4440.12	1.09	230.84	4482.13	1.03	146.93	4524.13	3.37	409.01
4399.11	1.45	235.51	4441.12	1.14	233.61	4483.13	1.00	156.65	4525.13	3.41	406.99
4400.11	1.41	235.64	4442.12	1.20	235.76	4484.13	0.97	167.57	4526.13	3.44	404.27
4401.11	1.36	235.56	4443.12	1.26	237.31	4485.13	0.93	179.15	4527.13	3.45	400.87
4402.11	1.31	235.15	4444.12	1.32	238.33	4486.13	0.89	191.07	4528.13	3.45	396.82
4403.11	1.25	234.28	4445.12	1.37	238.91	4487.13	0.85	203.05	4529.13	3.44	392.19
4404.11	1.19	232.89	4446.12	1.42	239.15	4488.13	0.81	214.94	4530.13	3.42	387.01
4405.11	1.13	230.92	4447.12	1.46	239.16	4489.13	0.77	226.59	4531.13	3.39	381.36
4406.11	1.08	228.31	4448.12	1.49	239.11	4490.13	0.75	237.88	4532.13	3.35	375.27

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
4533.13	3.30	368.83	4575.14	0.73	142.75	4617.15	0.22	74.73	4659.16	0.10	48.17
4534.14	3.24	362.08	4576.14	0.71	140.04	4618.15	0.21	73.82	4660.16	0.10	47.74
4535.14	3.17	355.08	4577.14	0.68	137.41	4619.15	0.21	72.92	4661.16	0.09	47.32
4536.14	3.10	347.90	4578.14	0.66	134.86	4620.15	0.21	72.05	4662.16	0.09	46.91
4537.14	3.02	340.58	4579.14	0.64	132.39	4621.15	0.20	71.19	4663.16	0.09	46.50
4538.14	2.94	333.18	4580.14	0.62	129.98	4622.15	0.20	70.35	4664.16	0.09	46.10
4539.14	2.85	325.73	4581.14	0.60	127.66	4623.15	0.19	69.53	4665.16	0.09	45.71
4540.14	2.77	318.27	4582.14	0.58	125.39	4624.15	0.19	68.72	4666.16	0.09	45.32
4541.14	2.68	310.85	4583.14	0.56	123.20	4625.15	0.18	67.93	4667.16	0.09	44.94
4542.14	2.59	303.49	4584.14	0.54	121.06	4626.15	0.18	67.15	4668.16	0.08	44.56
4543.14	2.50	296.21	4585.14	0.52	118.99	4627.15	0.18	66.39	4669.16	0.08	44.19
4544.14	2.41	289.04	4586.14	0.51	116.98	4628.15	0.17	65.65	4670.16	0.08	43.82
4545.14	2.33	281.99	4587.14	0.49	115.02	4629.15	0.17	64.92	4671.16	0.08	43.46
4546.14	2.24	275.09	4588.14	0.48	113.12	4630.15	0.17	64.20	4672.16	0.08	43.10
4547.14	2.16	268.33	4589.15	0.46	111.27	4631.15	0.16	63.50	4673.16	0.08	42.75
4548.14	2.08	261.74	4590.15	0.45	109.47	4632.15	0.16	62.81	4674.16	0.08	42.41
4549.14	2.00	255.31	4591.15	0.44	107.72	4633.15	0.16	62.13	4675.16	0.08	42.07
4550.14	1.92	249.06	4592.15	0.42	106.01	4634.15	0.15	61.47	4676.16	0.08	41.73
4551.14	1.85	242.98	4593.15	0.41	104.35	4635.15	0.15	60.82	4677.16	0.07	41.40
4552.14	1.77	237.07	4594.15	0.40	102.73	4636.15	0.15	60.18	4678.16	0.07	41.07
4553.14	1.70	231.34	4595.15	0.39	101.16	4637.15	0.14	59.55	4679.16	0.07	40.75
4554.14	1.64	225.79	4596.15	0.38	99.63	4638.15	0.14	58.93	4680.16	0.07	40.43
4555.14	1.57	220.41	4597.15	0.37	98.13	4639.15	0.14	58.33	4681.16	0.07	40.12
4556.14	1.51	215.19	4598.15	0.36	96.68	4640.15	0.14	57.73	4682.16	0.07	39.81
4557.14	1.45	210.14	4599.15	0.35	95.26	4641.15	0.13	57.15	4683.16	0.07	39.50
4558.14	1.40	205.26	4600.15	0.34	93.87	4642.15	0.13	56.57	4684.16	0.07	39.20
4559.14	1.34	200.53	4601.15	0.33	92.52	4643.15	0.13	56.01	4685.16	0.07	38.91
4560.14	1.29	195.96	4602.15	0.32	91.20	4644.15	0.13	55.46	4686.16	0.07	38.61
4561.14	1.24	191.54	4603.15	0.31	89.91	4645.15	0.12	54.91	4687.16	0.06	38.32
4562.14	1.19	187.26	4604.15	0.30	88.66	4646.15	0.12	54.38	4688.16	0.06	38.04
4563.14	1.15	183.12	4605.15	0.29	87.43	4647.15	0.12	53.85	4689.16	0.06	37.76
4564.14	1.10	179.11	4606.15	0.29	86.24	4648.16	0.12	53.33	4690.16	0.06	37.48
4565.14	1.06	175.24	4607.15	0.28	85.07	4649.16	0.12	52.82	4691.16	0.06	37.20
4566.14	1.02	171.50	4608.15	0.27	83.93	4650.16	0.11	52.32	4692.16	0.06	36.93
4567.14	0.98	167.87	4609.15	0.27	82.81	4651.16	0.11	51.83	4693.16	0.06	36.67
4568.14	0.95	164.37	4610.15	0.26	81.72	4652.16	0.11	51.35	4694.16	0.06	36.40
4569.14	0.91	160.97	4611.15	0.25	80.65	4653.16	0.11	50.87	4695.16	0.06	36.14
4570.14	0.88	157.69	4612.15	0.25	79.61	4654.16	0.11	50.40	4696.16	0.06	35.88
4571.14	0.85	154.51	4613.15	0.24	78.59	4655.16	0.10	49.94	4697.16	0.06	35.63
4572.14	0.82	151.43	4614.15	0.24	77.60	4656.16	0.10	49.49	4698.16	0.06	35.38
4573.14	0.79	148.45	4615.15	0.23	76.62	4657.16	0.10	49.04	4699.16	0.06	35.13
4574.14	0.76	145.56	4616.15	0.22	75.67	4658.16	0.10	48.60	4700.16	0.05	34.88

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
4701.16	0.05	34.64	4743.17	0.03	26.62	4785.18	0.02	21.37	4827.19	0.02	17.70
4702.16	0.05	34.40	4744.17	0.03	26.47	4786.18	0.02	21.27	4828.19	0.02	17.63
4703.17	0.05	34.17	4745.17	0.03	26.32	4787.18	0.02	21.17	4829.19	0.02	17.55
4704.17	0.05	33.93	4746.17	0.03	26.17	4788.18	0.02	21.06	4830.19	0.02	17.48
4705.17	0.05	33.70	4747.17	0.03	26.02	4789.18	0.02	20.96	4831.19	0.02	17.41
4706.17	0.05	33.47	4748.17	0.03	25.88	4790.18	0.02	20.87	4832.19	0.02	17.34
4707.17	0.05	33.25	4749.17	0.03	25.74	4791.18	0.02	20.77	4833.19	0.02	17.26
4708.17	0.05	33.03	4750.17	0.03	25.59	4792.18	0.02	20.67	4834.19	0.02	17.19
4709.17	0.05	32.81	4751.17	0.03	25.45	4793.18	0.02	20.57	4835.19	0.02	17.12
4710.17	0.05	32.59	4752.17	0.03	25.31	4794.18	0.02	20.48	4836.19	0.02	17.05
4711.17	0.05	32.38	4753.17	0.03	25.18	4795.18	0.02	20.38	4837.19	0.02	16.98
4712.17	0.05	32.16	4754.17	0.03	25.04	4796.18	0.02	20.29	4838.19	0.02	16.92
4713.17	0.05	31.95	4755.17	0.03	24.90	4797.18	0.02	20.19	4839.19	0.02	16.85
4714.17	0.05	31.75	4756.17	0.03	24.77	4798.18	0.02	20.10	4840.19	0.02	16.78
4715.17	0.05	31.54	4757.17	0.03	24.64	4799.18	0.02	20.01	4841.19	0.02	16.71
4716.17	0.05	31.34	4758.17	0.03	24.51	4800.18	0.02	19.92	4842.19	0.02	16.65
4717.17	0.04	31.14	4759.17	0.03	24.38	4801.18	0.02	19.83	4843.19	0.02	16.58
4718.17	0.04	30.94	4760.17	0.03	24.25	4802.18	0.02	19.74	4844.19	0.02	16.51
4719.17	0.04	30.74	4761.17	0.03	24.12	4803.18	0.02	19.65	4845.19	0.02	16.45
4720.17	0.04	30.55	4762.18	0.03	23.99	4804.18	0.02	19.56	4846.19	0.02	16.38
4721.17	0.04	30.36	4763.18	0.03	23.87	4805.18	0.02	19.47	4847.19	0.02	16.32
4722.17	0.04	30.17	4764.18	0.03	23.74	4806.18	0.02	19.38	4848.19	0.02	16.25
4723.17	0.04	29.98	4765.18	0.03	23.62	4807.18	0.02	19.30	4849.19	0.02	16.19
4724.17	0.04	29.79	4766.18	0.03	23.50	4808.18	0.02	19.21	4850.19	0.01	16.13
4725.17	0.04	29.61	4767.18	0.03	23.38	4809.18	0.02	19.13	4851.19	0.01	16.06
4726.17	0.04	29.43	4768.18	0.03	23.26	4810.18	0.02	19.04	4852.19	0.01	16.00
4727.17	0.04	29.25	4769.18	0.03	23.14	4811.18	0.02	18.96	4853.19	0.01	15.94
4728.17	0.04	29.07	4770.18	0.03	23.02	4812.18	0.02	18.87	4854.19	0.01	15.88
4729.17	0.04	28.90	4771.18	0.03	22.90	4813.18	0.02	18.79	4855.19	0.01	15.82
4730.17	0.04	28.72	4772.18	0.03	22.79	4814.18	0.02	18.71	4856.19	0.01	15.76
4731.17	0.04	28.55	4773.18	0.03	22.67	4815.18	0.02	18.63	4857.19	0.01	15.70
4732.17	0.04	28.38	4774.18	0.03	22.56	4816.18	0.02	18.55	4858.19	0.01	15.64
4733.17	0.04	28.21	4775.18	0.03	22.45	4817.19	0.02	18.47	4859.19	0.01	15.58
4734.17	0.04	28.04	4776.18	0.03	22.33	4818.19	0.02	18.39	4860.19	0.01	15.52
4735.17	0.04	27.88	4777.18	0.03	22.22	4819.19	0.02	18.31	4861.19	0.01	15.46
4736.17	0.04	27.72	4778.18	0.02	22.11	4820.19	0.02	18.23	4862.19	0.01	15.40
4737.17	0.04	27.55	4779.18	0.02	22.00	4821.19	0.02	18.15	4863.19	0.01	15.34
4738.17	0.04	27.39	4780.18	0.02	21.90	4822.19	0.02	18.08	4864.19	0.01	15.28
4739.17	0.04	27.24	4781.18	0.02	21.79	4823.19	0.02	18.00	4865.19	0.01	15.23
4740.17	0.04	27.08	4782.18	0.02	21.68	4824.19	0.02	17.92	4866.19	0.01	15.17
4741.17	0.03	26.92	4783.18	0.02	21.58	4825.19	0.02	17.85	4867.19	0.01	15.11
4742.17	0.03	26.77	4784.18	0.02	21.47	4826.19	0.02	17.77	4868.19	0.01	15.06

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
4869.19	0.01	15.00	4911.20	0.01	12.94	4953.21	0.01	11.33	4995.22	0.01	10.03
4870.19	0.01	14.95	4912.20	0.01	12.90	4954.21	0.01	11.29	4996.22	0.01	10.00
4871.19	0.01	14.89	4913.20	0.01	12.86	4955.21	0.01	11.26	4997.22	0.01	9.97
4872.19	0.01	14.84	4914.20	0.01	12.82	4956.21	0.01	11.23	4998.22	0.01	9.94
4873.19	0.01	14.78	4915.20	0.01	12.77	4957.21	0.01	11.19	4999.22	0.01	9.92
4874.19	0.01	14.73	4916.20	0.01	12.73	4958.21	0.01	11.16	5000.22	0.01	9.89
4875.20	0.01	14.67	4917.20	0.01	12.69	4959.21	0.01	11.12	5001.22	0.01	9.86
4876.20	0.01	14.62	4918.20	0.01	12.65	4960.21	0.01	11.09	5002.22	0.01	9.84
4877.20	0.01	14.57	4919.20	0.01	12.61	4961.21	0.01	11.06	5003.22	0.01	9.81
4878.20	0.01	14.52	4920.20	0.01	12.57	4962.21	0.01	11.03	5004.22	0.01	9.78
4879.20	0.01	14.46	4921.20	0.01	12.52	4963.21	0.01	10.99	5005.22	0.01	9.75
4880.20	0.01	14.41	4922.20	0.01	12.48	4964.21	0.01	10.96	5006.22	0.01	9.73
4881.20	0.01	14.36	4923.20	0.01	12.44	4965.21	0.01	10.93	5007.22	0.01	9.70
4882.20	0.01	14.31	4924.20	0.01	12.40	4966.21	0.01	10.90	5008.22	0.01	9.68
4883.20	0.01	14.26	4925.20	0.01	12.36	4967.21	0.01	10.86	5009.22	0.01	9.65
4884.20	0.01	14.21	4926.20	0.01	12.32	4968.21	0.01	10.83	5010.22	0.01	9.62
4885.20	0.01	14.16	4927.20	0.01	12.28	4969.21	0.01	10.80	5011.22	0.01	9.60
4886.20	0.01	14.11	4928.20	0.01	12.24	4970.21	0.01	10.77	5012.22	0.01	9.57
4887.20	0.01	14.06	4929.20	0.01	12.21	4971.21	0.01	10.74	5013.22	0.01	9.55
4888.20	0.01	14.01	4930.20	0.01	12.17	4972.21	0.01	10.71	5014.22	0.01	9.52
4889.20	0.01	13.96	4931.21	0.01	12.13	4973.21	0.01	10.67	5015.22	0.01	9.49
4890.20	0.01	13.91	4932.21	0.01	12.09	4974.21	0.01	10.64	5016.22	0.01	9.47
4891.20	0.01	13.86	4933.21	0.01	12.05	4975.21	0.01	10.61	5017.22	0.01	9.44
4892.20	0.01	13.81	4934.21	0.01	12.01	4976.21	0.01	10.58	5018.22	0.01	9.42
4893.20	0.01	13.76	4935.21	0.01	11.98	4977.21	0.01	10.55	5019.22	0.01	9.39
4894.20	0.01	13.71	4936.21	0.01	11.94	4978.21	0.01	10.52	5020.22	0.01	9.37
4895.20	0.01	13.67	4937.21	0.01	11.90	4979.21	0.01	10.49	5021.22	0.01	9.34
4896.20	0.01	13.62	4938.21	0.01	11.86	4980.21	0.01	10.46	5022.22	0.01	9.32
4897.20	0.01	13.57	4939.21	0.01	11.83	4981.21	0.01	10.43	5023.22	0.01	9.29
4898.20	0.01	13.53	4940.21	0.01	11.79	4982.21	0.01	10.40	5024.22	0.01	9.27
4899.20	0.01	13.48	4941.21	0.01	11.75	4983.21	0.01	10.37	5025.22	0.01	9.25
4900.20	0.01	13.43	4942.21	0.01	11.72	4984.21	0.01	10.34	5026.22	0.01	9.22
4901.20	0.01	13.39	4943.21	0.01	11.68	4985.21	0.01	10.31	5027.22	0.01	9.20
4902.20	0.01	13.34	4944.21	0.01	11.64	4986.21	0.01	10.28	5028.22	0.01	9.17
4903.20	0.01	13.30	4945.21	0.01	11.61	4987.21	0.01	10.26	5029.22	0.01	9.15
4904.20	0.01	13.25	4946.21	0.01	11.57	4988.21	0.01	10.23	5030.22	0.01	9.13
4905.20	0.01	13.21	4947.21	0.01	11.54	4989.22	0.01	10.20	5031.22	0.01	9.10
4906.20	0.01	13.16	4948.21	0.01	11.50	4990.22	0.01	10.17	5032.22	0.01	9.08
4907.20	0.01	13.12	4949.21	0.01	11.47	4991.22	0.01	10.14	5033.22	0.01	9.05
4908.20	0.01	13.07	4950.21	0.01	11.43	4992.22	0.01	10.11	5034.22	0.01	9.03
4909.20	0.01	13.03	4951.21	0.01	11.40	4993.22	0.01	10.08	5035.22	0.01	9.01
4910.20	0.01	12.99	4952.21	0.01	11.36	4994.22	0.01	10.06	5036.22	0.01	8.98

Electric and Magnetic Field Effects

Citrus County Combined Cycle Site

Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft

CrossSection: 4- New Configuration Entering Station - Near Plant Access Road

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
5037.22	0.01	8.96	5079.23	0.01	8.07	5121.24	0.00	7.32	5163.25	0.00	6.68
5038.22	0.01	8.94	5080.23	0.01	8.05	5122.24	0.00	7.31	5164.25	0.00	6.67
5039.22	0.01	8.92	5081.23	0.01	8.03	5123.24	0.00	7.29	5165.25	0.00	6.65
5040.22	0.01	8.89	5082.23	0.01	8.01	5124.24	0.00	7.27	5166.25	0.00	6.64
5041.22	0.01	8.87	5083.23	0.01	8.00	5125.24	0.00	7.26	5167.25	0.00	6.62
5042.22	0.01	8.85	5084.23	0.01	7.98	5126.24	0.00	7.24	5168.25	0.00	6.61
5043.22	0.01	8.82	5085.23	0.01	7.96	5127.24	0.00	7.22	5169.25	0.00	6.60
5044.22	0.01	8.80	5086.23	0.01	7.94	5128.24	0.00	7.21	5170.25	0.00	6.58
5045.23	0.01	8.78	5087.23	0.01	7.92	5129.24	0.00	7.19	5171.25	0.00	6.57
5046.23	0.01	8.76	5088.23	0.01	7.90	5130.24	0.00	7.18	5172.25	0.00	6.55
5047.23	0.01	8.74	5089.23	0.01	7.88	5131.24	0.00	7.16	5173.25	0.00	6.54
5048.23	0.01	8.71	5090.23	0.01	7.86	5132.24	0.00	7.14	5174.25	0.00	6.53
5049.23	0.01	8.69	5091.23	0.01	7.85	5133.24	0.00	7.13	5175.25	0.00	6.51
5050.23	0.01	8.67	5092.23	0.01	7.83	5134.24	0.00	7.11	5176.25	0.00	6.50
5051.23	0.01	8.65	5093.23	0.01	7.81	5135.24	0.00	7.10	5177.25	0.00	6.49
5052.23	0.01	8.63	5094.23	0.01	7.79	5136.24	0.00	7.08	5178.25	0.00	6.47
5053.23	0.01	8.60	5095.23	0.01	7.77	5137.24	0.00	7.07	5179.25	0.00	6.46
5054.23	0.01	8.58	5096.23	0.01	7.75	5138.24	0.00	7.05	5180.25	0.00	6.45
5055.23	0.01	8.56	5097.23	0.01	7.74	5139.24	0.00	7.03	5181.25	0.00	6.43
5056.23	0.01	8.54	5098.23	0.01	7.72	5140.24	0.00	7.02	5182.25	0.00	6.42
5057.23	0.01	8.52	5099.23	0.01	7.70	5141.24	0.00	7.00	5183.25	0.00	6.41
5058.23	0.01	8.50	5100.23	0.01	7.68	5142.24	0.00	6.99	5184.25	0.00	6.39
5059.23	0.01	8.48	5101.23	0.01	7.66	5143.24	0.00	6.97	5185.25	0.00	6.38
5060.23	0.01	8.46	5102.23	0.00	7.65	5144.24	0.00	6.96	5186.25	0.00	6.37
5061.23	0.01	8.43	5103.24	0.00	7.63	5145.24	0.00	6.94	5187.25	0.00	6.35
5062.23	0.01	8.41	5104.24	0.00	7.61	5146.24	0.00	6.93	5188.25	0.00	6.34
5063.23	0.01	8.39	5105.24	0.00	7.59	5147.24	0.00	6.91	5189.25	0.00	6.33
5064.23	0.01	8.37	5106.24	0.00	7.58	5148.24	0.00	6.90	5190.25	0.00	6.32
5065.23	0.01	8.35	5107.24	0.00	7.56	5149.24	0.00	6.88	5191.25	0.00	6.30
5066.23	0.01	8.33	5108.24	0.00	7.54	5150.24	0.00	6.87	5192.25	0.00	6.29
5067.23	0.01	8.31	5109.24	0.00	7.52	5151.24	0.00	6.85	5193.25	0.00	6.28
5068.23	0.01	8.29	5110.24	0.00	7.51	5152.24	0.00	6.84	5194.25	0.00	6.26
5069.23	0.01	8.27	5111.24	0.00	7.49	5153.24	0.00	6.82	5195.25	0.00	6.25
5070.23	0.01	8.25	5112.24	0.00	7.47	5154.24	0.00	6.81	5196.25	0.00	6.24
5071.23	0.01	8.23	5113.24	0.00	7.46	5155.24	0.00	6.80	5197.25	0.00	6.23
5072.23	0.01	8.21	5114.24	0.00	7.44	5156.24	0.00	6.78	5198.25	0.00	6.21
5073.23	0.01	8.19	5115.24	0.00	7.42	5157.24	0.00	6.77	5199.25	0.00	6.20
5074.23	0.01	8.17	5116.24	0.00	7.41	5158.24	0.00	6.75	5200.25	0.00	6.19
5075.23	0.01	8.15	5117.24	0.00	7.39	5159.25	0.00	6.74	5201.25	0.00	6.18
5076.23	0.01	8.13	5118.24	0.00	7.37	5160.25	0.00	6.72	5202.25	0.00	6.16
5077.23	0.01	8.11	5119.24	0.00	7.35	5161.25	0.00	6.71	5203.25	0.00	6.15
5078.23	0.01	8.09	5120.24	0.00	7.34	5162.25	0.00	6.69	5204.25	0.00	6.14

Electric and Magnetic Field Effects


Citrus County Combined Cycle Site


Units: **English** Physical System: **47** Conductors (**33** Energized Phases)
 E-Field Transducer Height **3.28** ft B-Field Transducer Height **3.28** ft


CrossSection: **4- New Configuration Entering Station - Near Plant Access Road**

Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)	Dist From RowLeft (ft)	Electric Field (kV/m)	Magnetic Field (mG)
5205.25	0.00	6.13	5247.26	0.00	5.64
5206.25	0.00	6.11	5248.26	0.00	5.63
5207.25	0.00	6.10	5249.26	0.00	5.62
5208.25	0.00	6.09	5250.26	0.00	5.61
5209.25	0.00	6.08	5251.26	0.00	5.60
5210.25	0.00	6.07	5252.26	0.00	5.59
5211.25	0.00	6.05	5253.26	0.00	5.58
5212.25	0.00	6.04	5254.26	0.00	5.57
5213.25	0.00	6.03	5255.26	0.00	5.56
5214.25	0.00	6.02	5256.26	0.00	5.55
5215.25	0.00	6.01	5257.26	0.00	5.54
5216.25	0.00	5.99	5258.26	0.00	5.53
5217.26	0.00	5.98	5259.26	0.00	5.52
5218.26	0.00	5.97	5260.26	0.00	5.51
5219.26	0.00	5.96	5261.26	0.00	5.50
5220.26	0.00	5.95	5262.26	0.00	5.49
5221.26	0.00	5.93	5263.26	0.00	5.48
5222.26	0.00	5.92	5264.26	0.00	5.47
5223.26	0.00	5.91	5265.26	0.00	5.46
5224.26	0.00	5.90	5266.26	0.00	5.45
5225.26	0.00	5.89	5267.26	0.00	5.44
5226.26	0.00	5.88	5268.26	0.00	5.43
5227.26	0.00	5.87	5269.26	0.00	5.41
5228.26	0.00	5.85	5270.26	0.00	5.40
5229.26	0.00	5.84	5271.26	0.00	5.39
5230.26	0.00	5.83	5272.26	0.00	5.38
5231.26	0.00	5.82	5273.27	0.00	5.38
5232.26	0.00	5.81	5274.27	0.00	5.37
5233.26	0.00	5.80	5275.27	0.00	5.36
5234.26	0.00	5.79	5276.27	0.00	5.35
5235.26	0.00	5.77	5277.27	0.00	5.34
5236.26	0.00	5.76	5278.27	0.00	5.33
5237.26	0.00	5.75	5279.27	0.00	5.32
5238.26	0.00	5.74	5280.27	0.00	5.31
5239.26	0.00	5.73	5281.27	0.00	5.30
5240.26	0.00	5.72			
5241.26	0.00	5.71			
5242.26	0.00	5.70			
5243.26	0.00	5.69			
5244.26	0.00	5.68			
5245.26	0.00	5.67			
5246.26	0.00	5.65			

EXHIBIT B – Cross Section Drawings

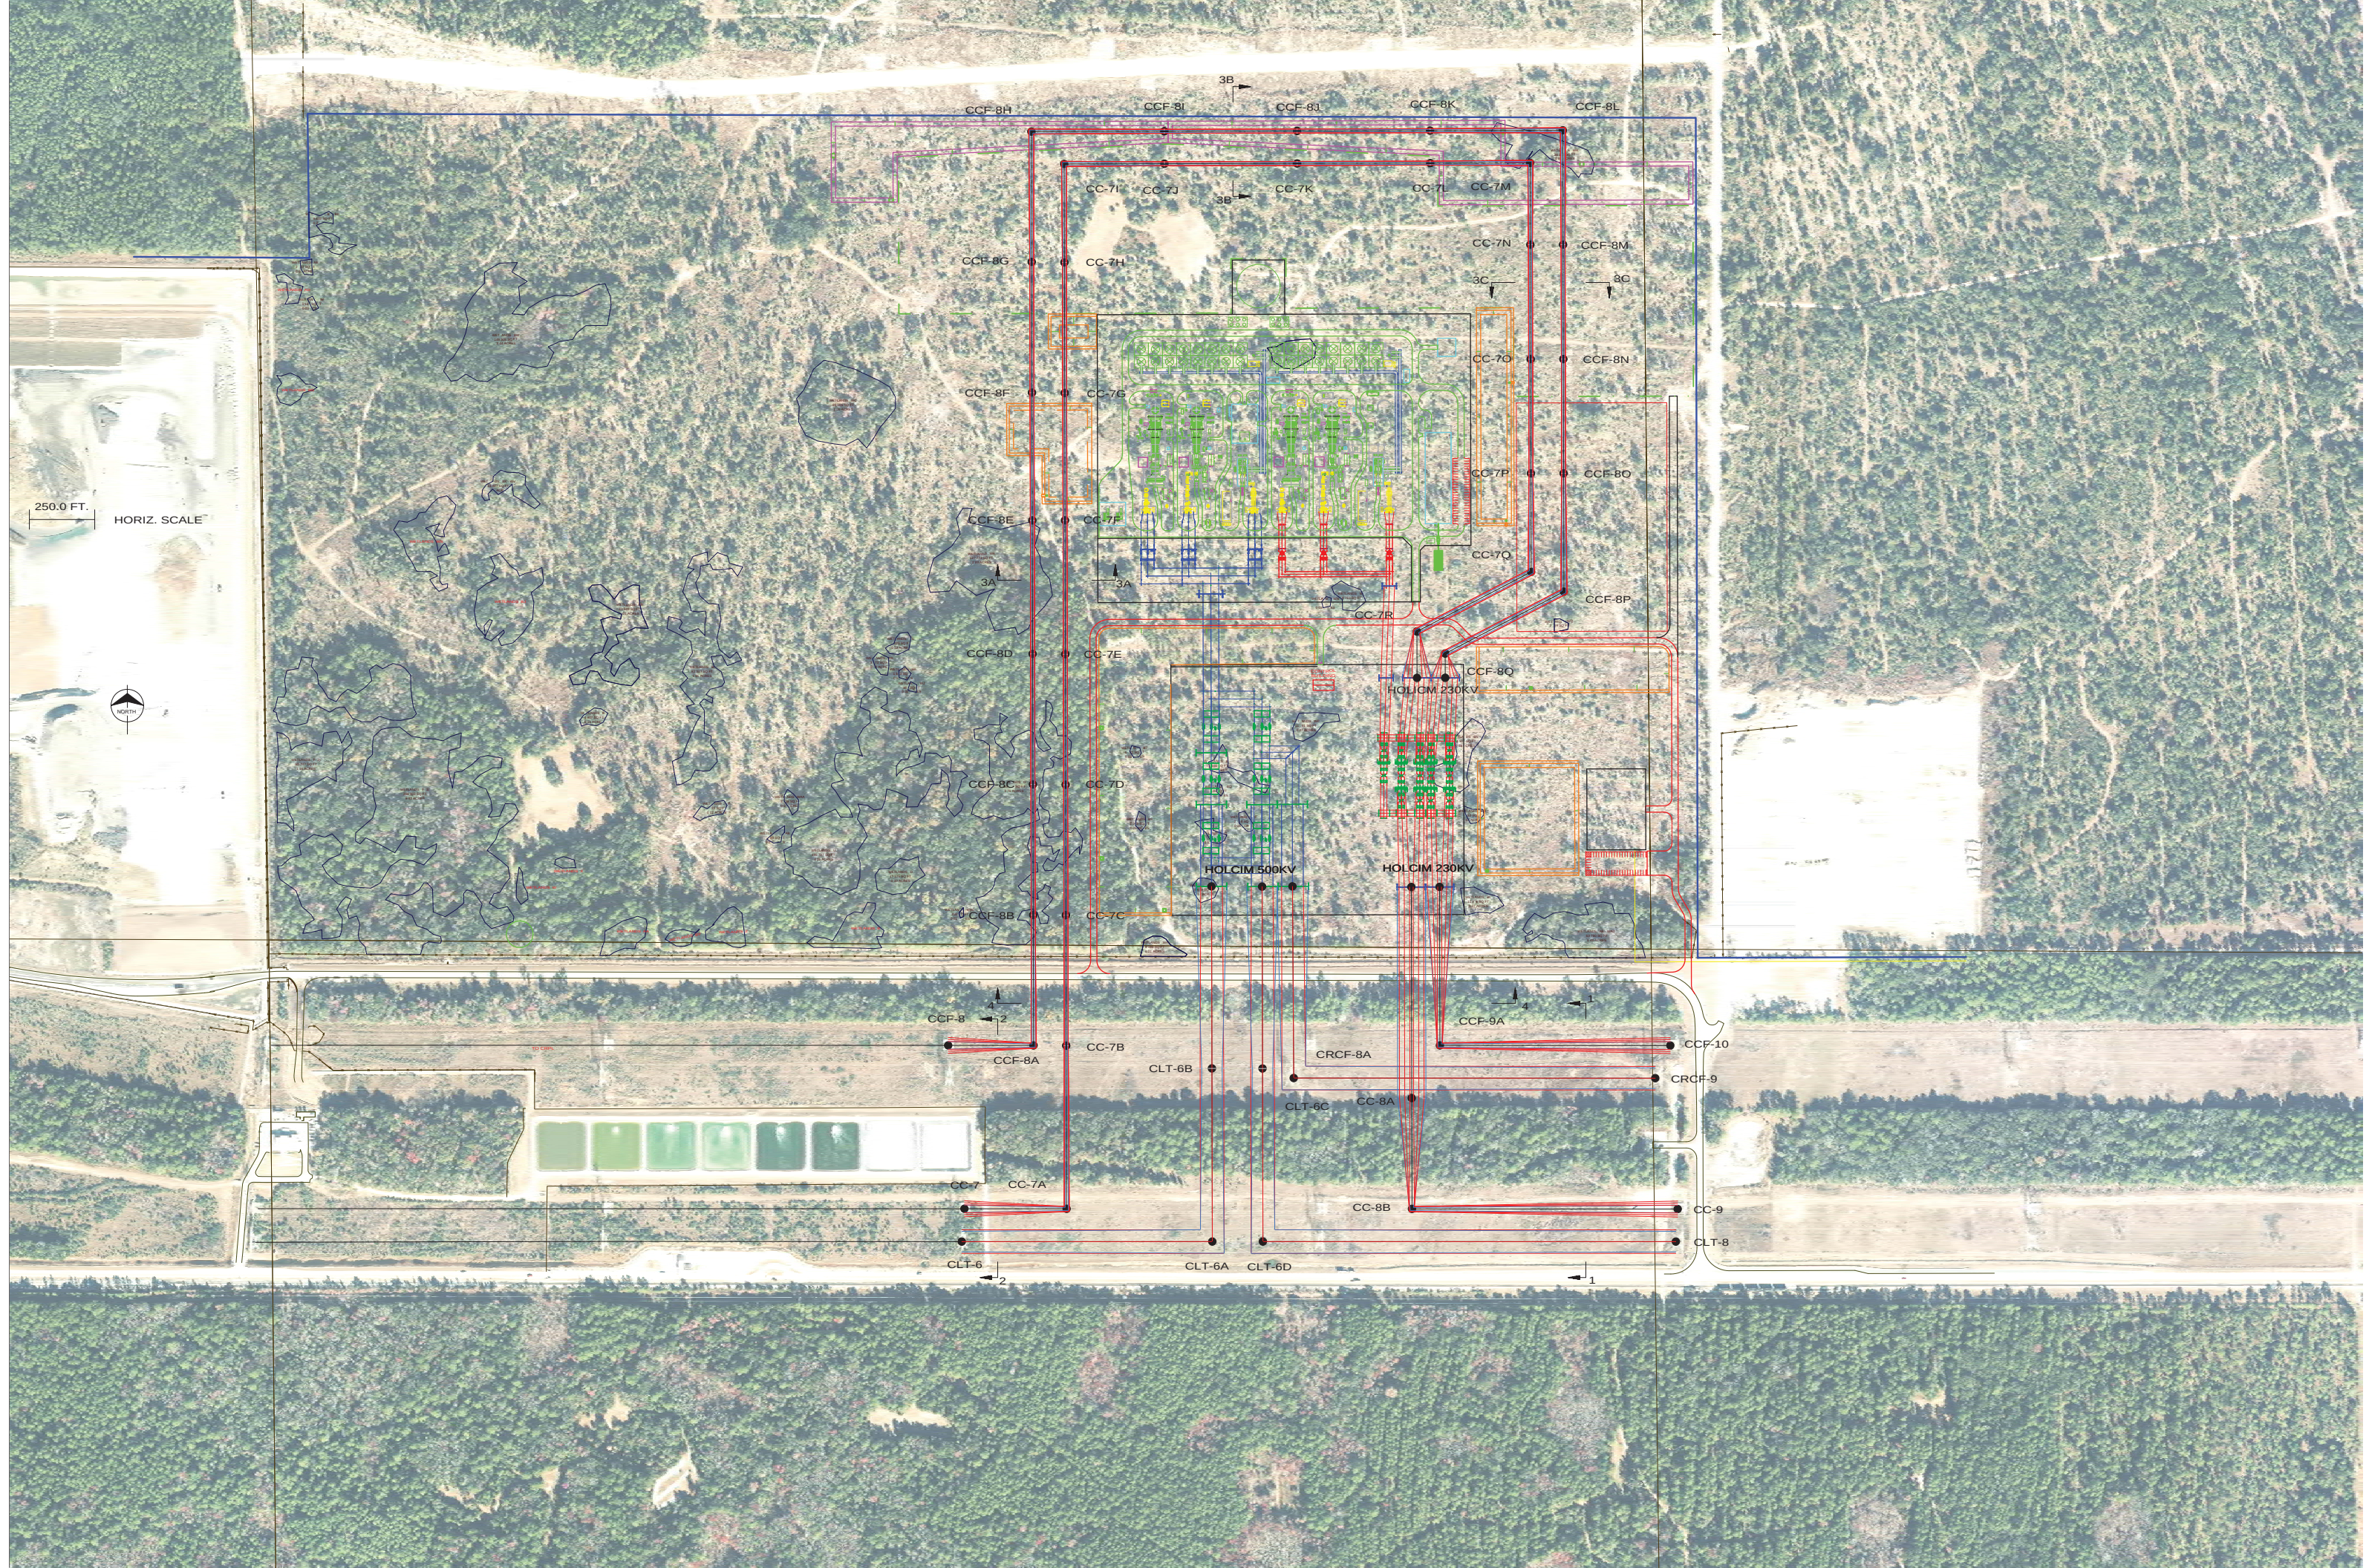



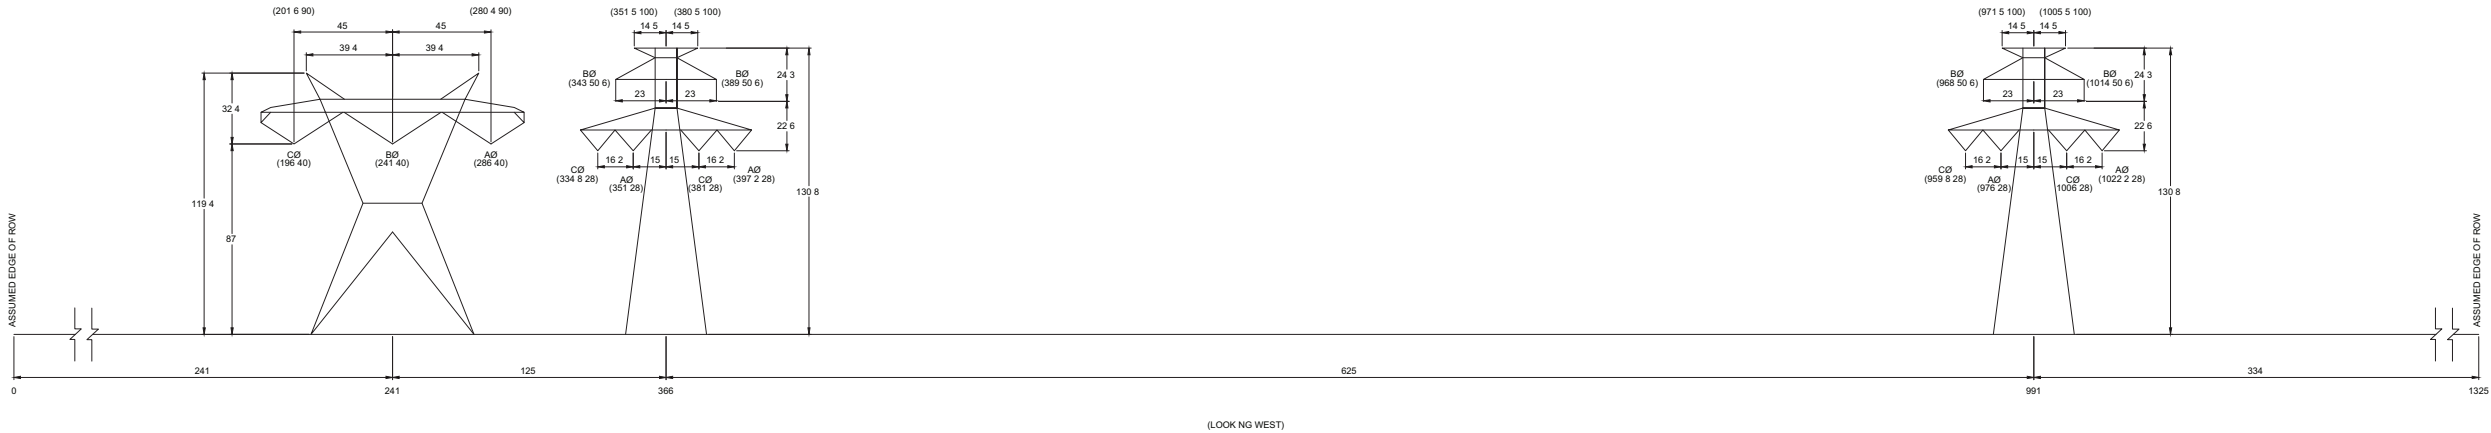

PRELIMINARY - NOT
FOR CONSTRUCTION



date	7/7/14	detailed	RMS BMcD
designed	JPP BMcD	checked	DAB BMcD



EMF CALCULATIONS CROSS SECTION 2 CITRUS COUNTY COMBINED CYCLE SITE	
project	contract
71404	
drawing	rev
SKETCH 2	
sheet 2	of 4 sheets
SCALE N T S	

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17

no | date | by | ckd | description

A

B

C

D

E

F

G

H


I

J


K

L


M

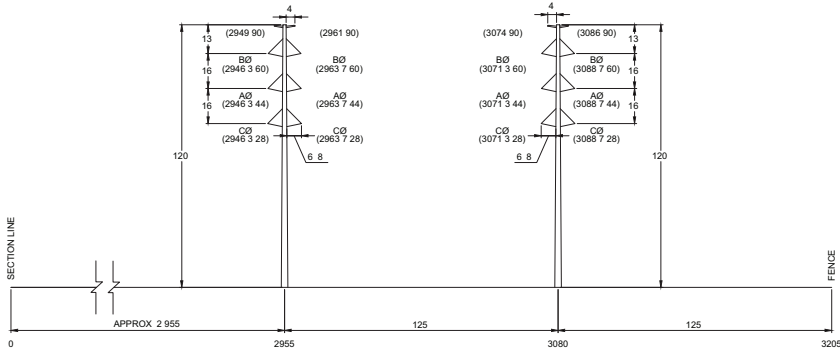

3A
(LOOKING NORTH)

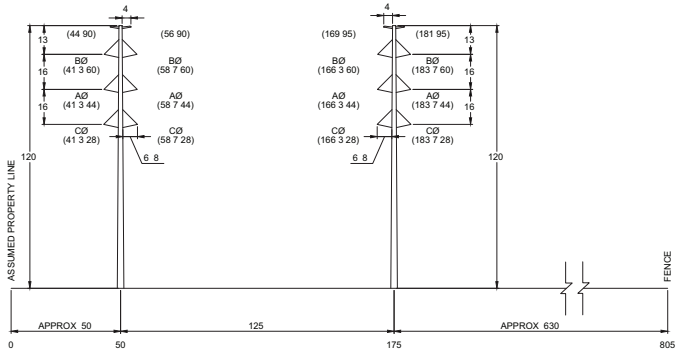

3B
(LOOKING EAST)

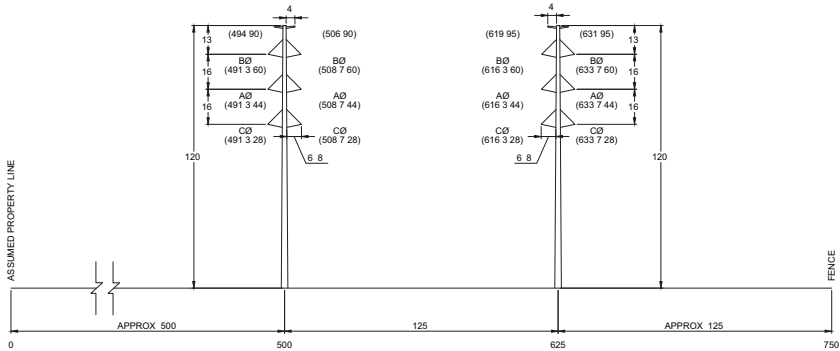

3C
(LOOKING SOUTH)

PRELIMINARY - NOT
FOR CONSTRUCTION



date 7/7/14	detailed RMS BMcD
designed JPP BMcD	checked DAB BMcD




EMF CALCULATIONS
CROSS SECTION 3A, B & C
CITRUS COUNTY COMBINED CYCLE SITE

project 71404	contract
------------------	----------

drawing	rev
SKETCH 3	-0

sheet 3	of 4	sheets
---------	------	--------

SCALE: N T S





Burns & McDonnell World Headquarters
9400 Ward Parkway
Kansas City, MO 64114
Phone: 816-333-9400
Fax: 816-333-3690
www.burnsmcd.com

Burns & McDonnell: Making our clients successful for more than 100 years