

- Notes:
1. Grid values represent % of maximum (POD) excess constituent concentration and are averages for cross-sections and grid points. For example, the value of 1.2% at Grid 6, 16 is the average for the shaded area. The values shown are the maximum experienced at each grid point. See Section C.1.1. See maximum absolute flow (MAF) flow.
 2. Grid values determined with the 1D and 2D models described in Section C.4.
 3. Discharge parameters:
 $Q = 100 \text{ CFS}$
 $C = \text{unit concentration} = 1.1$
 $AT = 120 \text{ F}$
 4. Grid based on arbitrary datum.

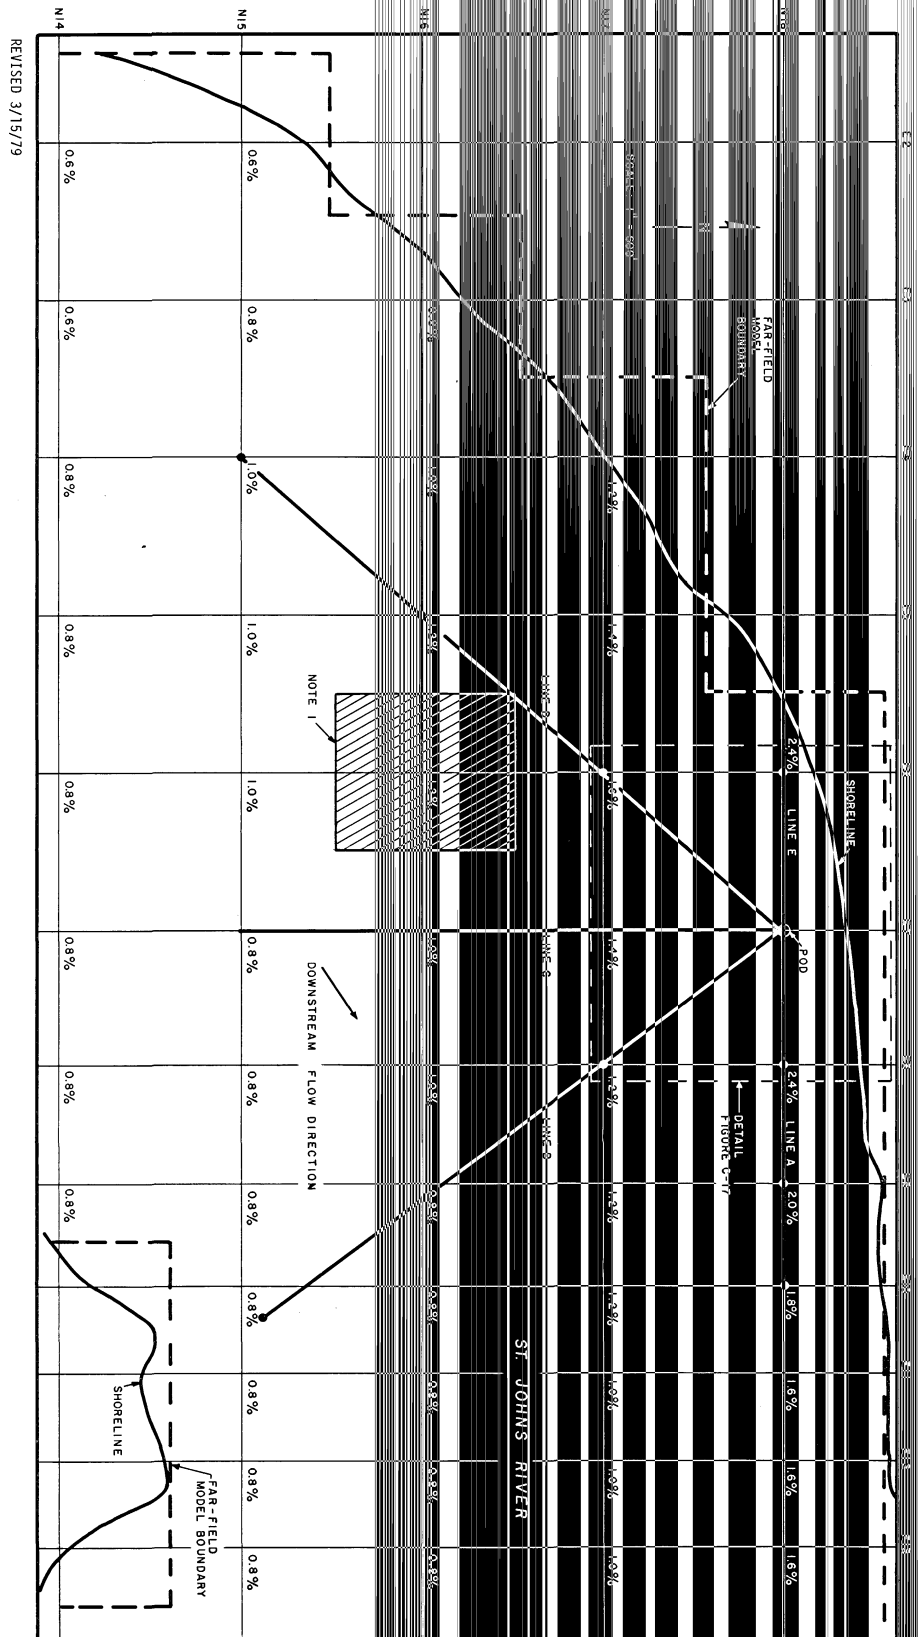


Figure C-16. Far Field AQUAL2 Assessment Phase III.