

ATTACHMENTS

ATTACHMENT A: Maps

Attached pursuant to Section A. Condition I.

✕

1125

1125 Geddle Rd

Tallahassee, FL 32304

30.457°N, 84.407°W

Arvoh E. Hopkins
Generating Station

1125 Geddle Rd

Tallahassee Power Plant

Unit 1

Unit 2

Unit 3


Google

3D

+


-

Google Camera: 1.169 m 30°27'03"N 84°23'56"W 41 m 100%

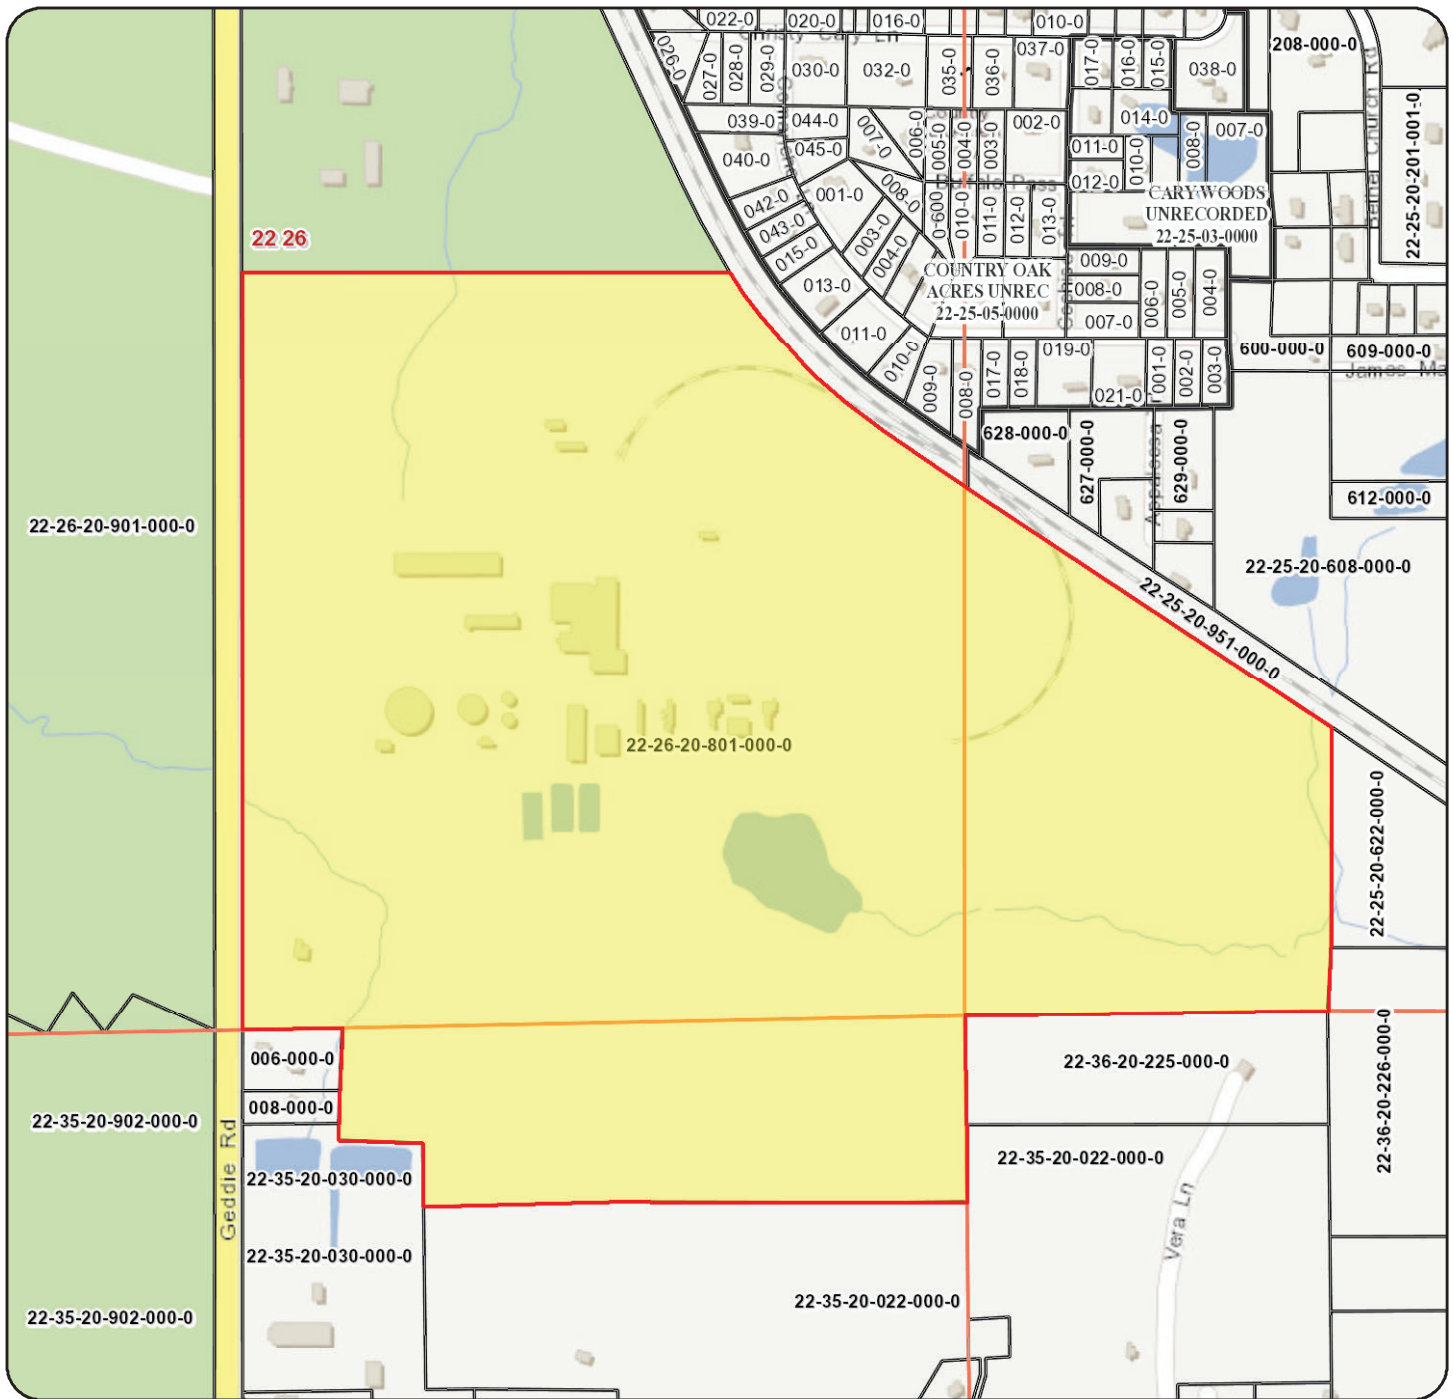

Leon County Property Appraiser

Legend			
	Township		Lot
	Section		Access Easement
	Subdivision		River
	Tax Parcel		Waterbody
			Building
			Park
			City Limit
			Imagery 1/2015

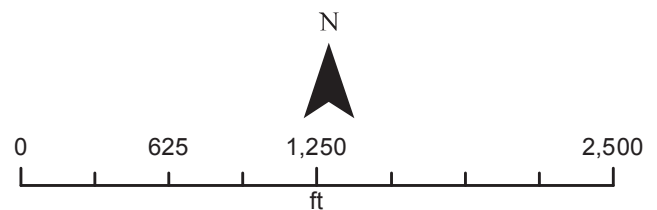

Akin Akinyemi, R.A.
Leon County Property Appraiser

315 S. Calhoun St, Third Floor
Tallahassee, FL 32301

Phone: (850) 606-6200
Fax: (850) 606-6201

Email: admin@leonpa.org
Website: leonpa.org

DISCLAIMER: This product has been compiled from the most accurate source data from Leon County, the City of Tallahassee, and the Leon County Property Appraiser's Office. However, this product is for reference purposes only and is not to be construed as a legal document or survey instrument. Any reliance on the information contained herein is at the user's own risk. Leon County, the City of Tallahassee, and the Leon County Property Appraiser's Office assume no responsibility for any use of the information contained herein or any loss resulting therefrom.

Date Drawn: May 03, 2018

ATTACHMENTS

ATTACHMENT B: Surface Water Management System Operation and Maintenance Plan

1. In accordance with §373.416(2), F.S., unless revoked or abandoned, all stormwater management systems, dams, impoundments, reservoirs, appurtenant works, or works authorized under Part IV of Chapter 373, F.S., must be operated and maintained in perpetuity. The operation and maintenance shall be in accordance with the designs, plans, calculations, and other specifications that are submitted with any site certification application, amendment or modification and approved by the Department.

2. The Licensee shall be responsible for keeping records documenting that relevant Conditions contained in the SCA and other materials presented during the certification proceeding, modifications, amendments, post-certification submittals, and as otherwise approved are met. This documentation shall include, at a minimum, the date of each inspection, the name and qualifications of the inspector, any maintenance actions taken, and a determination by the inspector as to whether the system is operating as intended. Inspection documentation must be readily available and shall be provided at the Department's request. Submittal of the inspection documentation to the Department is not required.

3. Prior to installation of the filter media, the Licensee shall submit test results, from a certified independent laboratory, of the media material that will be used in construction of the stormwater treatment system, to the Department for review and in accordance with Condition XXI., Procedures for Post-Certification Submittals. The test shall address the following filter media parameters: uniformity coefficient; effective grain size; sieve analysis; percent silts, clays, and organic matter; and permeability test (constant head). If the test results indicate that the actual permeability rate is less than the value used in the authorized design or if any of the parameters do not meet the design standards listed in Appendix B-2 of the Applicant's Handbook Volume II, then the Licensee shall submit additional media material test results for Department review in accordance with Condition XXI., Procedures for Post-Certification Submittals.

4. The engineer of record shall certify that the filter media used in construction of the treatment system is of same source as material used for the certified laboratory test.

5. Erosion controls around the perimeter of filters shall remain in place until the drainage basin has been stabilized. Grass seed and mulch or sod shall be installed and maintained on all exposed slopes and disturbed soil areas within 48 hours of completing final grade, and at any other time as necessary, to prevent erosion and sedimentation.

6. The Licensee shall be responsible for ensuring that erosion control devices/procedures are inspected and maintained daily during all phases of construction authorized until all areas that were disturbed during construction are sufficiently stabilized to prevent erosion, siltation, and turbid discharges.

7. The stormwater management system shall be inspected by a registered professional to evaluate whether the system is functioning as designed and permitted. The registered professional may record their inspection on Form No. 62-330.311(1), F.A.C., Operation and Maintenance Inspection Certification, or may provide their evaluation in any other format; however, any report must be signed and sealed by the registered professional. Submittal of the inspection report to the Department is not required; but the report shall be made available to the Department upon request. Inspections shall be made by the registered professional in accordance with this schedule:

ATTACHMENTS

For detention with filtration:

- a. On the first anniversary of the date of conversion to Operation and Maintenance Phase.
 - b. Every second year on the anniversary of conversion to Operation and Maintenance phase, after the first year of successful operation.
8. The Stormwater Operation and Maintenance Plan, as approved and enclosed with this post-certification approval, shall be implemented.
9. The stormwater system shall be inspected periodically for accumulation of debris and trash. Accumulations of debris and trash that negatively affect the function of the system shall be removed upon discovery.
10. The stormwater system shall be inspected periodically for silt accumulation. Accumulations of silt that negatively affect the function of the system shall be removed.
11. Each sediment control sump (or equivalent) and each clean-out shall be inspected on at least a quarterly basis. Licensee shall remove any deposited sediment or debris within the sump. Any clean-out that is damaged shall be repaired. If applicable, Licensee shall verify that any grate on each sediment sump is in place. If applicable, inspect each overflow weir and baffle and confirm that it is free-flowing and clear of debris.
12. All structures authorized by this License shall remain in operable condition and shall not be allowed to deteriorate or otherwise contribute to a water quality violation for the life of the Facility. All stormwater structures identified by this License shall be maintained in proper working order for the life of the Facility
13. Within 30 days of any failure of a stormwater management system or deviation from any authorized submittals, a report shall be submitted to the Department on Form 62-330.311(1), F.A.C., Operation and Maintenance Inspection Certification, describing the remedial actions taken to resolve the failure of deviation. This report shall be signed and sealed by a registered professional.
14. For emergencies involving a serious threat to the public health, safety, welfare, or environment, the emergency telephone contact number is (800) 320-0519 (State Warning Point). The Department telephone number for reporting nonthreatening problems or system malfunctions is (850) 595-0663, day or night.

ATTACHMENTS

ATTACHMENT C: Mitigation Plan

Attached as applicable