



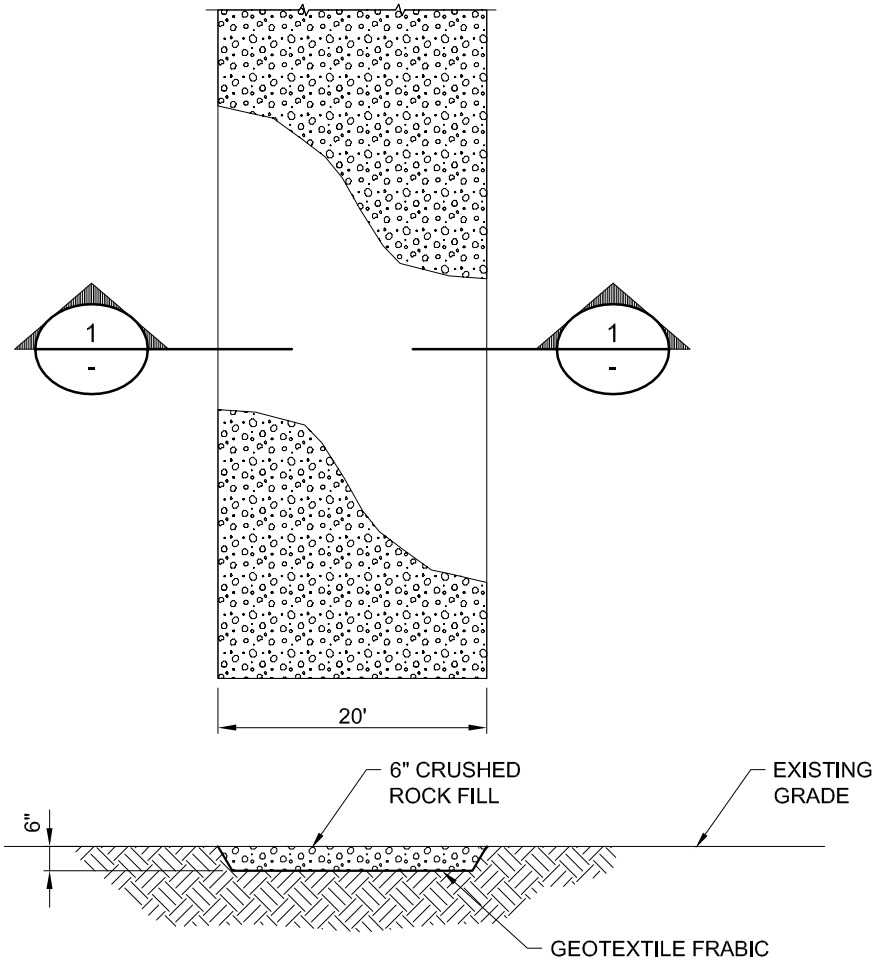

NOTES:

1. A SILT FENCE SHALL BE INSTALLED AROUND ALL AREAS OF CONSTRUCTION.
2. REMOVE 12" INCHES OF EXISTING MATERIAL IN ACCESS ROAD AREA.
3. INSTALL GEOTEXTILE FABRIC ON BOTTOM AND SIDES OF EXCAVATION.
4. INSTALL AND COMPACT 12 INCHES OF CRUSHED ROCK OR LIMESTONE IN ACCESS ROAD EXCAVATION.

LEGEND:



ROCK
FILL

				BLACK & VEATCH ORLANDO, FLORIDA		ORLANDO UTILITIES COMMISSION ORLANDO FLORIDA		 OUC The Reliable One		PROJECT 145796	DRAWING NUMBER FIGURE 6
0		INITIAL ISSUE		ENGINEER JLB	DRAWN JBN	AT GRADE ACCESS ROAD, ROCK FILL		SCALE NONE		SHEET NO. 1	
NO	DATE	REVISIONS AND RECORD OF ISSUE	BY	CHK	APP						
				CHECKED RM	DATE 4/22/11						