



PROJECT MANAGER: - C:\PW\WORK\MIDRINE\0346037\CSS-PITS-SEWER LATERAL C-09 TO C-10.DWG - C-9 - PLOTTED 9/14/2012 11:02 AM BY HORNE, MICHAEL

FIELD BOOK INFORMATION: -

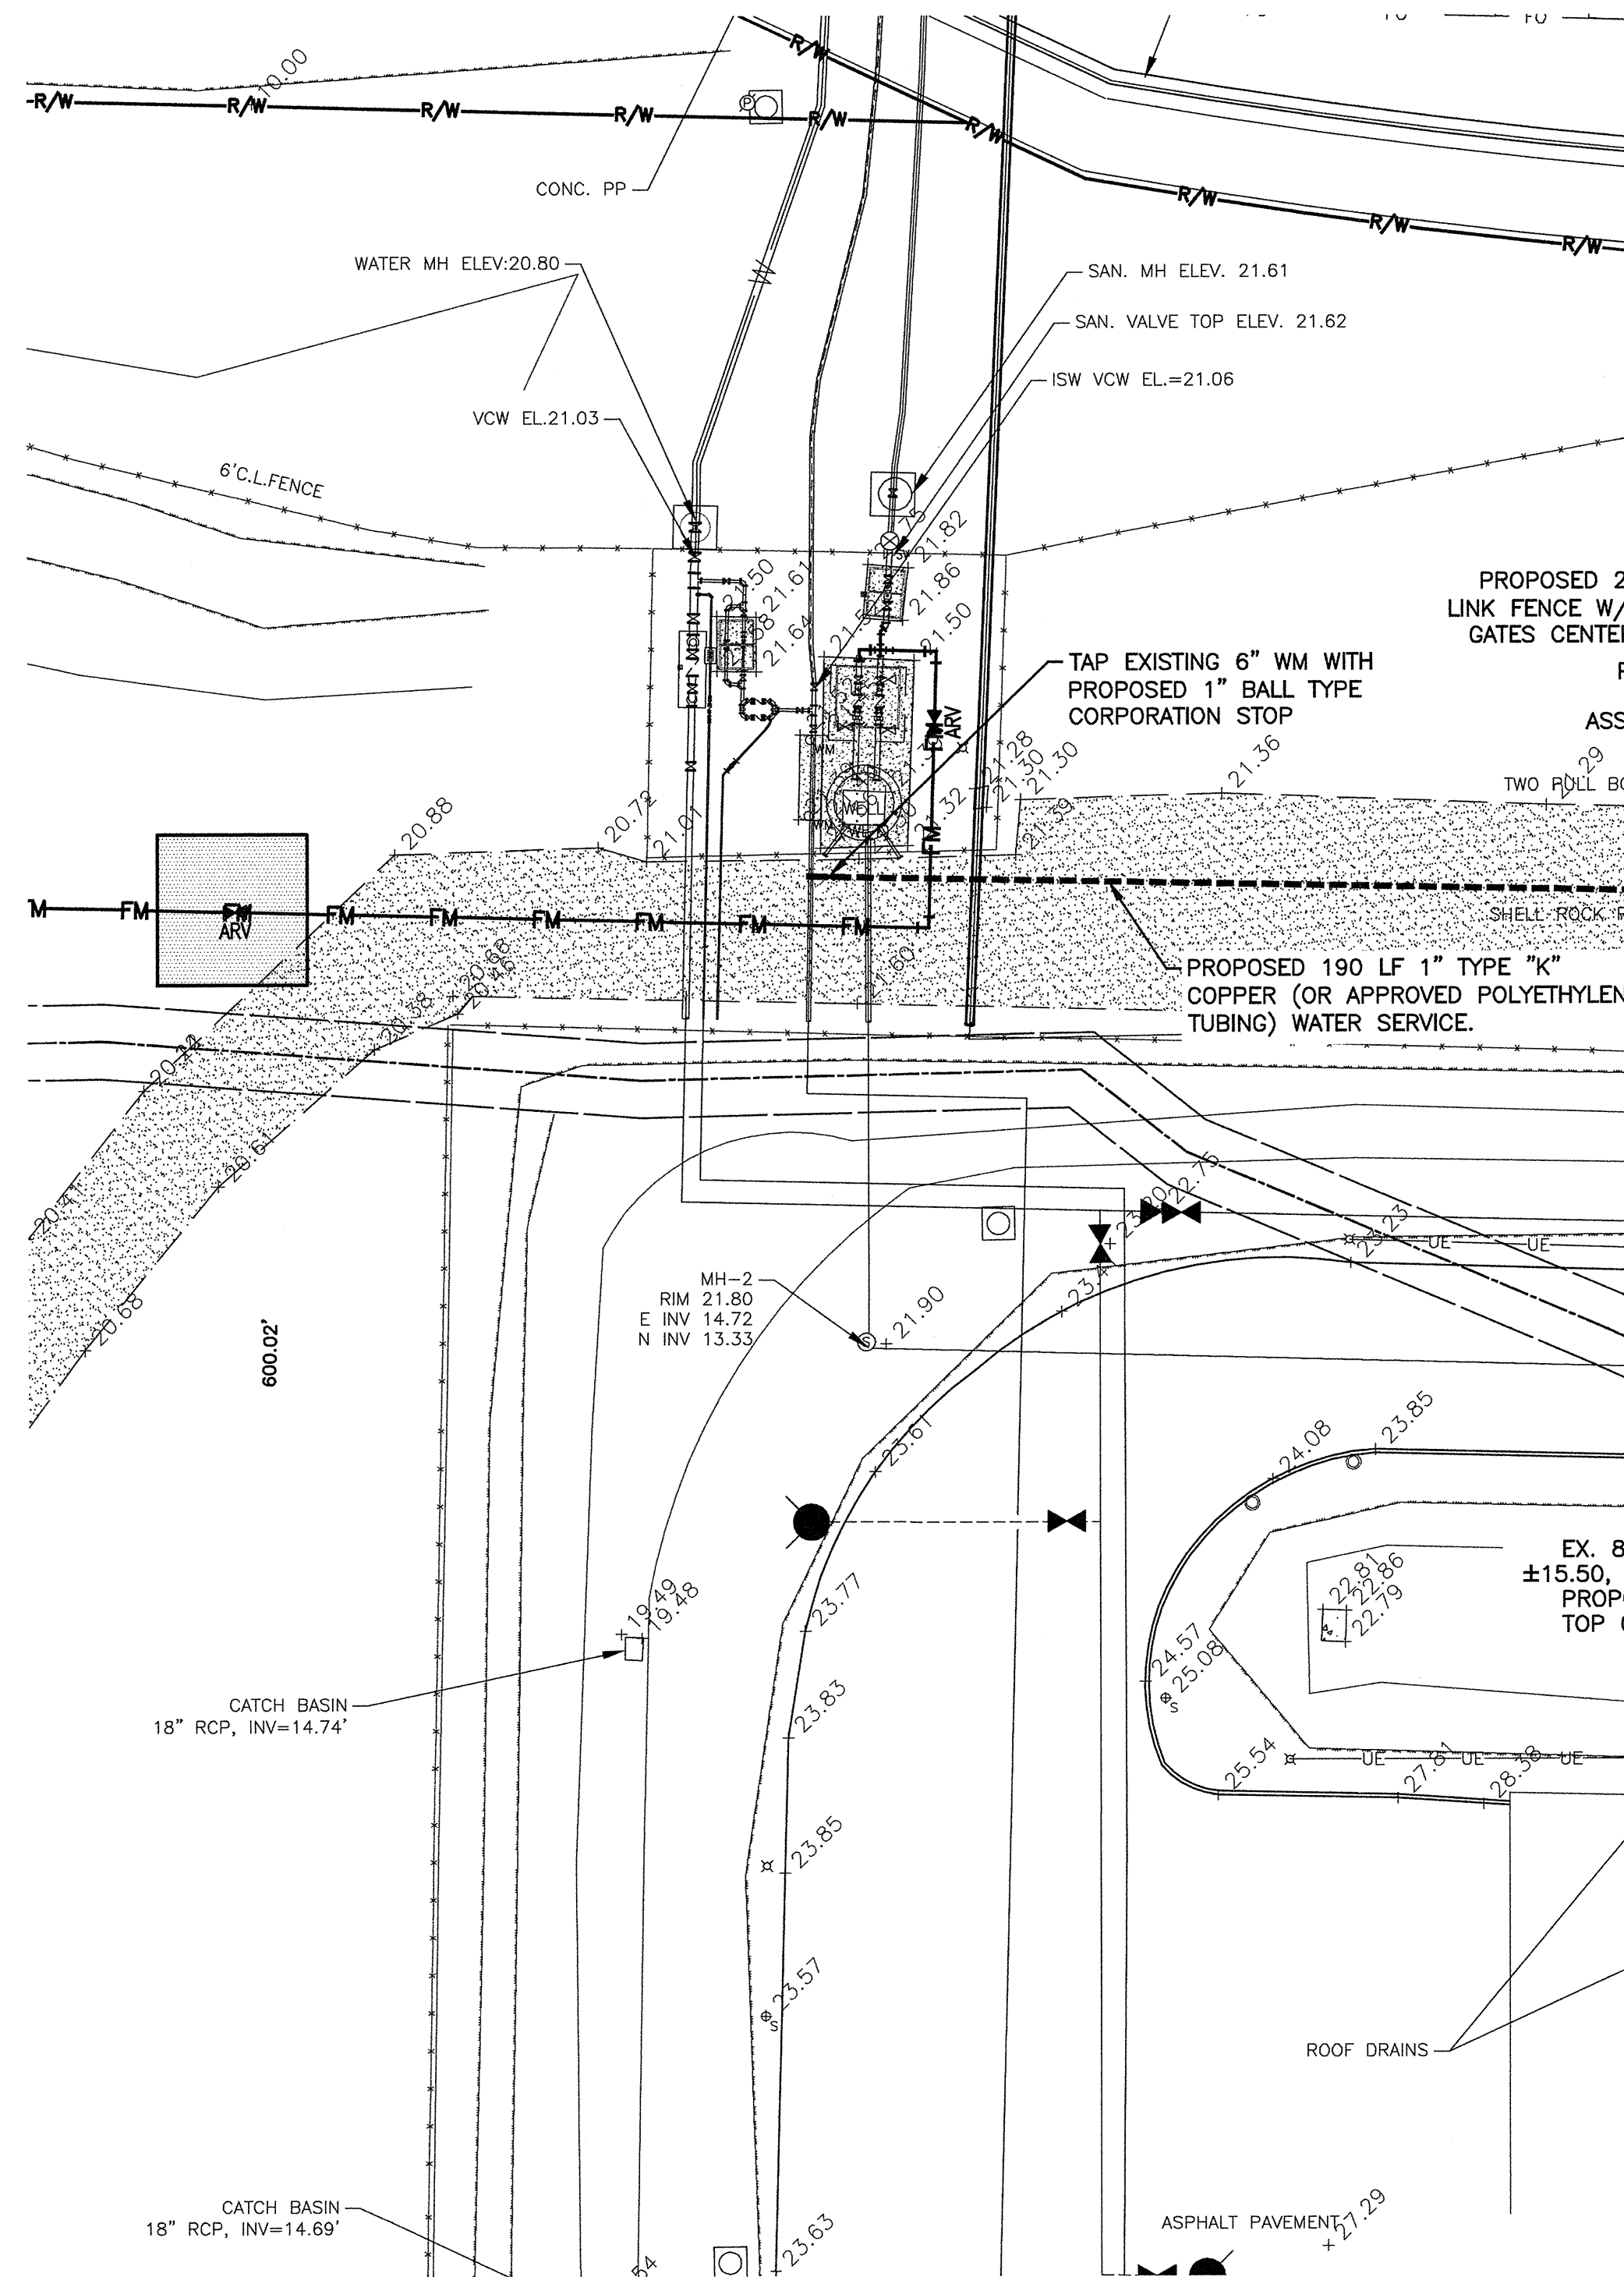


SANITARY SEWER LATERAL PLAN

SCALE: 1"=20.00'

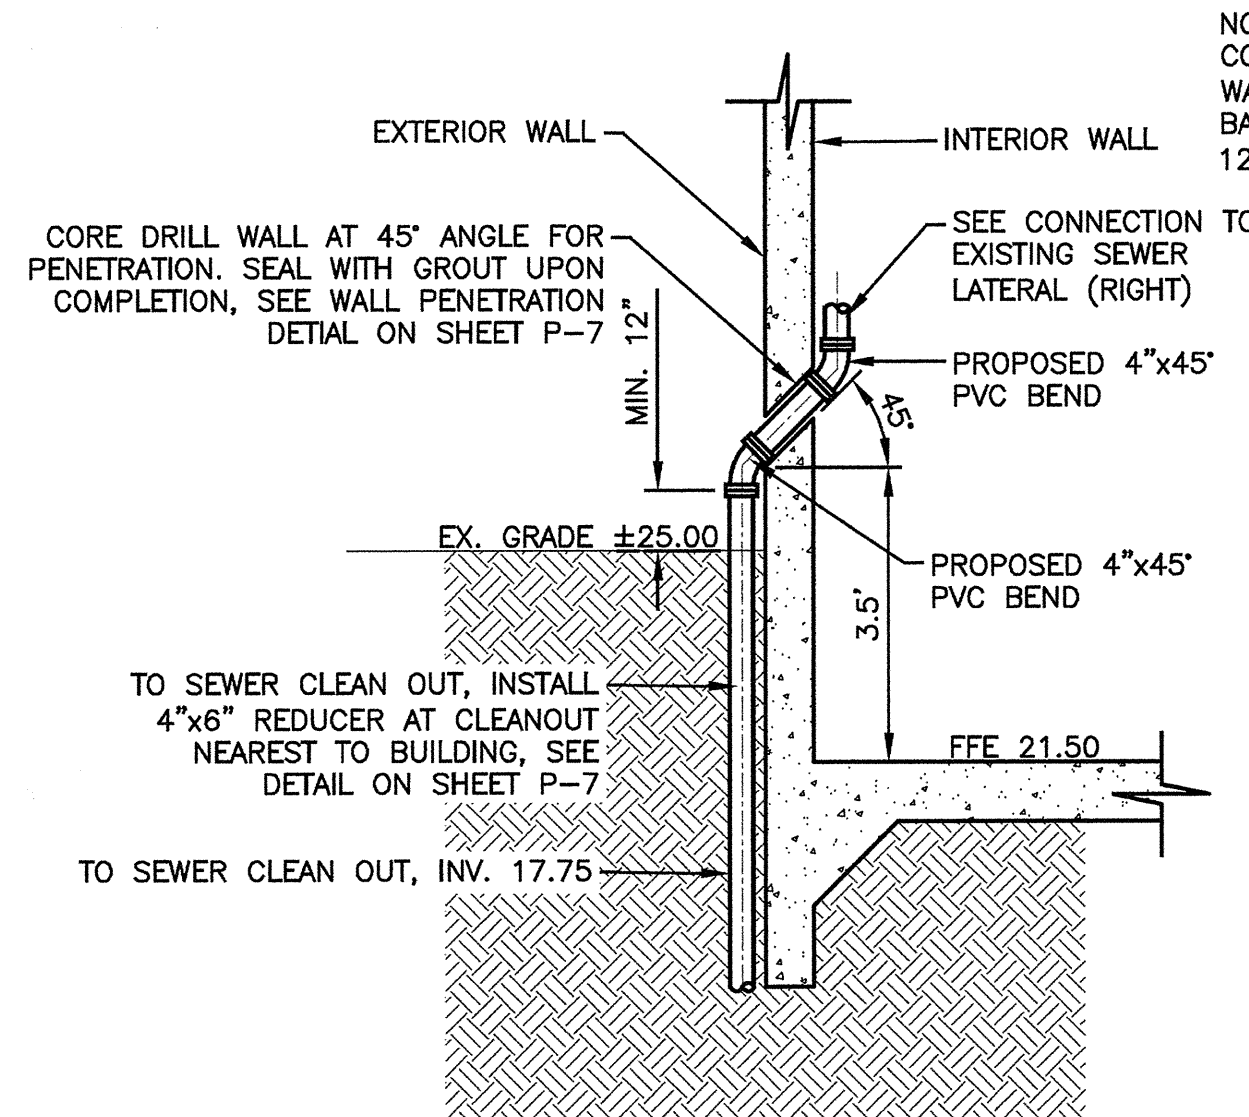


SIDE VIEW
SEWER LATERAL WALL PENETRATION
SCALE: N.T.S.


NOTE:
CONTRACTOR TO LOCATE AND CORE DRILL
WALL BETWEEN EXISTING #6 VERTICAL
BARS. NO. 6 VERTICAL BARS SPACED AT
12" IN EACH FACE.

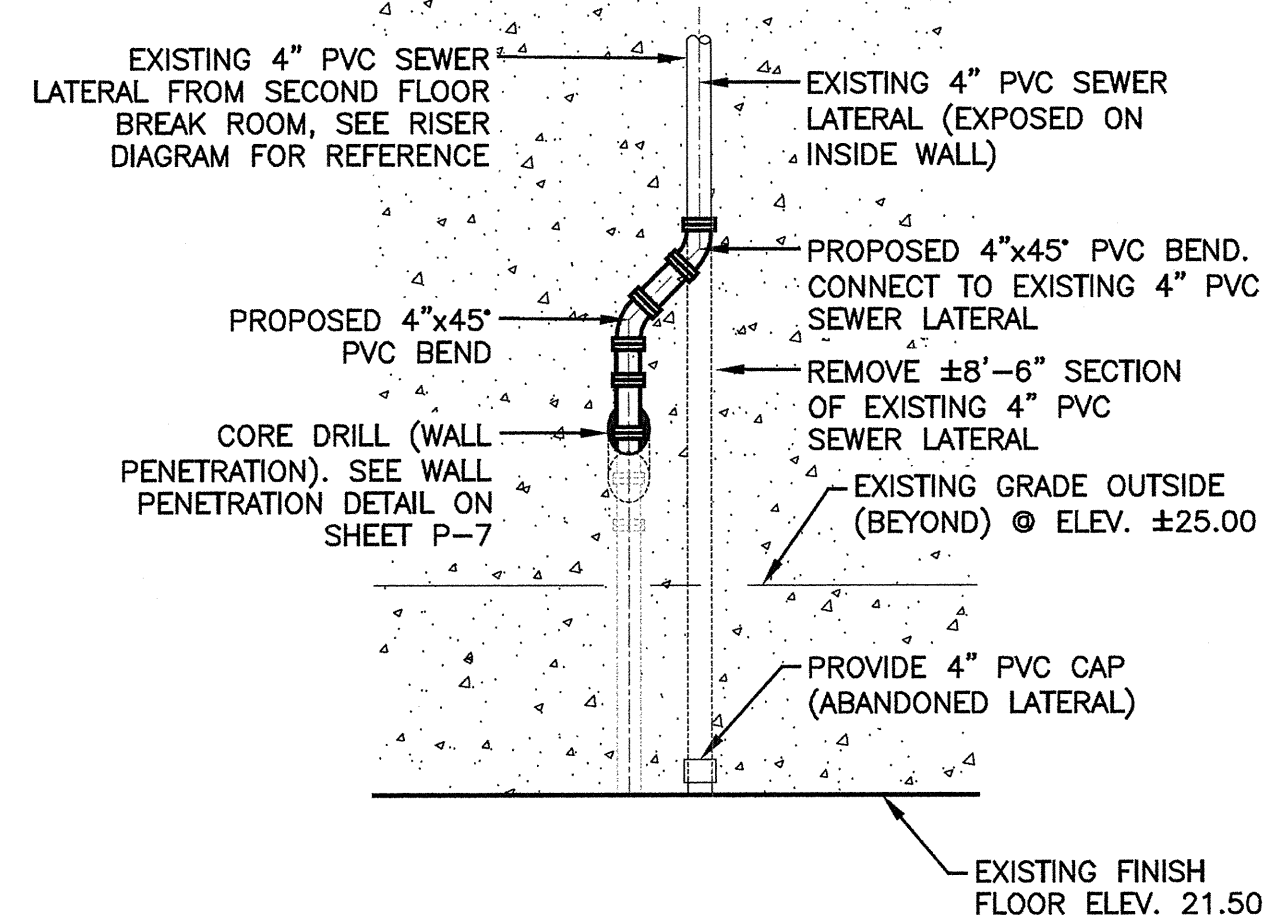

FRONT VIEW - INTERIOR WALL
CONNECTION TO EXISTING LATERAL
SCALE: N.T.S.

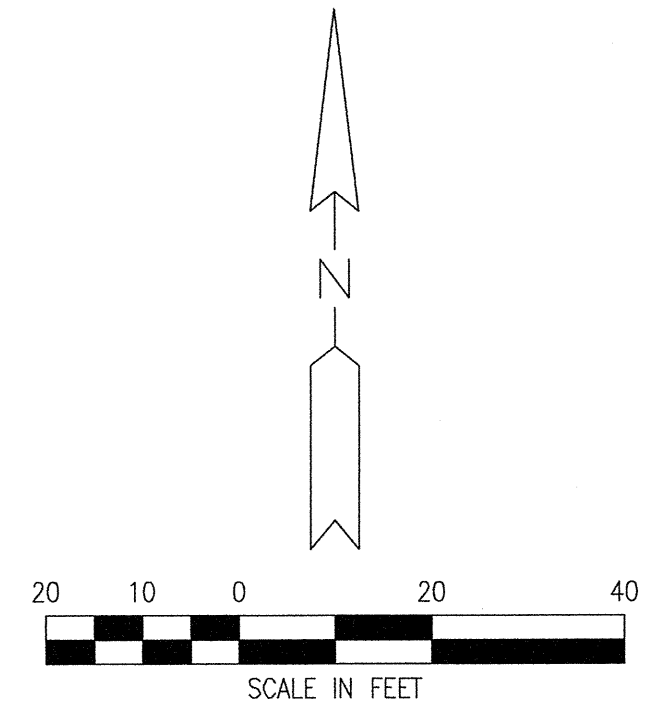

NOTE:
CONTRACTOR SHALL FIELD VERIFY UNDERGROUND
ELECTRICAL LINE PRIOR TO BEGINNING WORK.

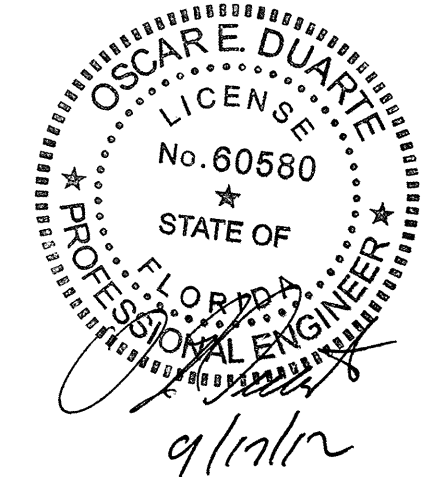

NOTES:

- CLEAN OUTS WILL BE REQUIRED AT CHANGES IN DIRECTION AND EVERY 75 FEET.
- SANITARY SERVICE LATERALS SHALL HAVE A MIN. SLOPE OF 1.0% FROM THE BUILDING TO THE PUMP STATION.
- ALL PVC PIPE AND FITTINGS SHALL BE FACTORY COLOR CODED GREEN.

SWA BIOSOLIDS PROCESSING FACILITY
INDUSTRIAL WASTE FORCE MAIN PROJECT
PALM BEACH COUNTY, FLORIDA

SANITARY SEWER LATERAL PLAN
SWA BIOSOLIDS PROCESSING FACILITY

ISSUED FOR: DATE: BY:
75% REVIEW 05/02/12 CEM
100% REVIEW 06/15/12 CEM
FINAL DESIGN 7-6-12 CEM
ENV. PERMITS 9/17/12 CEM

JOB NO.
NEF2001-01L

SHEET

C-9

NOT VALID FOR CONSTRUCTION
UNLESS SIGNED AND DATED:

WADETRIM

3700 Ocala Highway NE, Suite D
Palm Bay, FL 32909
321.726.3388 FAX: 321.726.3383
www.wadetrtrim.com

© Wade Trim Group, Inc.