



August 18, 2011

Ms. Cindy Mulkey
Program Administrator
Office of Siting Coordination
Florida Department of Environmental Protection
3900 Commonwealth Boulevard
Tallahassee, Fl 32399-3000

RE: Seminole Electric Cooperative, Inc.
Seminole Generation Station, Putnam County, Fl.
Power Plant Certification PA78-10
Post Certification Amendment to Application

Dear Ms. Mulkey:

Pursuant to Section 403.5113 (1) (a), Florida Statutes, and Rule 62-17.205, Florida Administrative Code, please accept this letter and the attachments hereto as additional post-certification amendments to the Seminole Electric Cooperative, Inc. ("Seminole") Site Certification Application ("Application") for the Seminole Generating Station in Putnam County, Florida. These post-certification amendments address a proposed 4660 square foot concrete slab adjacent to the Unit 2 FGD scrubber modules and a proposed 1200 square foot awning (roof addition) to be added to the coal yard maintenance building.

The proposed Unit 2 FGD scrubber concrete apron (see attached drawing no. 1) is required to minimize the possibility of discharges to groundwater from piping or other equipment that has historically caused abnormal event (upset) reporting to the DEP Northeast District office. This apron will allow the liquids from leaks to be captured and recycled back into the FGD system. This apron will not increase runoff or change the quality of water that enters the stormwater treatment system.

The proposed awning to be added to the coal yard maintenance building (see attached drawing no. 2) will allow heavy equipment to be sheltered from the weather. The area to be covered has an existing concrete slab covering the same area as the proposed awning. No changes in quantity to the impervious surface area is proposed since the area is already impervious and stormwater from this area is treated in the permitted stormwater system.

Based on the above information, Seminole requests concurrence from the Office of Siting Coordination that the 4660 square foot concrete apron and the proposed 1200 square foot awning for the coal yard maintenance building can be approved as post-certification amendments to the Site Certification Application.

If you have any questions concerning this information please contact me at (813) 963-0994.

Sincerely,


A handwritten signature in black ink, appearing to read 'Robert Yarbrough', with a stylized flourish at the end.

Robert Yarbrough
Senior Environmental Engineer

cc: Mike Roddy
Jim Alves w/attachments
Ann Seiler – FDEP w/attachments



Hatched area is new concrete
Six channels will be cut in old curb for drainage
New concrete area will have a 12" curb surrounding
Unit 2 FGD System
Dimensions in feet

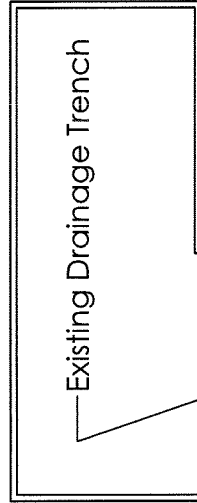


Existing Drainage Trench

(6) Drainage Channels

233

20

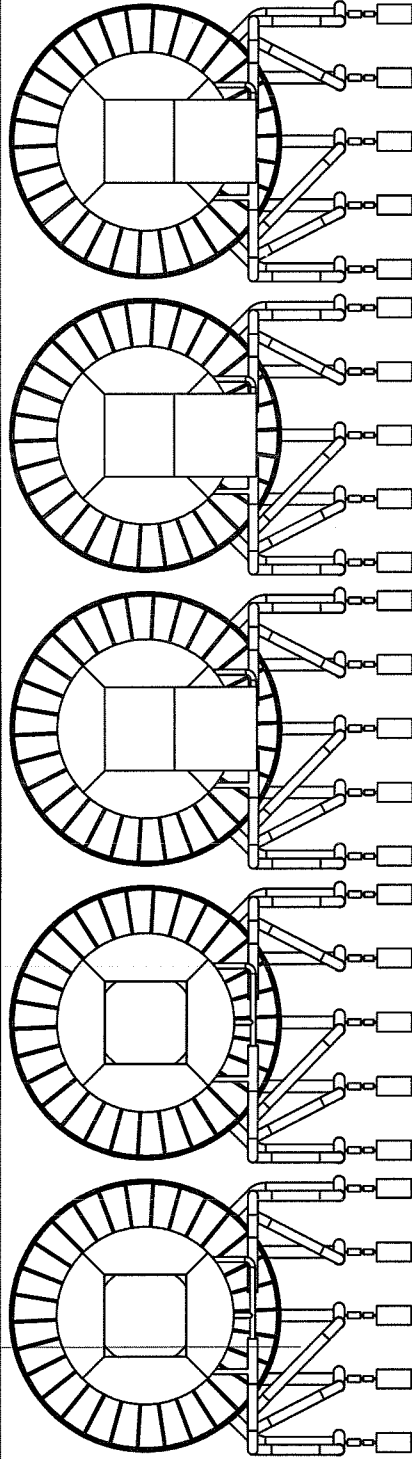

Existing Curbed Concrete

TITLE:

Unit 2 FGD
Spill Containment Addition

SIZE DRAWN BY:

A Ty Parker

SCALE: 1:1024

SHEET 1 OF 1

Seminole Electric
COOPERATIVE, INC.
IN PARTNERSHIP WITH THOSE WE SERVE



5

4

3

2

1

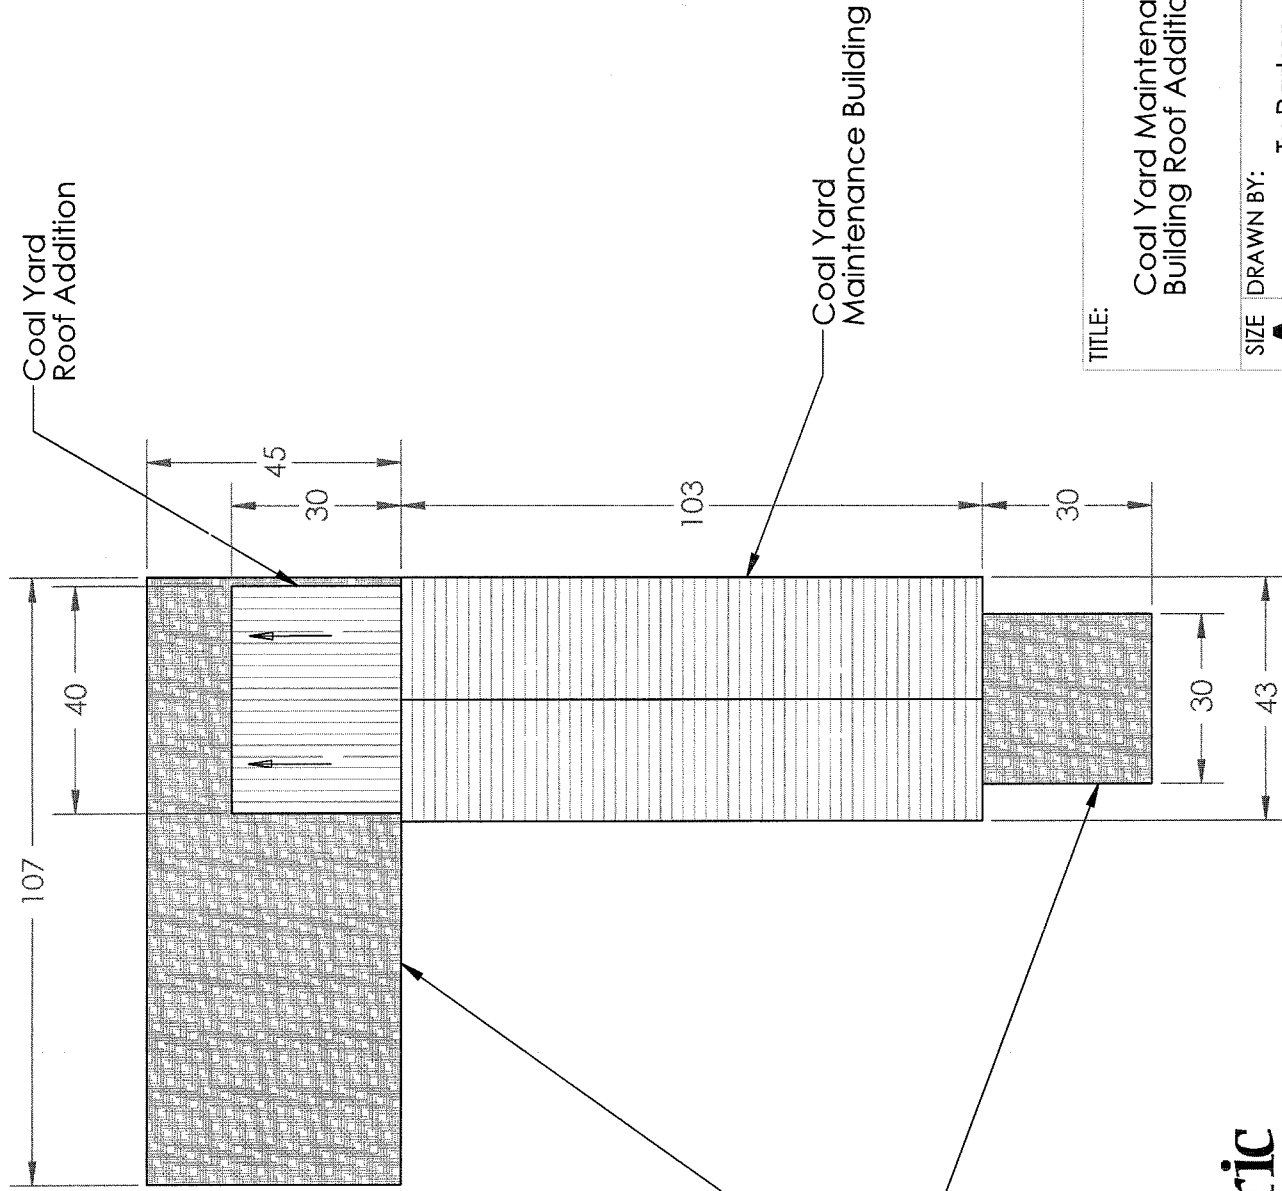

TITLE:

Coal Yard Maintenance
Building Roof Addition

SIZE

A

DRAWN BY:

Ty Parker

SCALE: 1:48

SHEET 1 OF 1

Dimensions in feet
Roof addition is built over
existing asphalt

Existing Impermeable
Asphalt Surface

