



8/18/2025

Ms. Cindy Mulkey
Florida Department of Environmental Protection
Siting Office
2600 Blair Stone Road
Tallahassee, Florida 32399-3000

Re: Seminole Electric Cooperative, Inc.
Seminole Generating Station, Putnam County Florida
Power Plant Certification No. PA 78-10
Post-Certification Amendment

Dear Ms. Mulkey:

Pursuant to Section 403.5113(1)(a), Florida Statutes and Rule 62-17.205, Florida Administrative Code, please accept this letter and attachments as a post-certification amendment to the Seminole Electric Cooperative, Inc. ("Seminole") Site Certification Application ("Application") for the Seminole Generating Station in Putnam County, Florida. This post-certification amendment addresses the installation of two (2) concrete pads within the Seminole Combined Cycle Facility (SCCF).

Seminole is proposing the installation of:

- (1) A 24 square foot concrete pad for installation of the potable water carbon filter. This pad will be located south of the administration building and adjacent to the existing potable water treatment system. Seminole provided notification of the installation of the carbon filtration system as a post certification amendment submitted November 22, 2024 (approved December 19, 2024).
- (2) An approximately 1200 square foot concrete pad immediately south of the ammonia storage tanks. This pad will provide a more stable surface to offload ammonia.

An aerial indicating the location of each of these pads is attached.

Stormwater runoff within SCCF ultimately drains to the on-site retention pond (South Pond). The most recent analysis of the pond treatment volume (submitted February 14, 2023 in support of Amendment AM23-277) indicates the South Pond has 0.5 acre feet (21,780 cubic feet) of available treatment volume. The estimated increase in runoff from the proposed concrete additions will be minor and within the ability of the existing stormwater system to provide necessary treatment.

The installation of the two concrete pads will not cause any adverse environmental impacts or require any changes to the existing Conditions of Certification for the Seminole Generating Station.


If the Department concurs, Seminole requests that the Department approve the requested amendment and provide written notification of same to Seminole, all reviewing agencies, and all parties to the original certification. If you or any of the parties have any questions or concerns, or require additional information, please contact me at (813) 963-0994, ext. 1224 or Justin Gostnell at (813) 244-4877 or by email at jgostnell@seminole-electric.com.

Sincerely,

A handwritten signature in blue ink, appearing to read "Lewis Snyder", enclosed within a blue oval.

Lewis Snyder,
Director of Regulatory Compliance


Cc: Justin Gostnell, Seminole
16313 North Dale Mabry Highway Tampa, Florida 33618-2000
Telephone 813.963.0994 www.seminole-electric.com

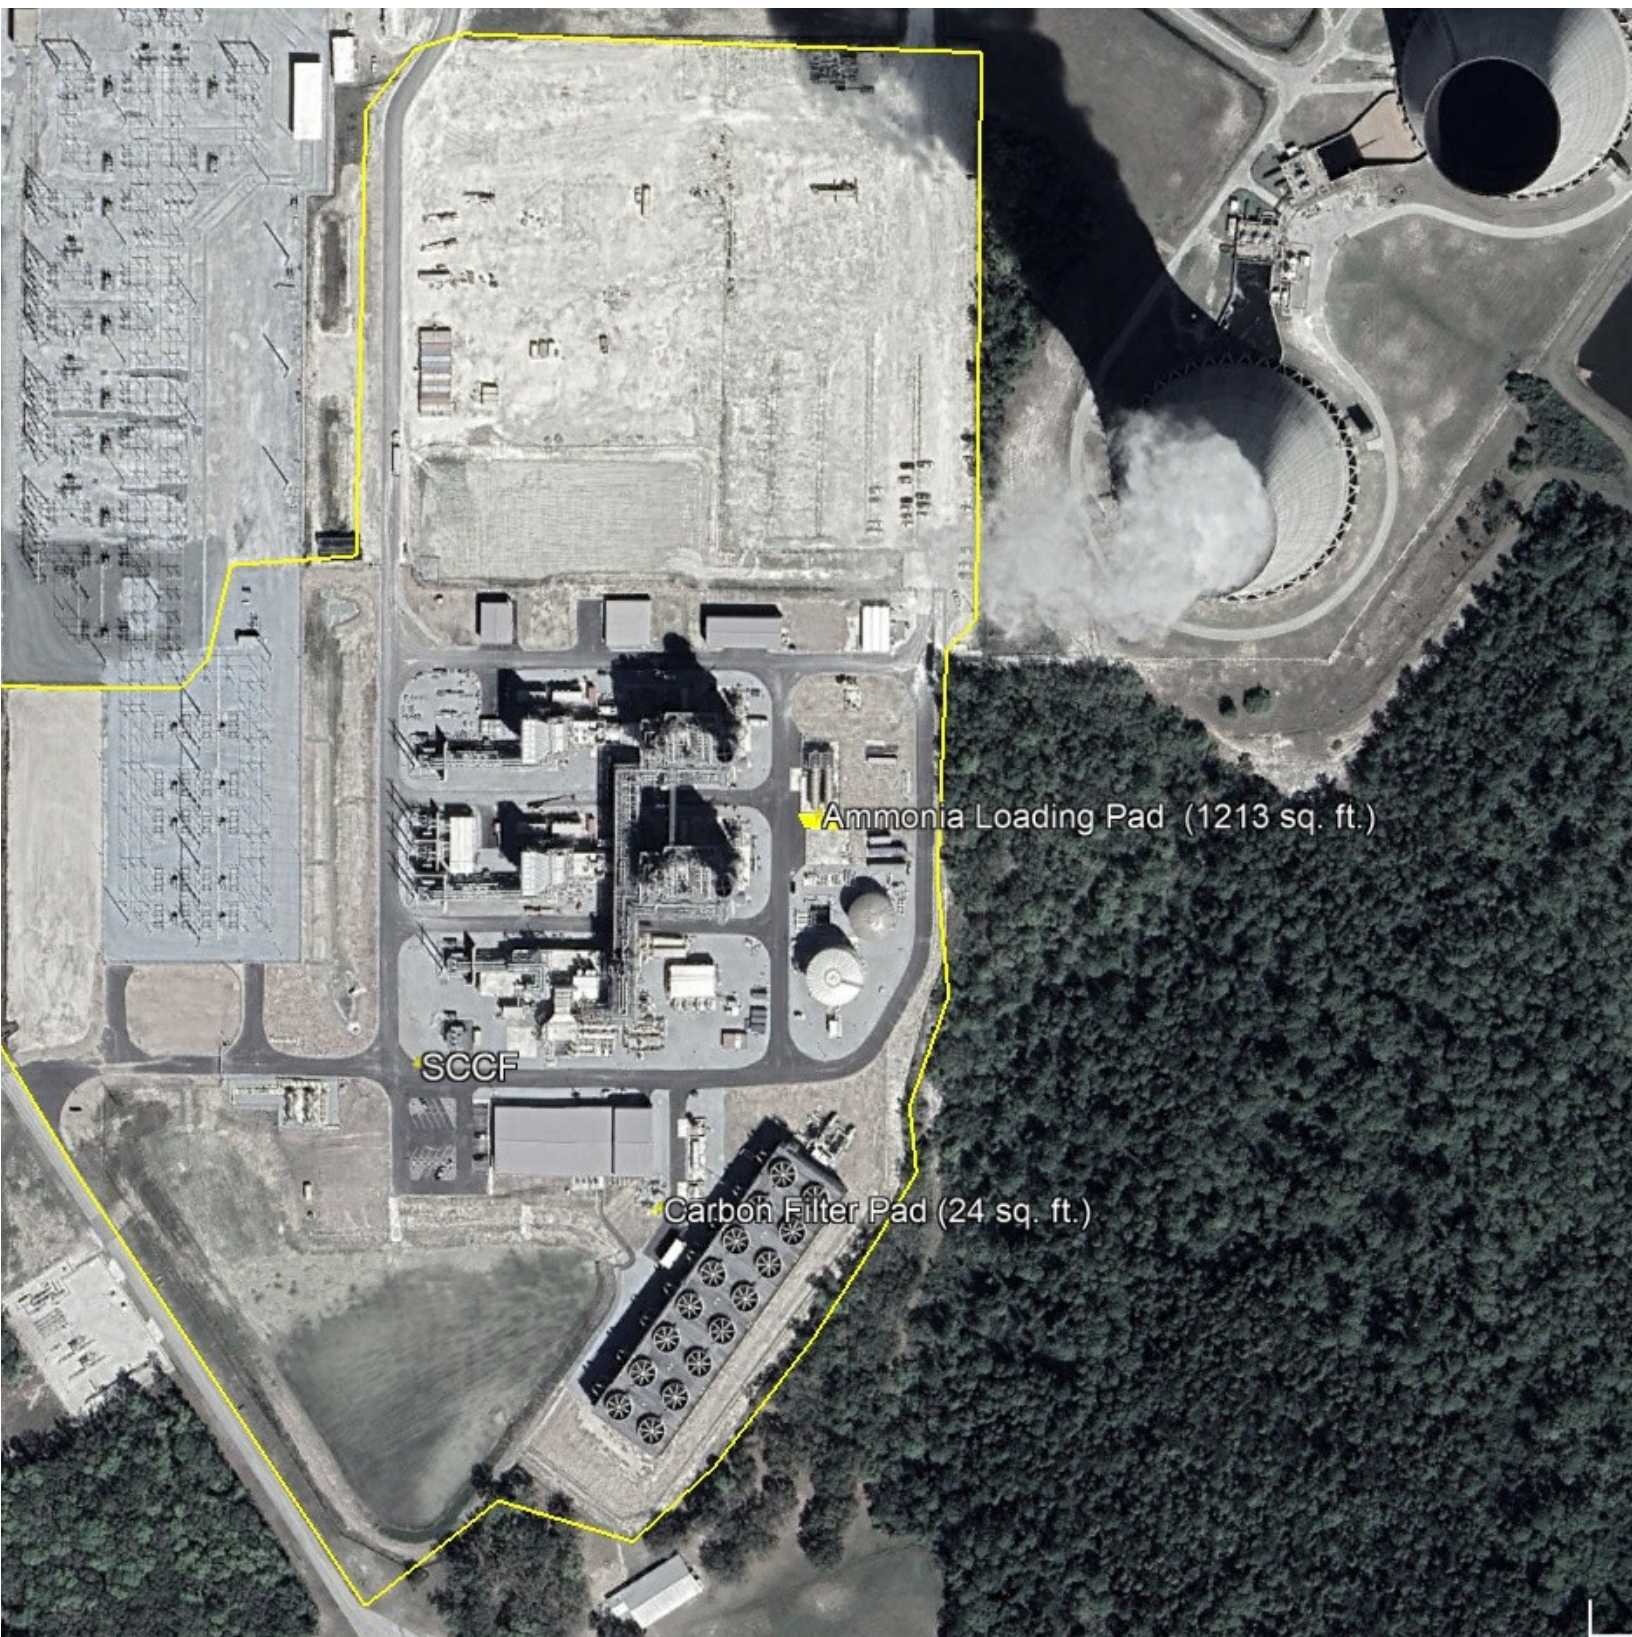

Ammonia Loading Pad (1213 sq. ft.)

SCCF

Carbon Filter Pad (24 sq. ft.)

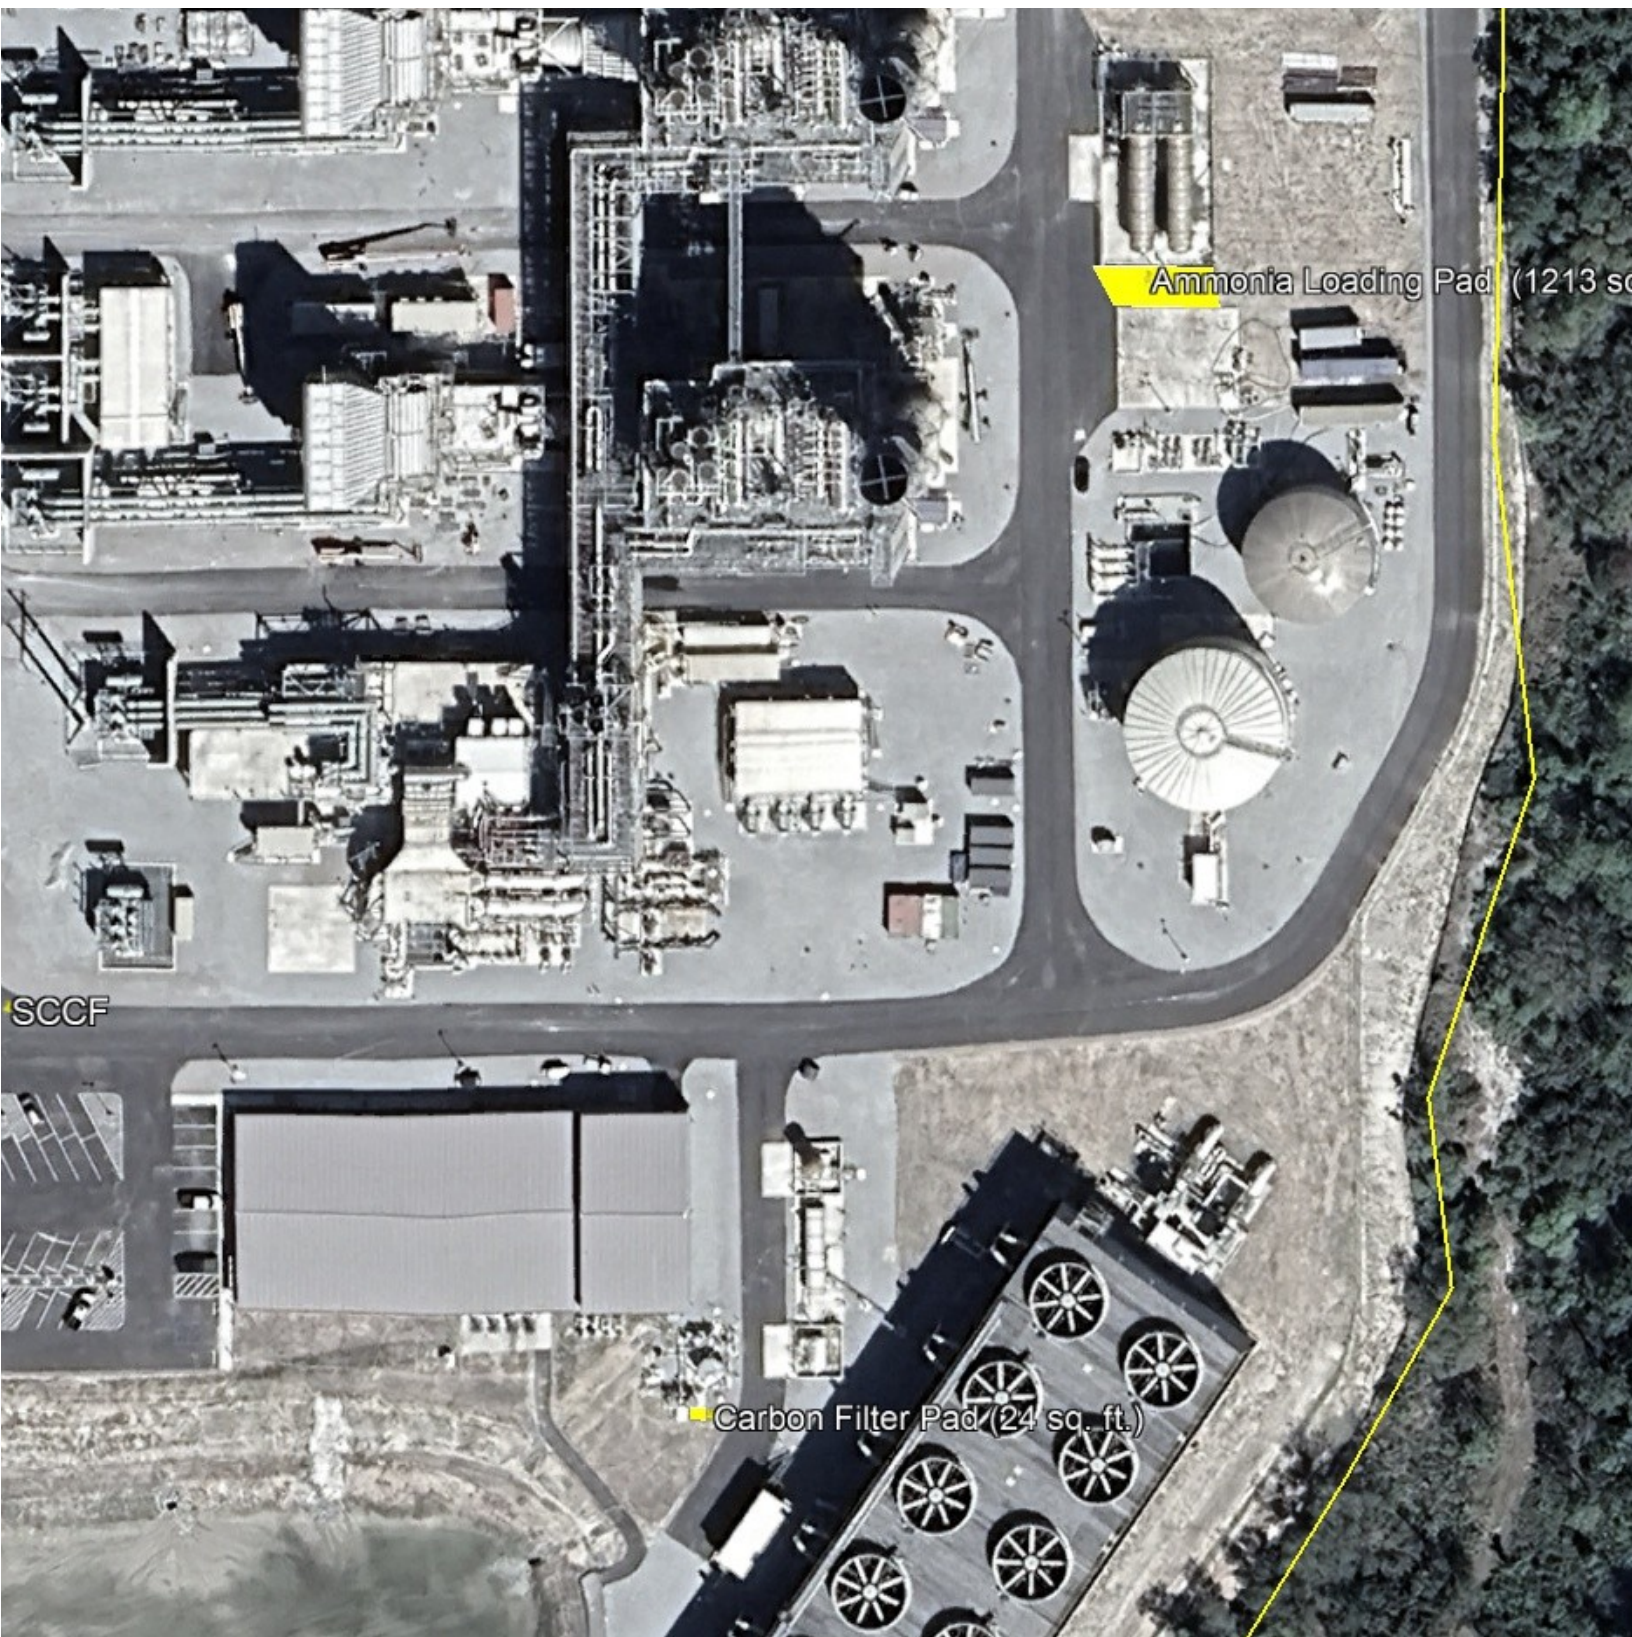

Ammonia Loading Pad (1213 sq. ft.)

SCCF

Carbon Filter Pad (24 sq. ft.)